




O-B SST (°C) for identifier 11932  
Number of obs. plotted = 52    Number of outliers = 26

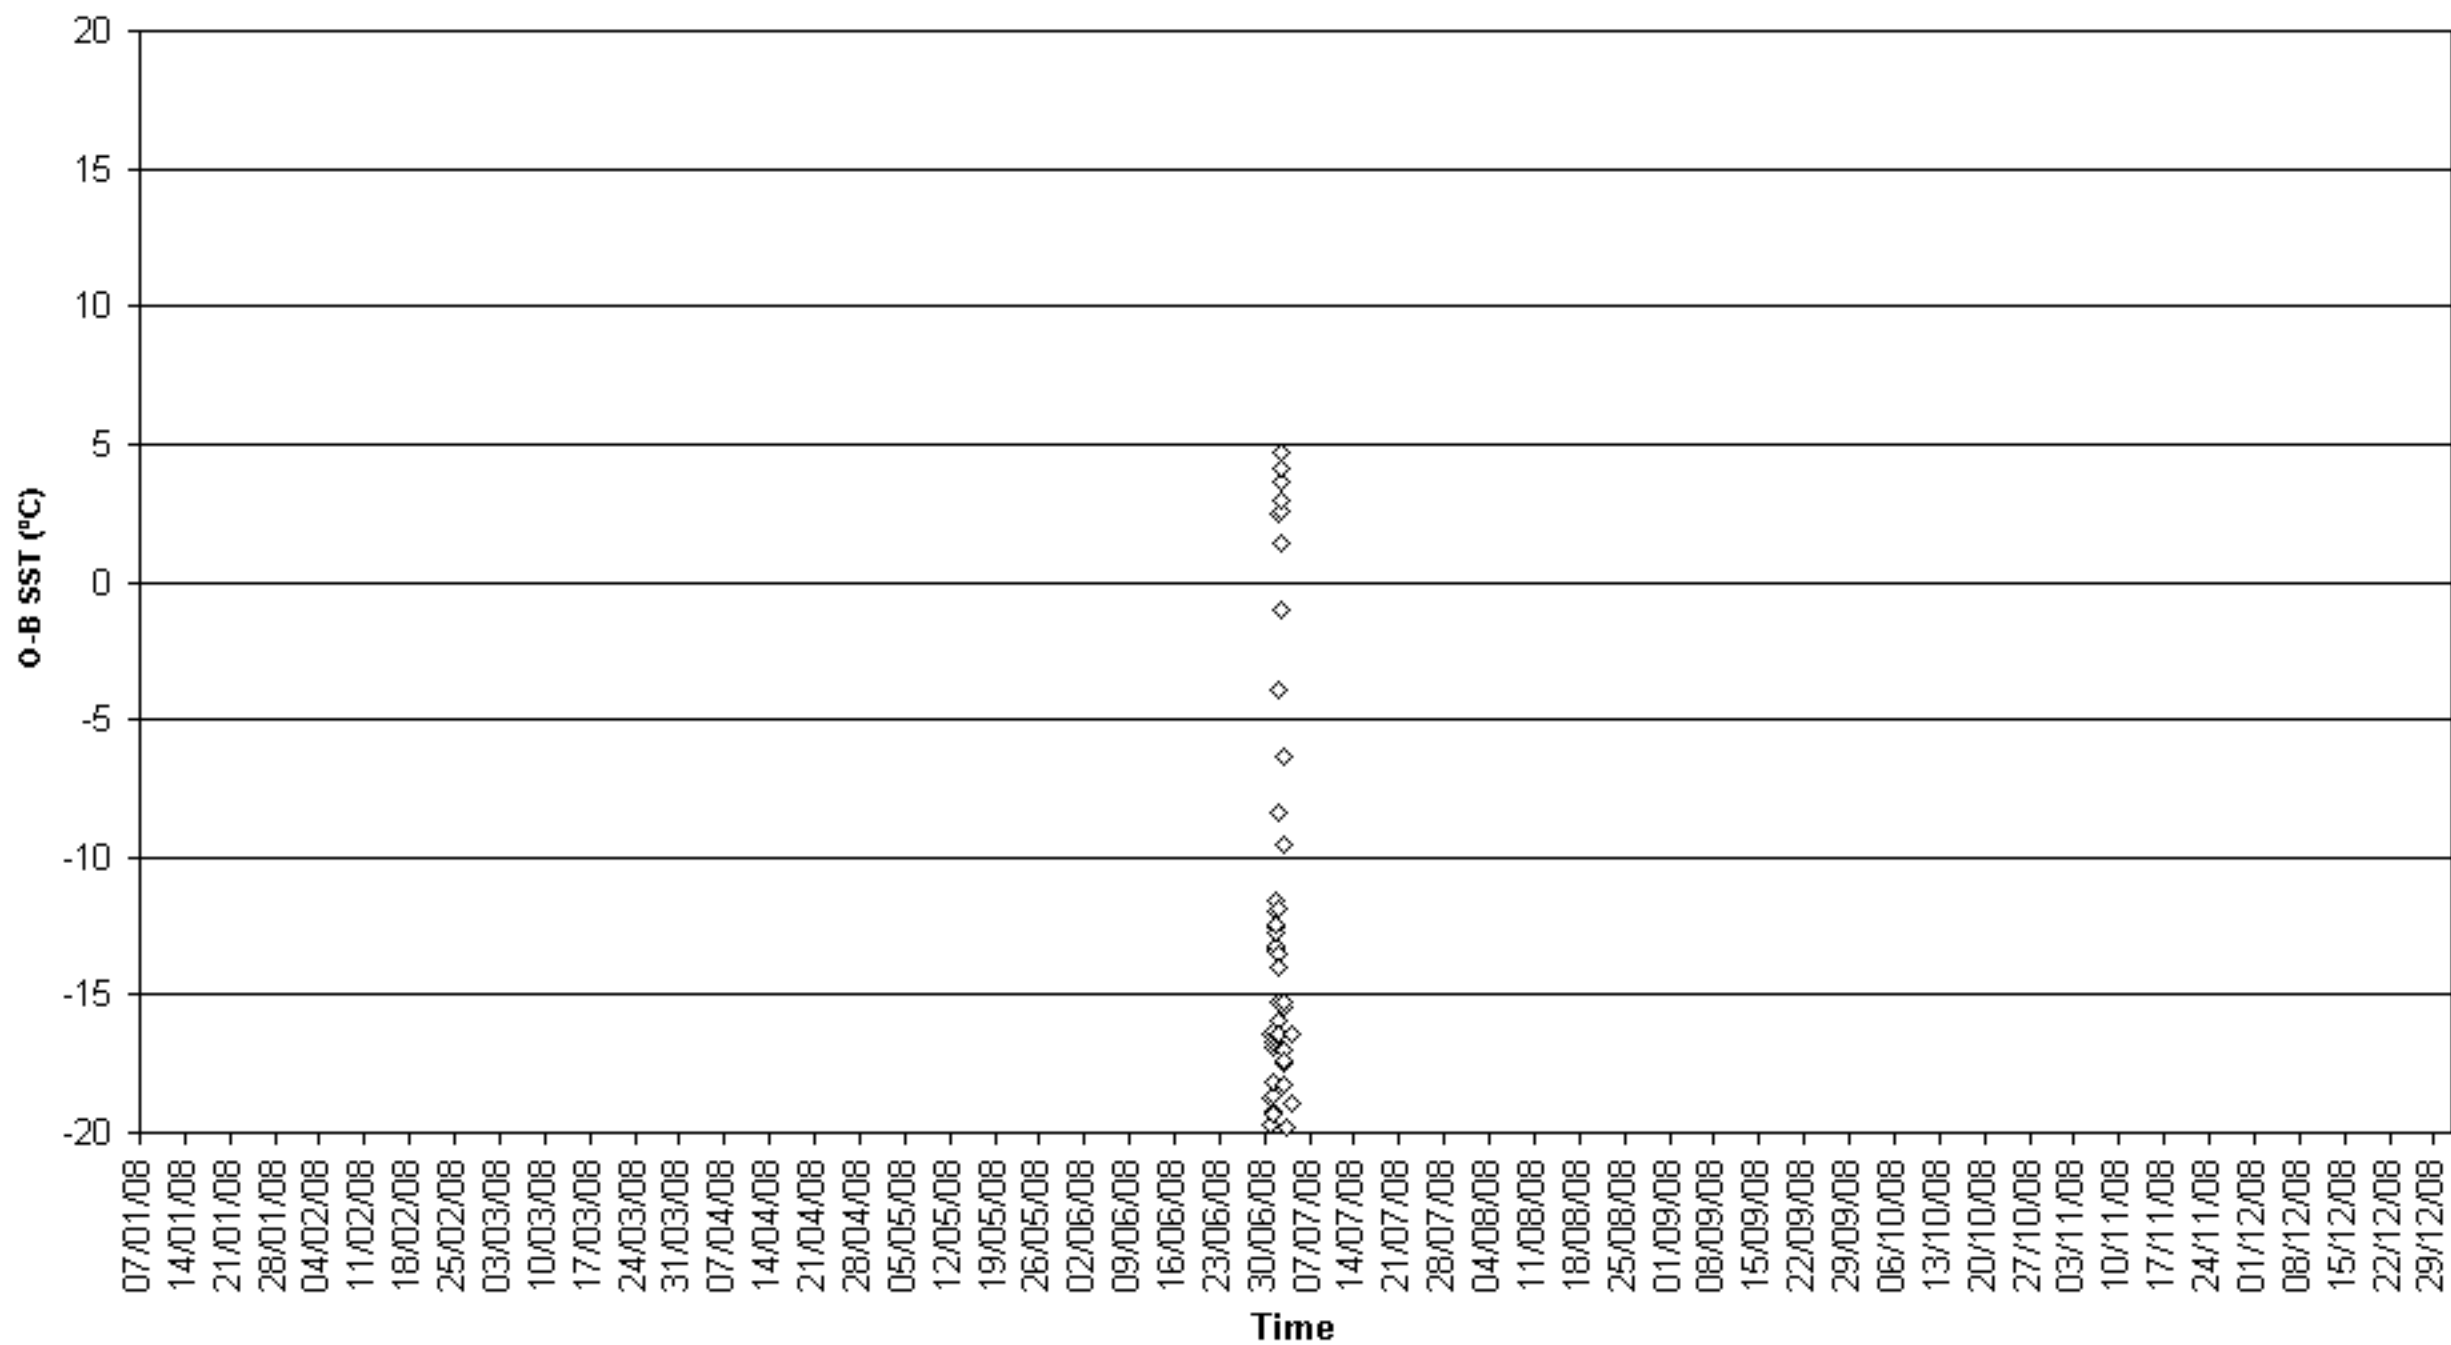


O-B SST (°C) for identifier 13949  
Number of obs. plotted = 143 Number of outliers = 0

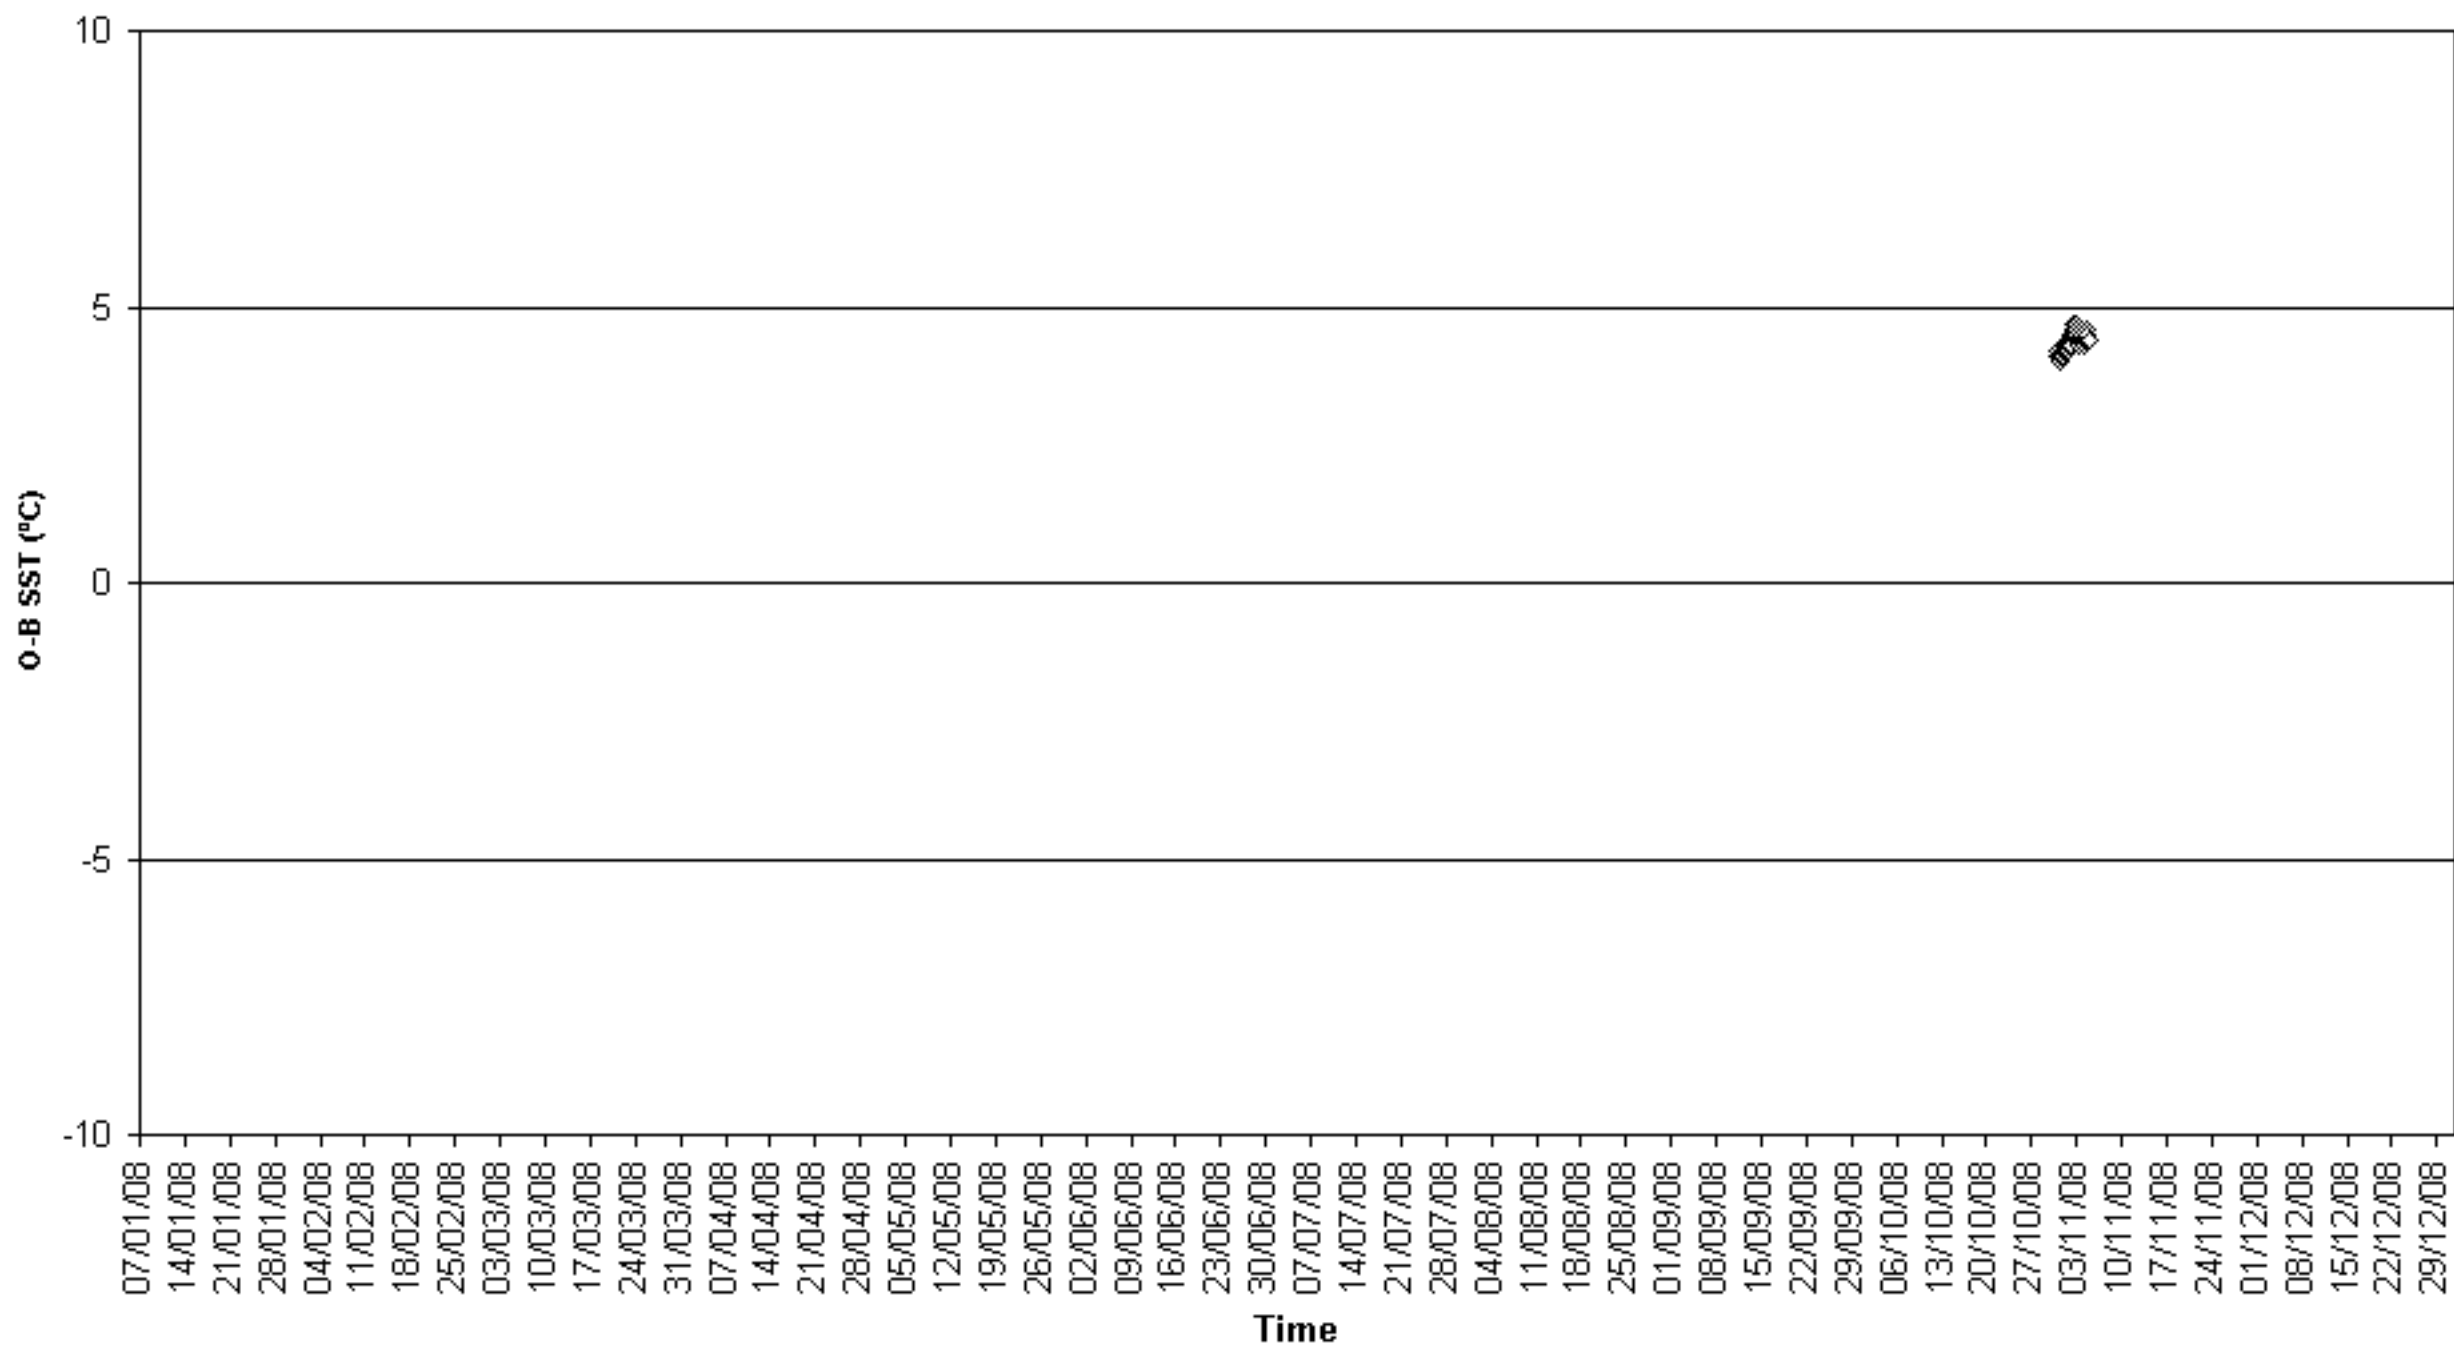


O-B SST (°C) for identifier 15905  
Number of obs. plotted = 201    Number of outliers = 45

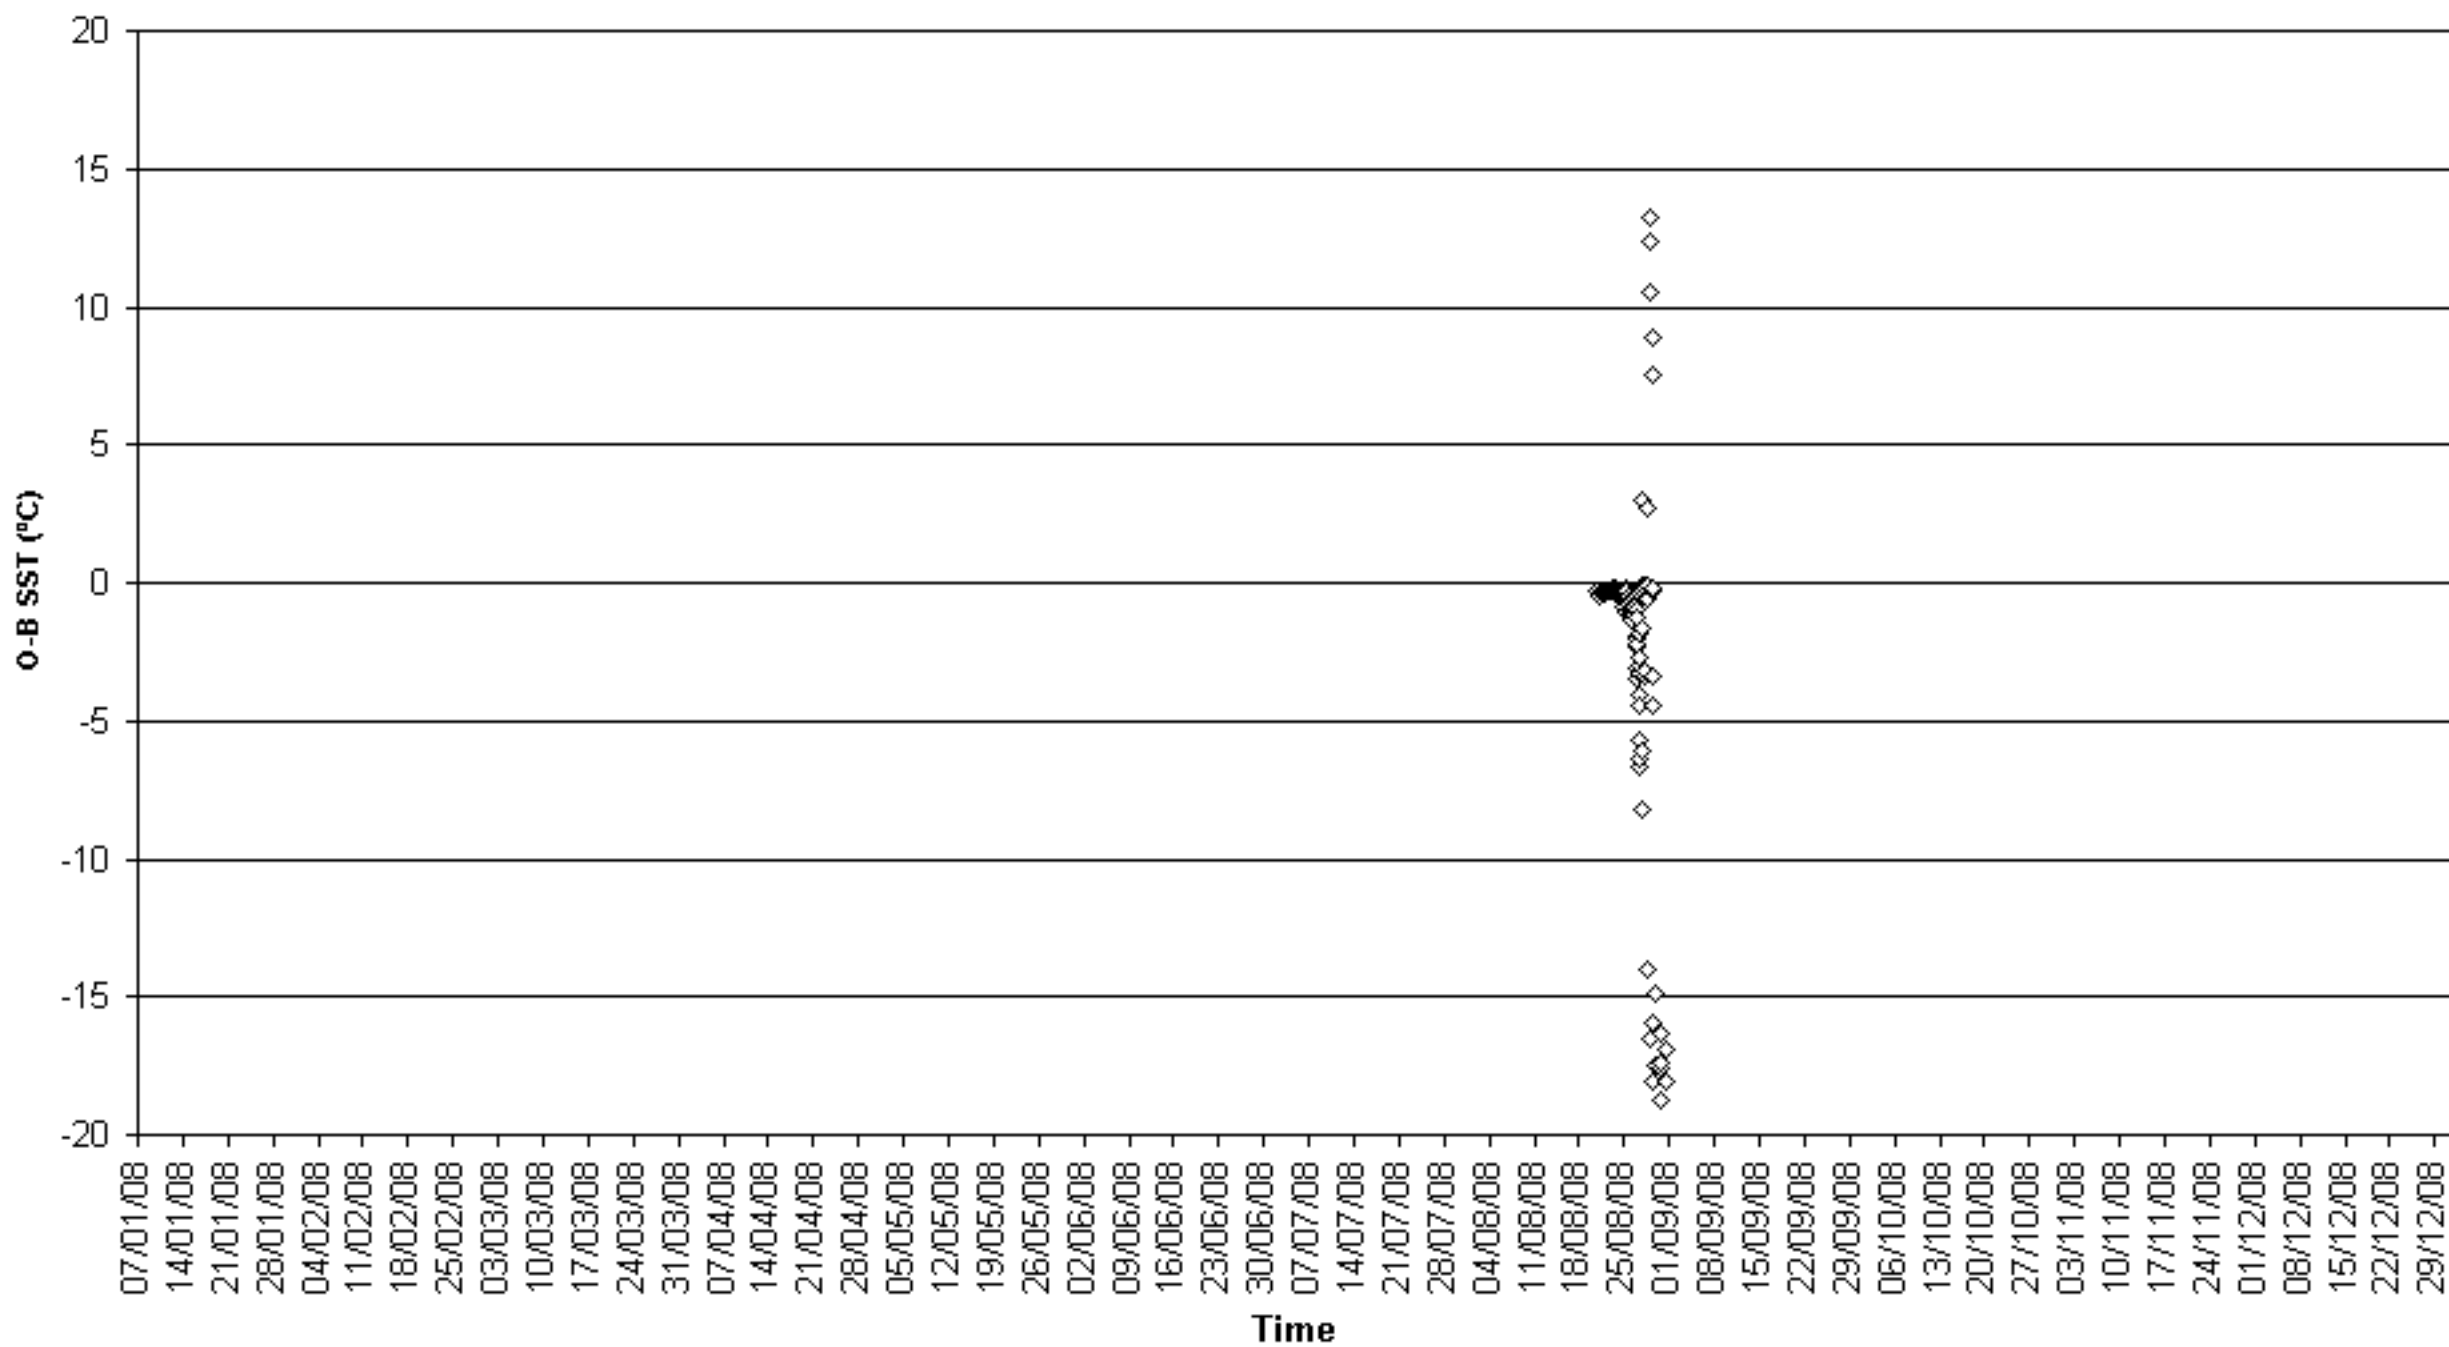


O-B SST (°C) for identifier 17673  
Number of obs. plotted = 3936 Number of outliers = 10

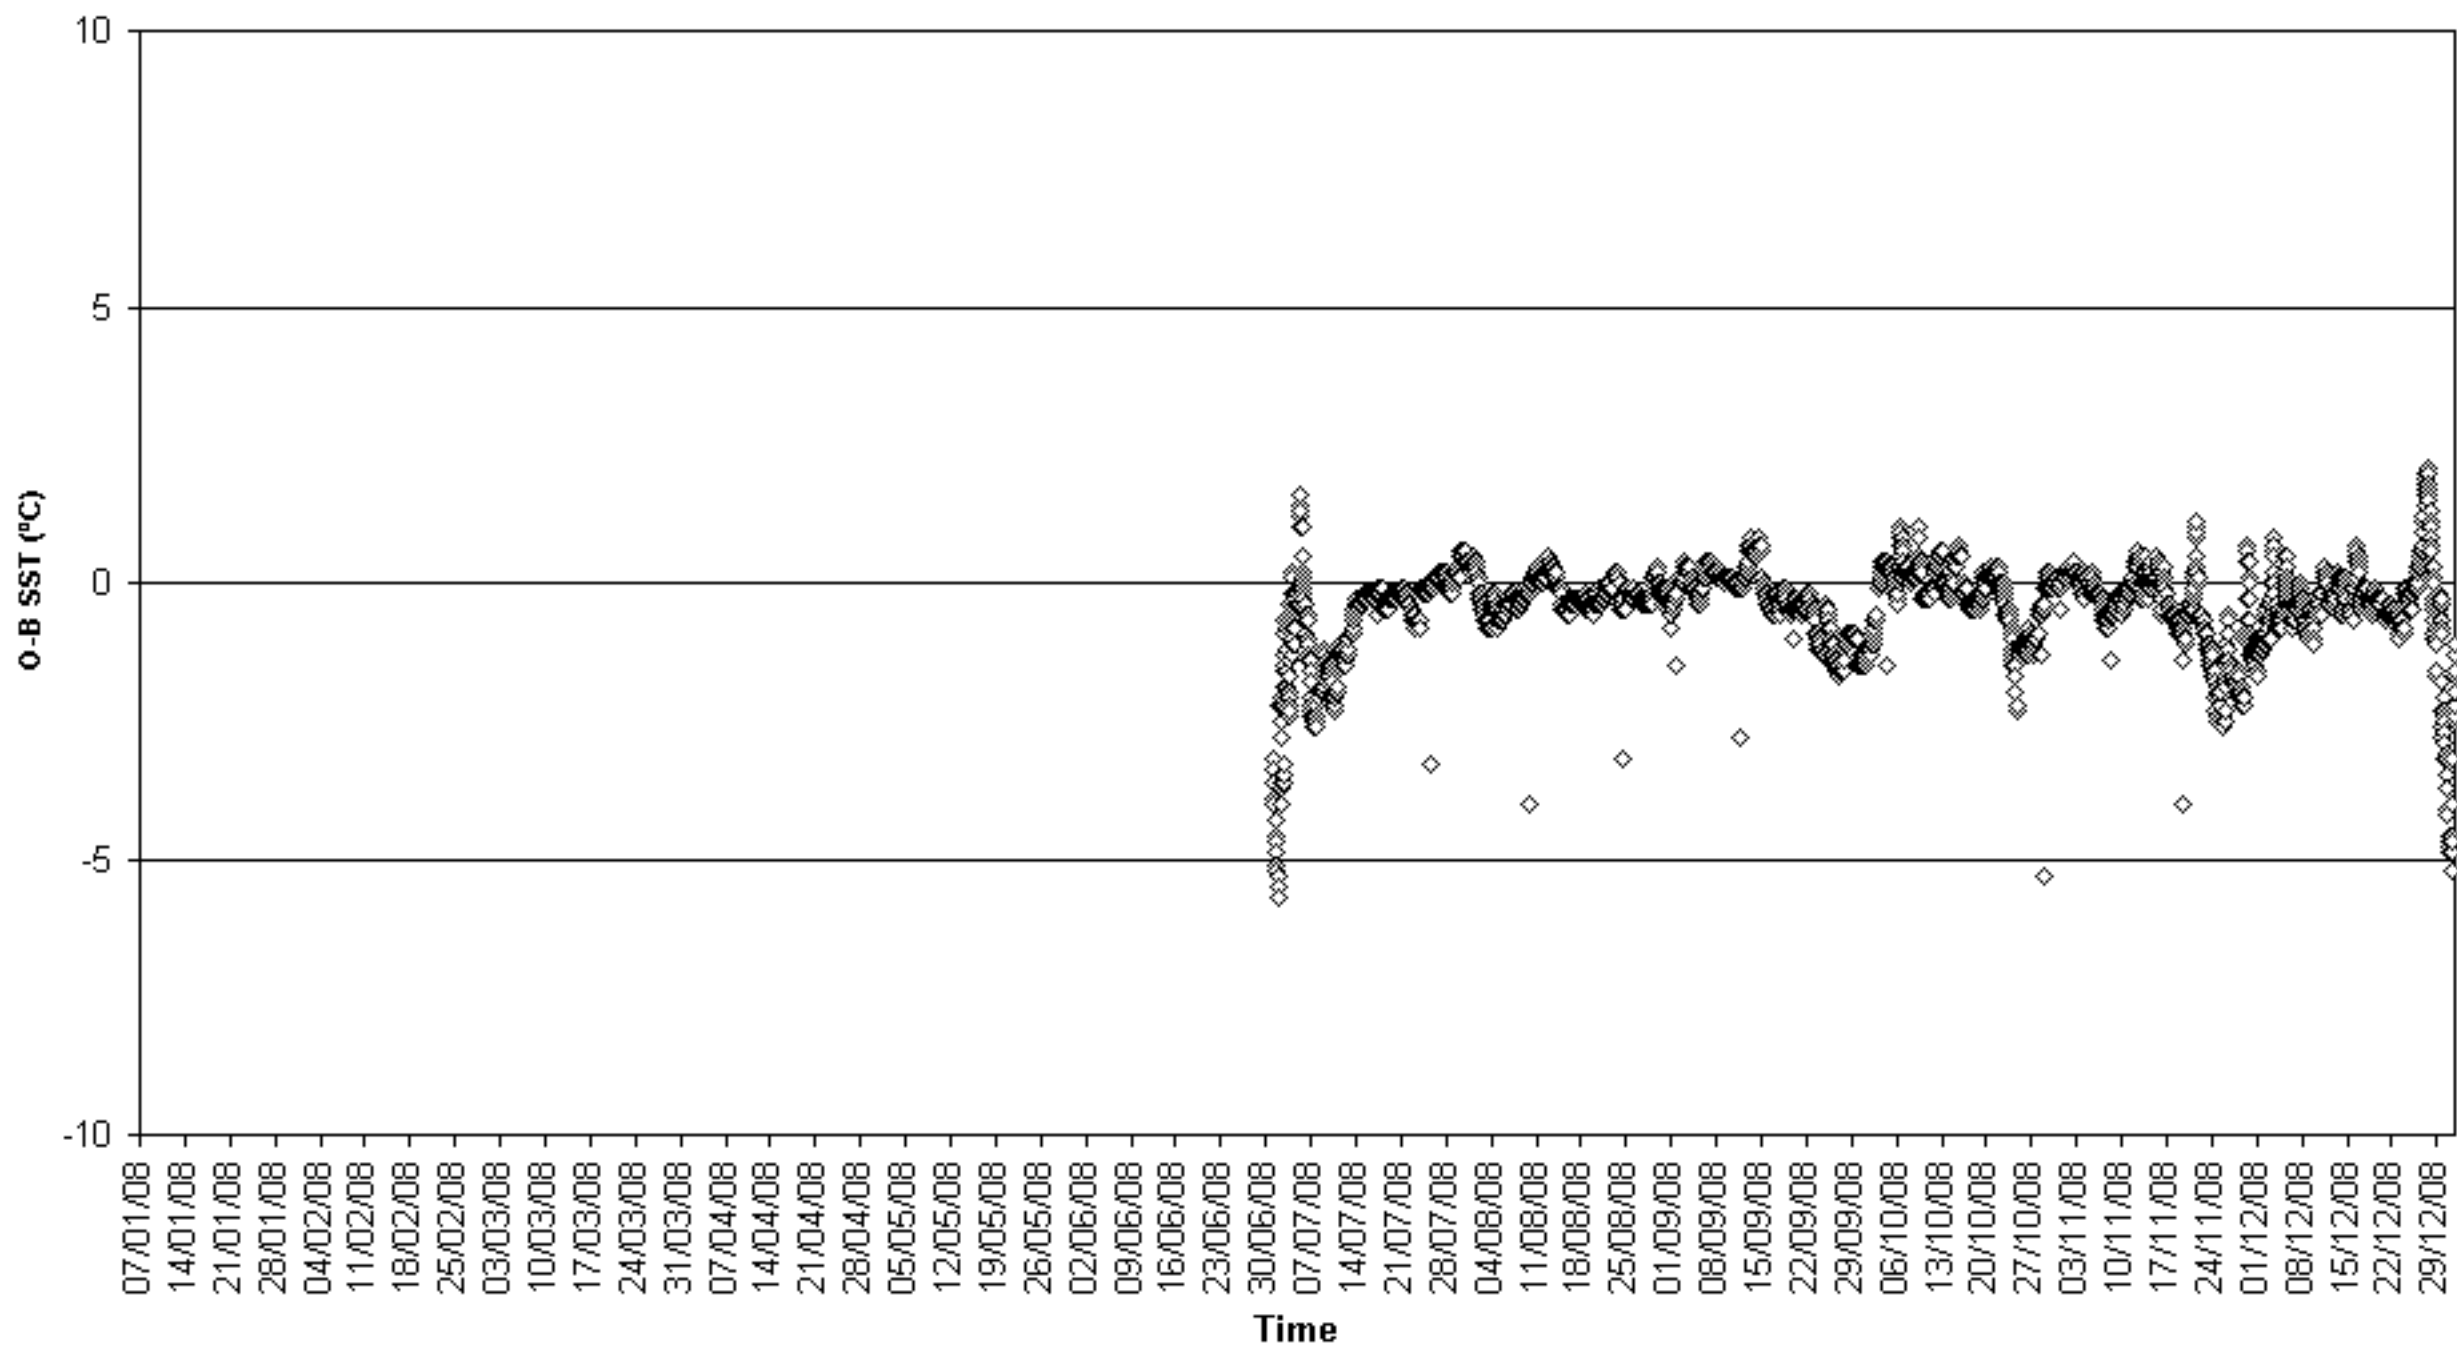


O-B SST (°C) for identifier 22585  
Number of obs. plotted = 52 Number of outliers = 6

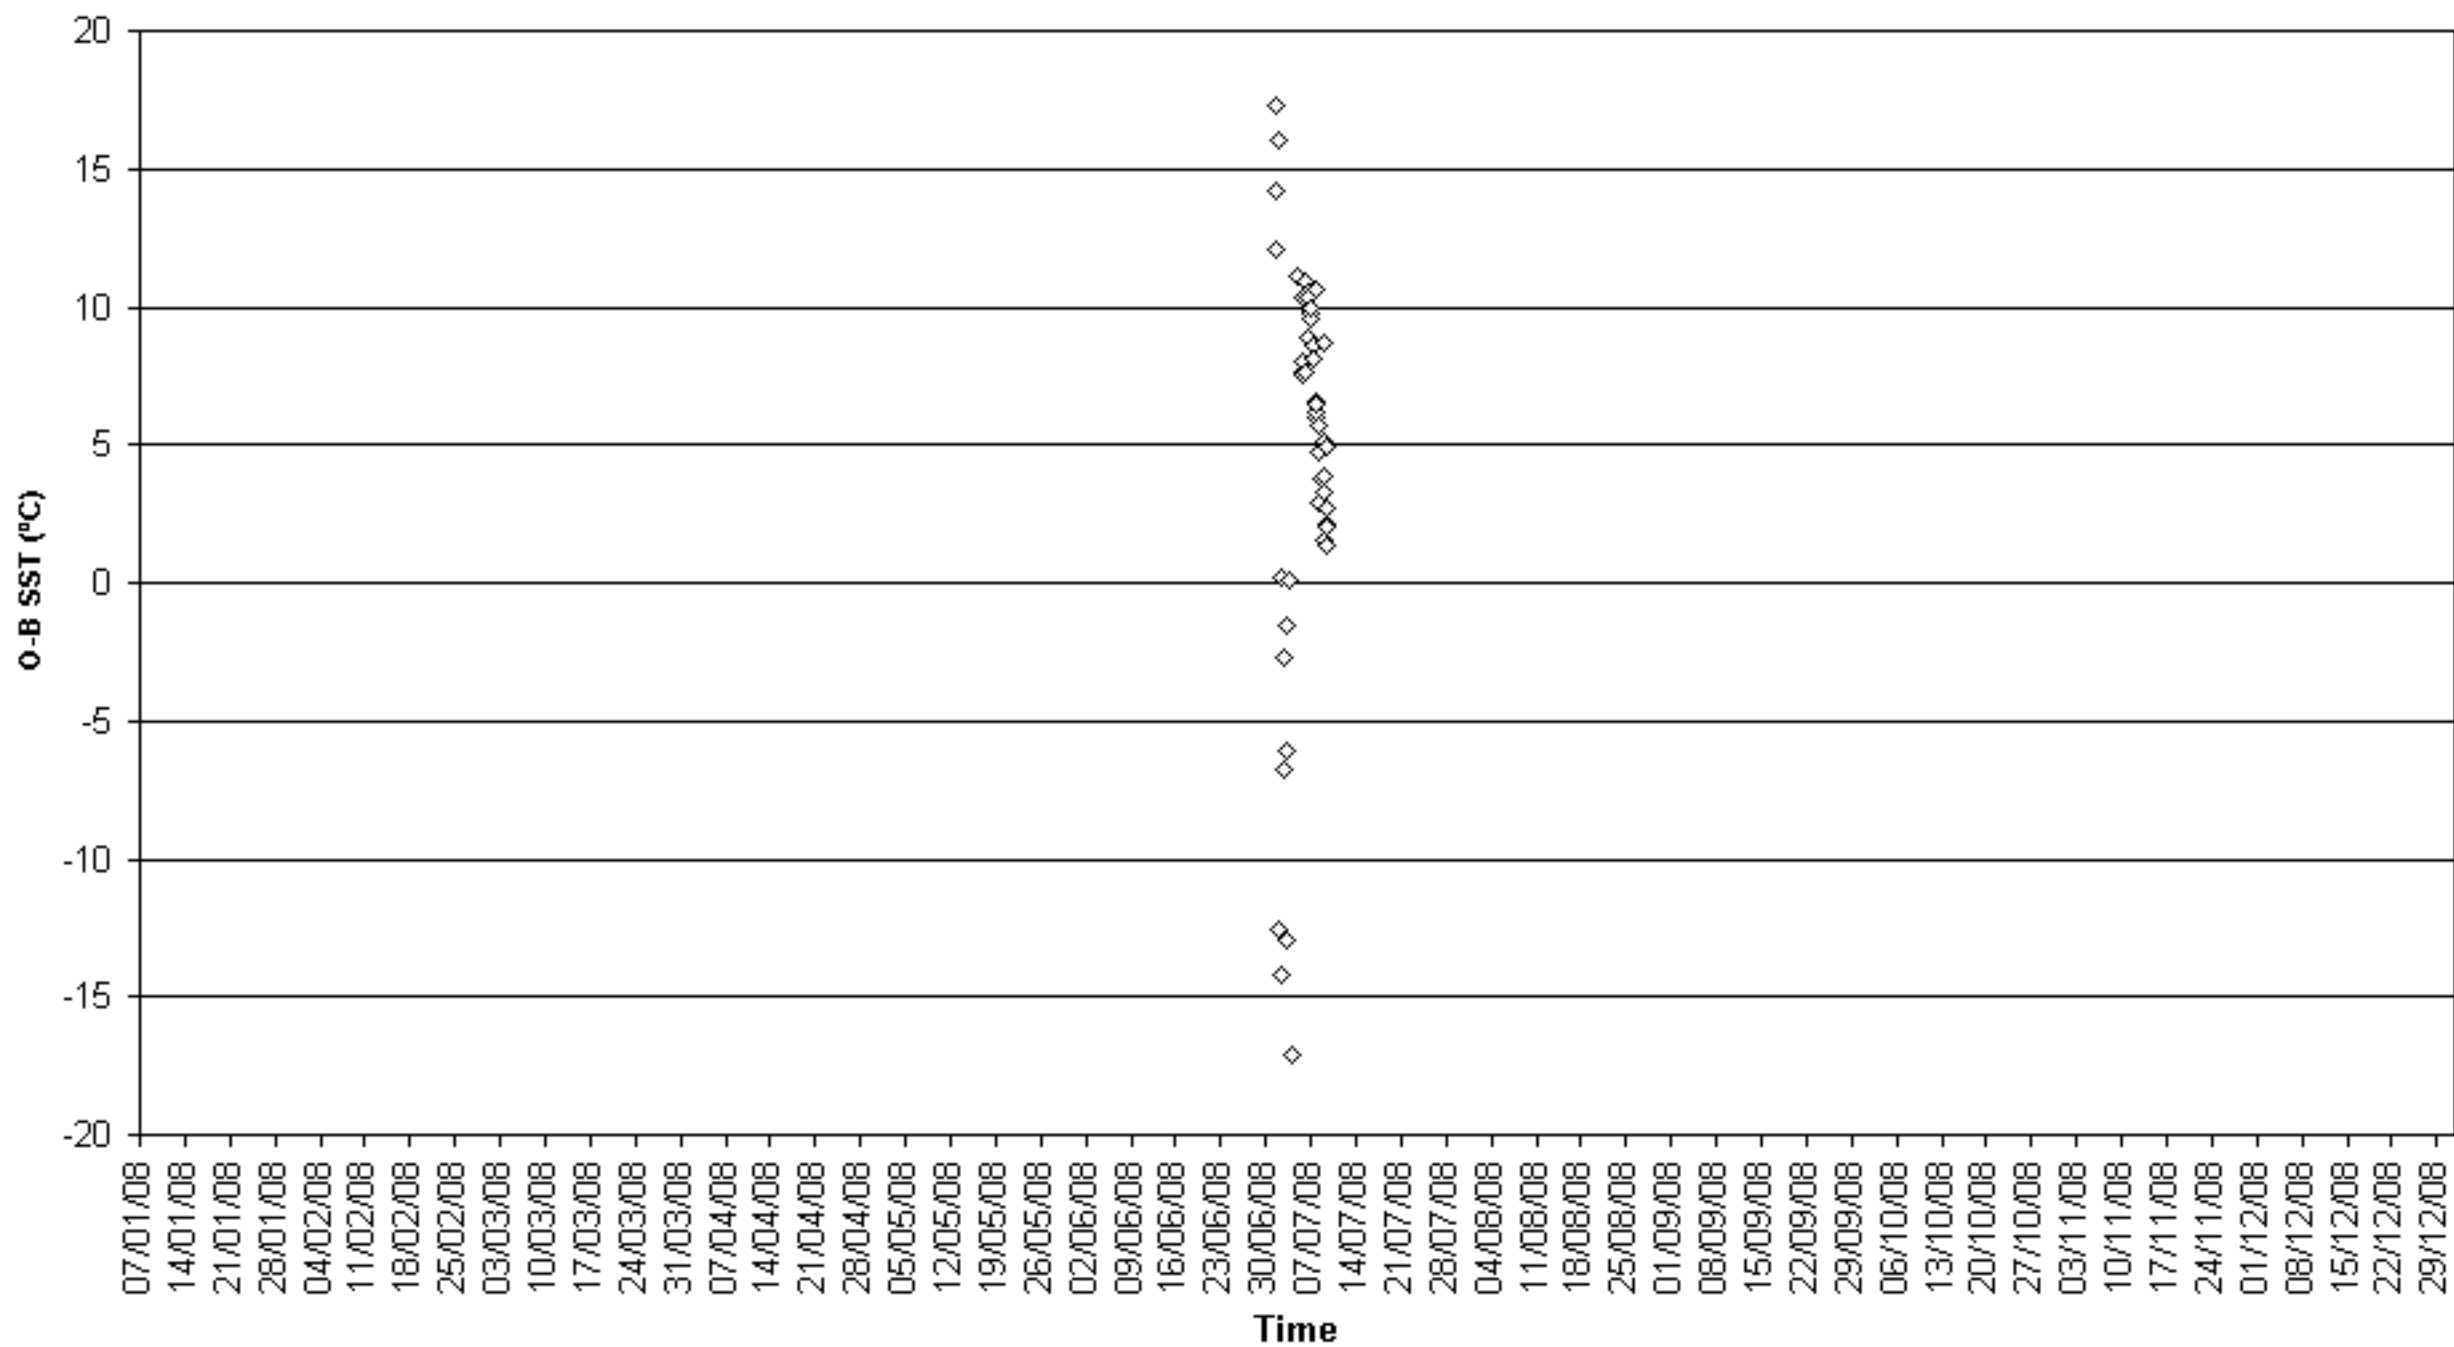


O-B SST (°C) for identifier 23960  
Number of obs. plotted = 19 Number of outliers = 80

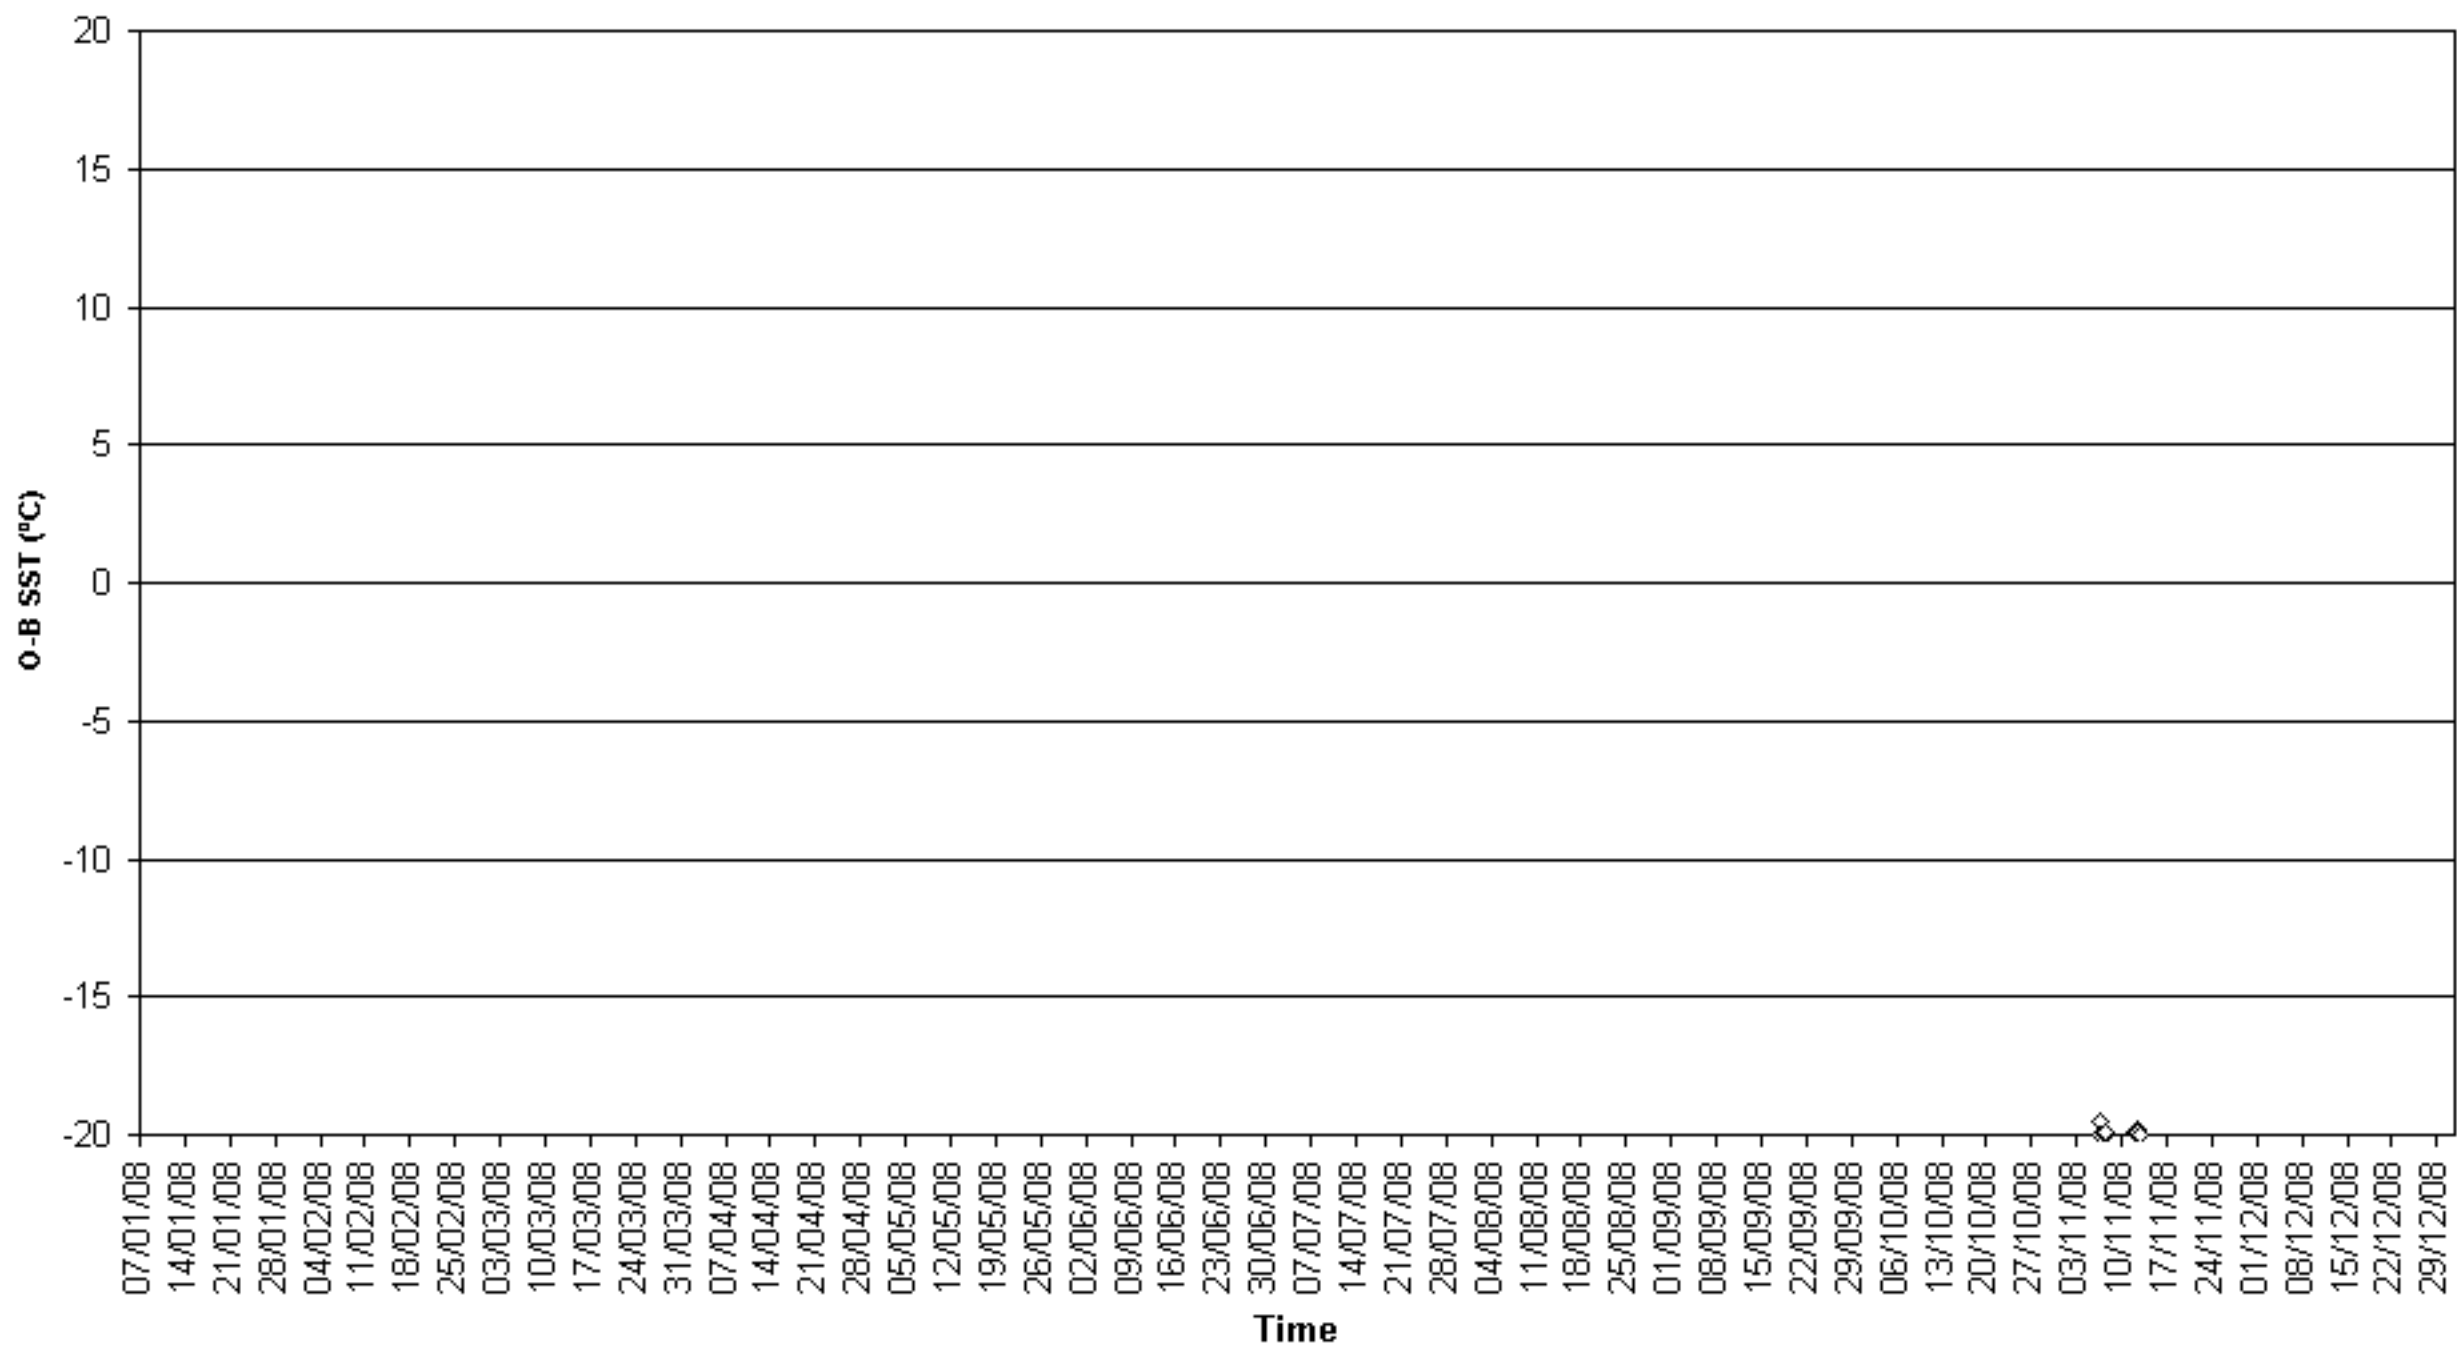

O-B SST (°C) for identifier 31733  
Number of obs. plotted = 4195 Number of outliers = 0

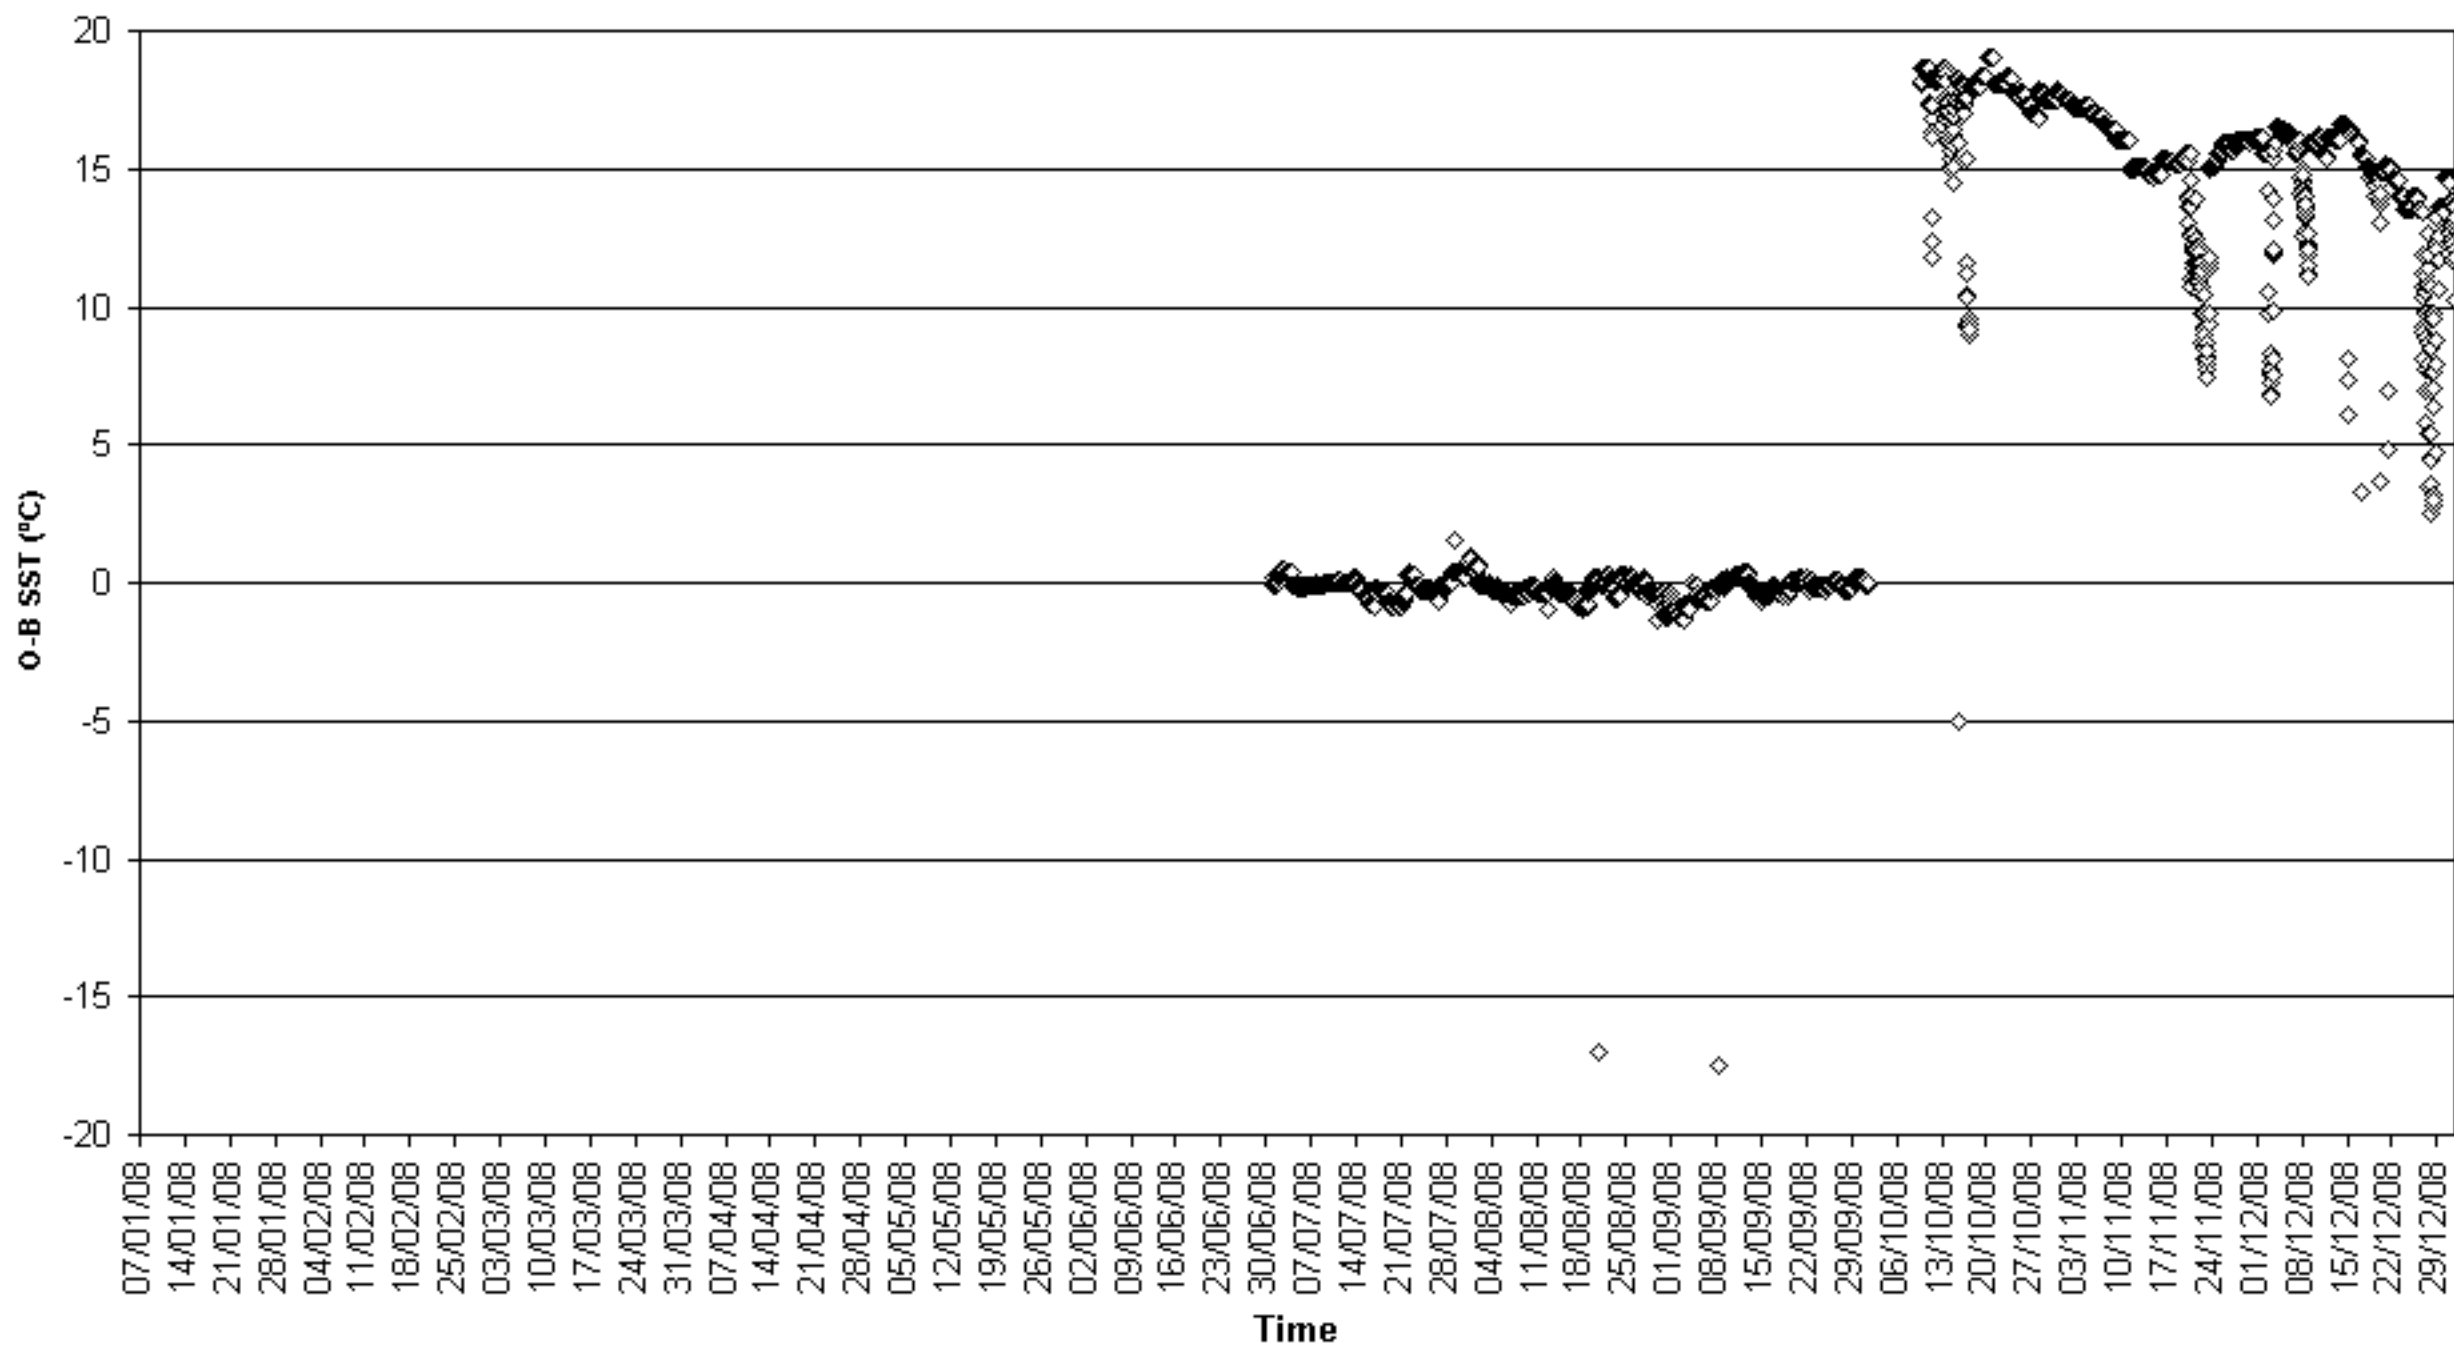


O-B SST (°C) for identifier 33691  
Number of obs. plotted = 50 Number of outliers = 0

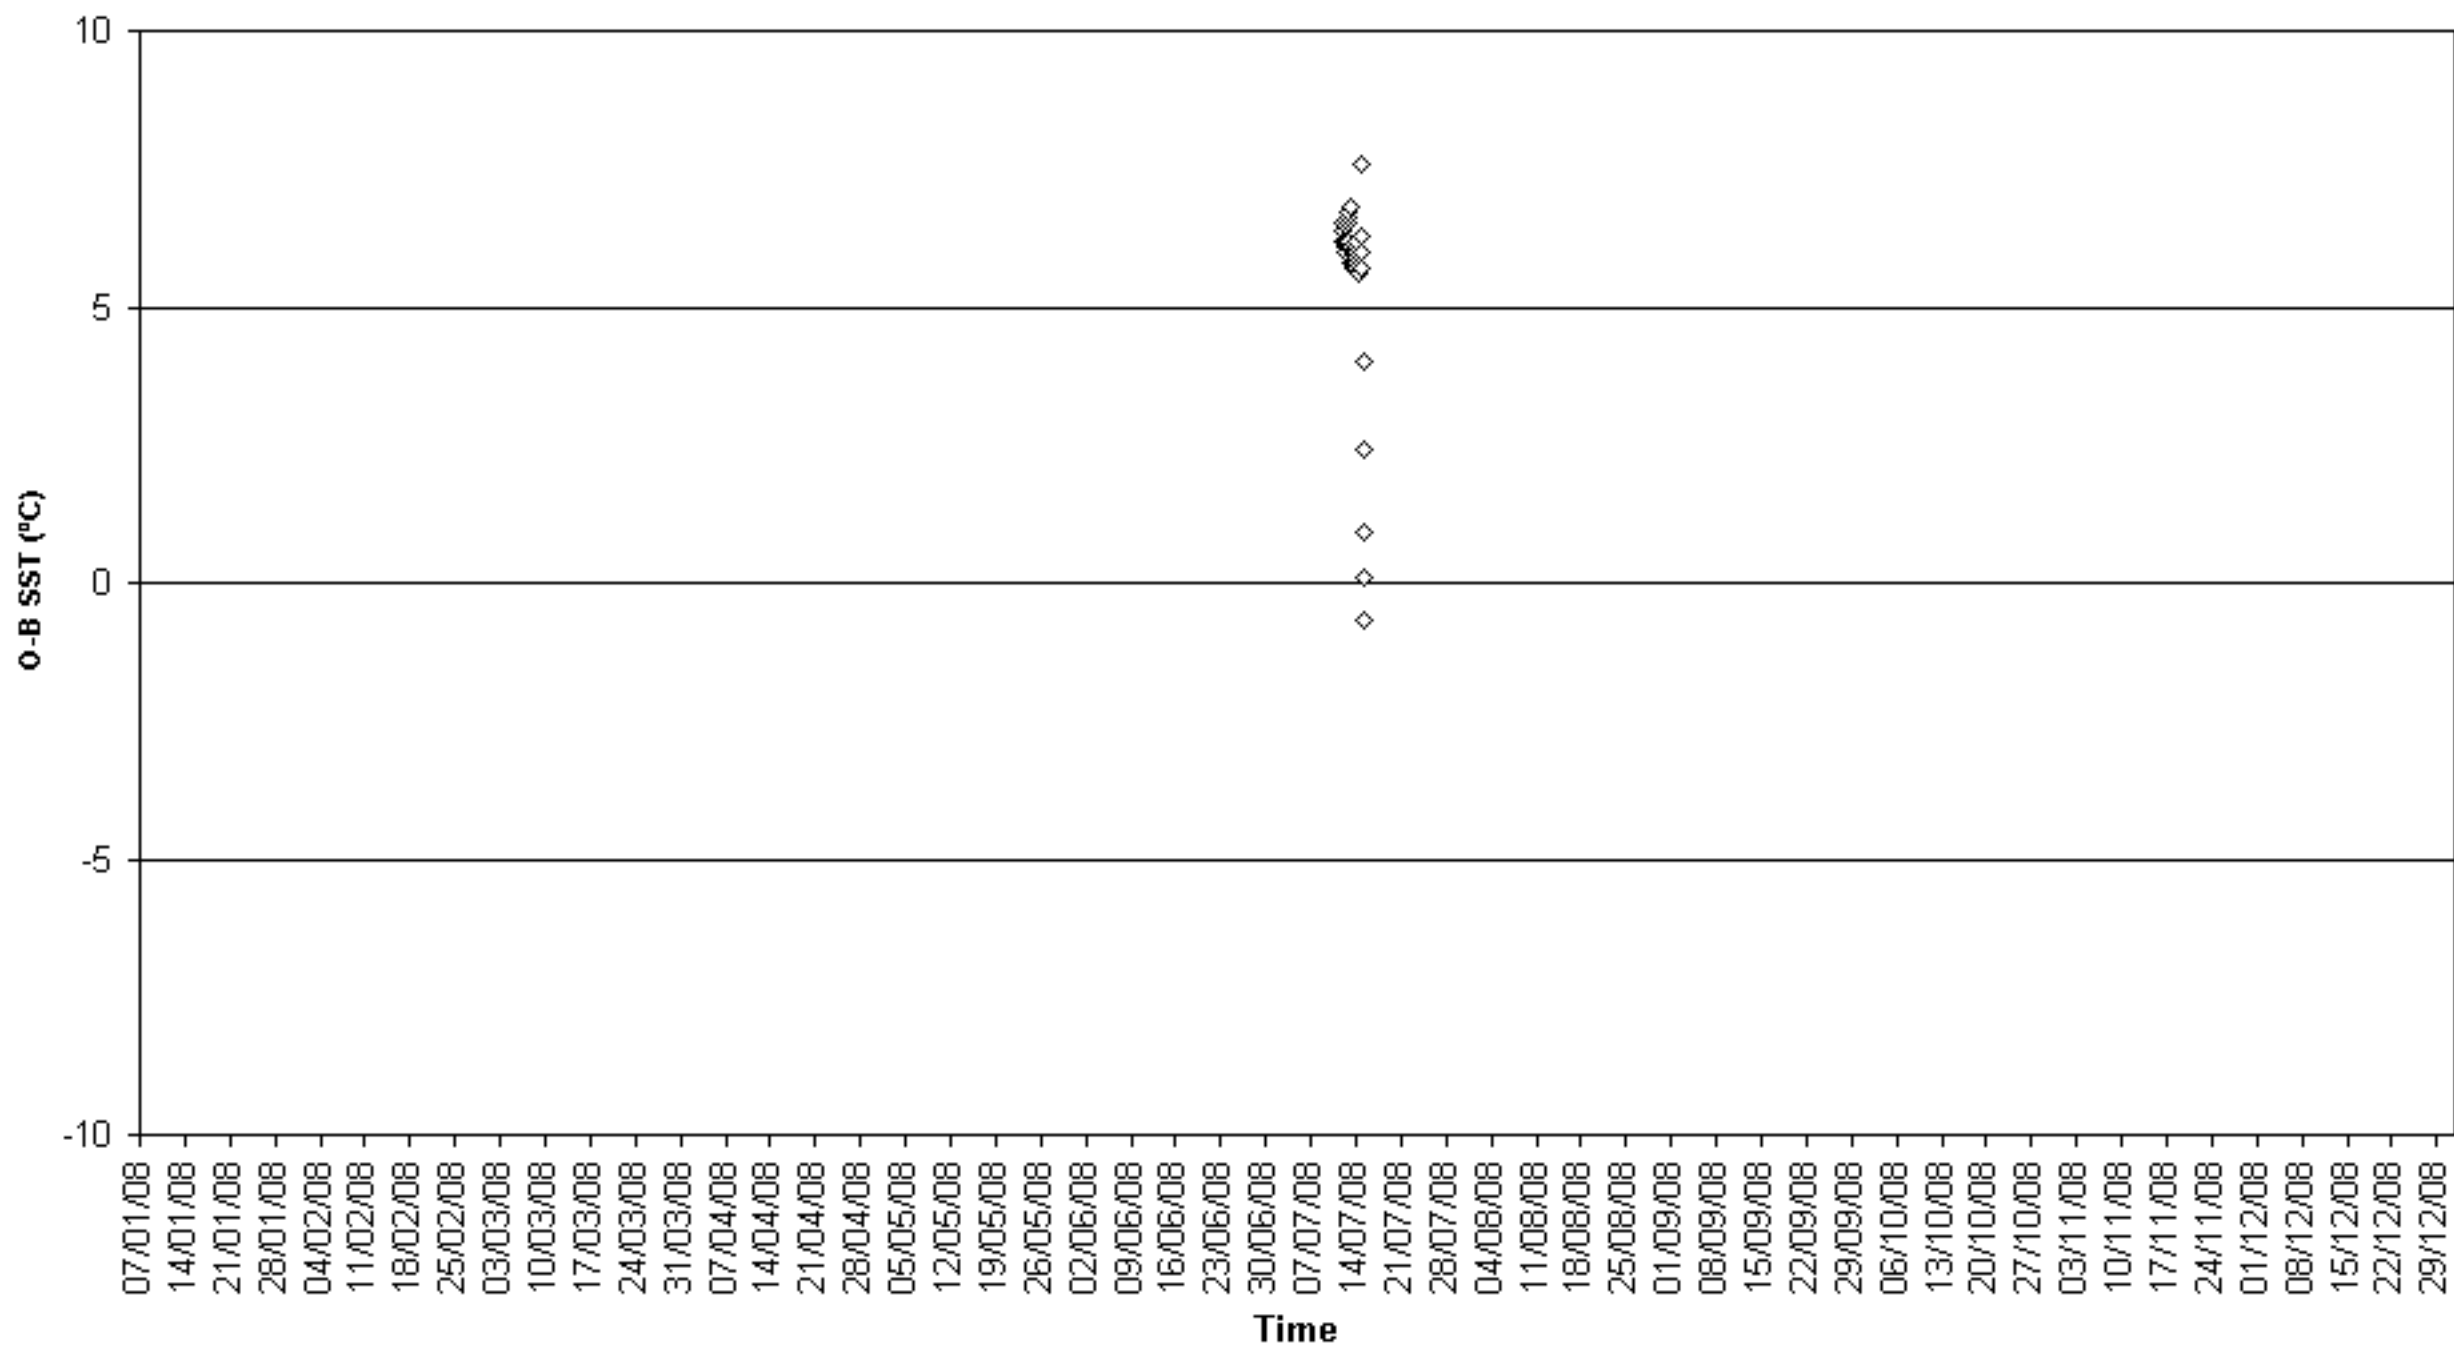





O-B SST (°C) for identifier 33952  
Number of obs. plotted = 45 Number of outliers = 0

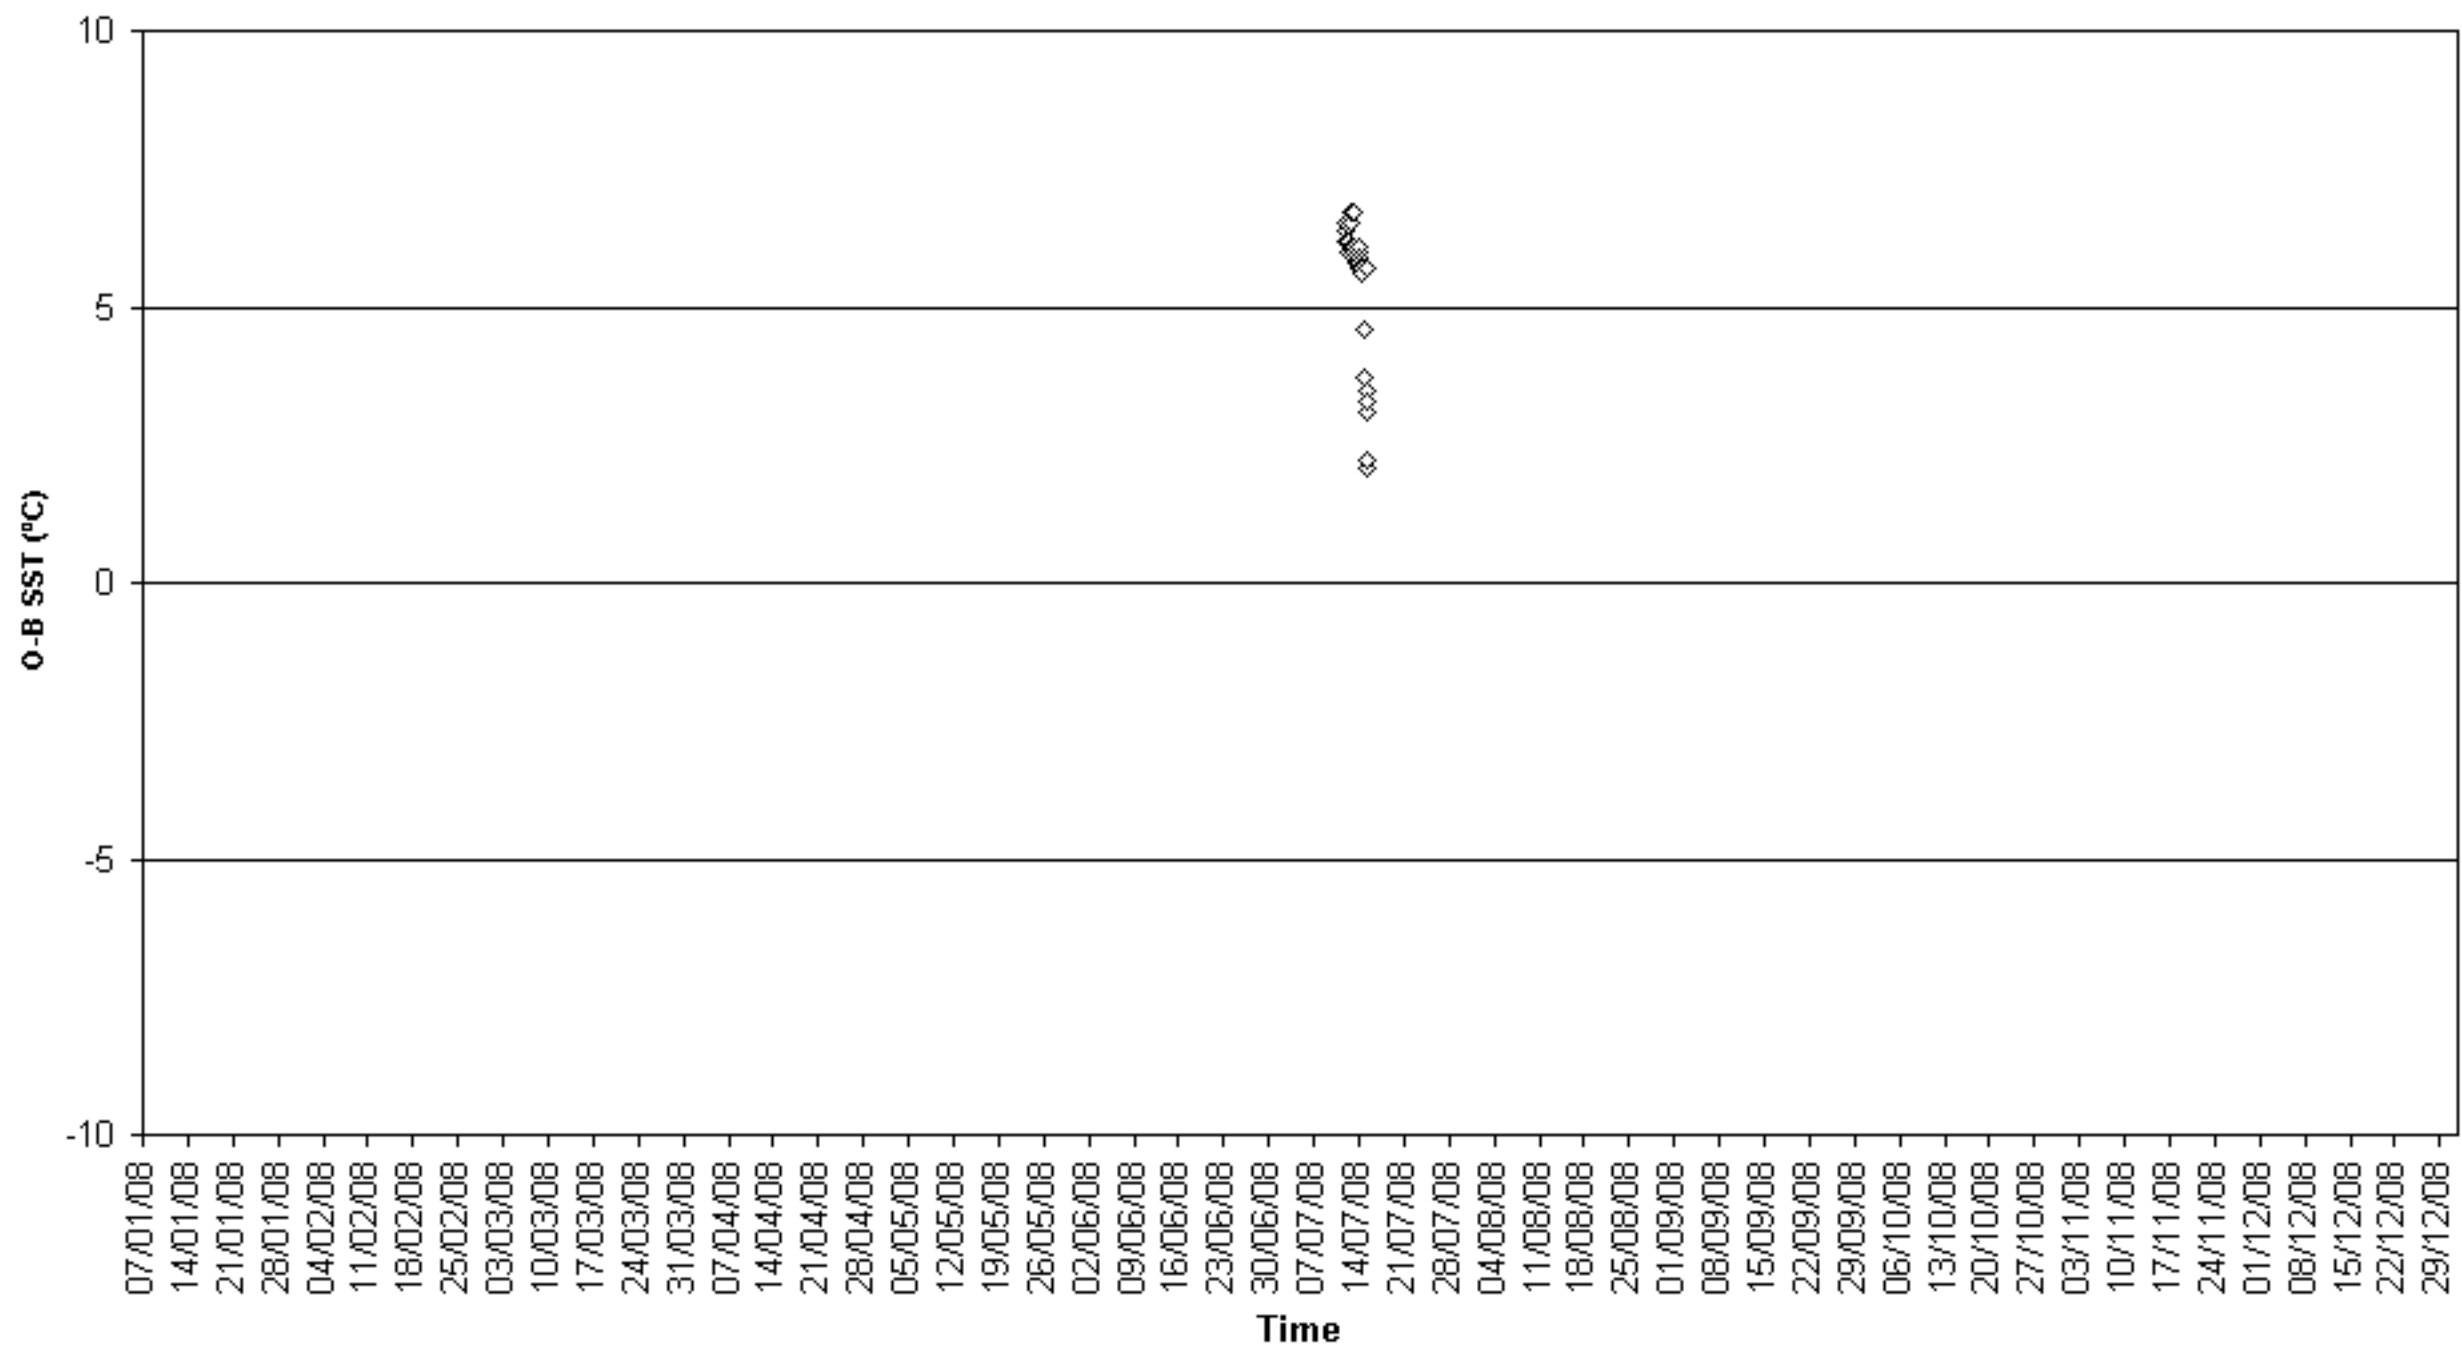


O-B SST (°C) for identifier 41927  
Number of obs. plotted = 1214 Number of outliers = 87

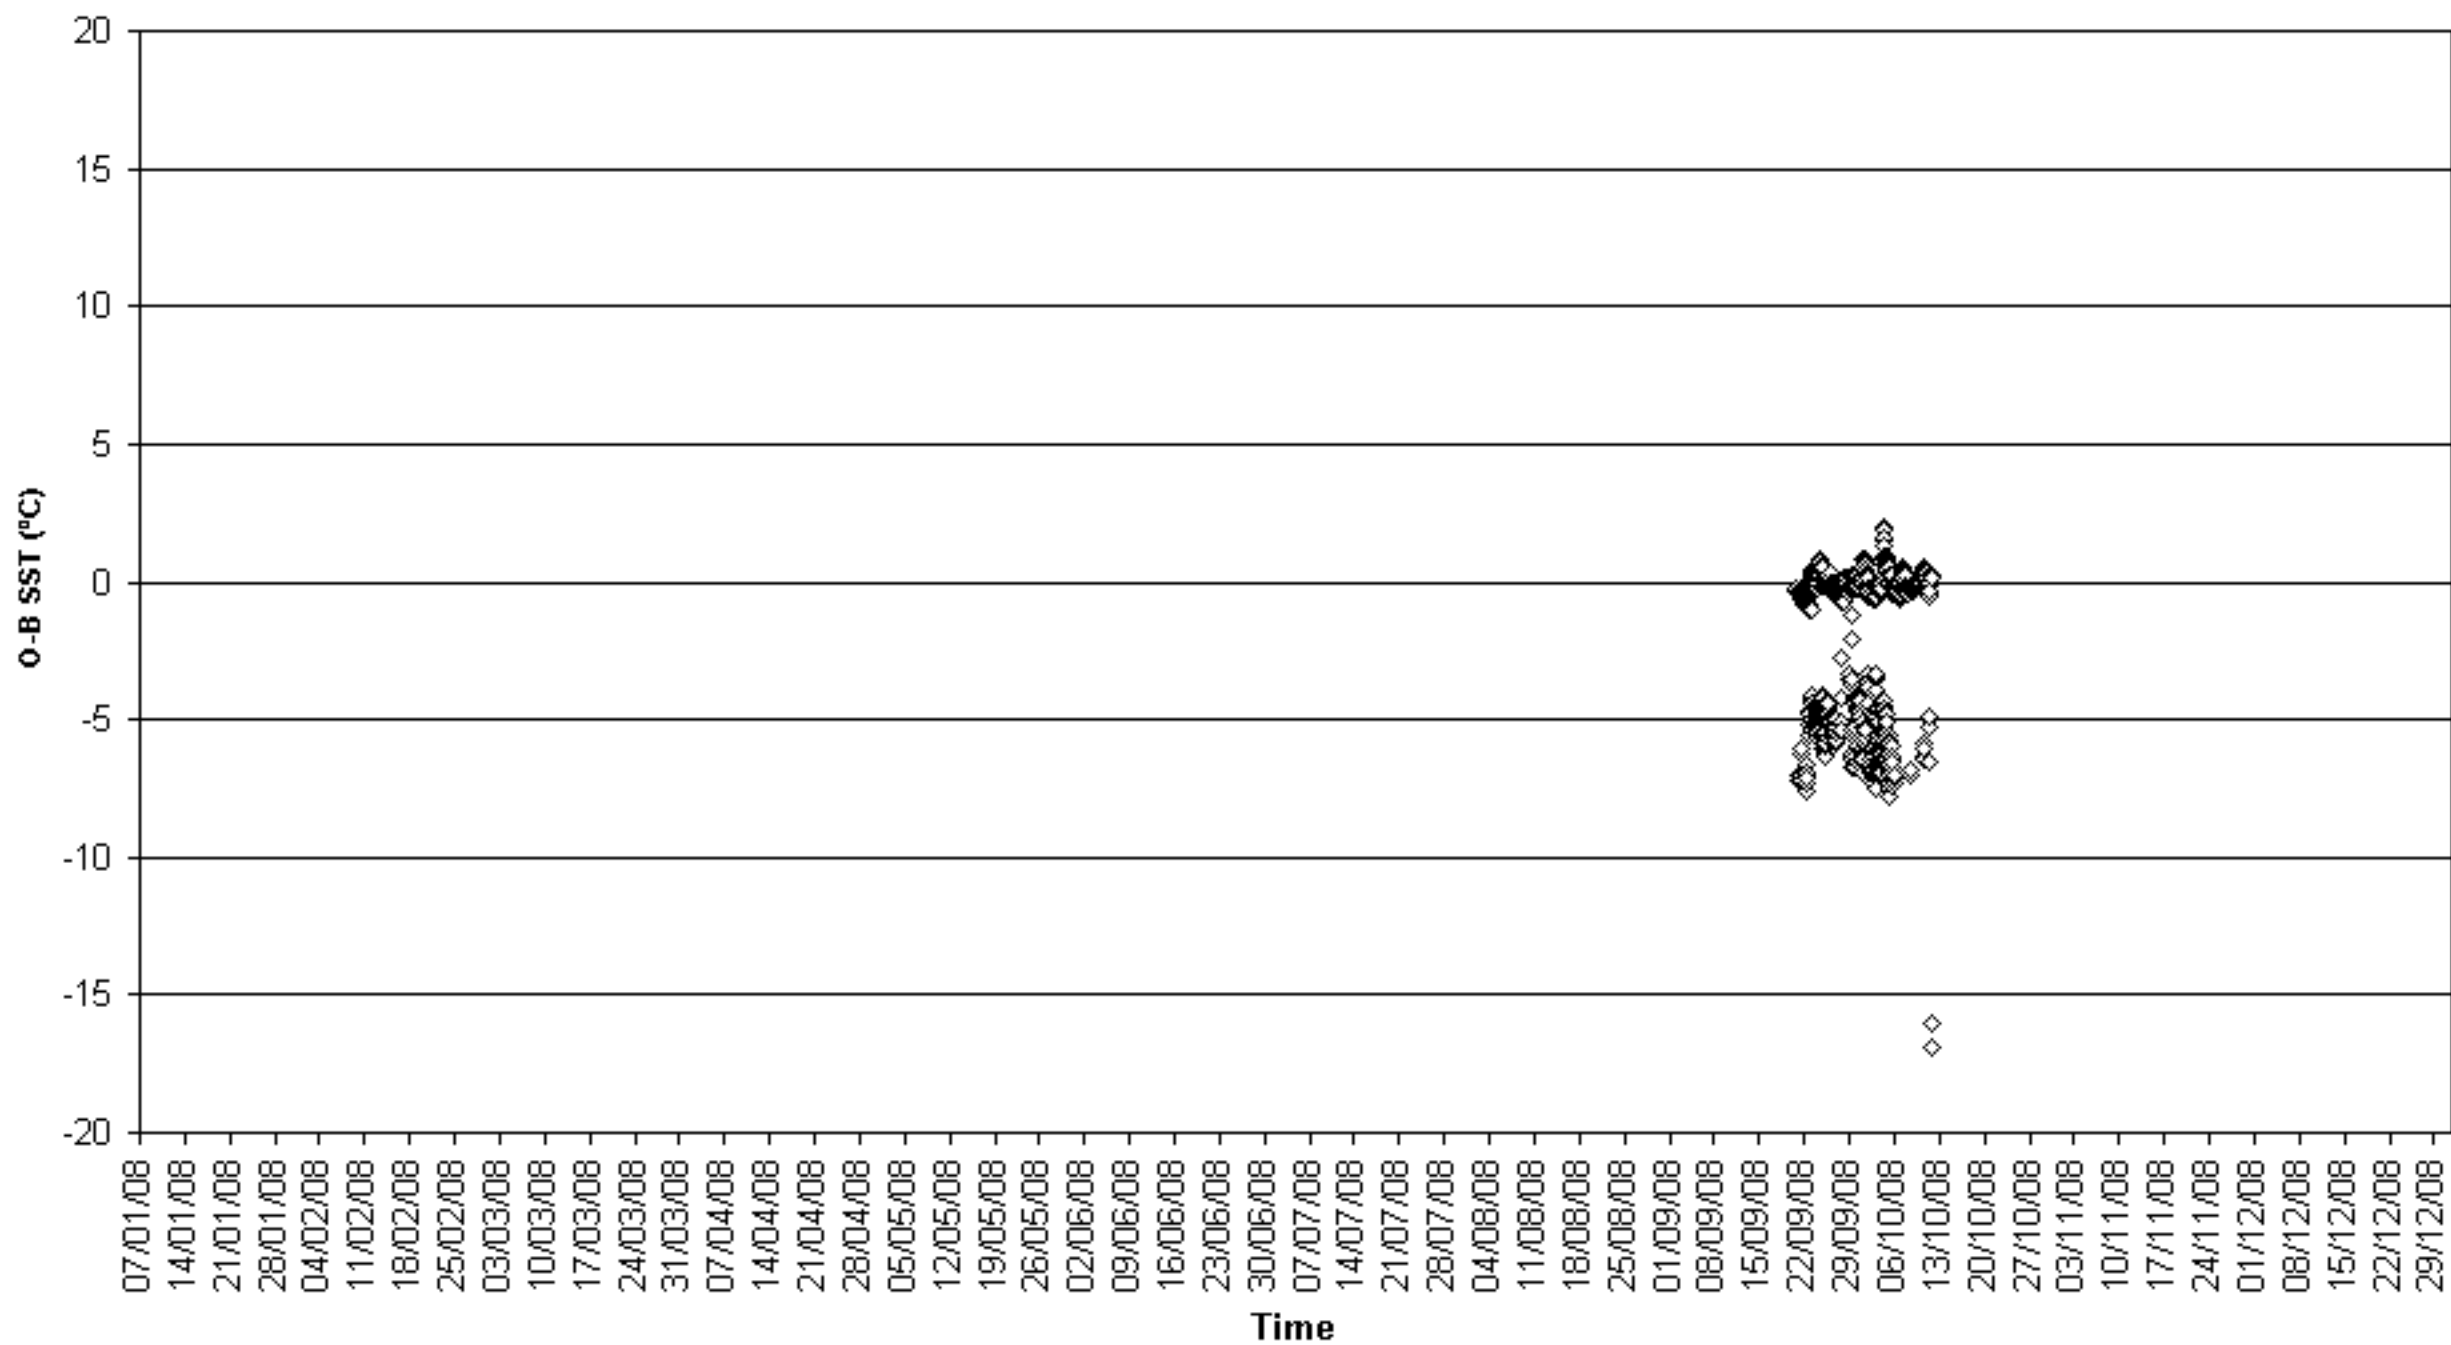


O-B SST (°C) for identifier 42536  
Number of obs. plotted = 1040 Number of outliers = 585

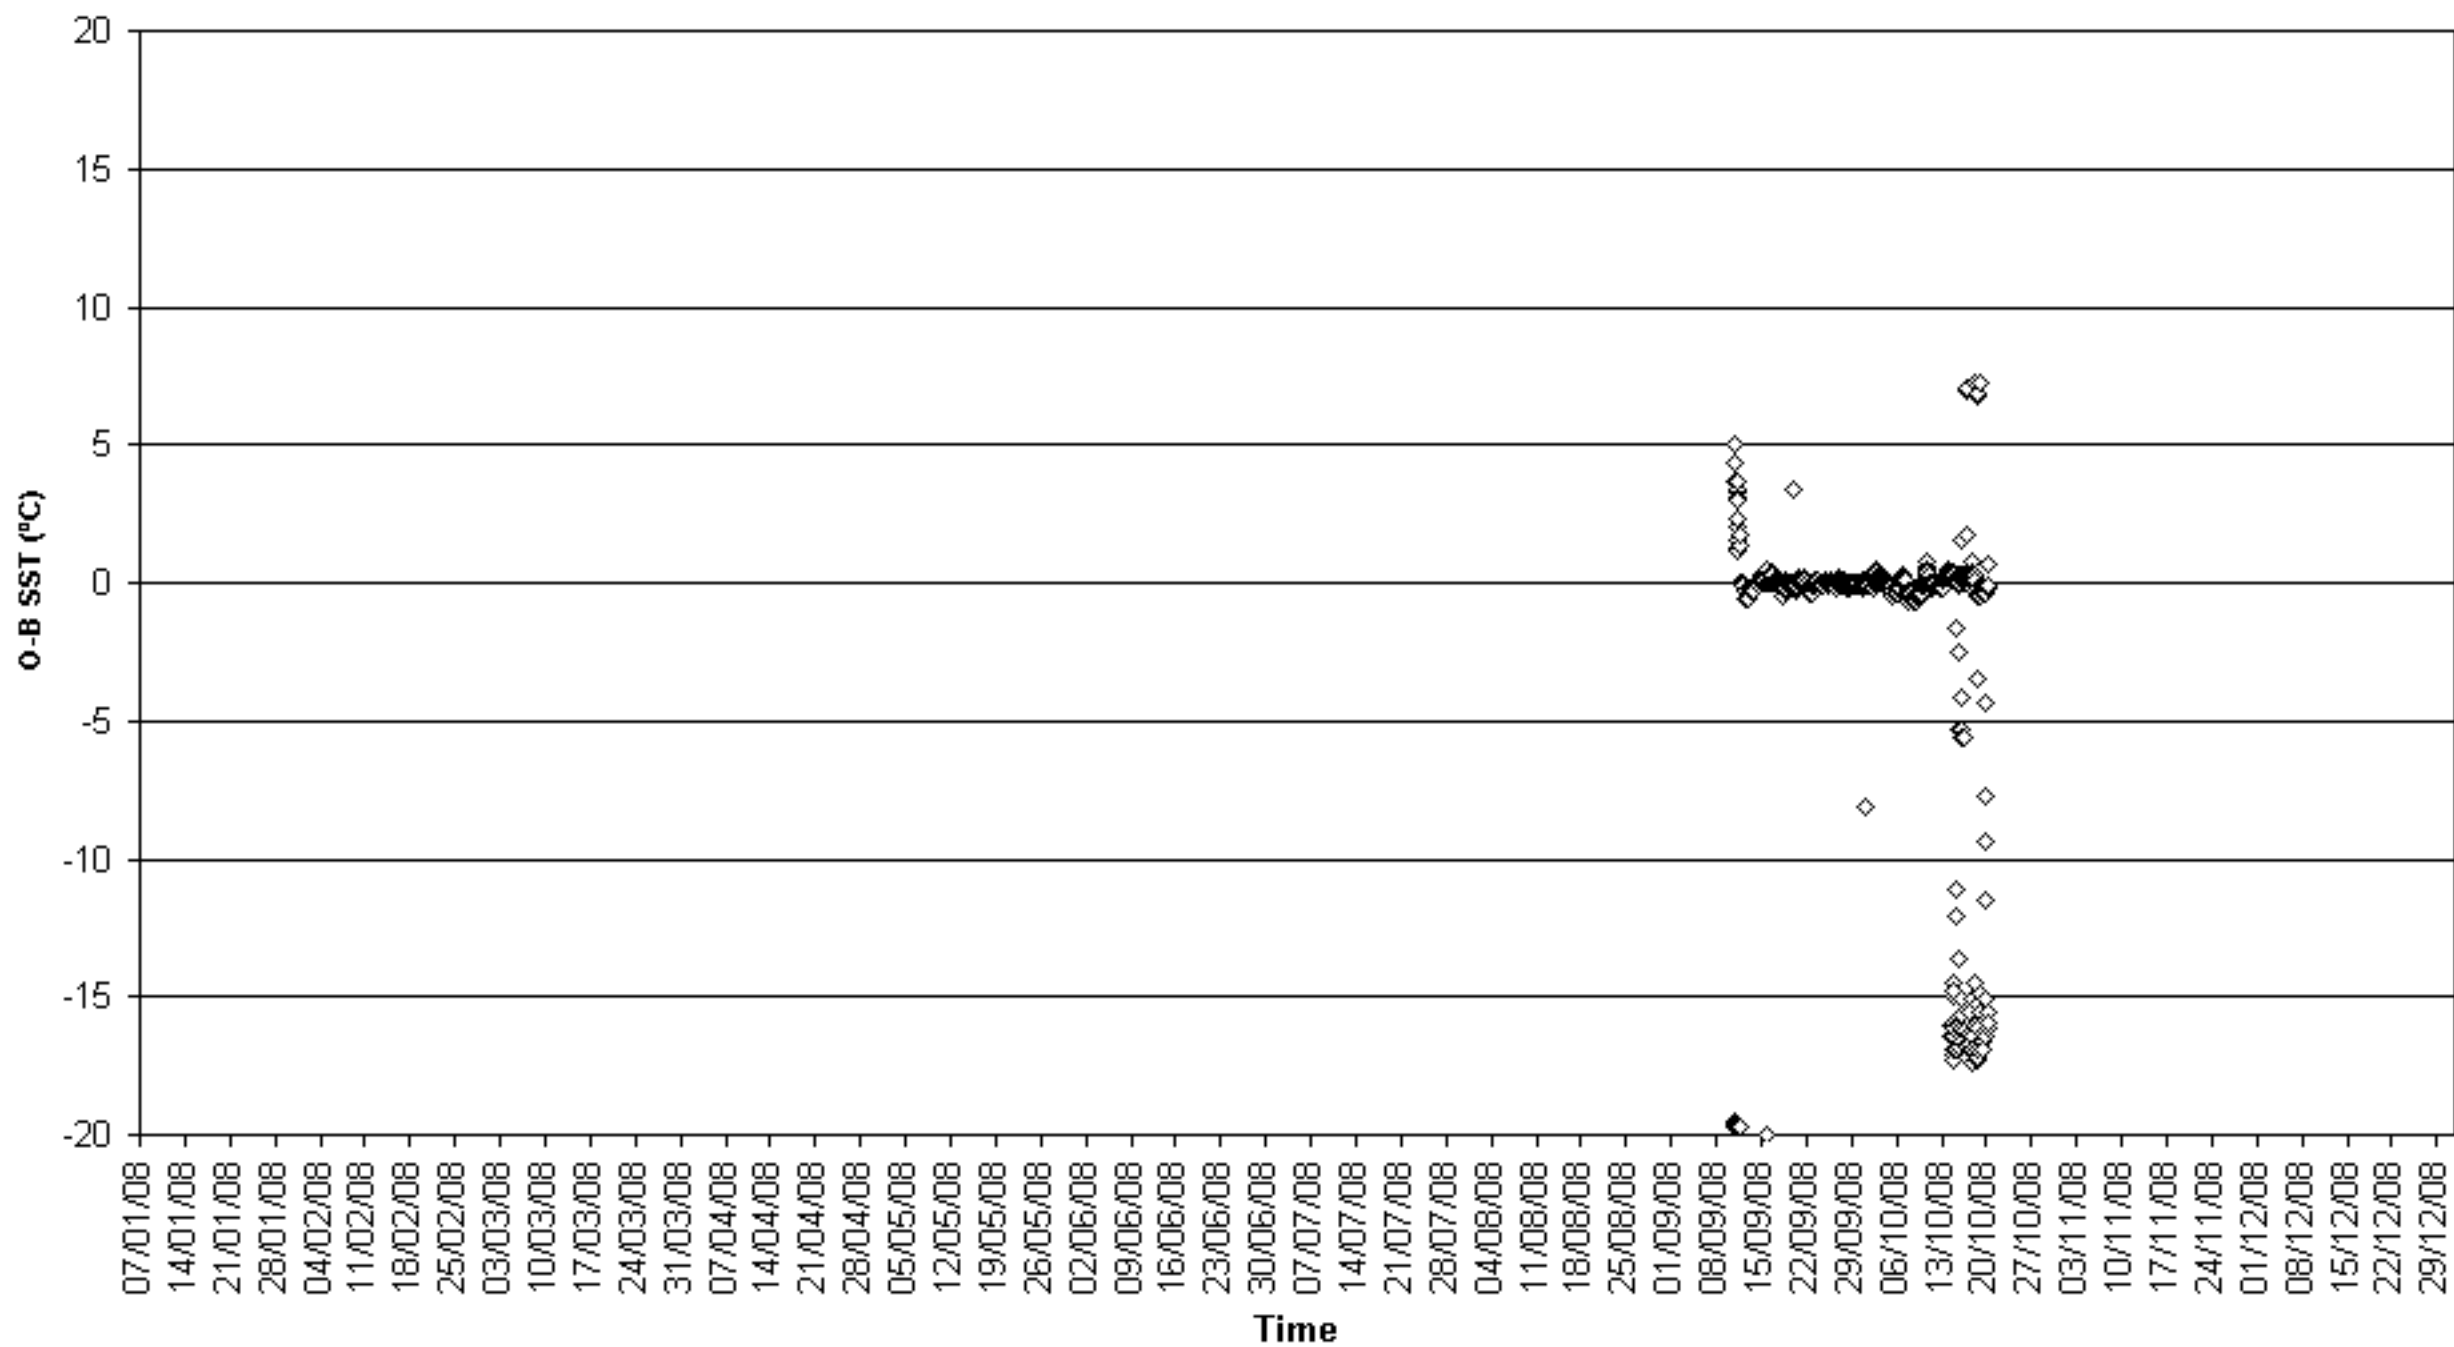


O-B SST (°C) for identifier 42542  
Number of obs. plotted = 3931 Number of outliers = 21

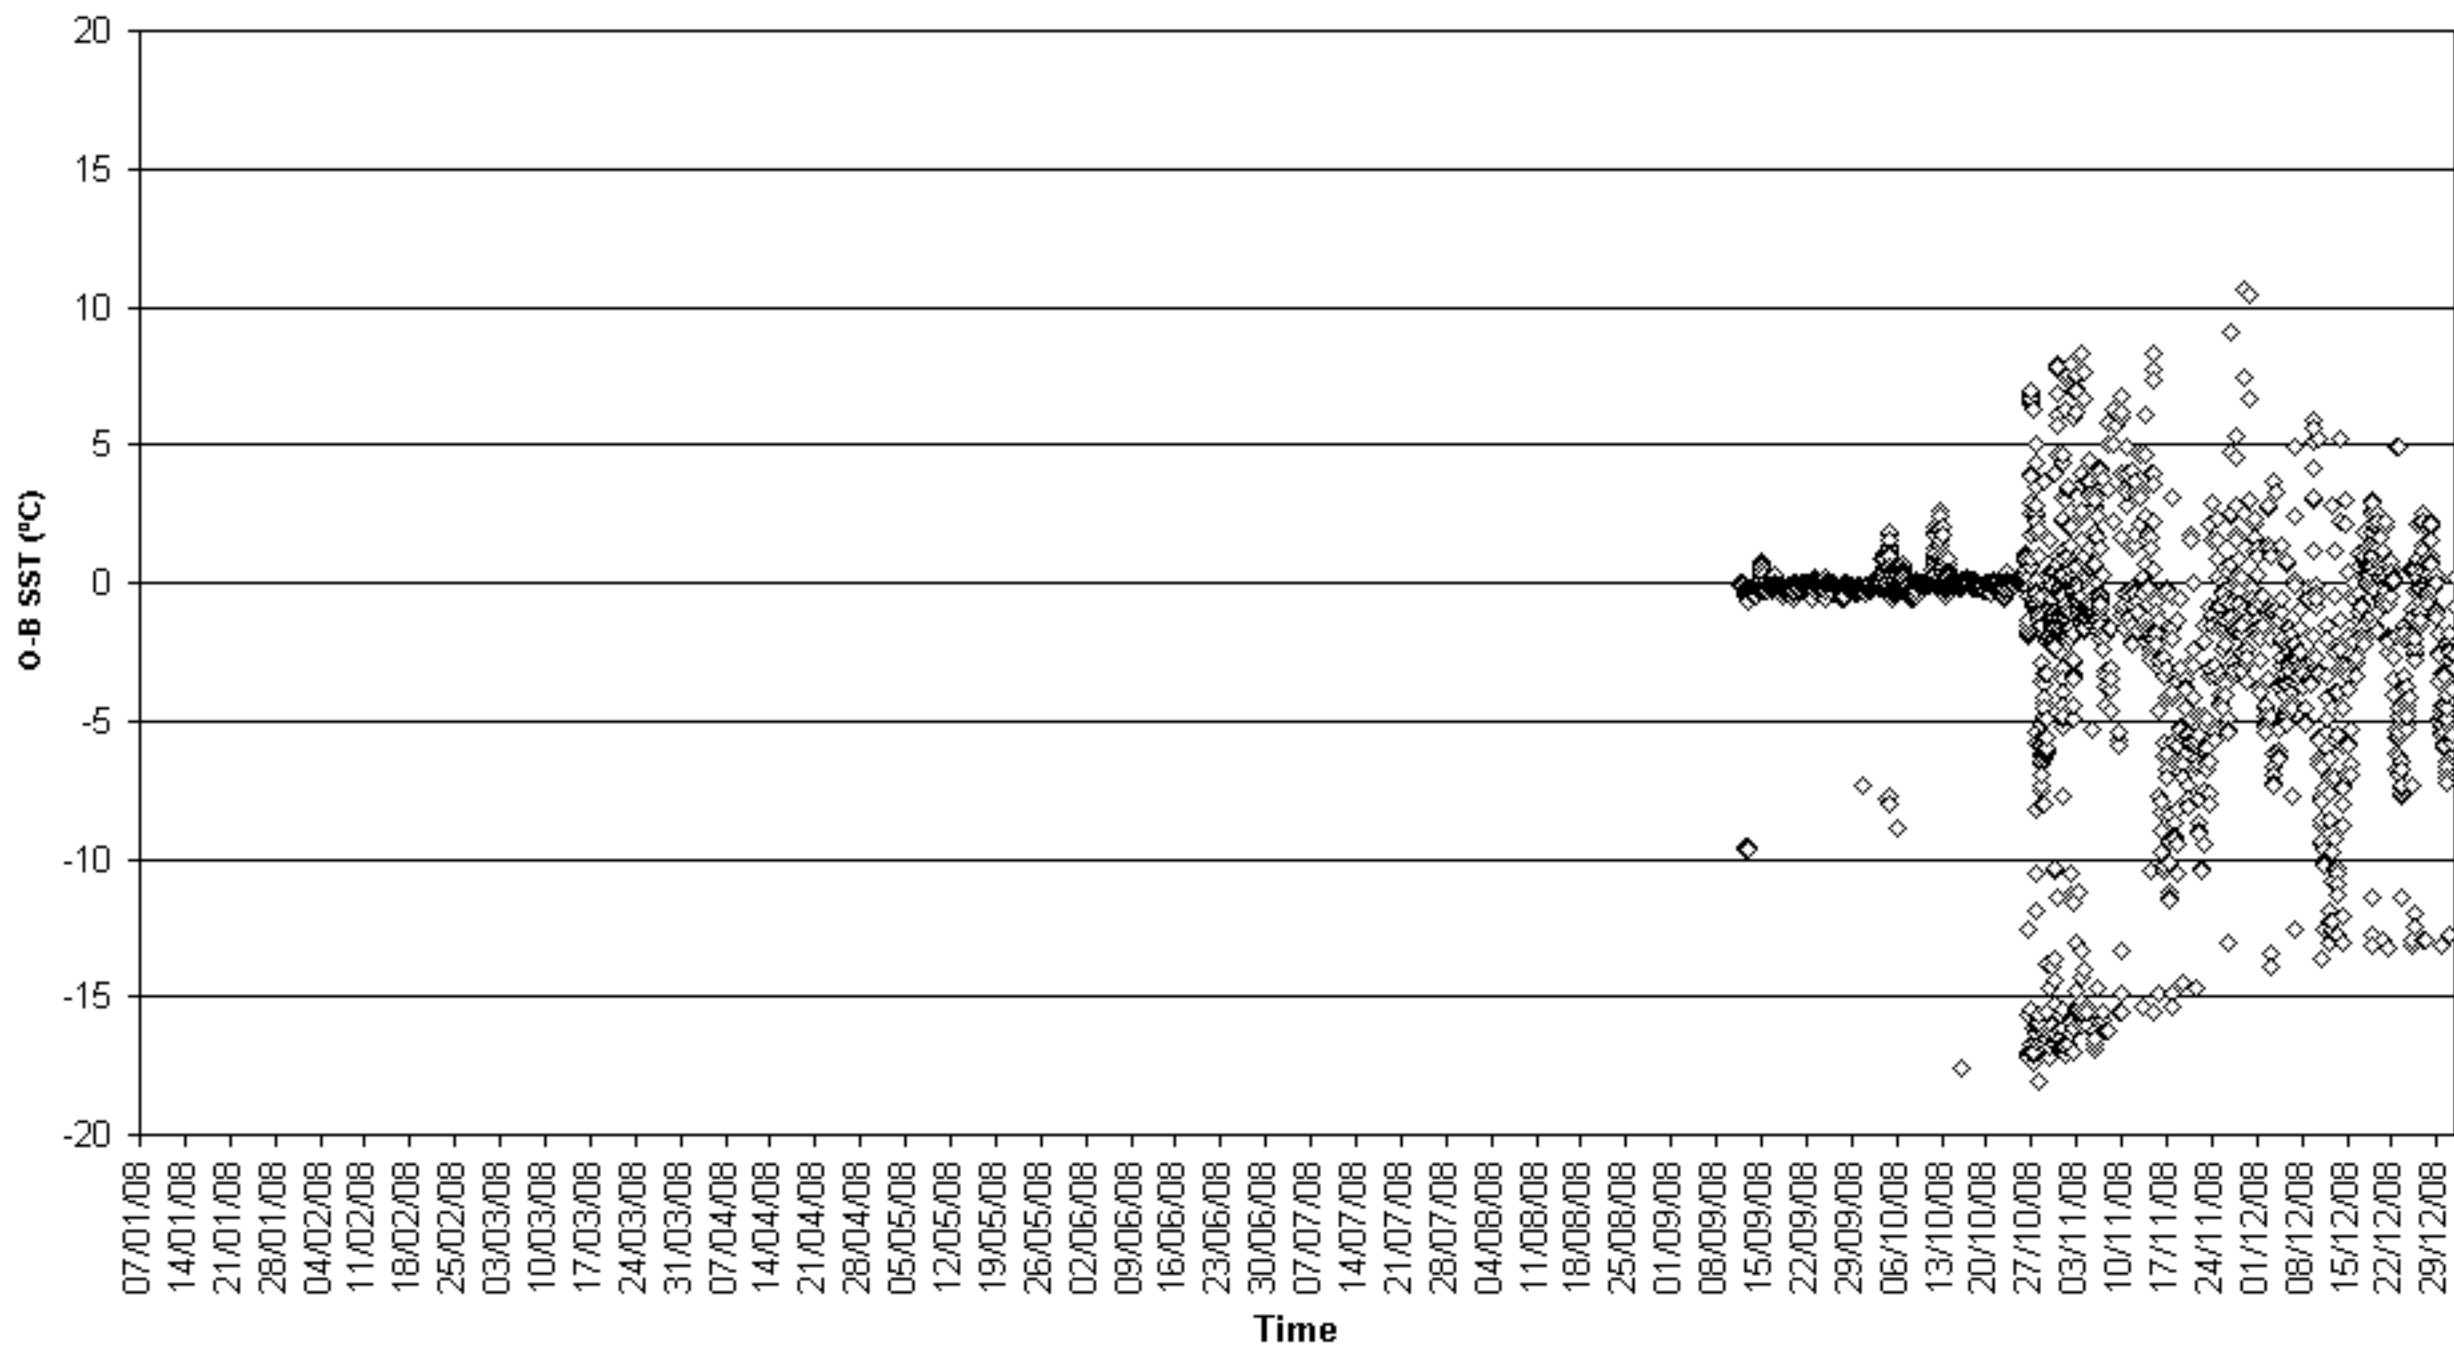


O-B SST (°C) for identifier 44741  
Number of obs. plotted = 127 Number of outliers = 0

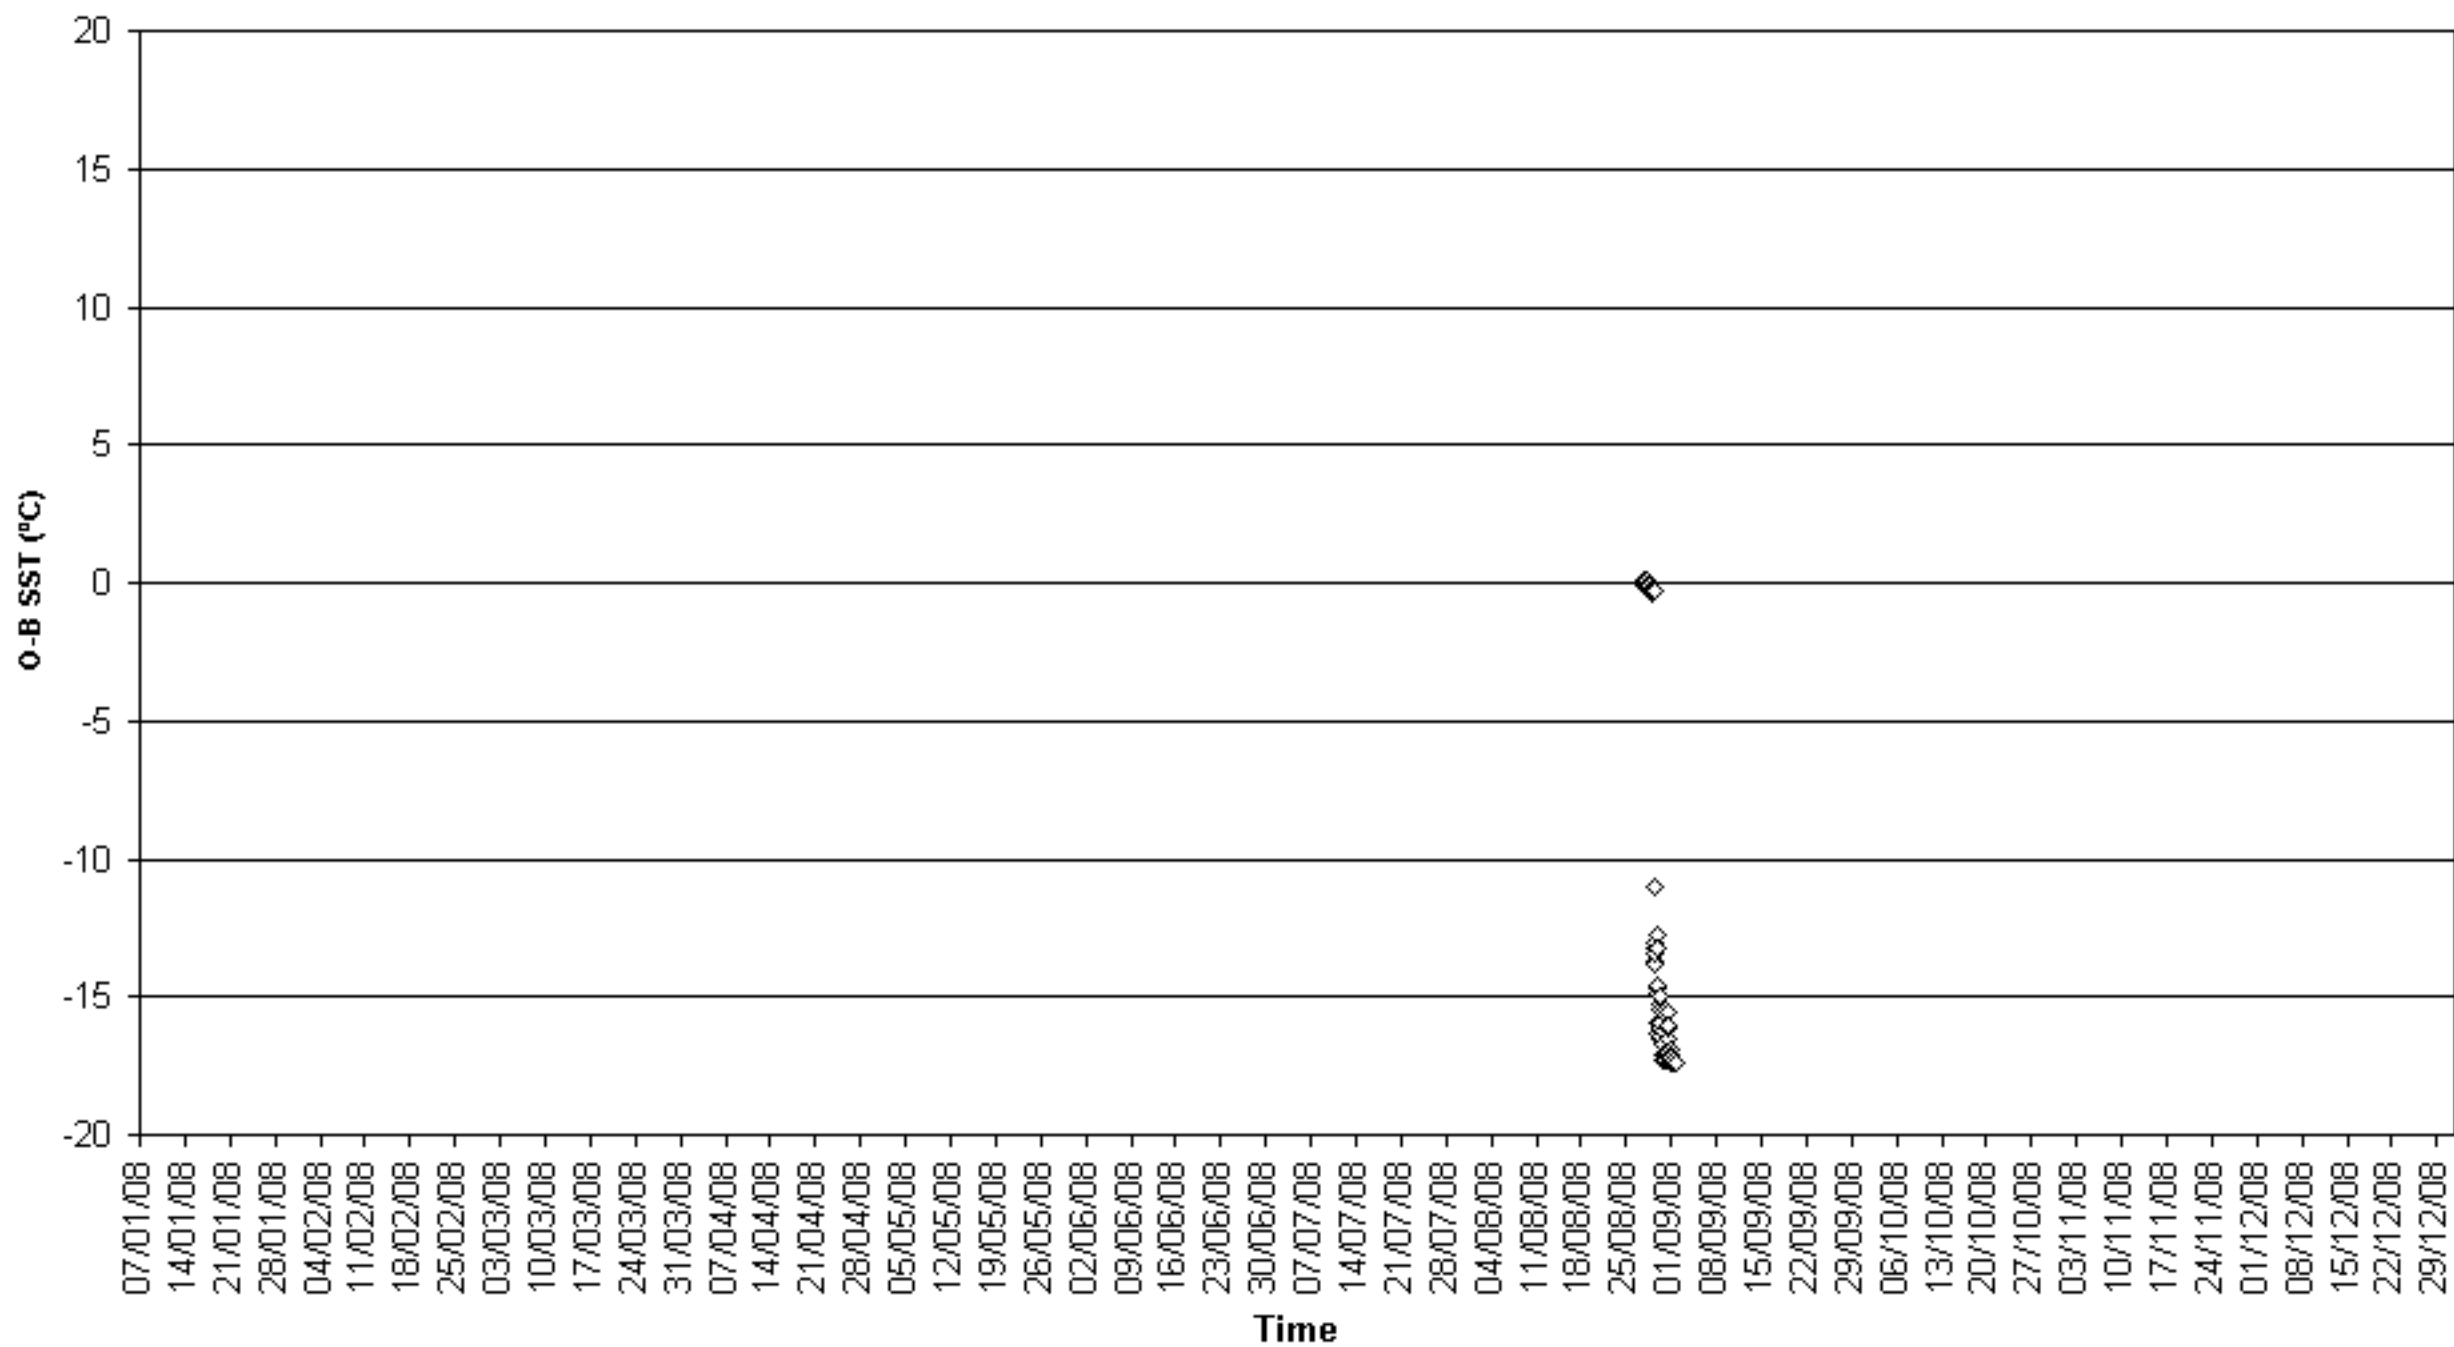


O-B SST (°C) for identifier 48521  
Number of obs. plotted = 0 Number of outliers = 126

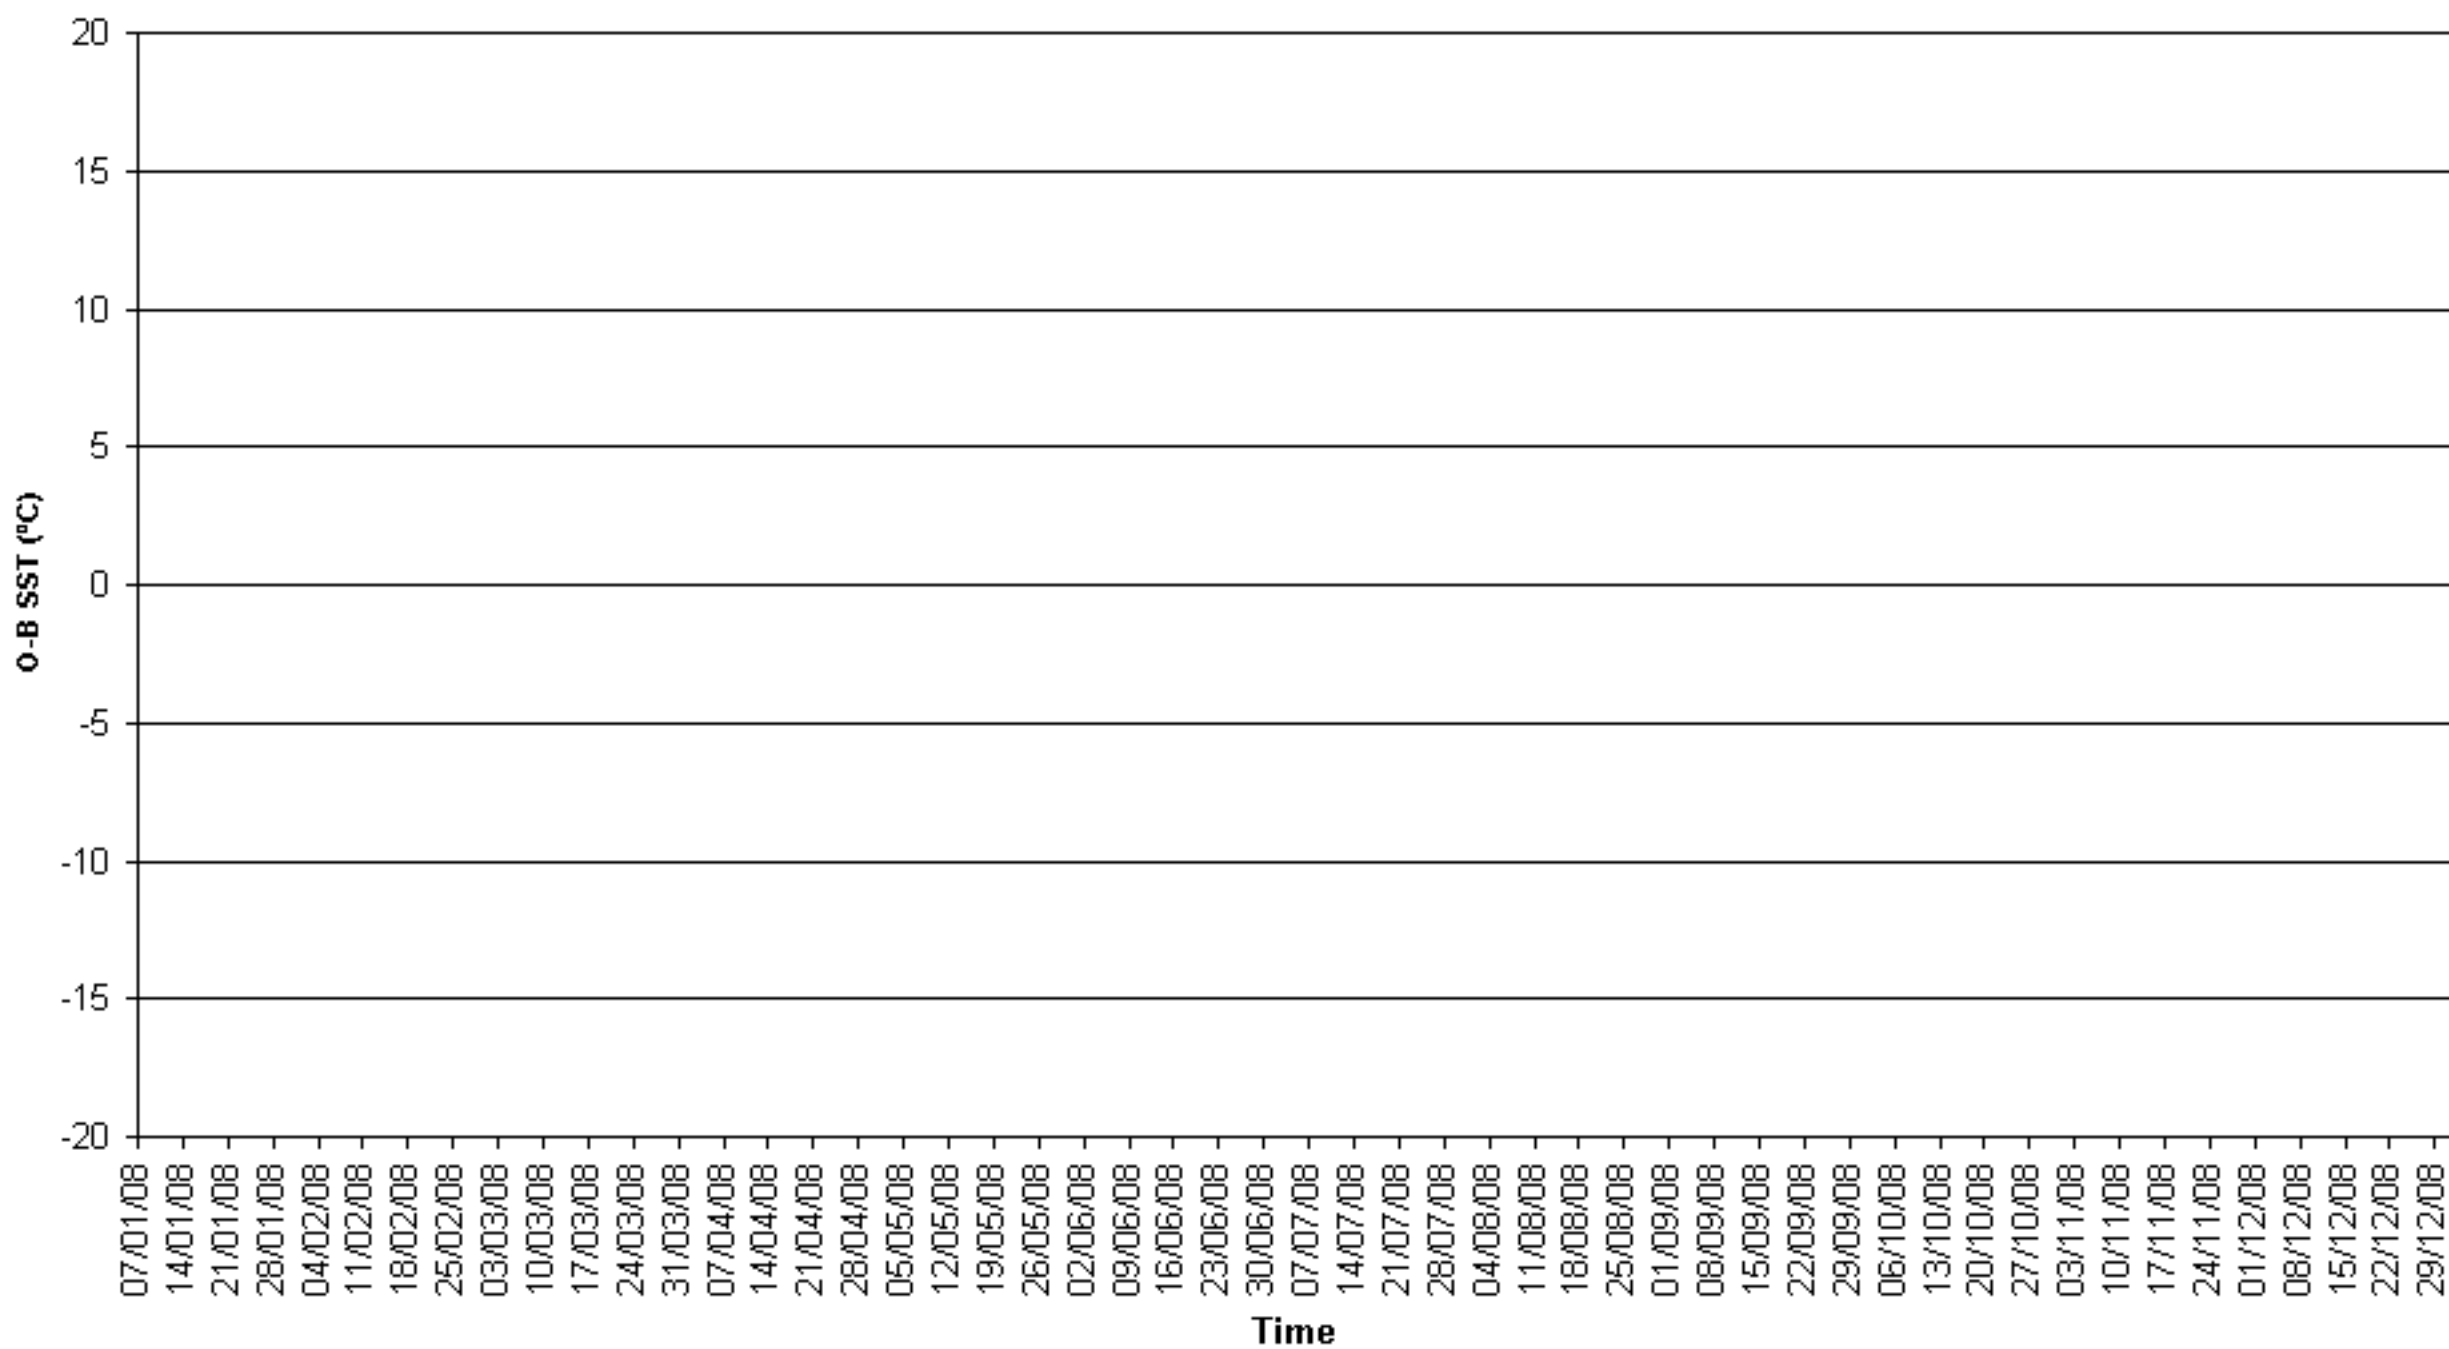

O-B SST (°C) for identifier 48525  
Number of obs. plotted = 0    Number of outliers = 96

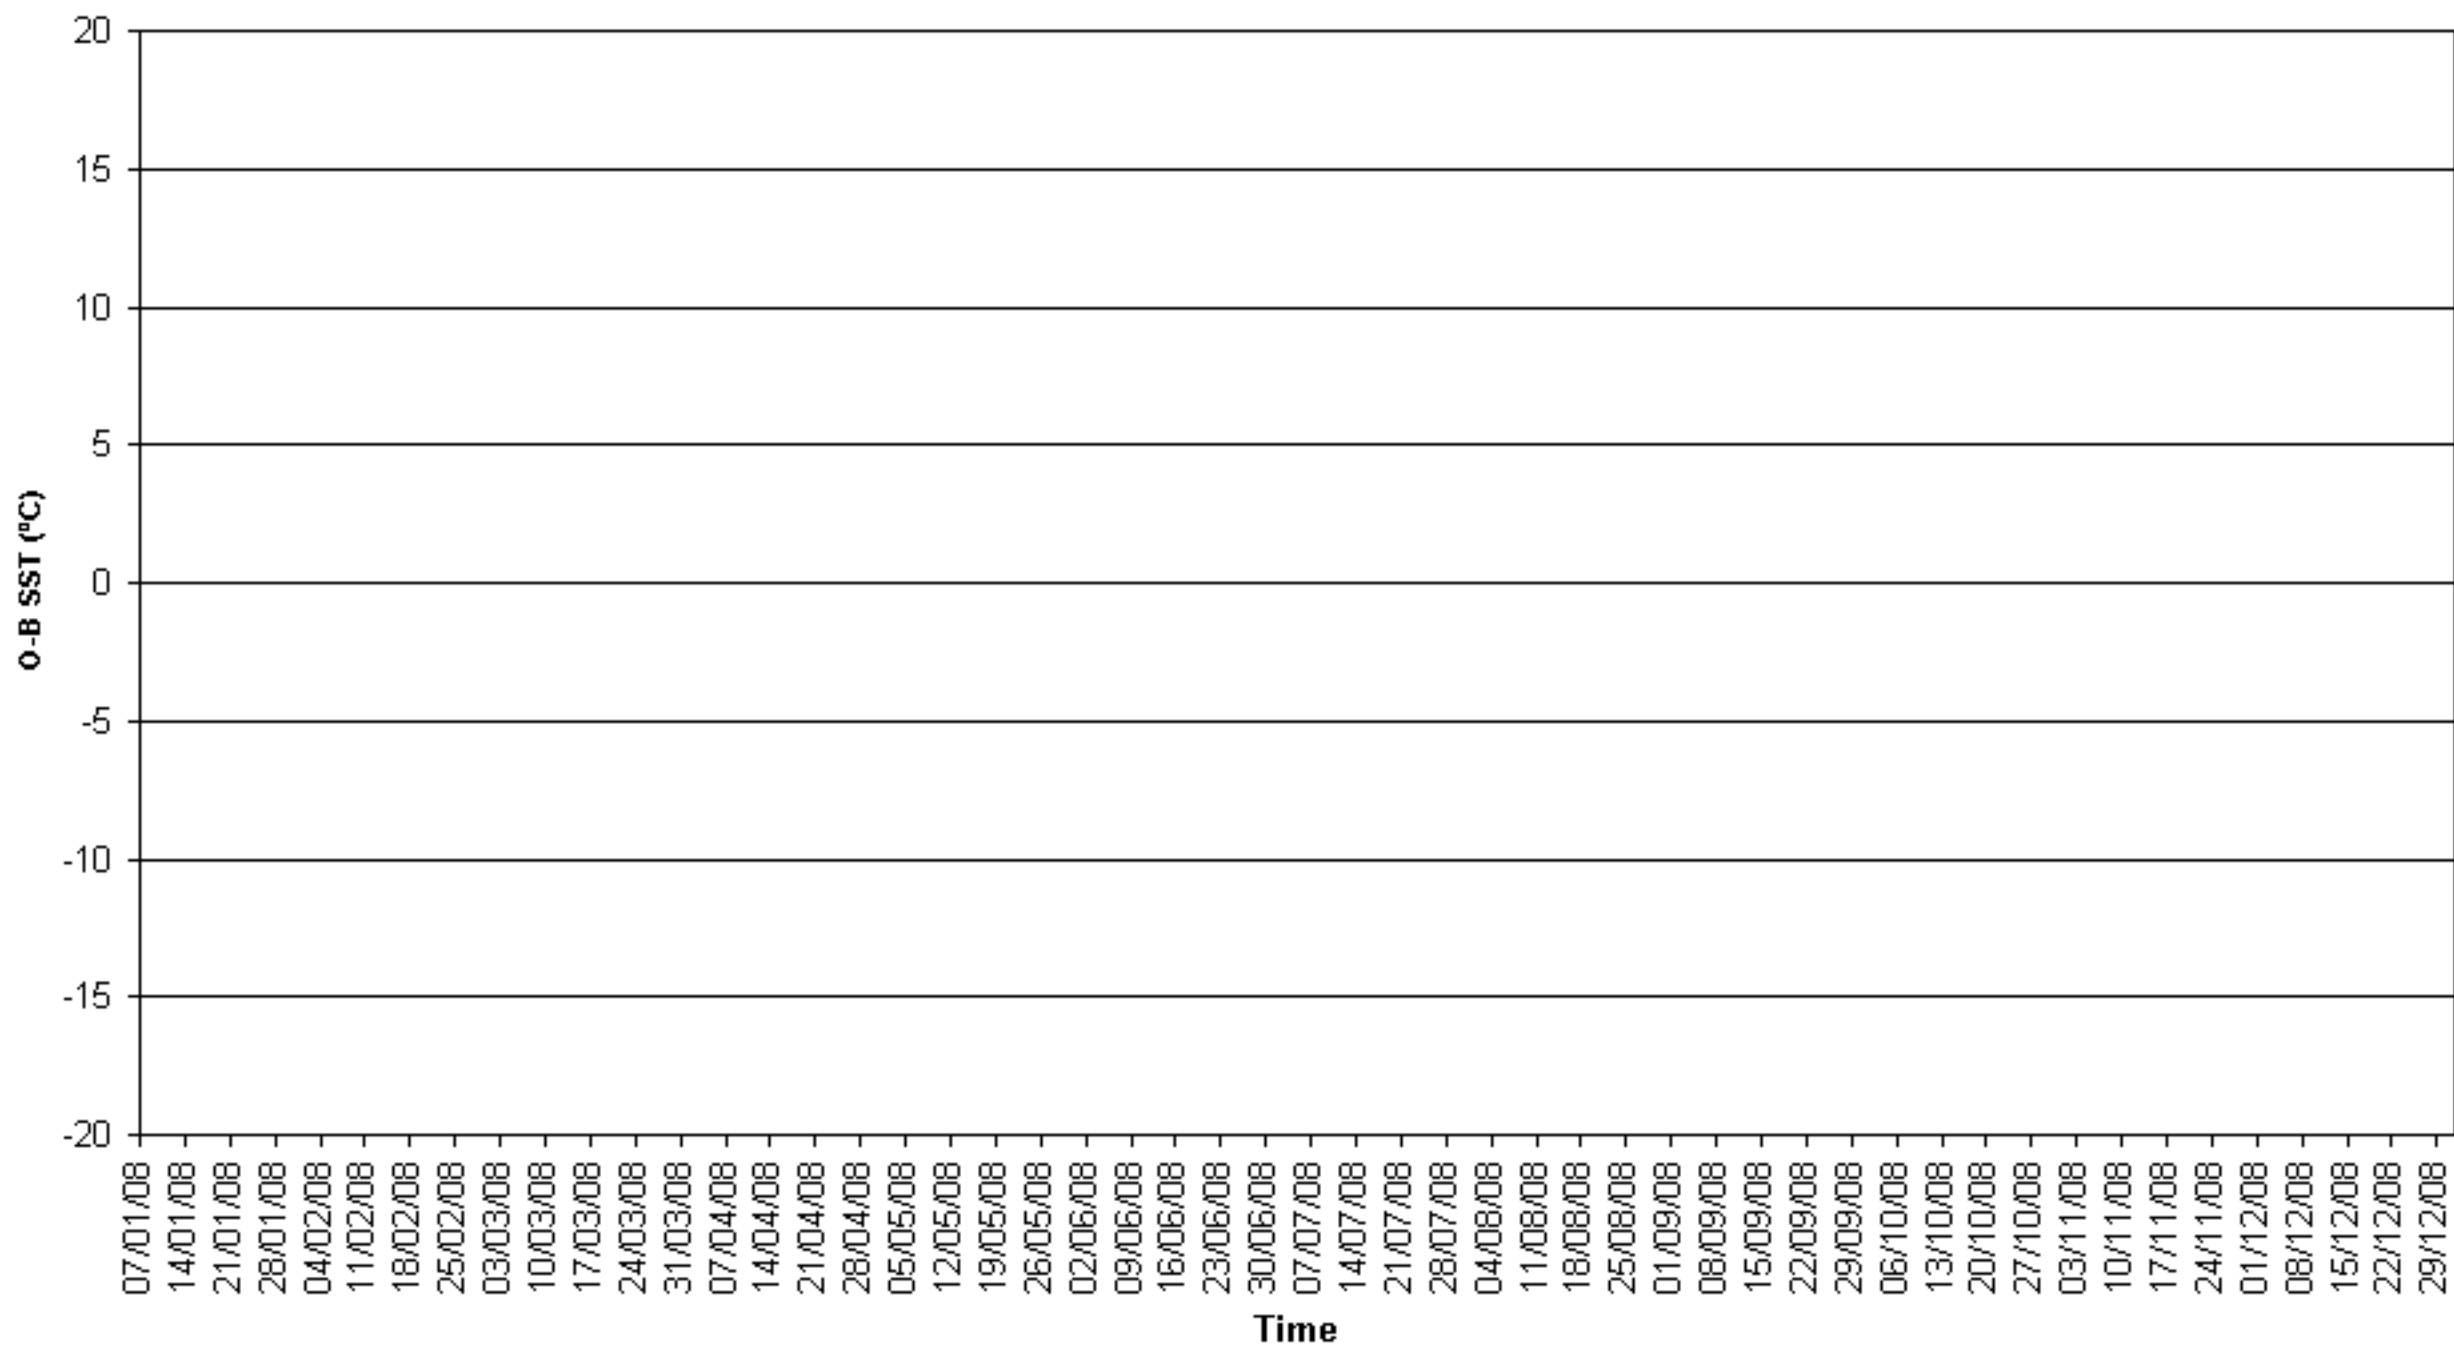


O-B SST (°C) for identifier 52664  
Number of obs. plotted = 710 Number of outliers = 43

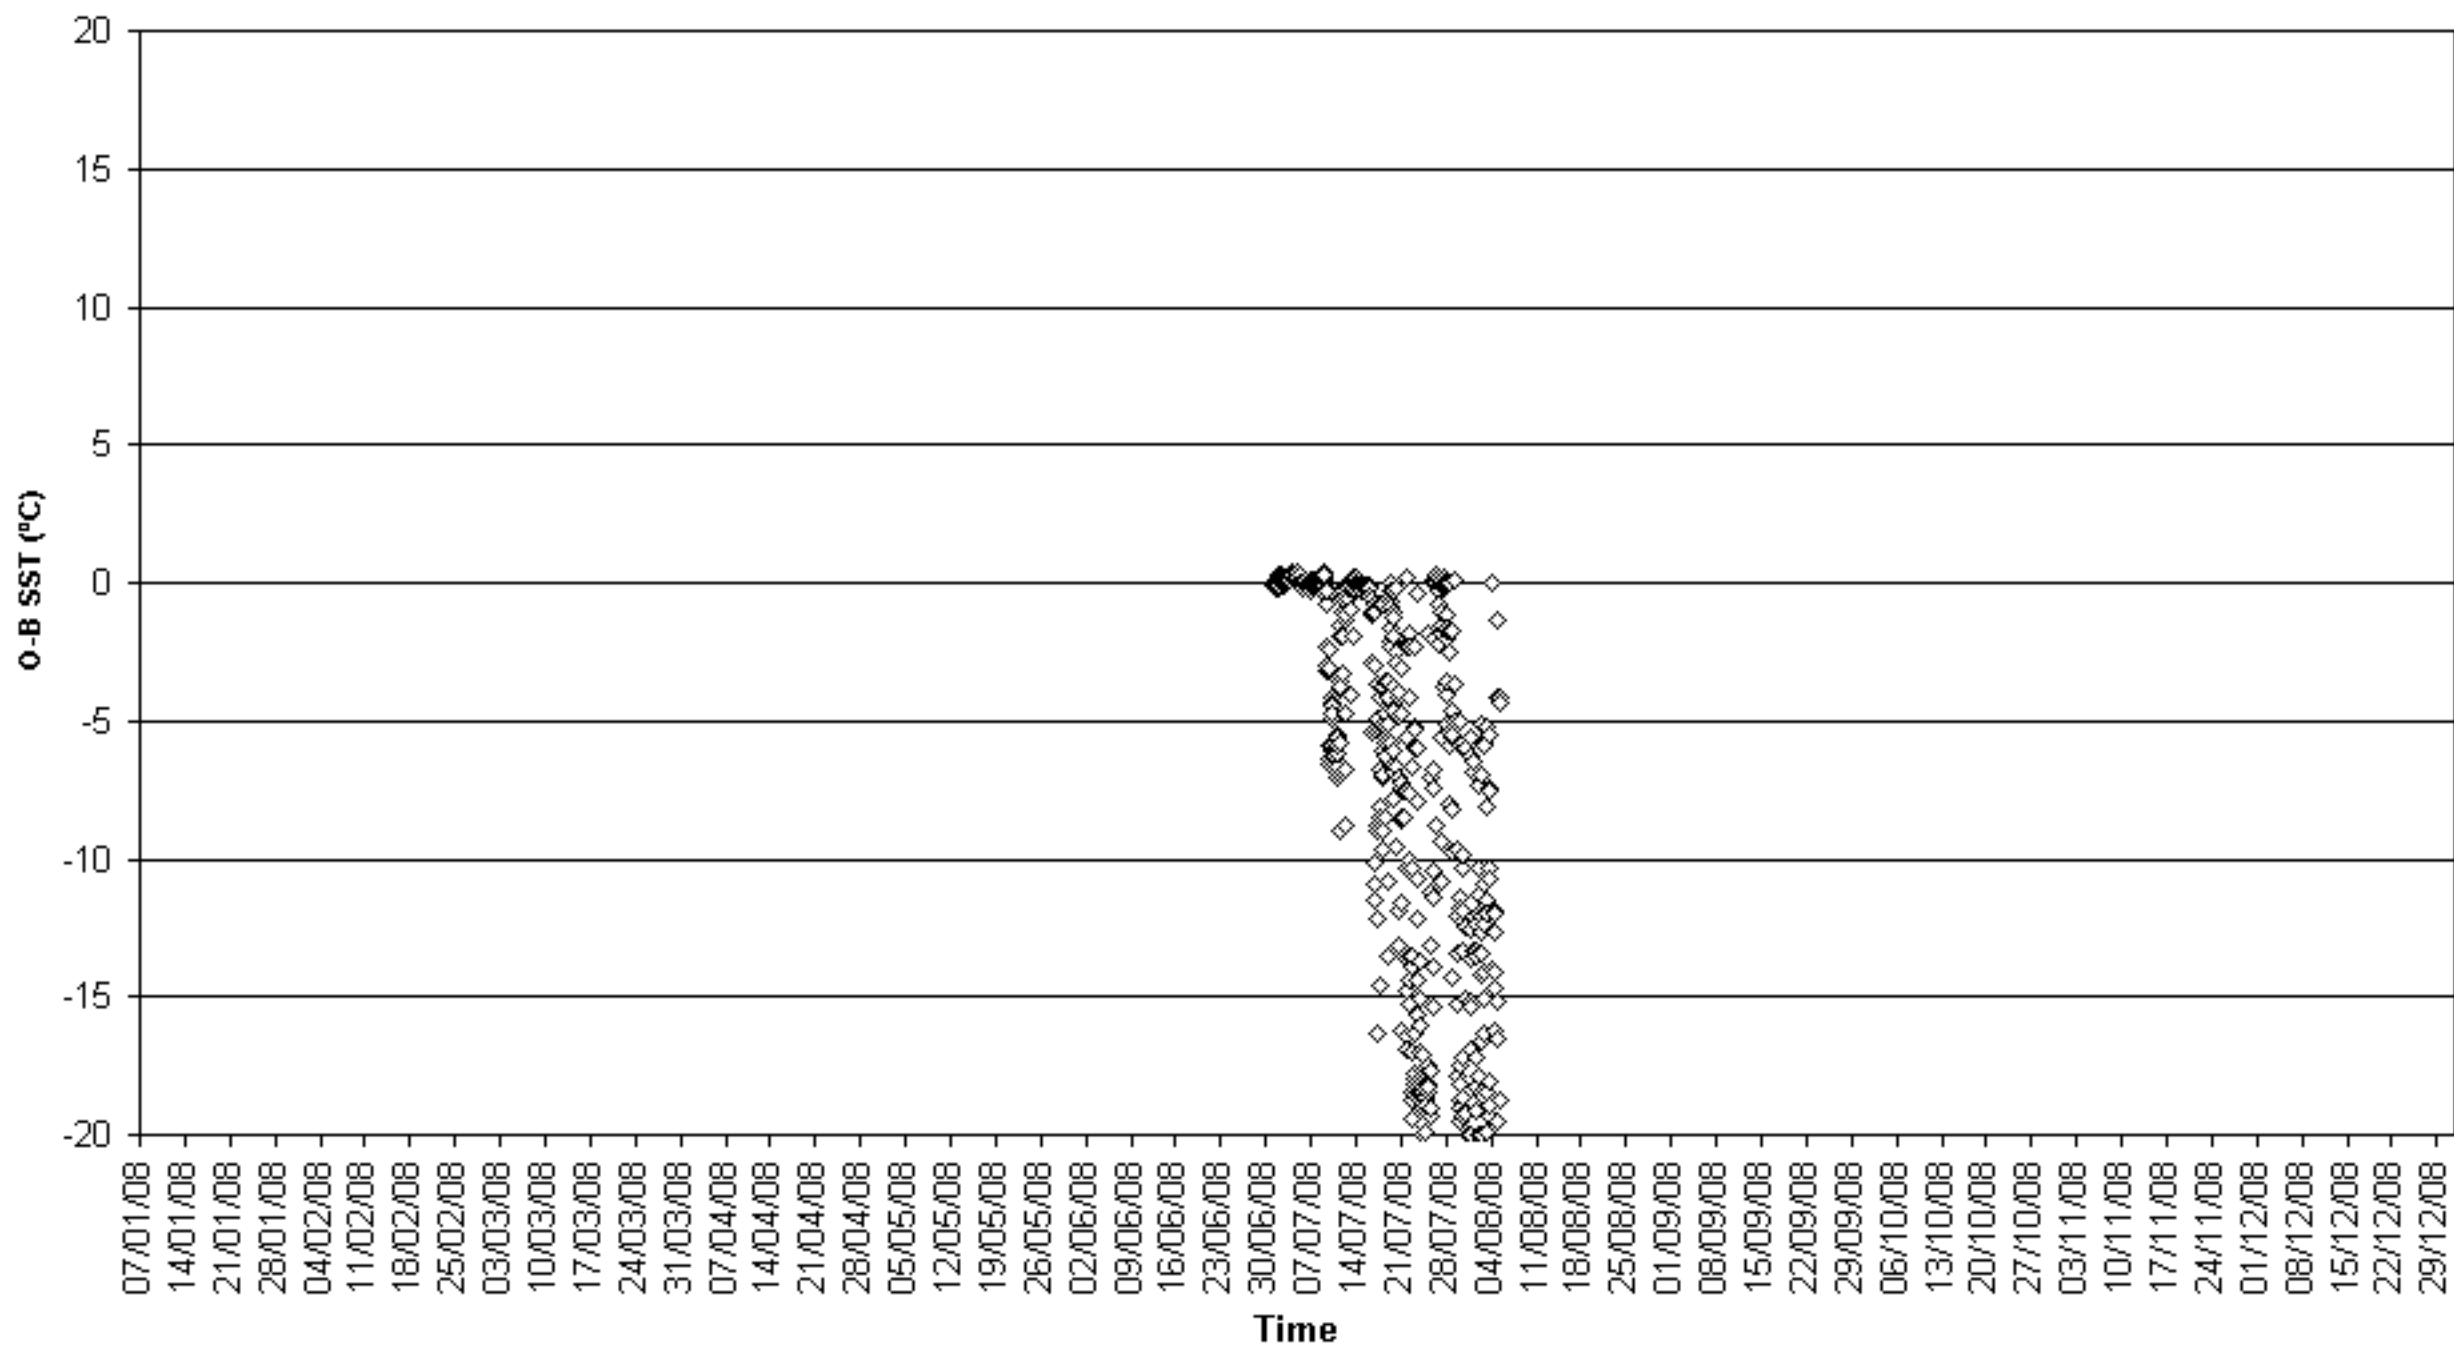





O-B SST (°C) for identifier 56528  
Number of obs. plotted = 52 Number of outliers = 0

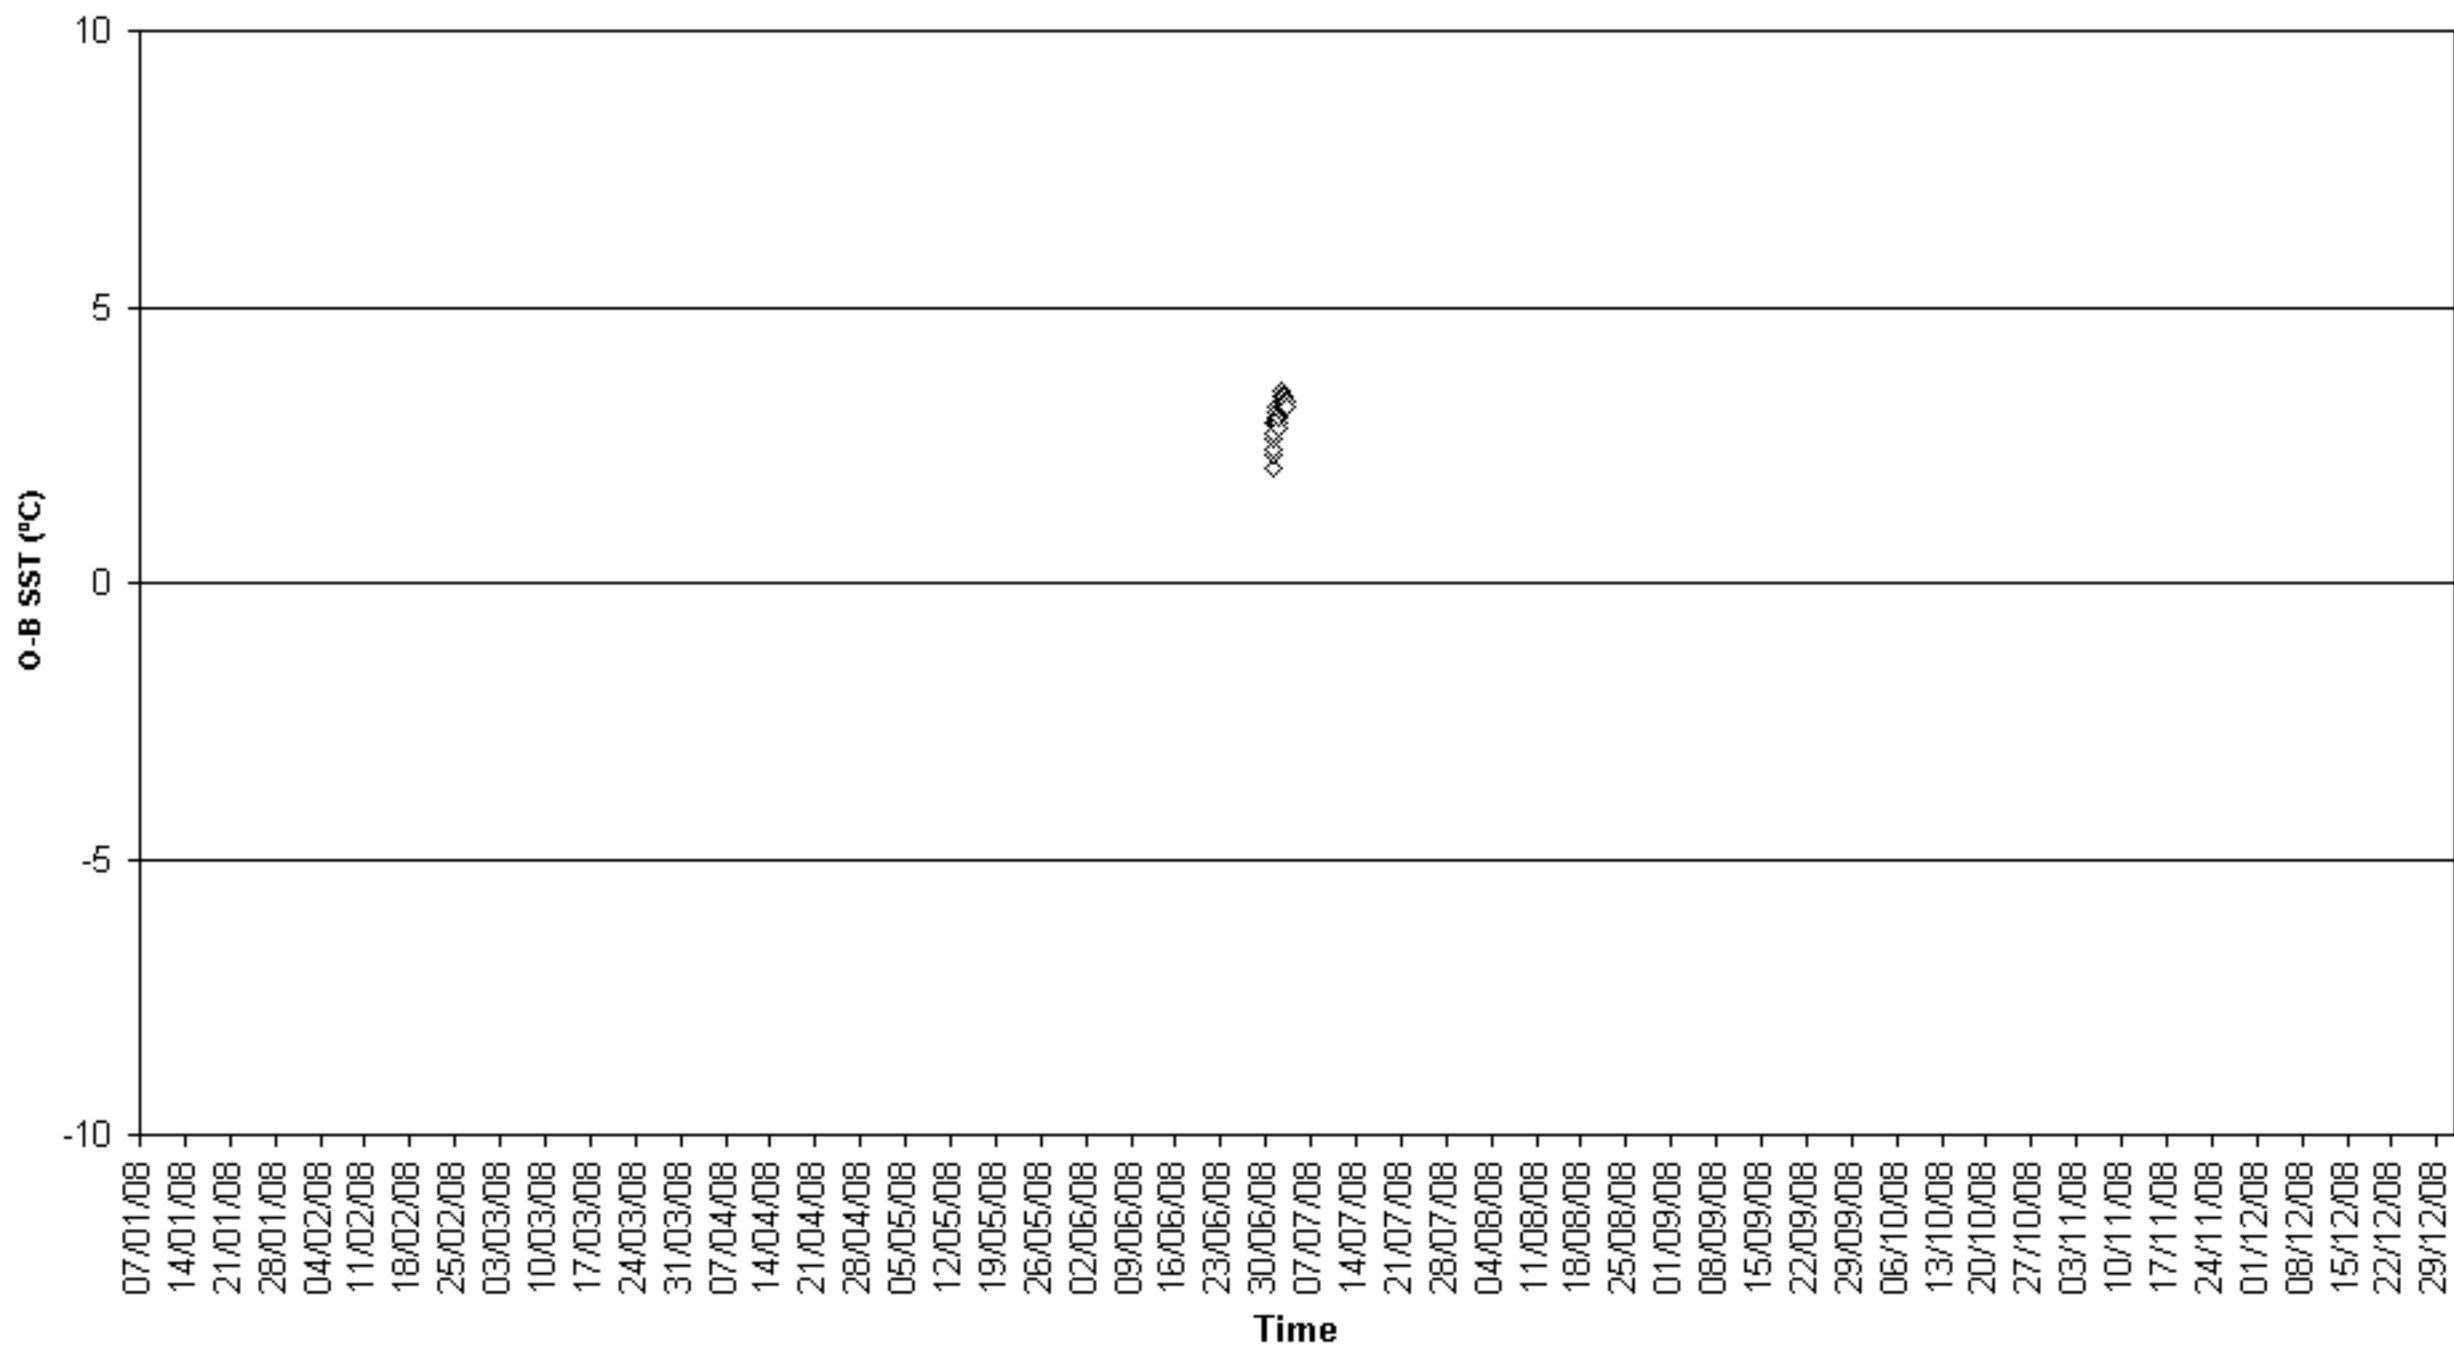


O-B SST (°C) for identifier 63529  
Number of obs. plotted = 11737 Number of outliers = 75

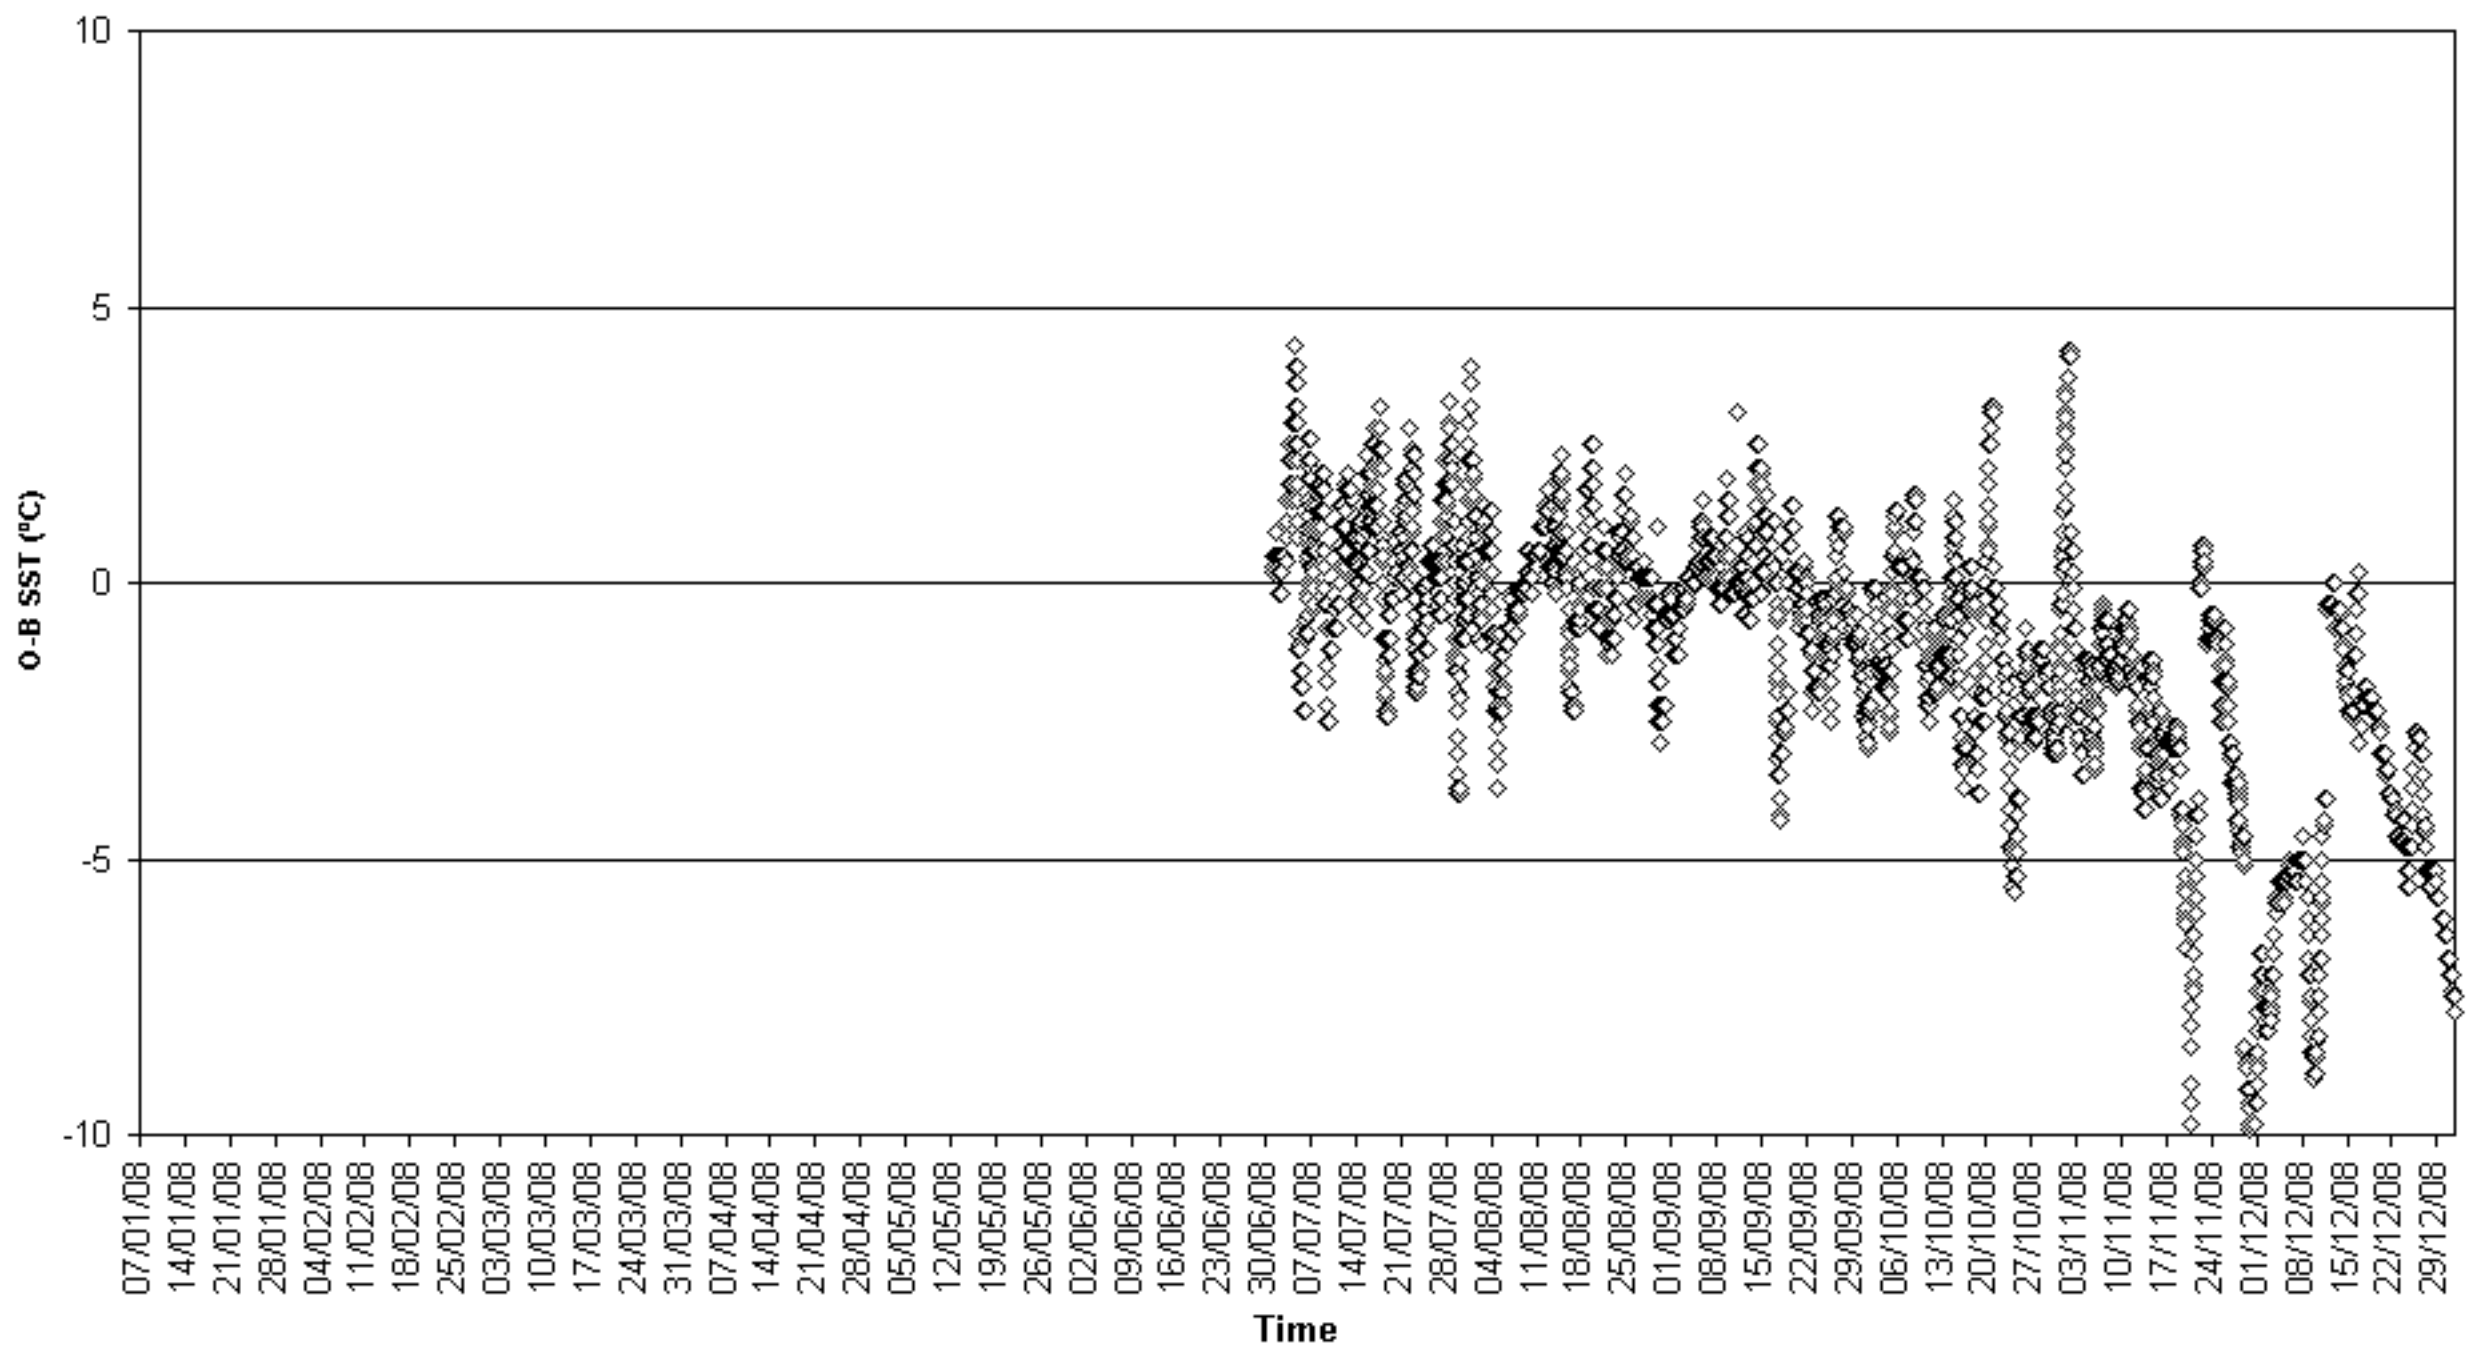


O-B SST (°C) for identifier 63990  
Number of obs. plotted = 4442 Number of outliers = 2

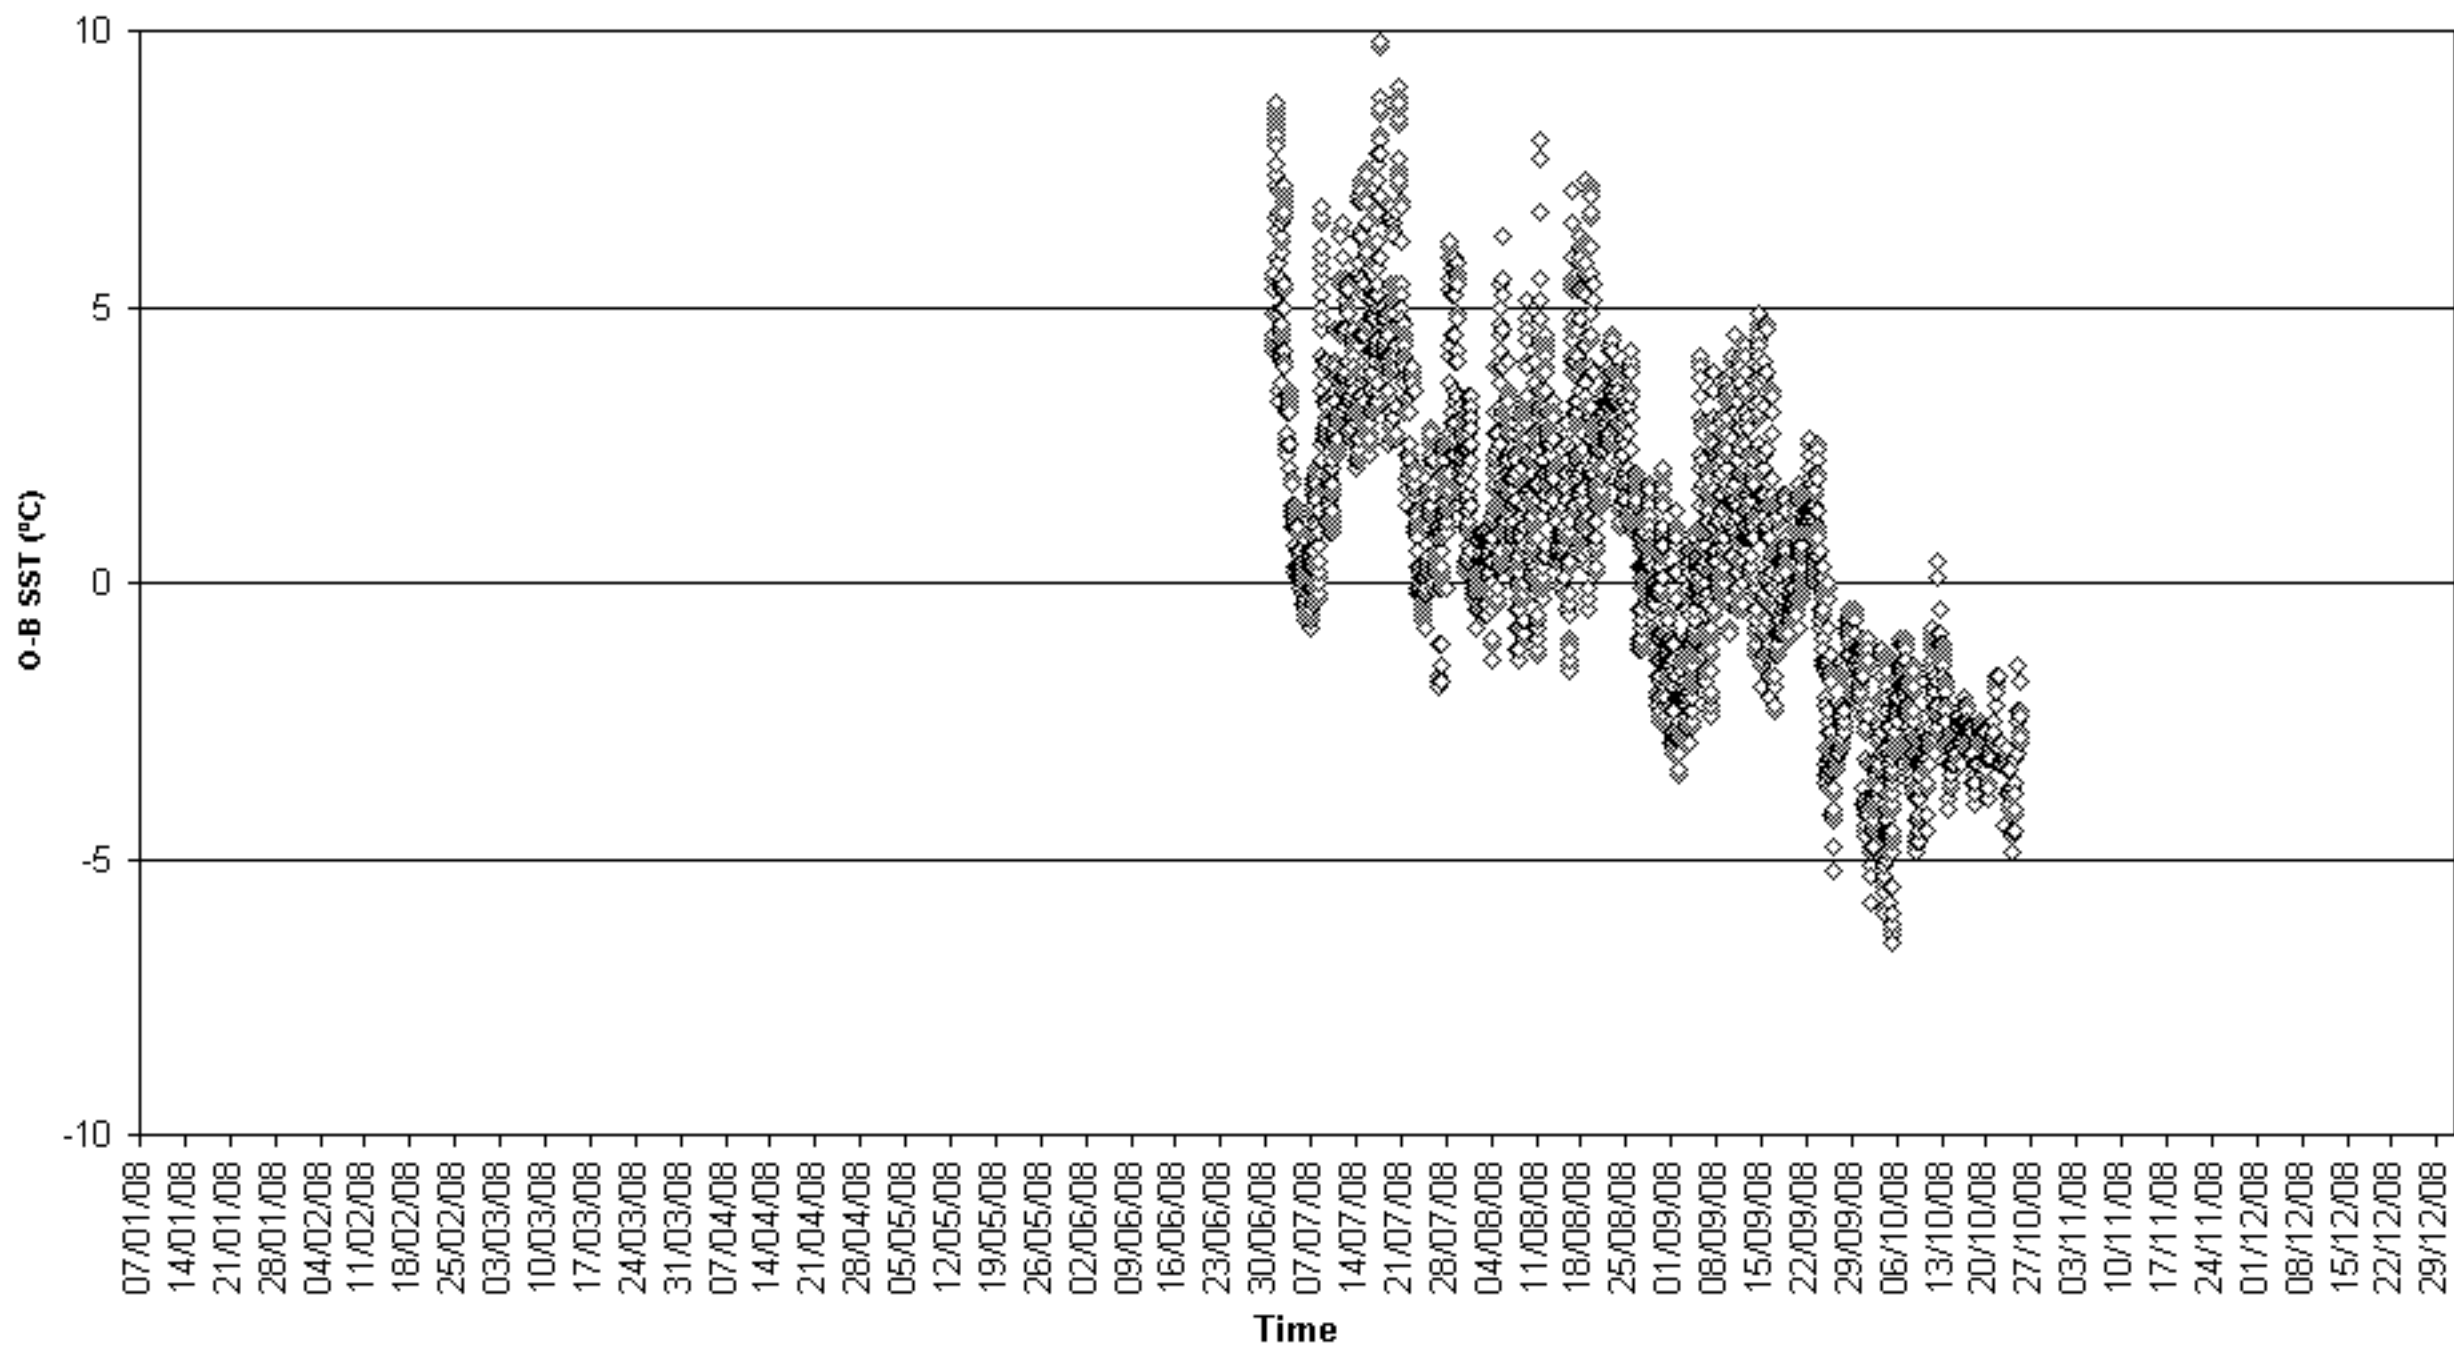


O-B SST (°C) for identifier 9HJB9  
Number of obs. plotted = 269 Number of outliers = 142

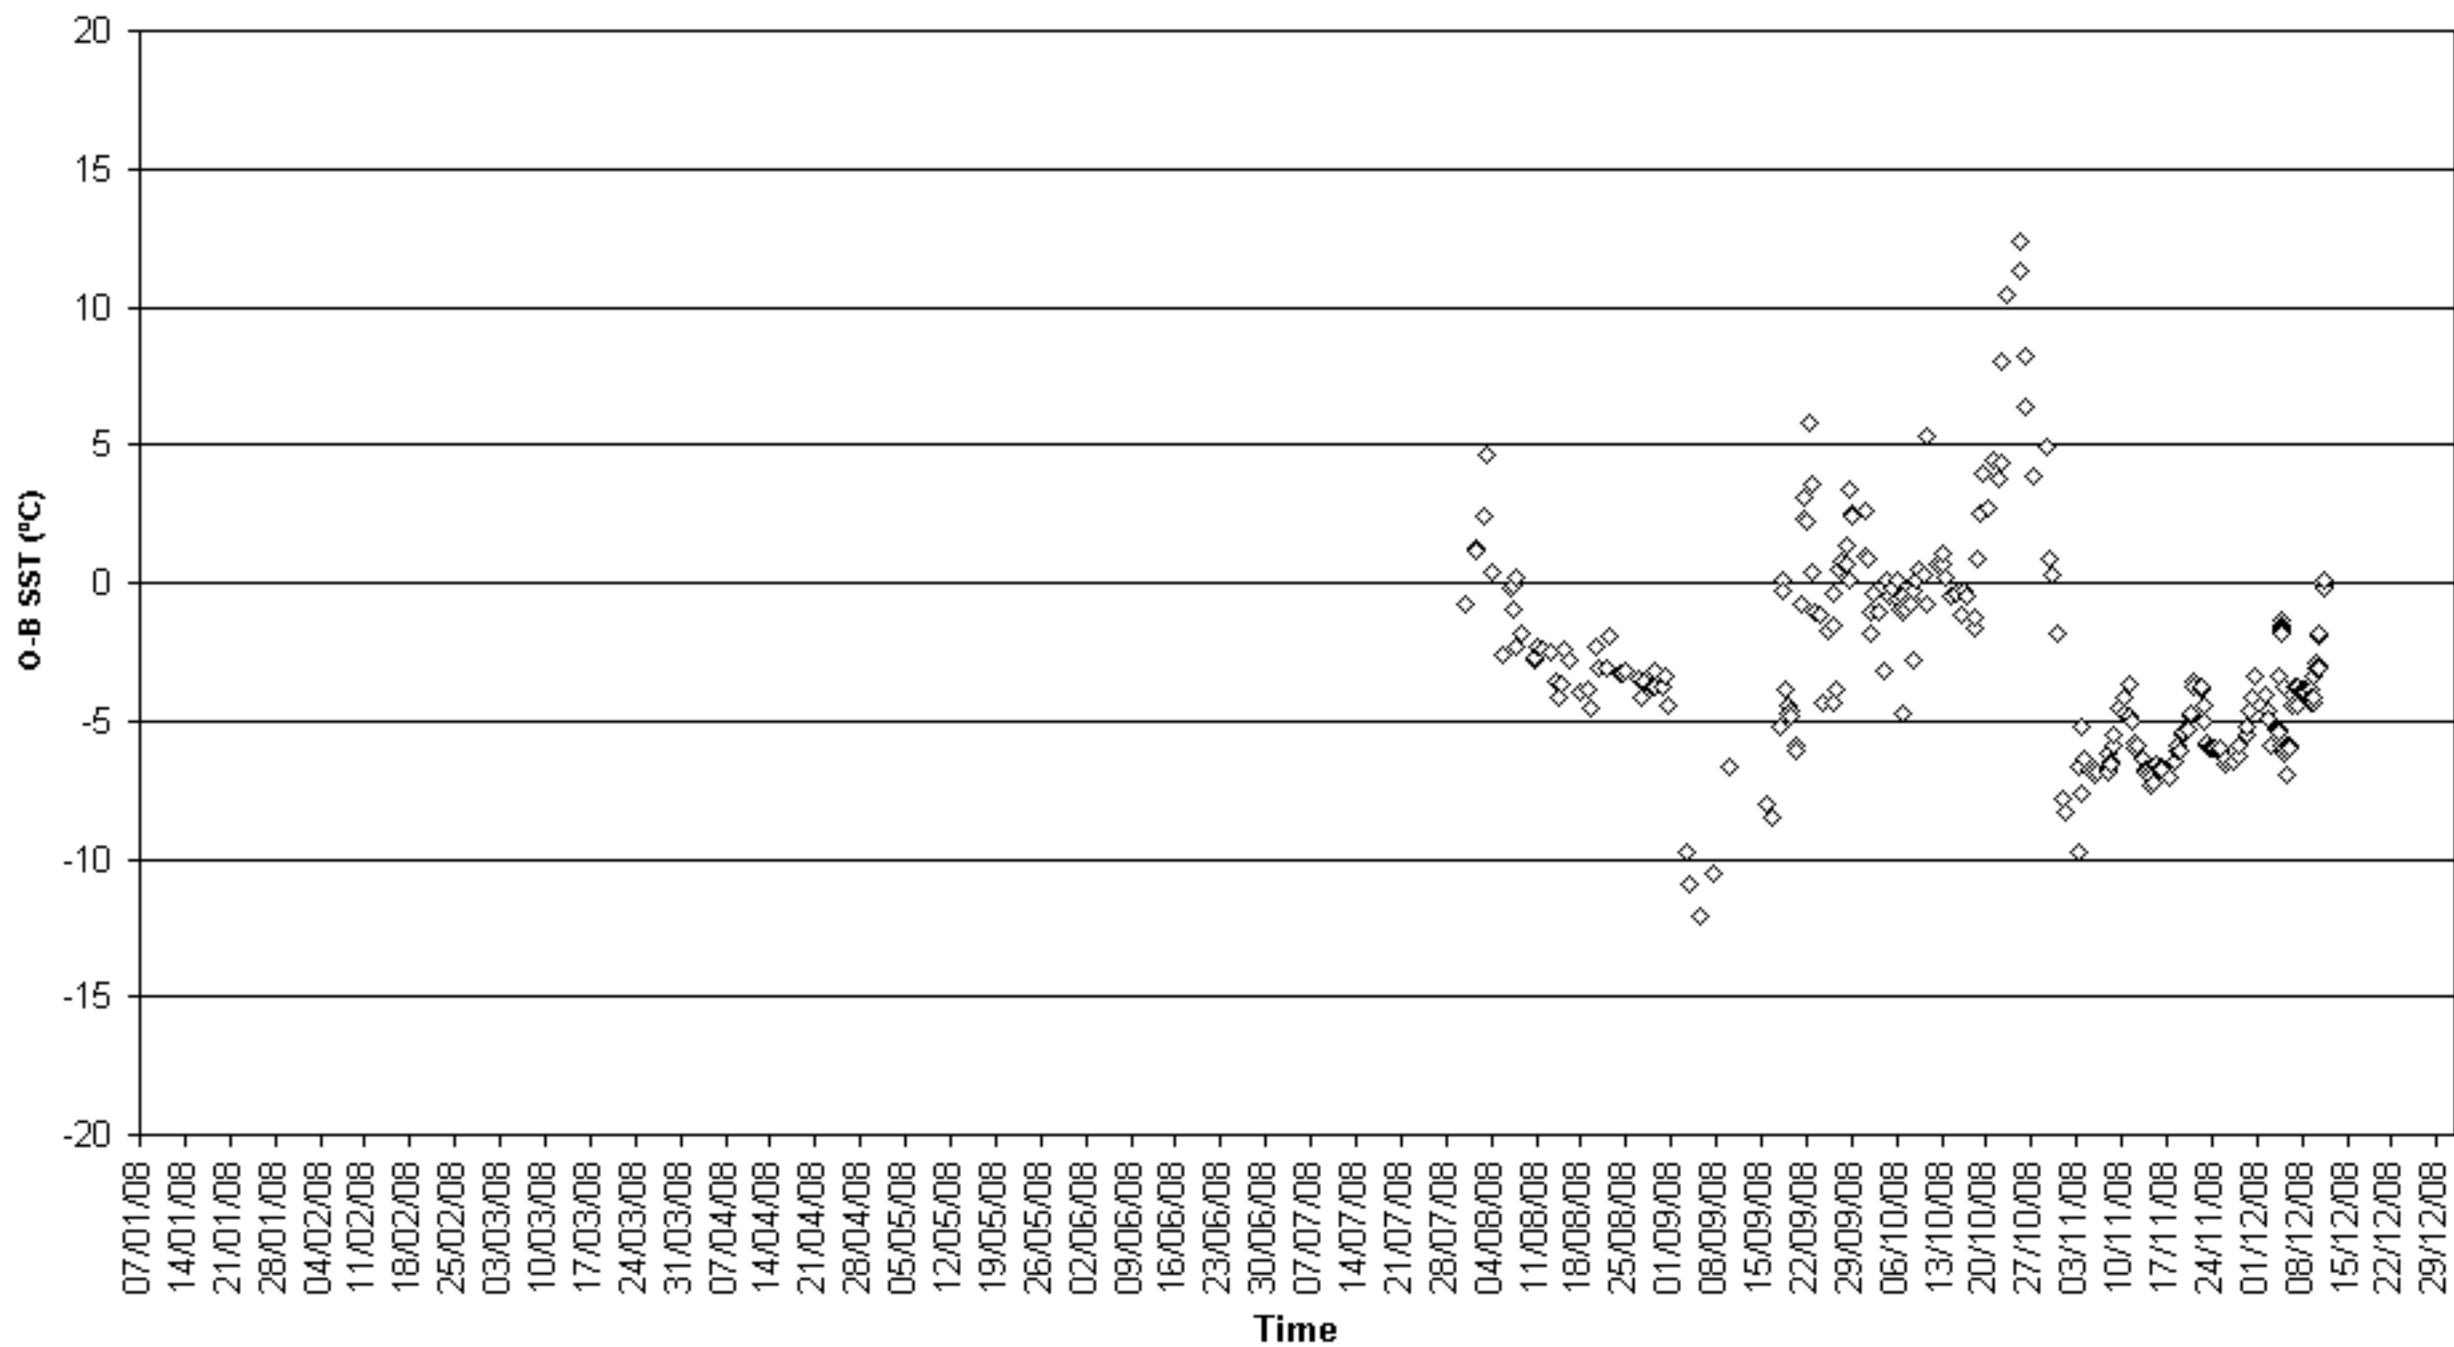


O-B SST (°C) for identifier 9VEN5  
Number of obs. plotted = 216 Number of outliers = 0

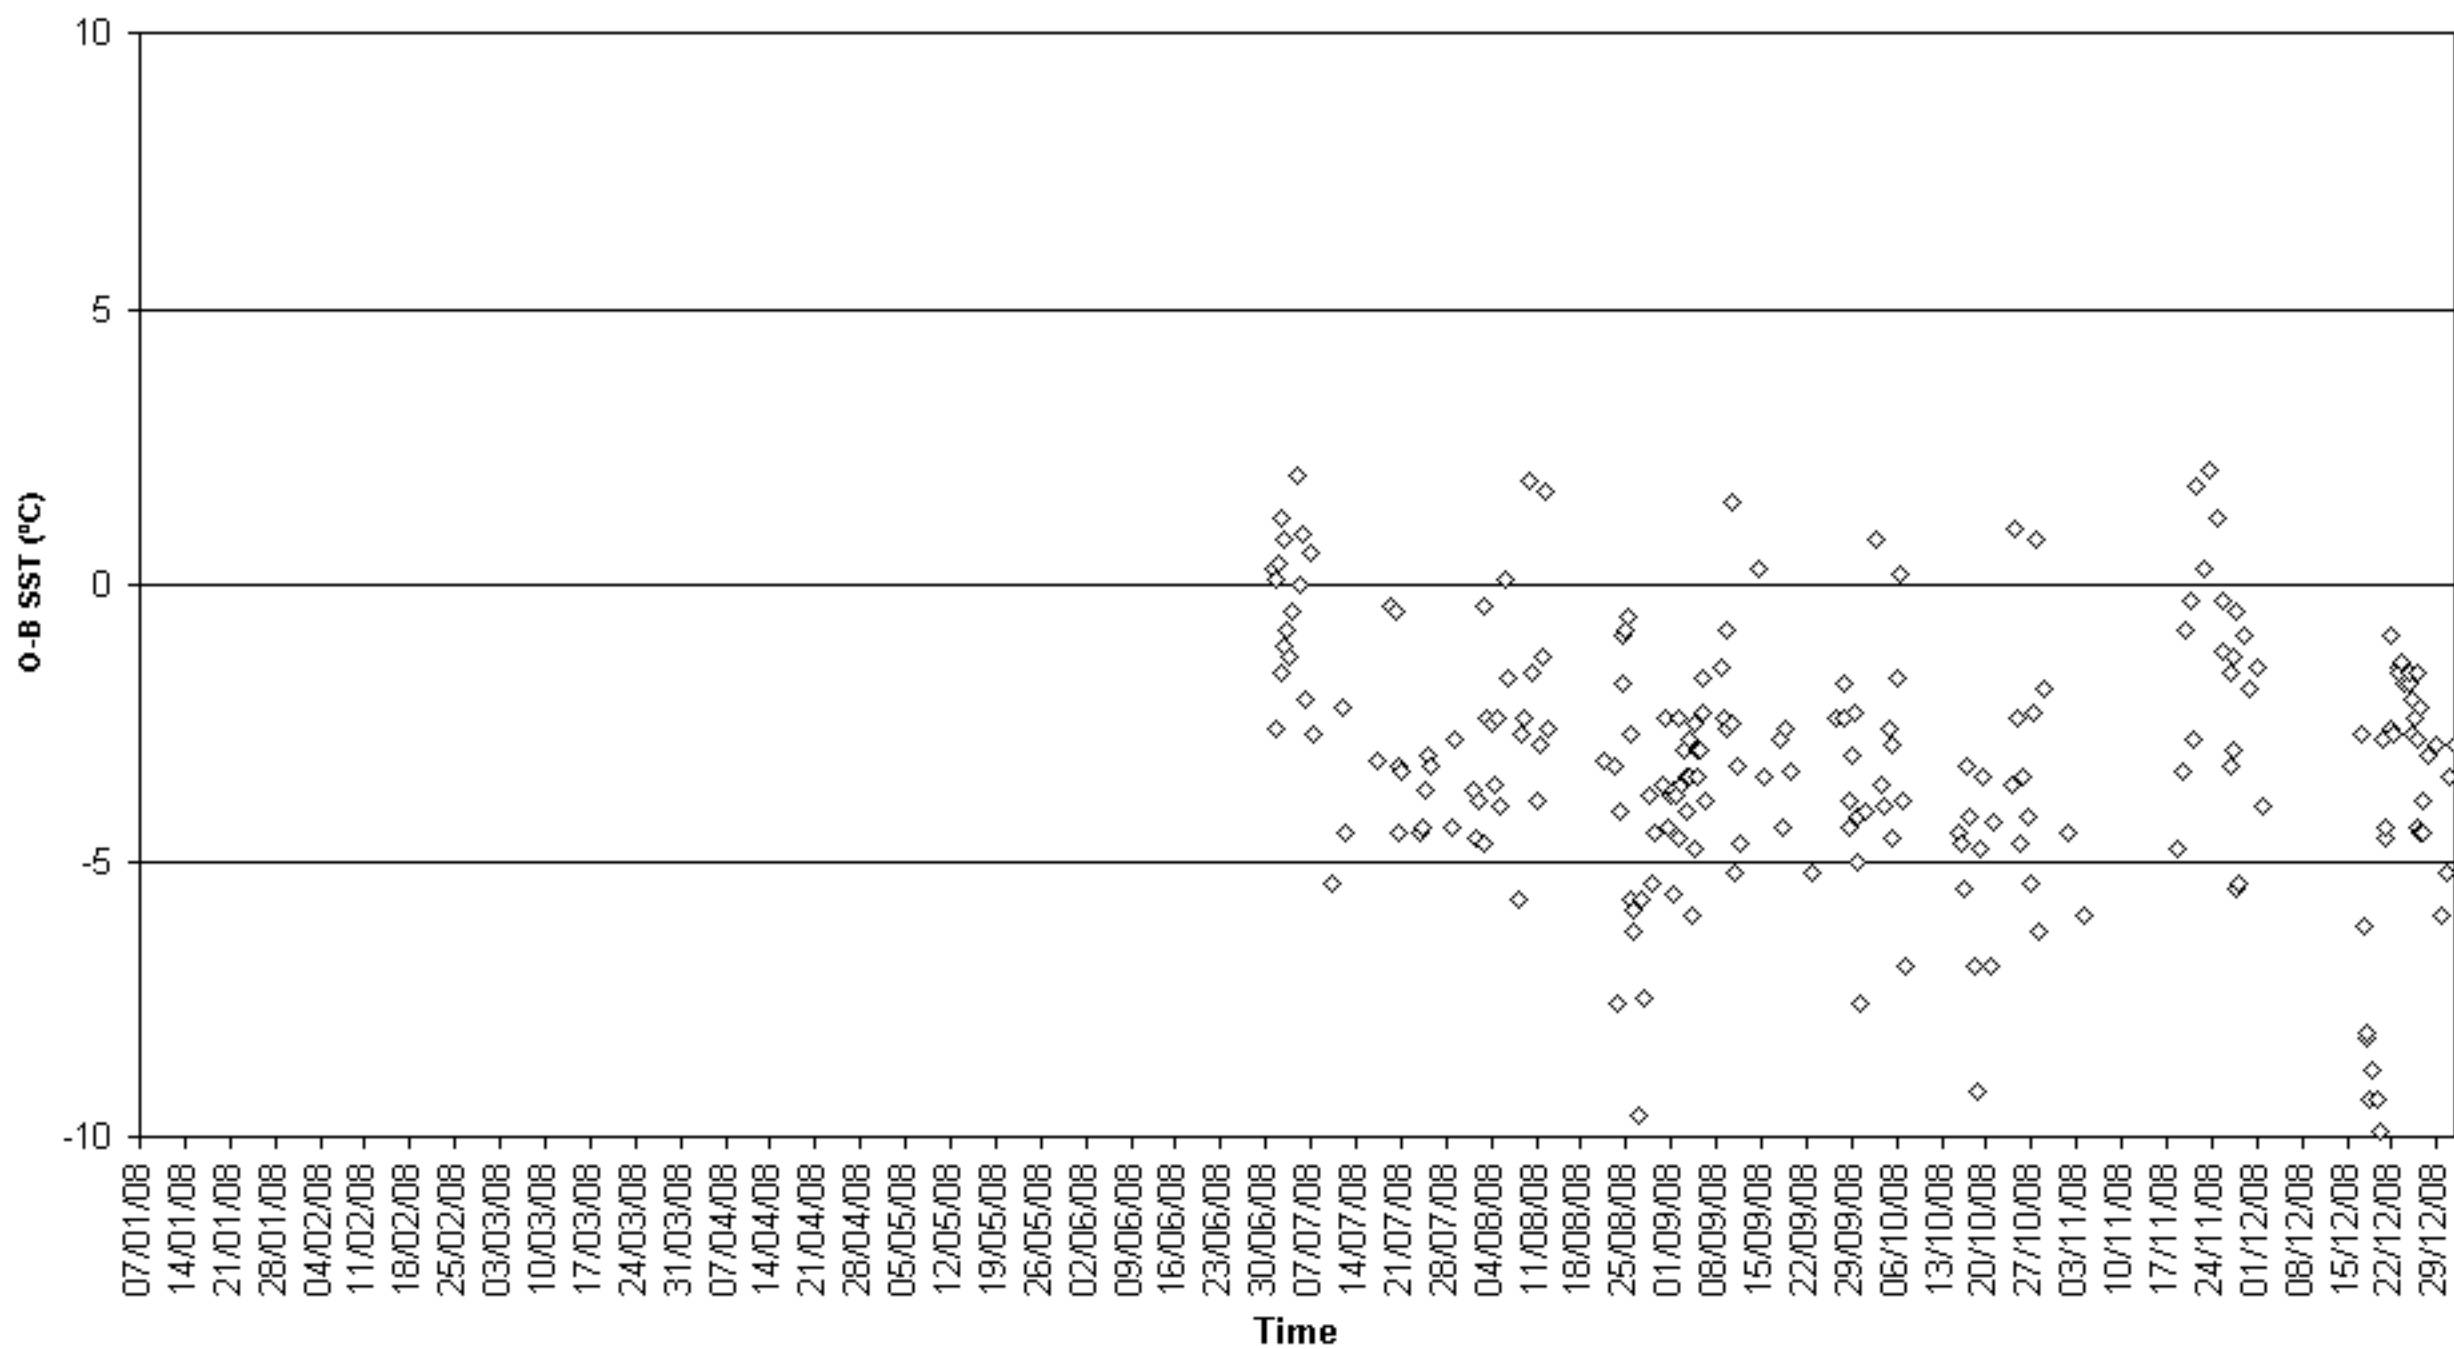


O-B SST (°C) for identifier A8K03  
Number of obs. plotted = 99 Number of outliers = 0

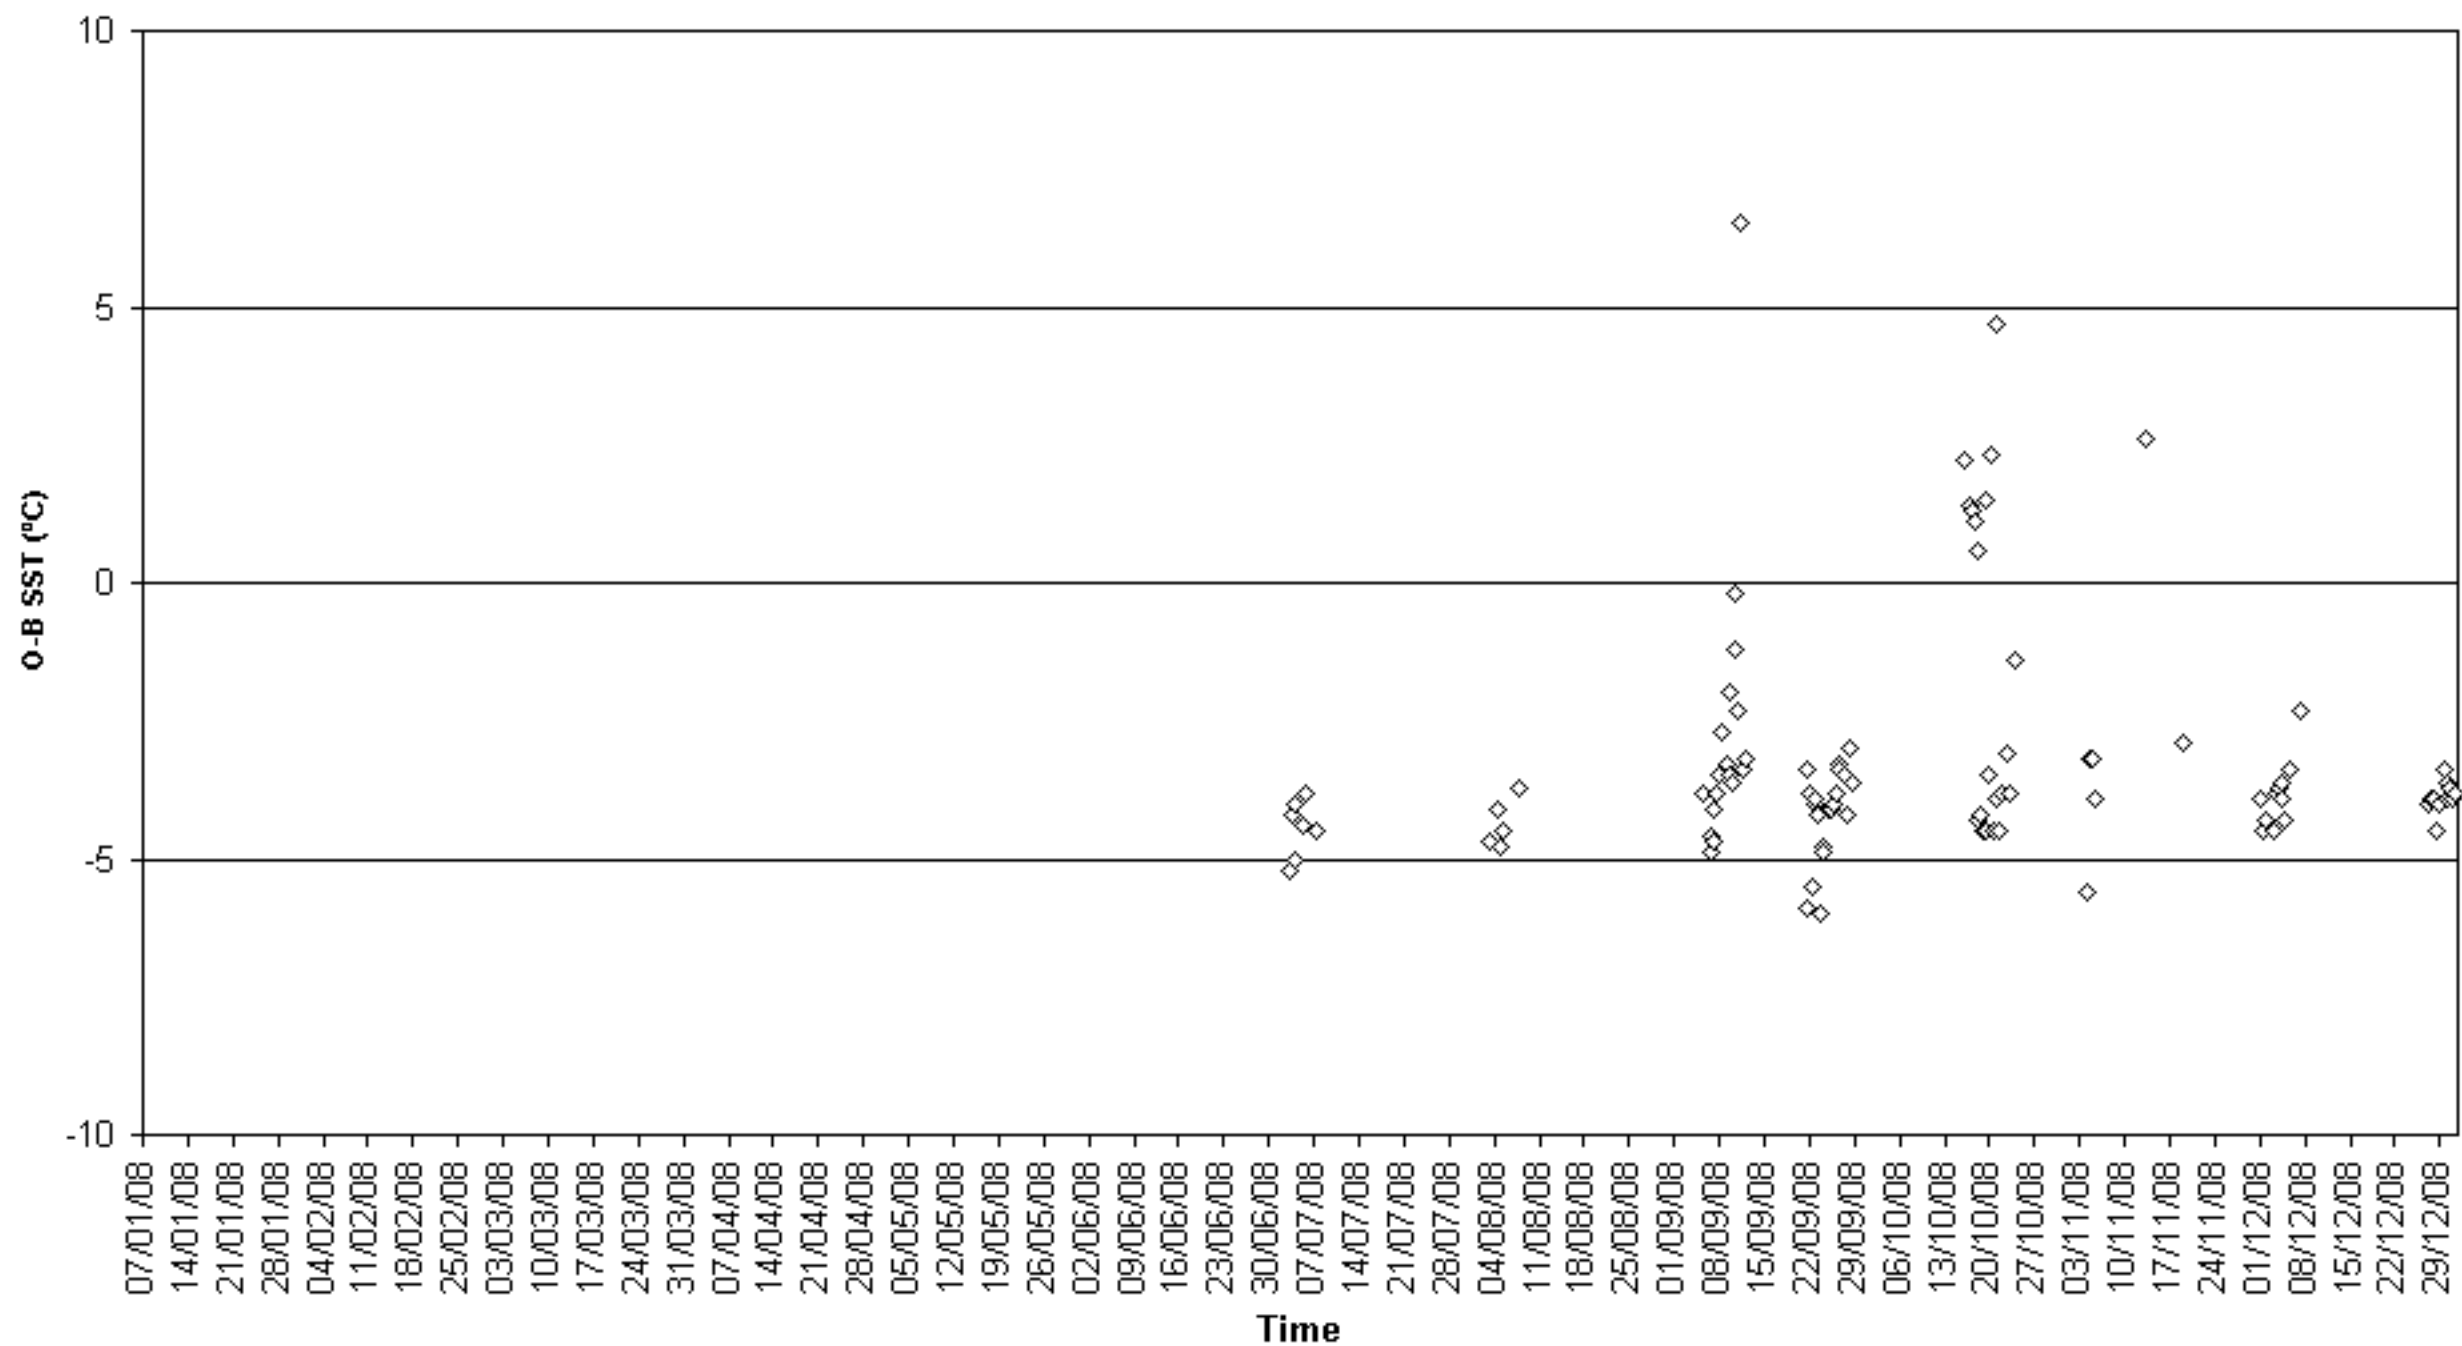

**O-B SST (°C) for identifier BATFR11**  
**Number of obs. plotted = 78    Number of outliers = 3**

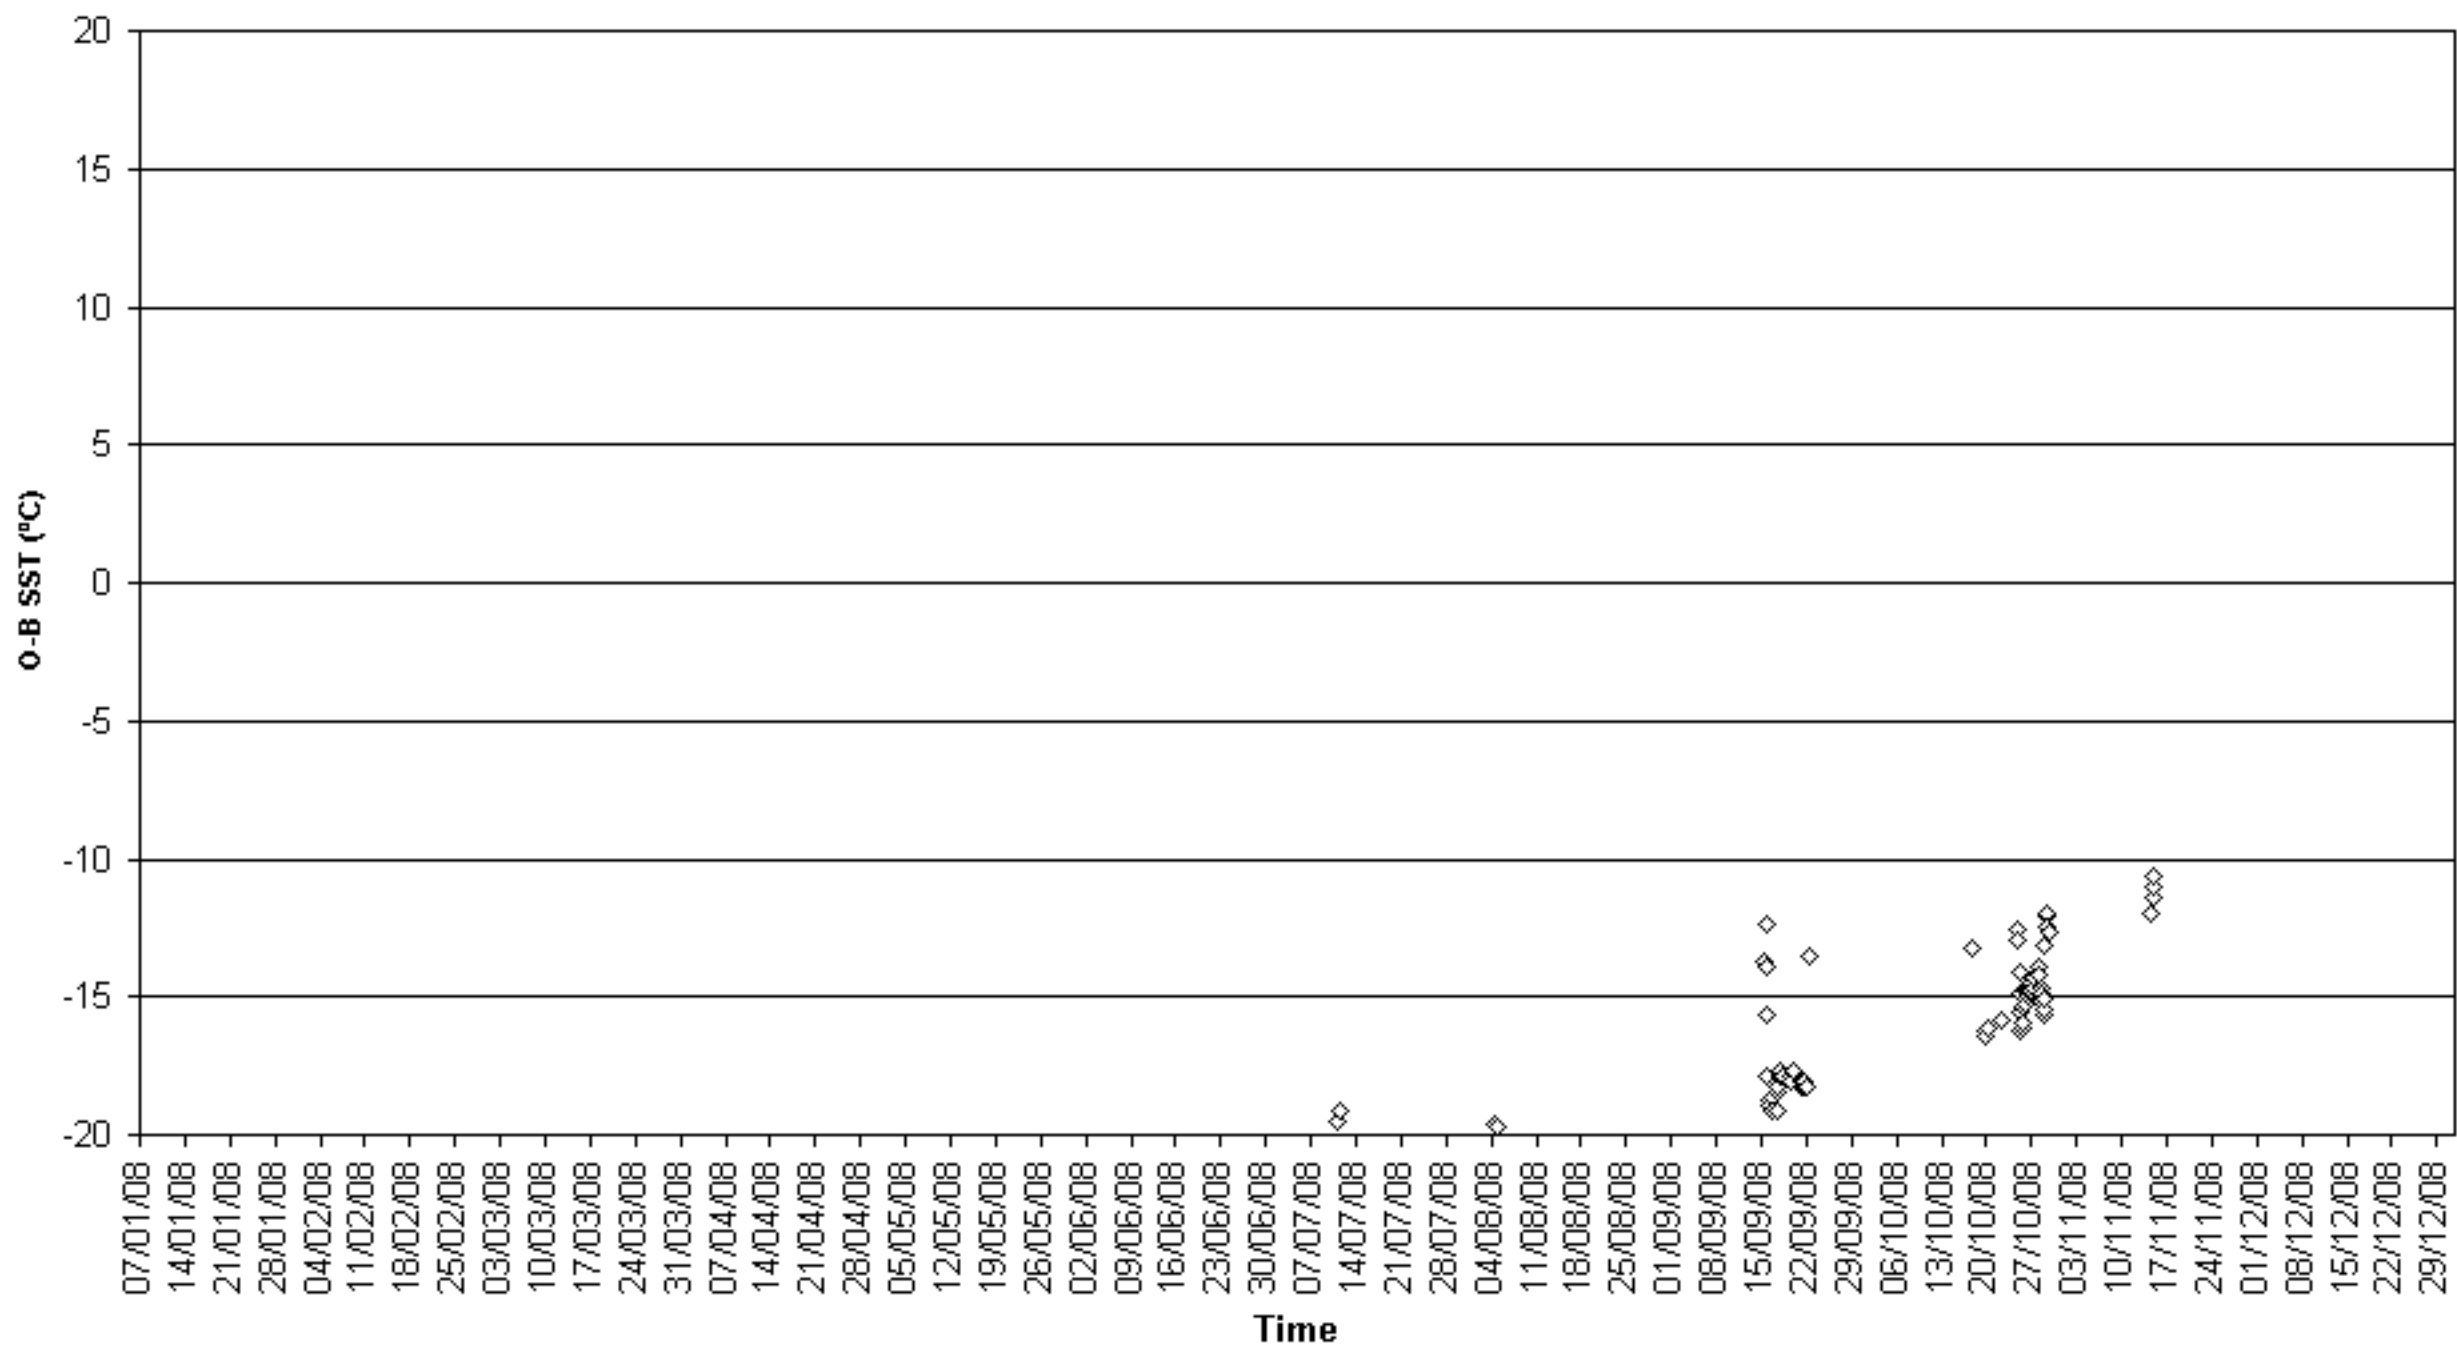


O-B SST (°C) for identifier BATFR46  
Number of obs. plotted = 1638 Number of outliers = 116

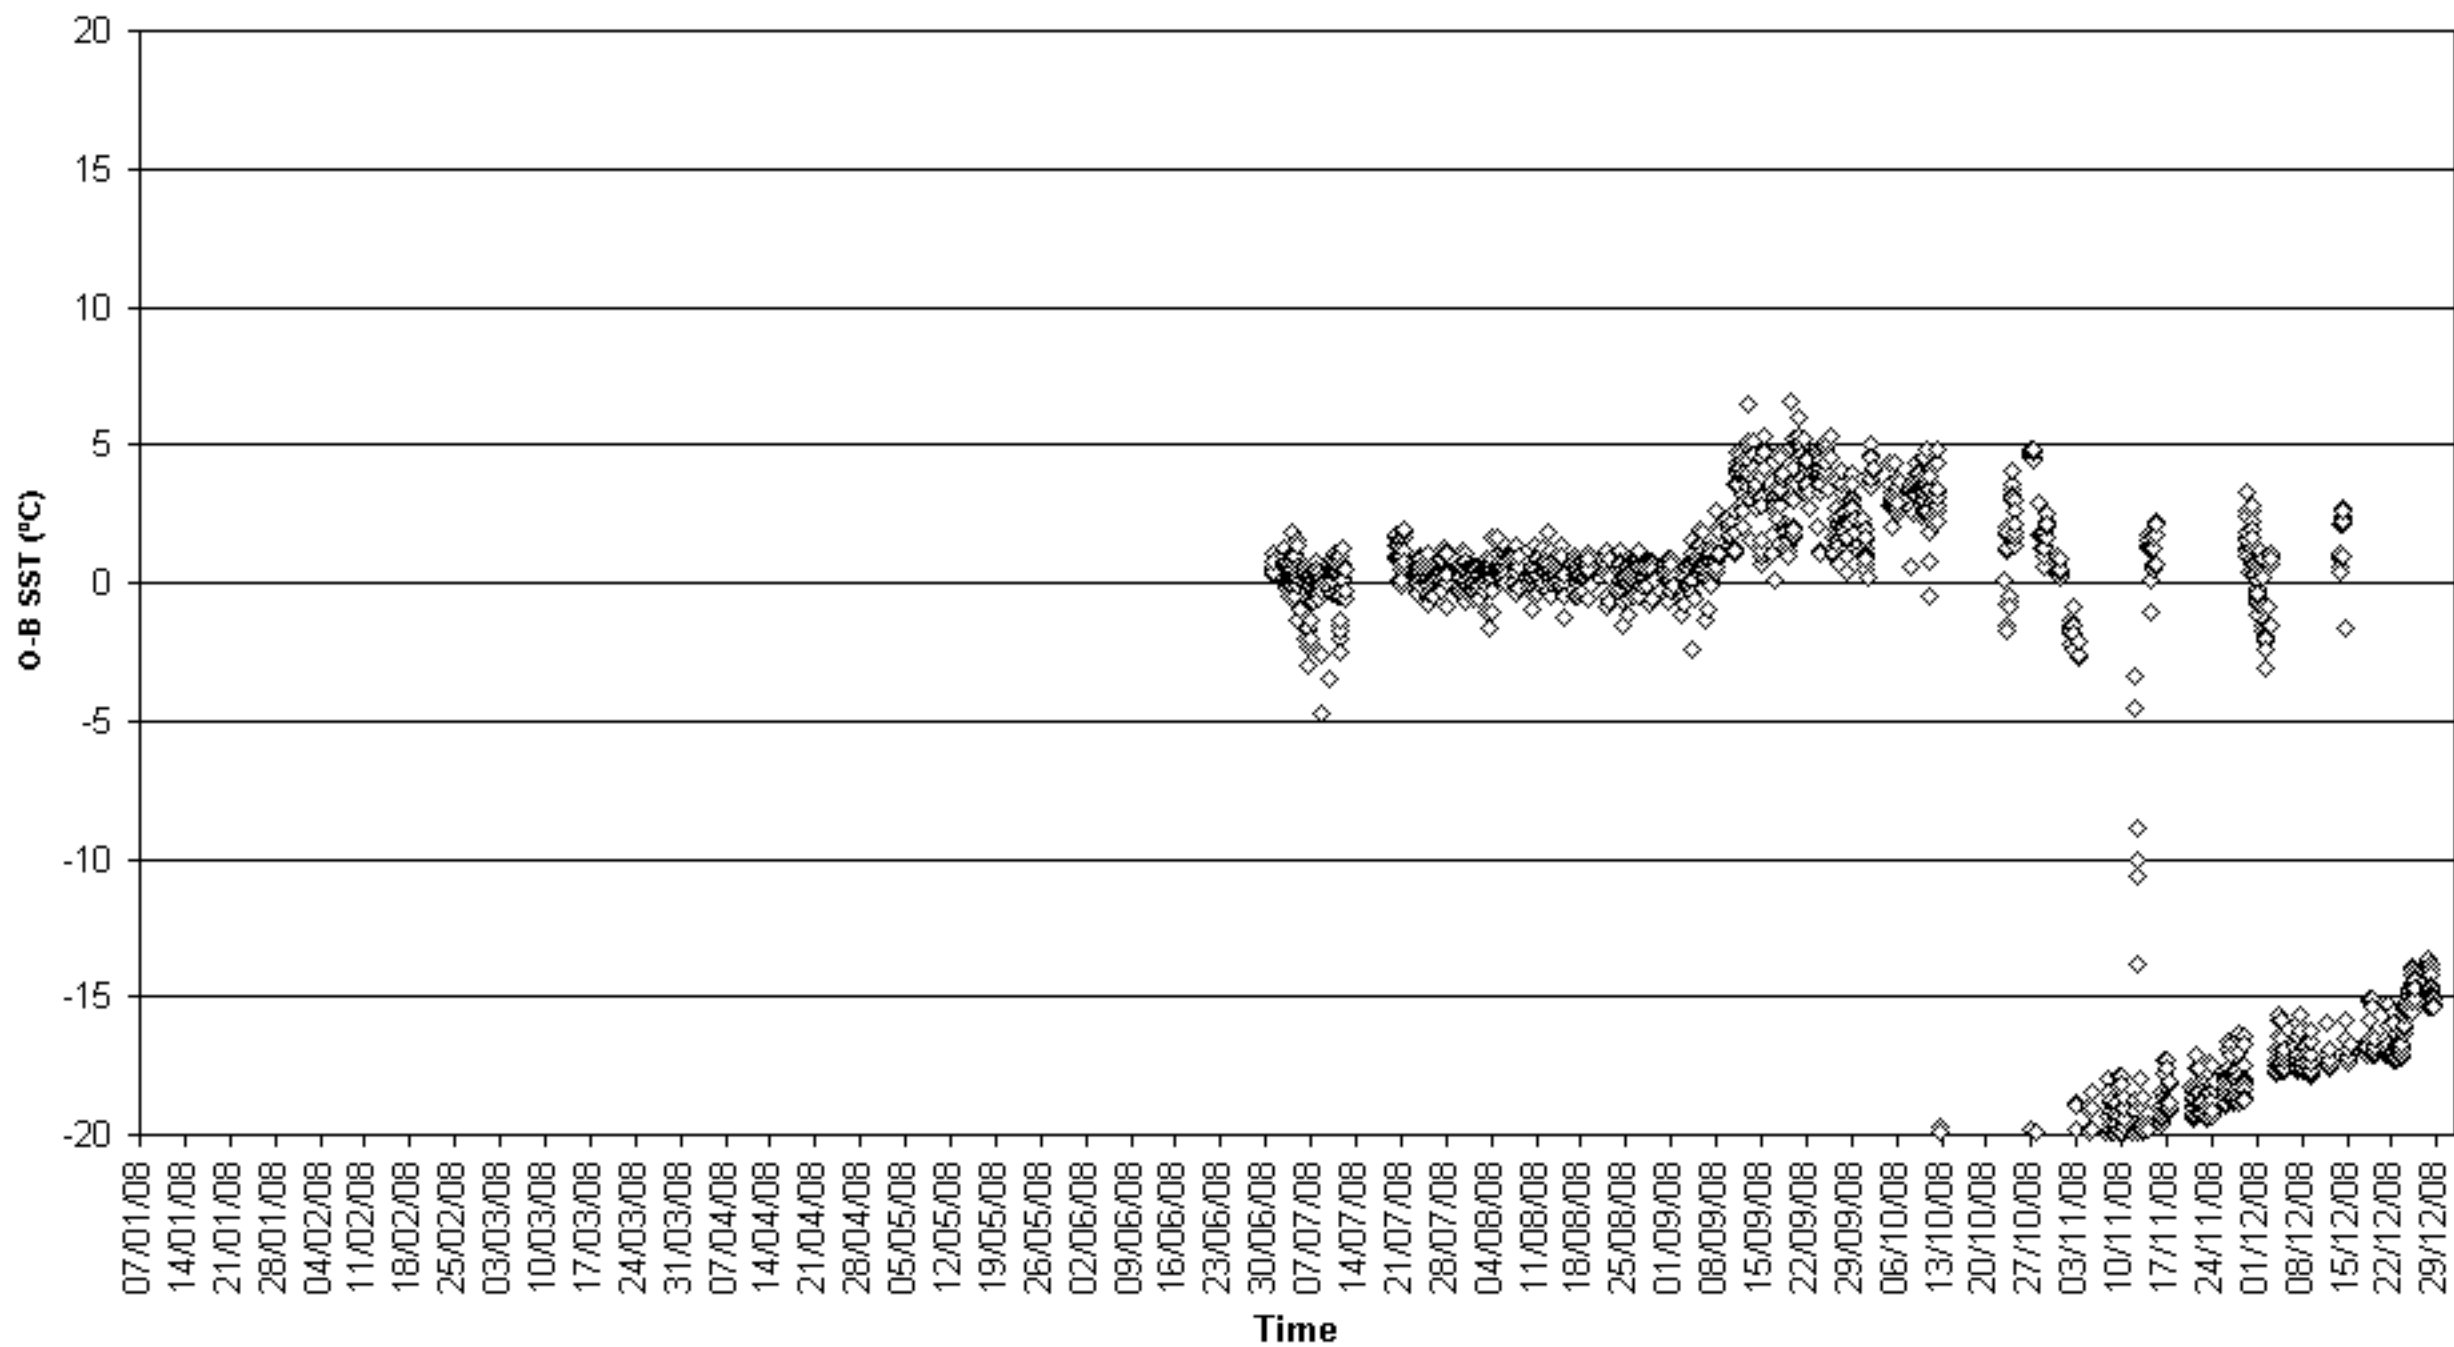





O-B SST (°C) for identifier C6UB2  
Number of obs. plotted = 135 Number of outliers = 6

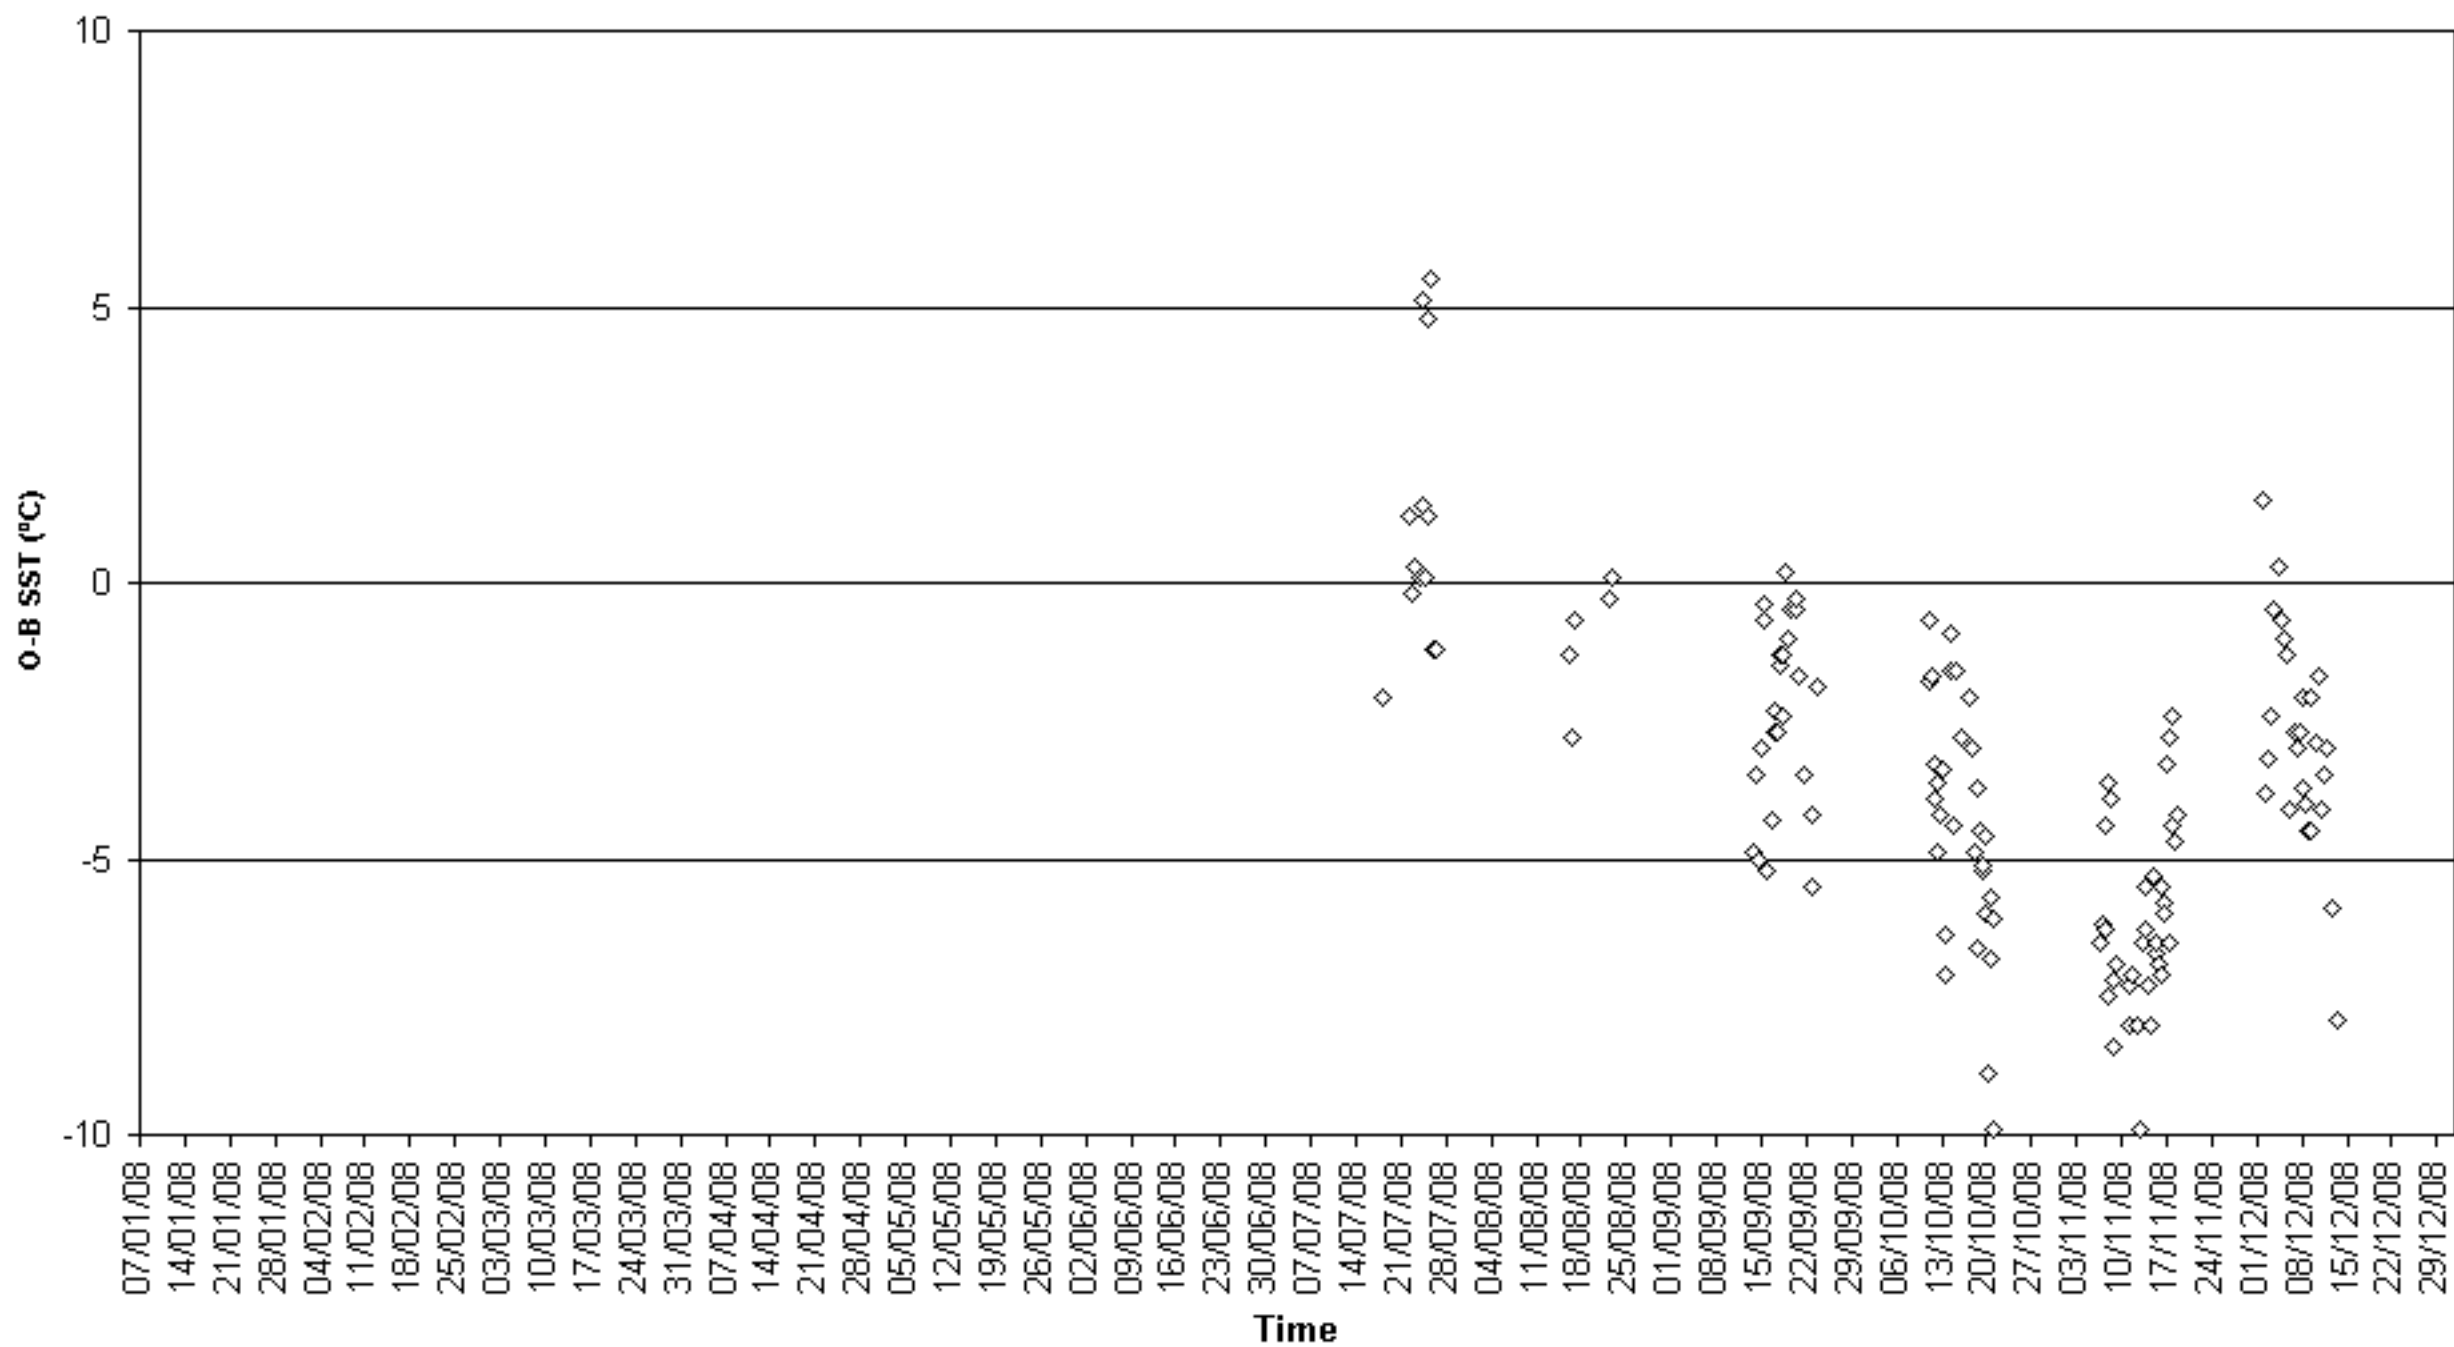


O-B SST (°C) for identifier DDFL2  
Number of obs. plotted = 42 Number of outliers = 0

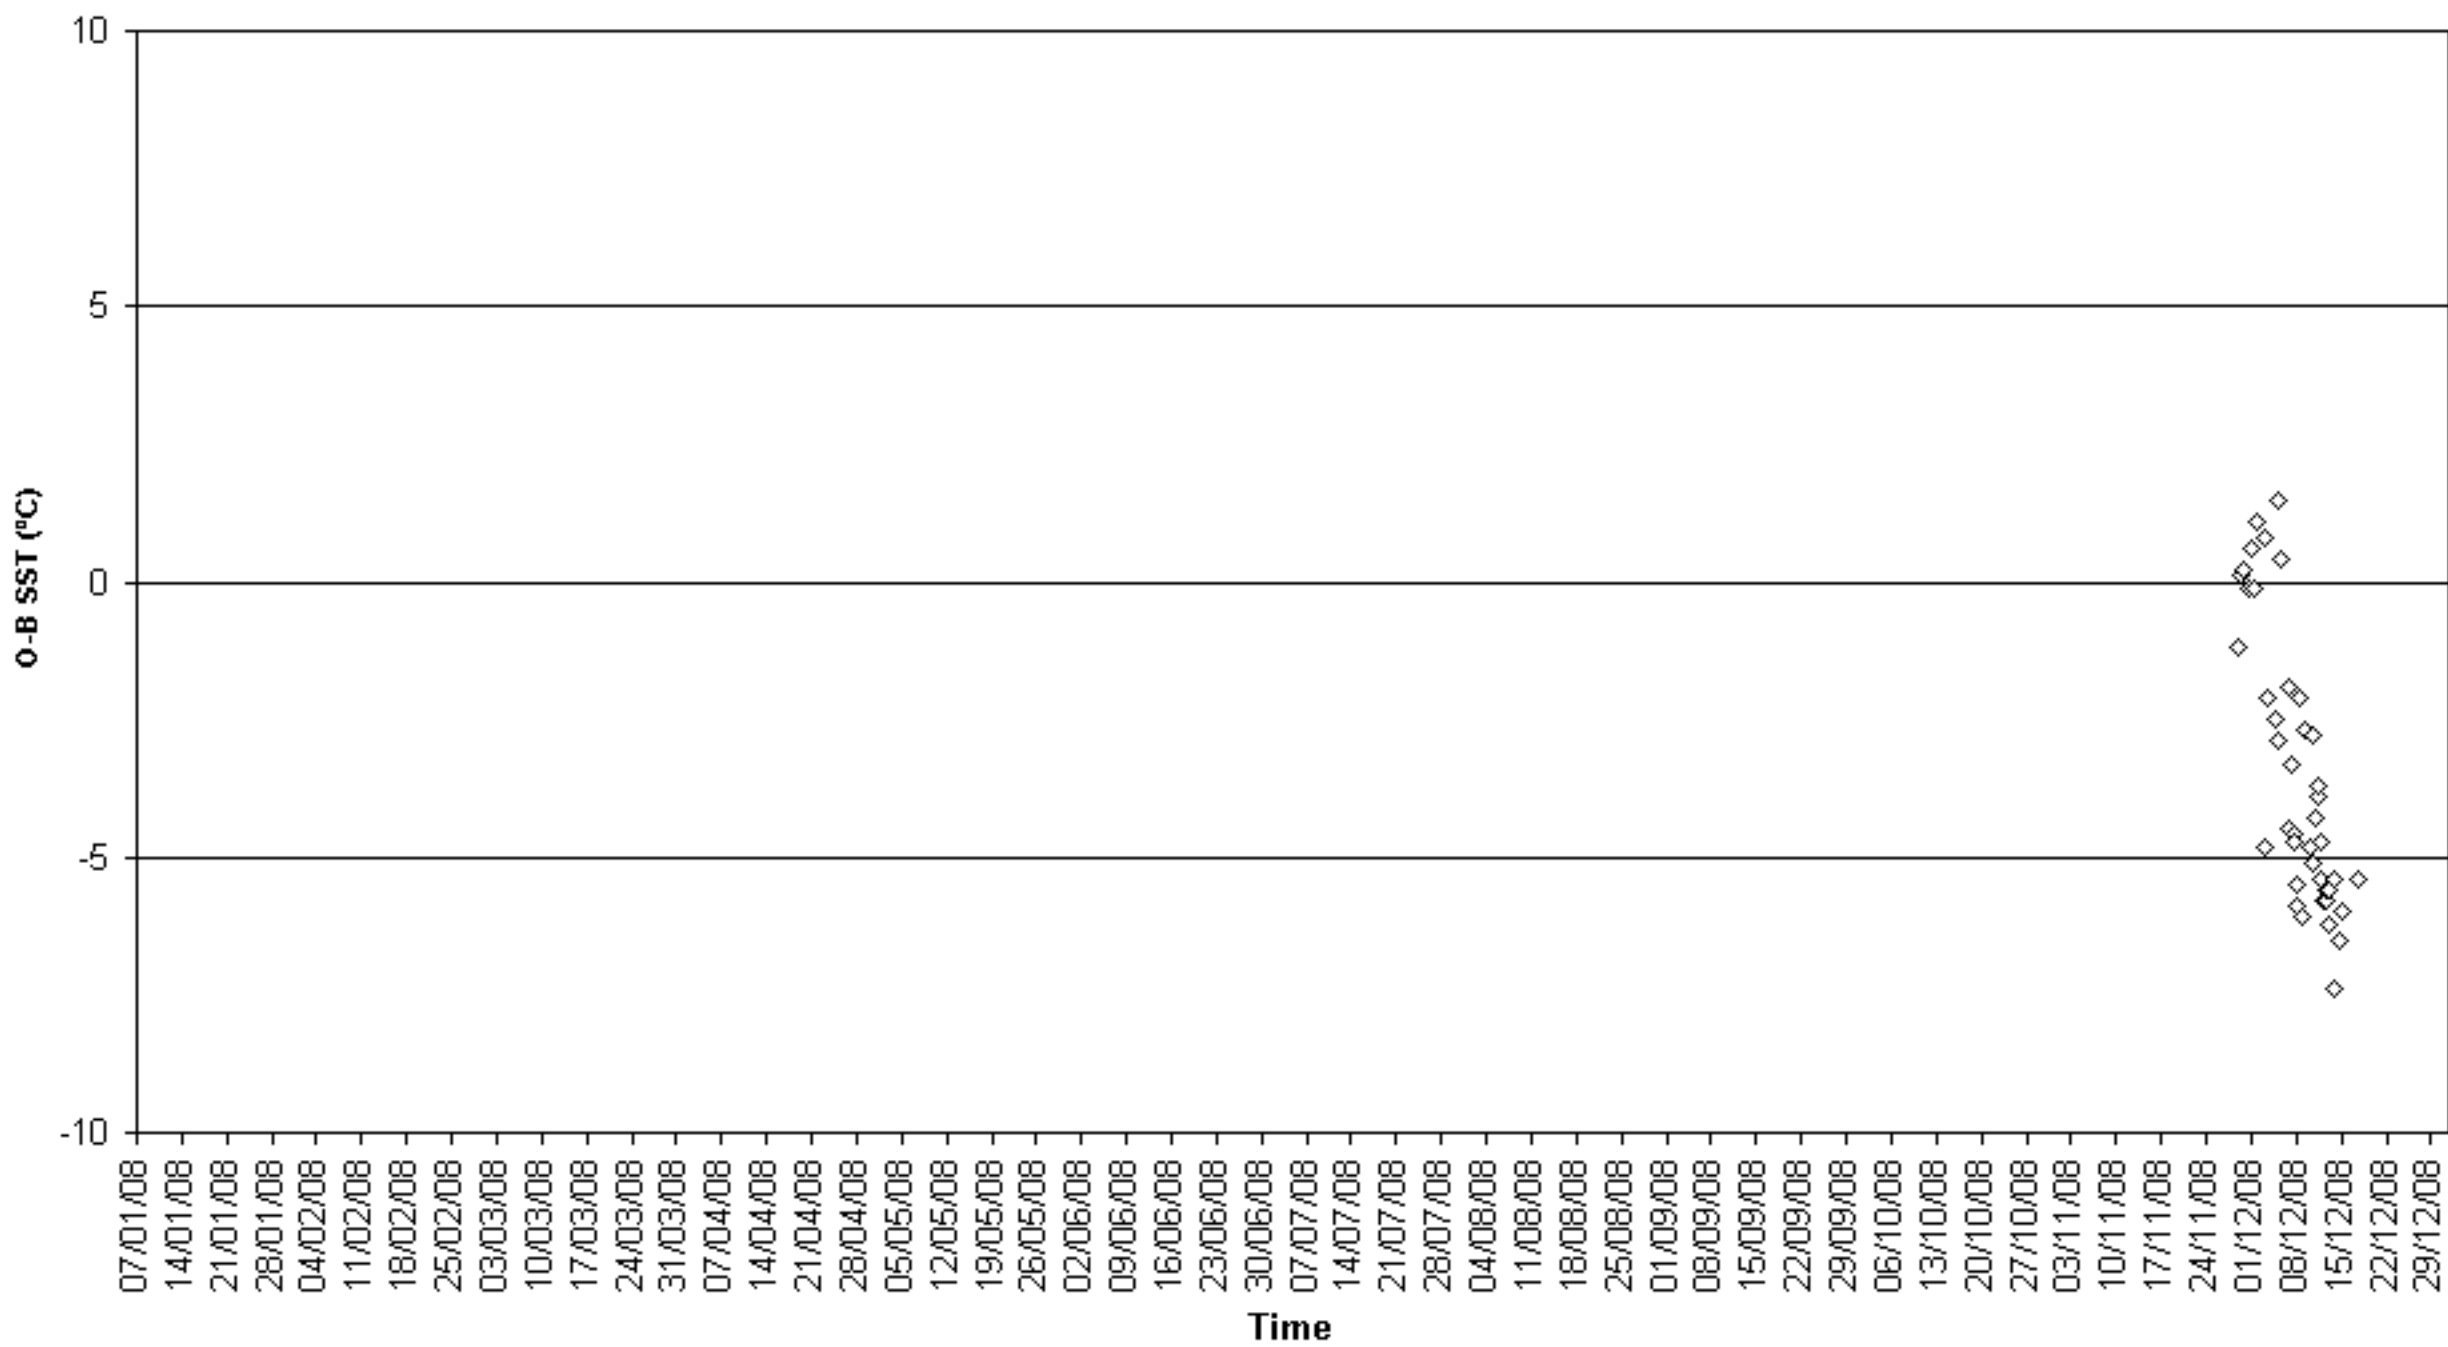


O-B SST (°C) for identifier DEAL  
Number of obs. plotted = 53 Number of outliers = 0

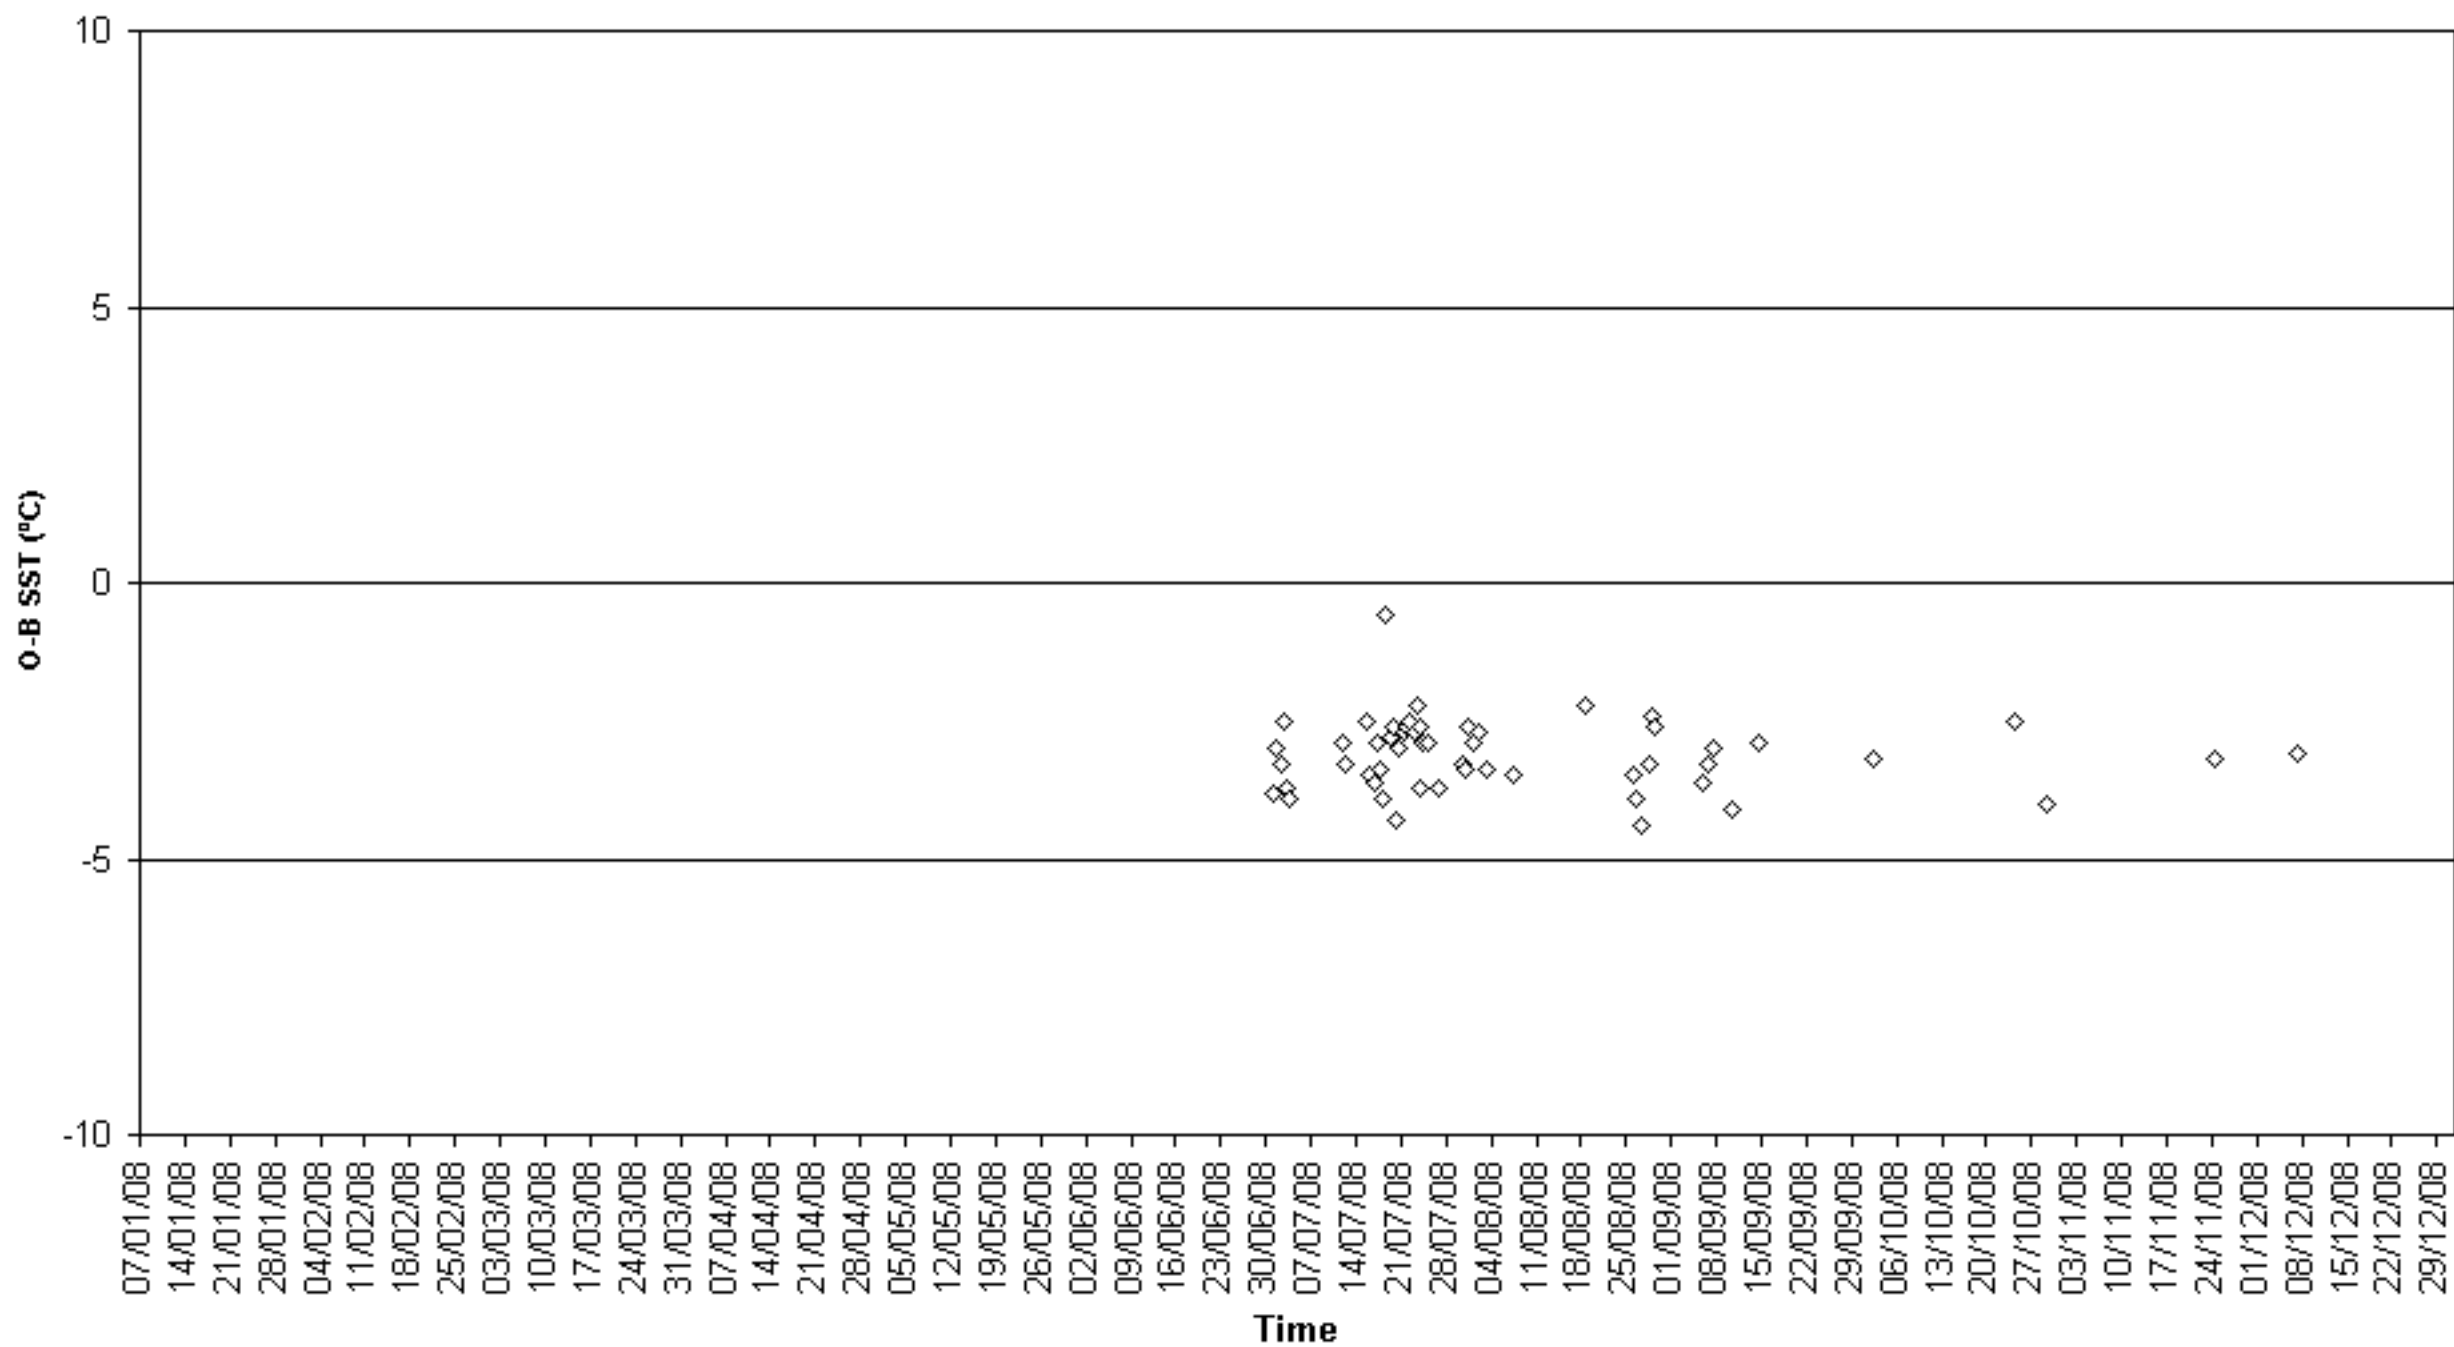


O-B SST (°C) for identifier DIBZ  
Number of obs. plotted = 49 Number of outliers = 0

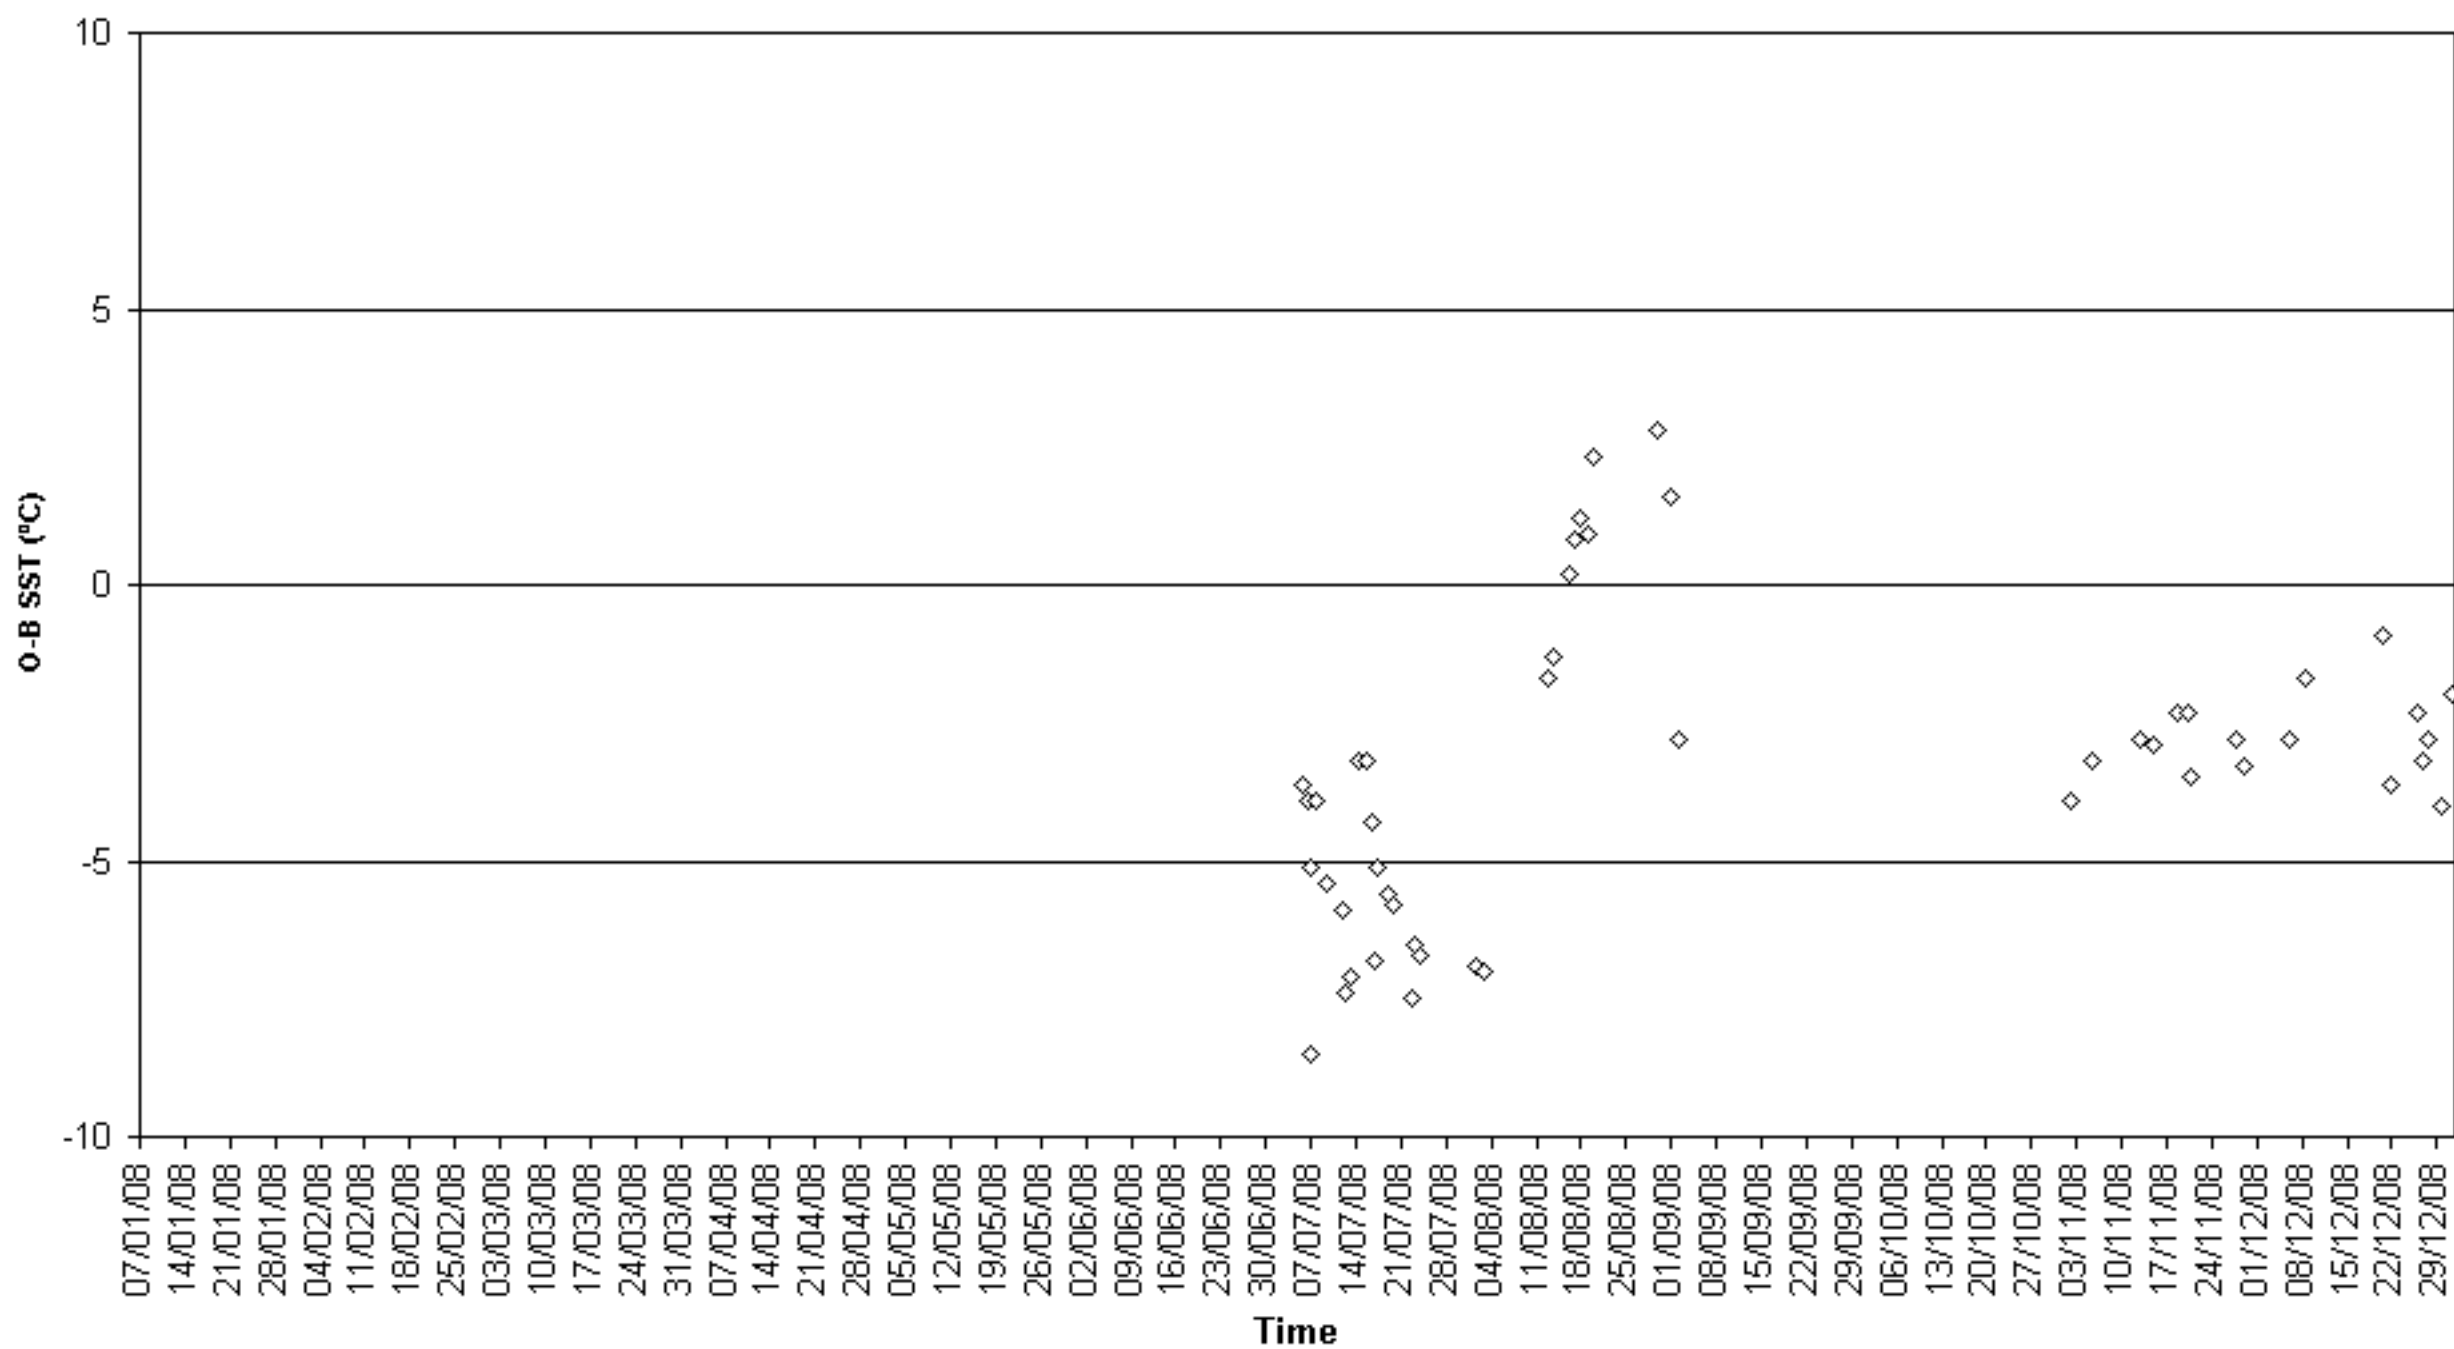


O-B SST (°C) for identifier DPCK  
Number of obs. plotted = 237 Number of outliers = 0

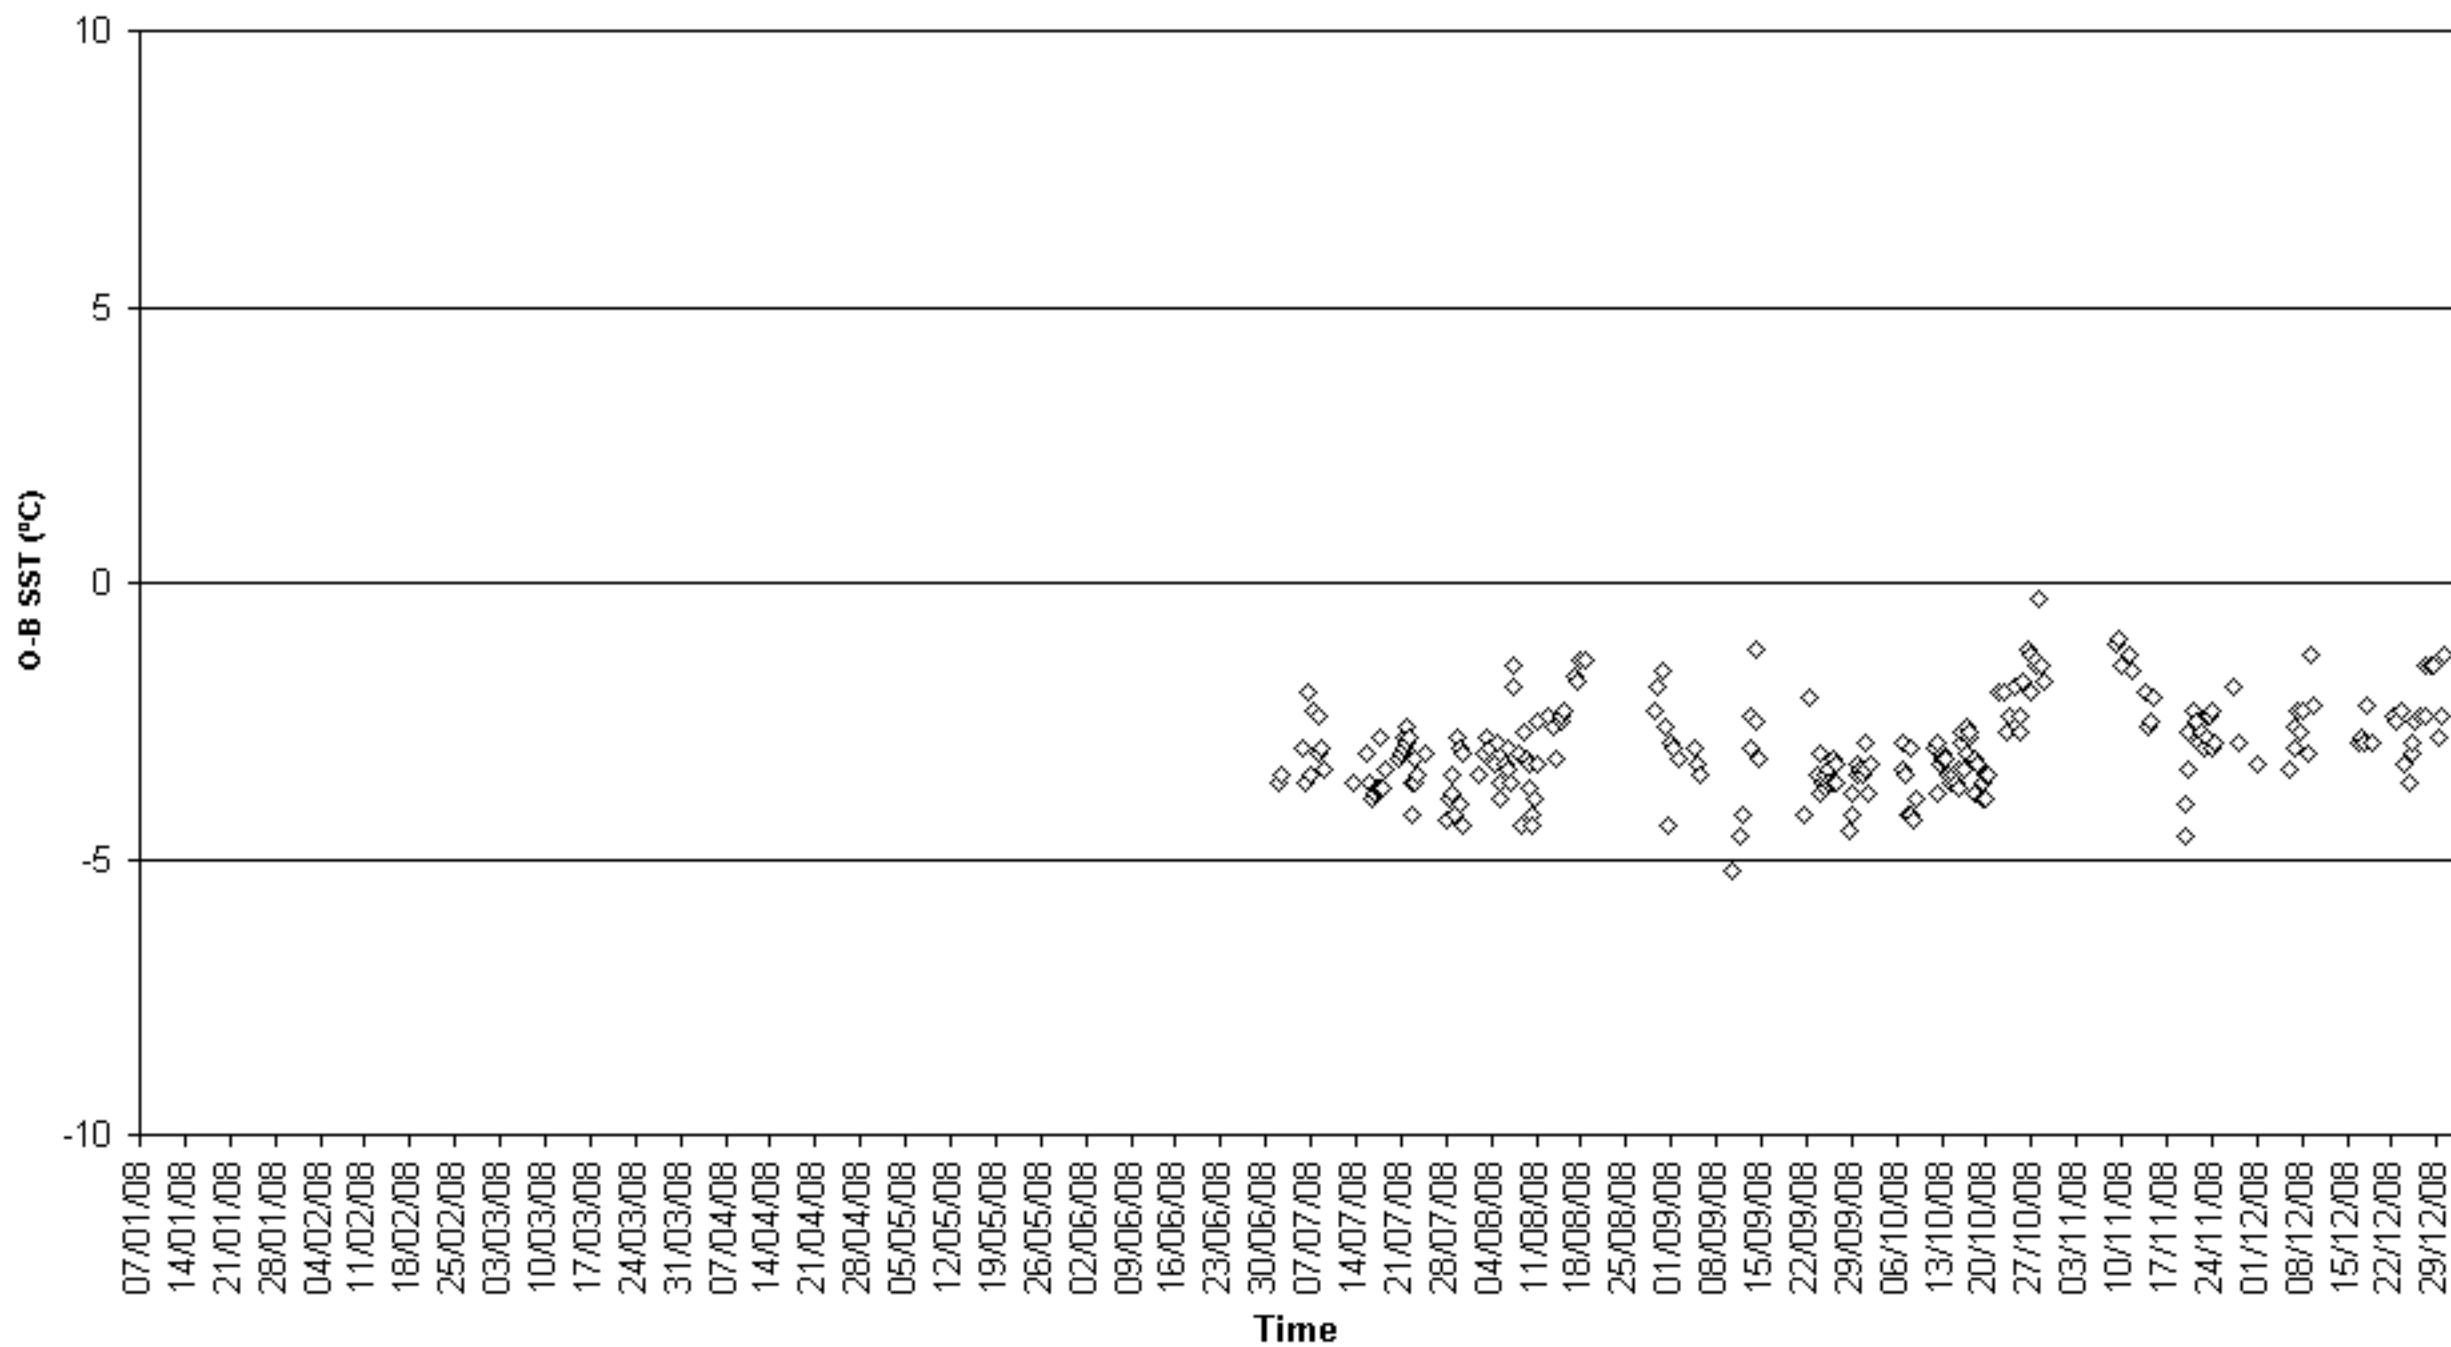


O-B SST (°C) for identifier HZZD  
Number of obs. plotted = 43 Number of outliers = 1

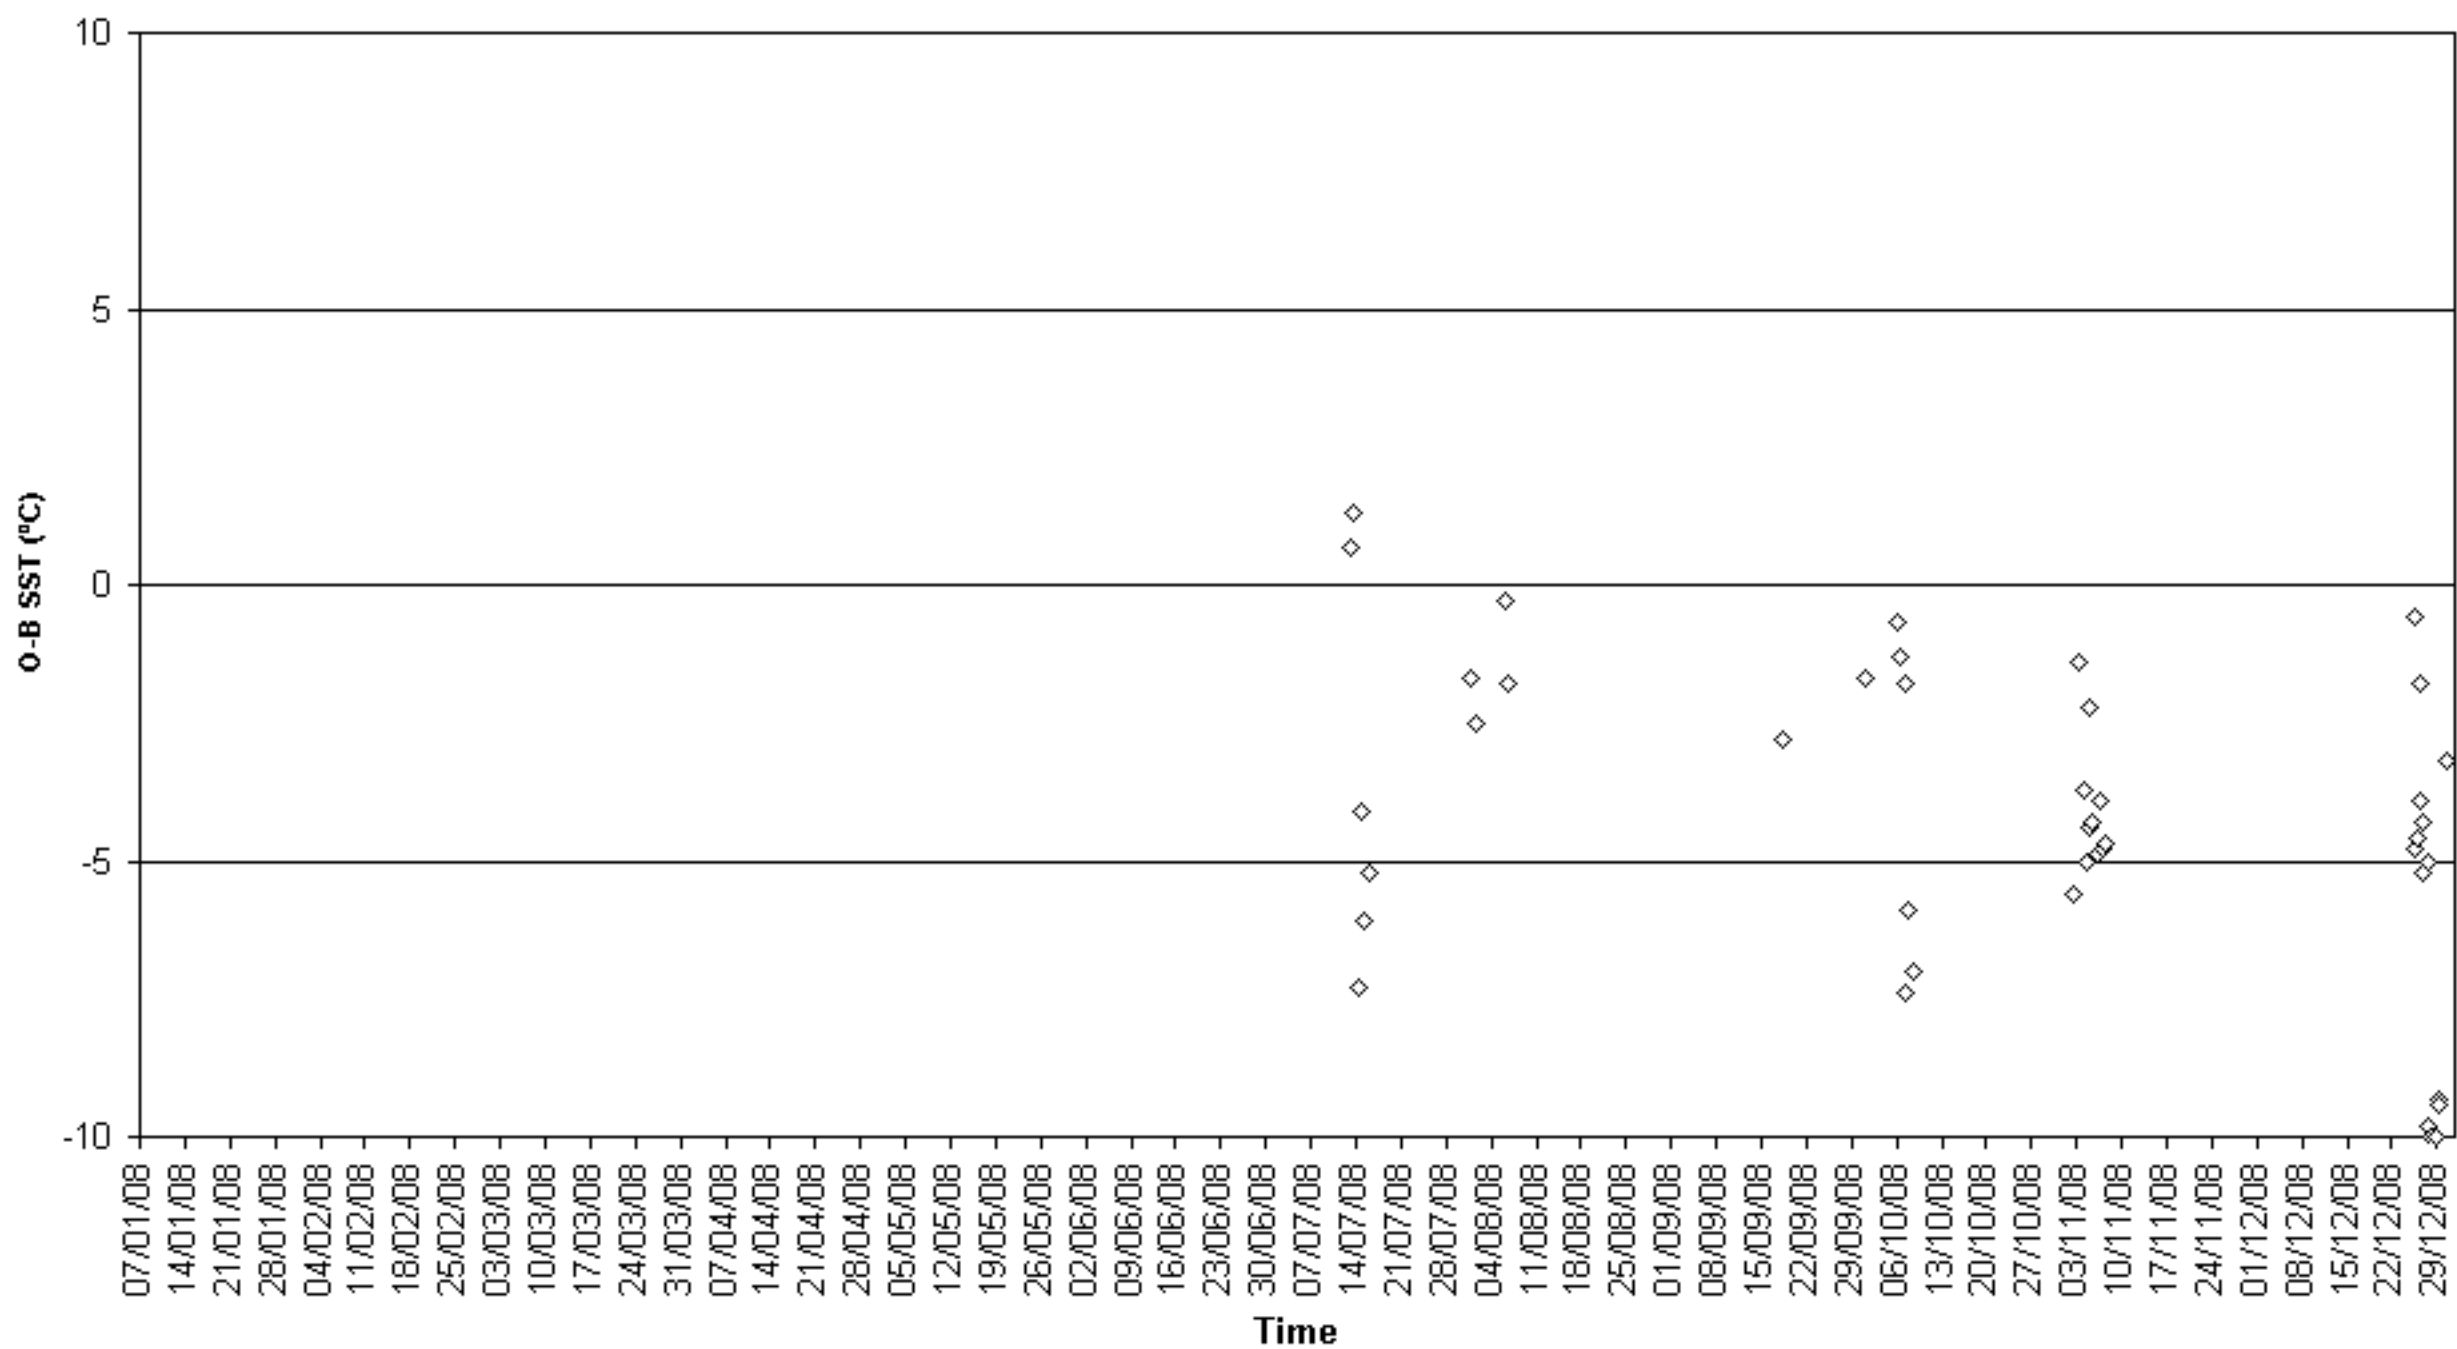

O-B SST (°C) for identifier KHRC  
Number of obs. plotted = 274 Number of outliers = 0

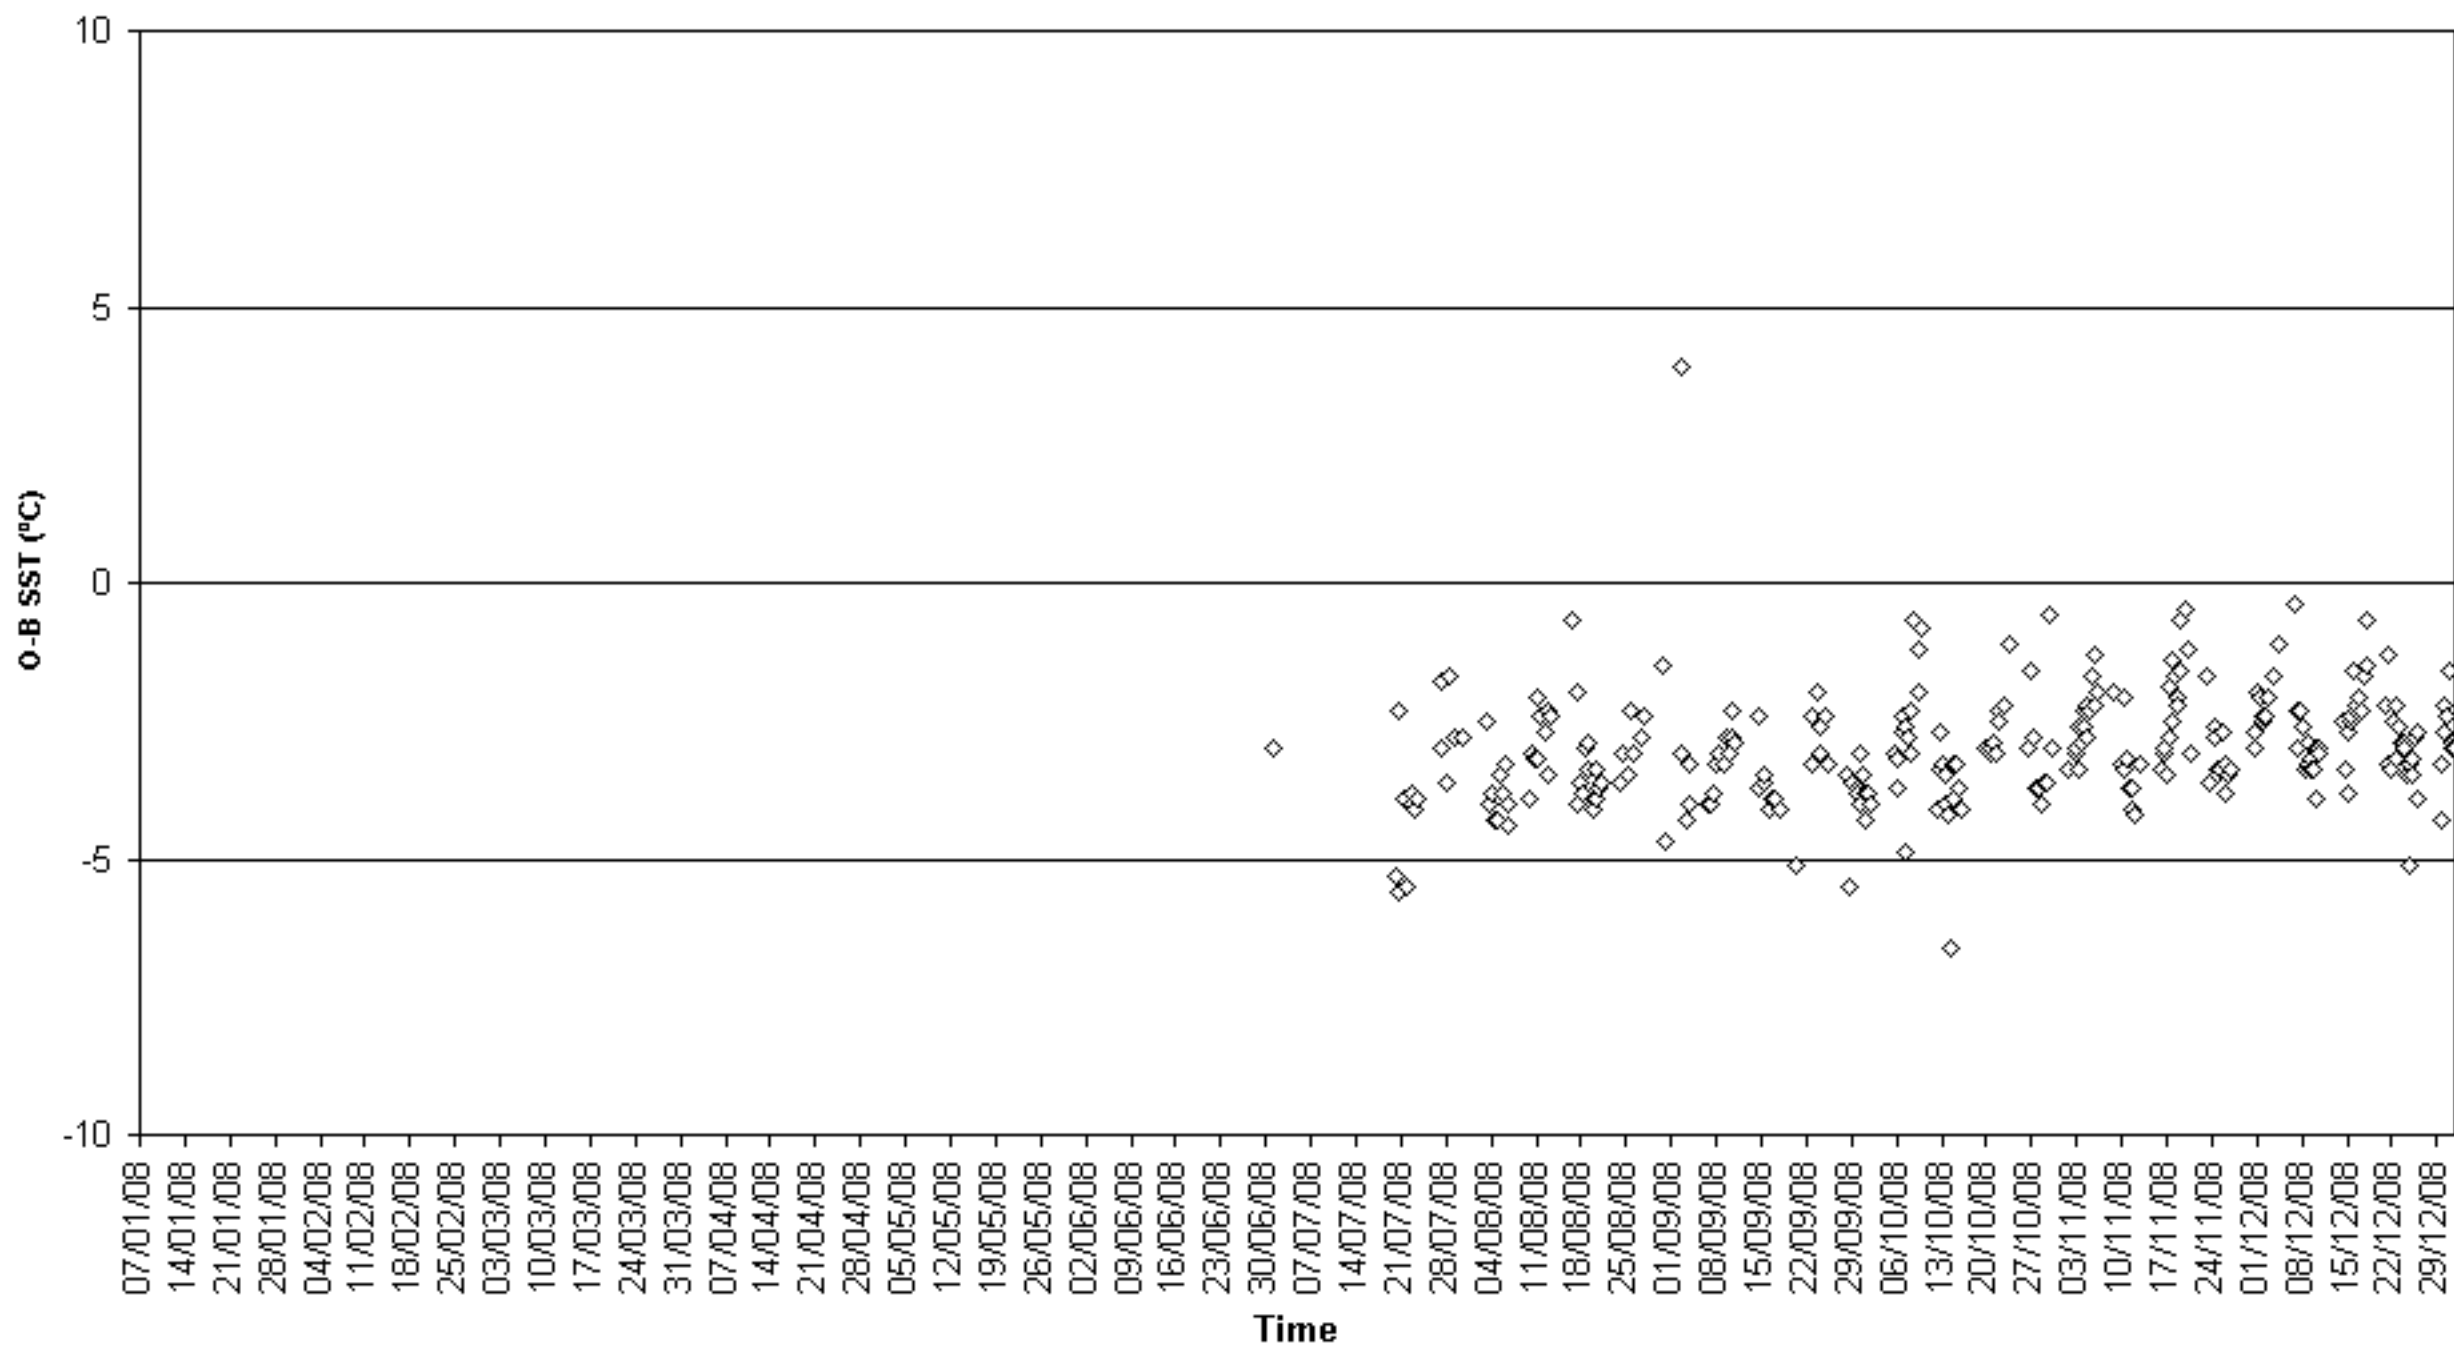


O-B SST (°C) for identifier KRHX  
Number of obs. plotted = 179 Number of outliers = 0

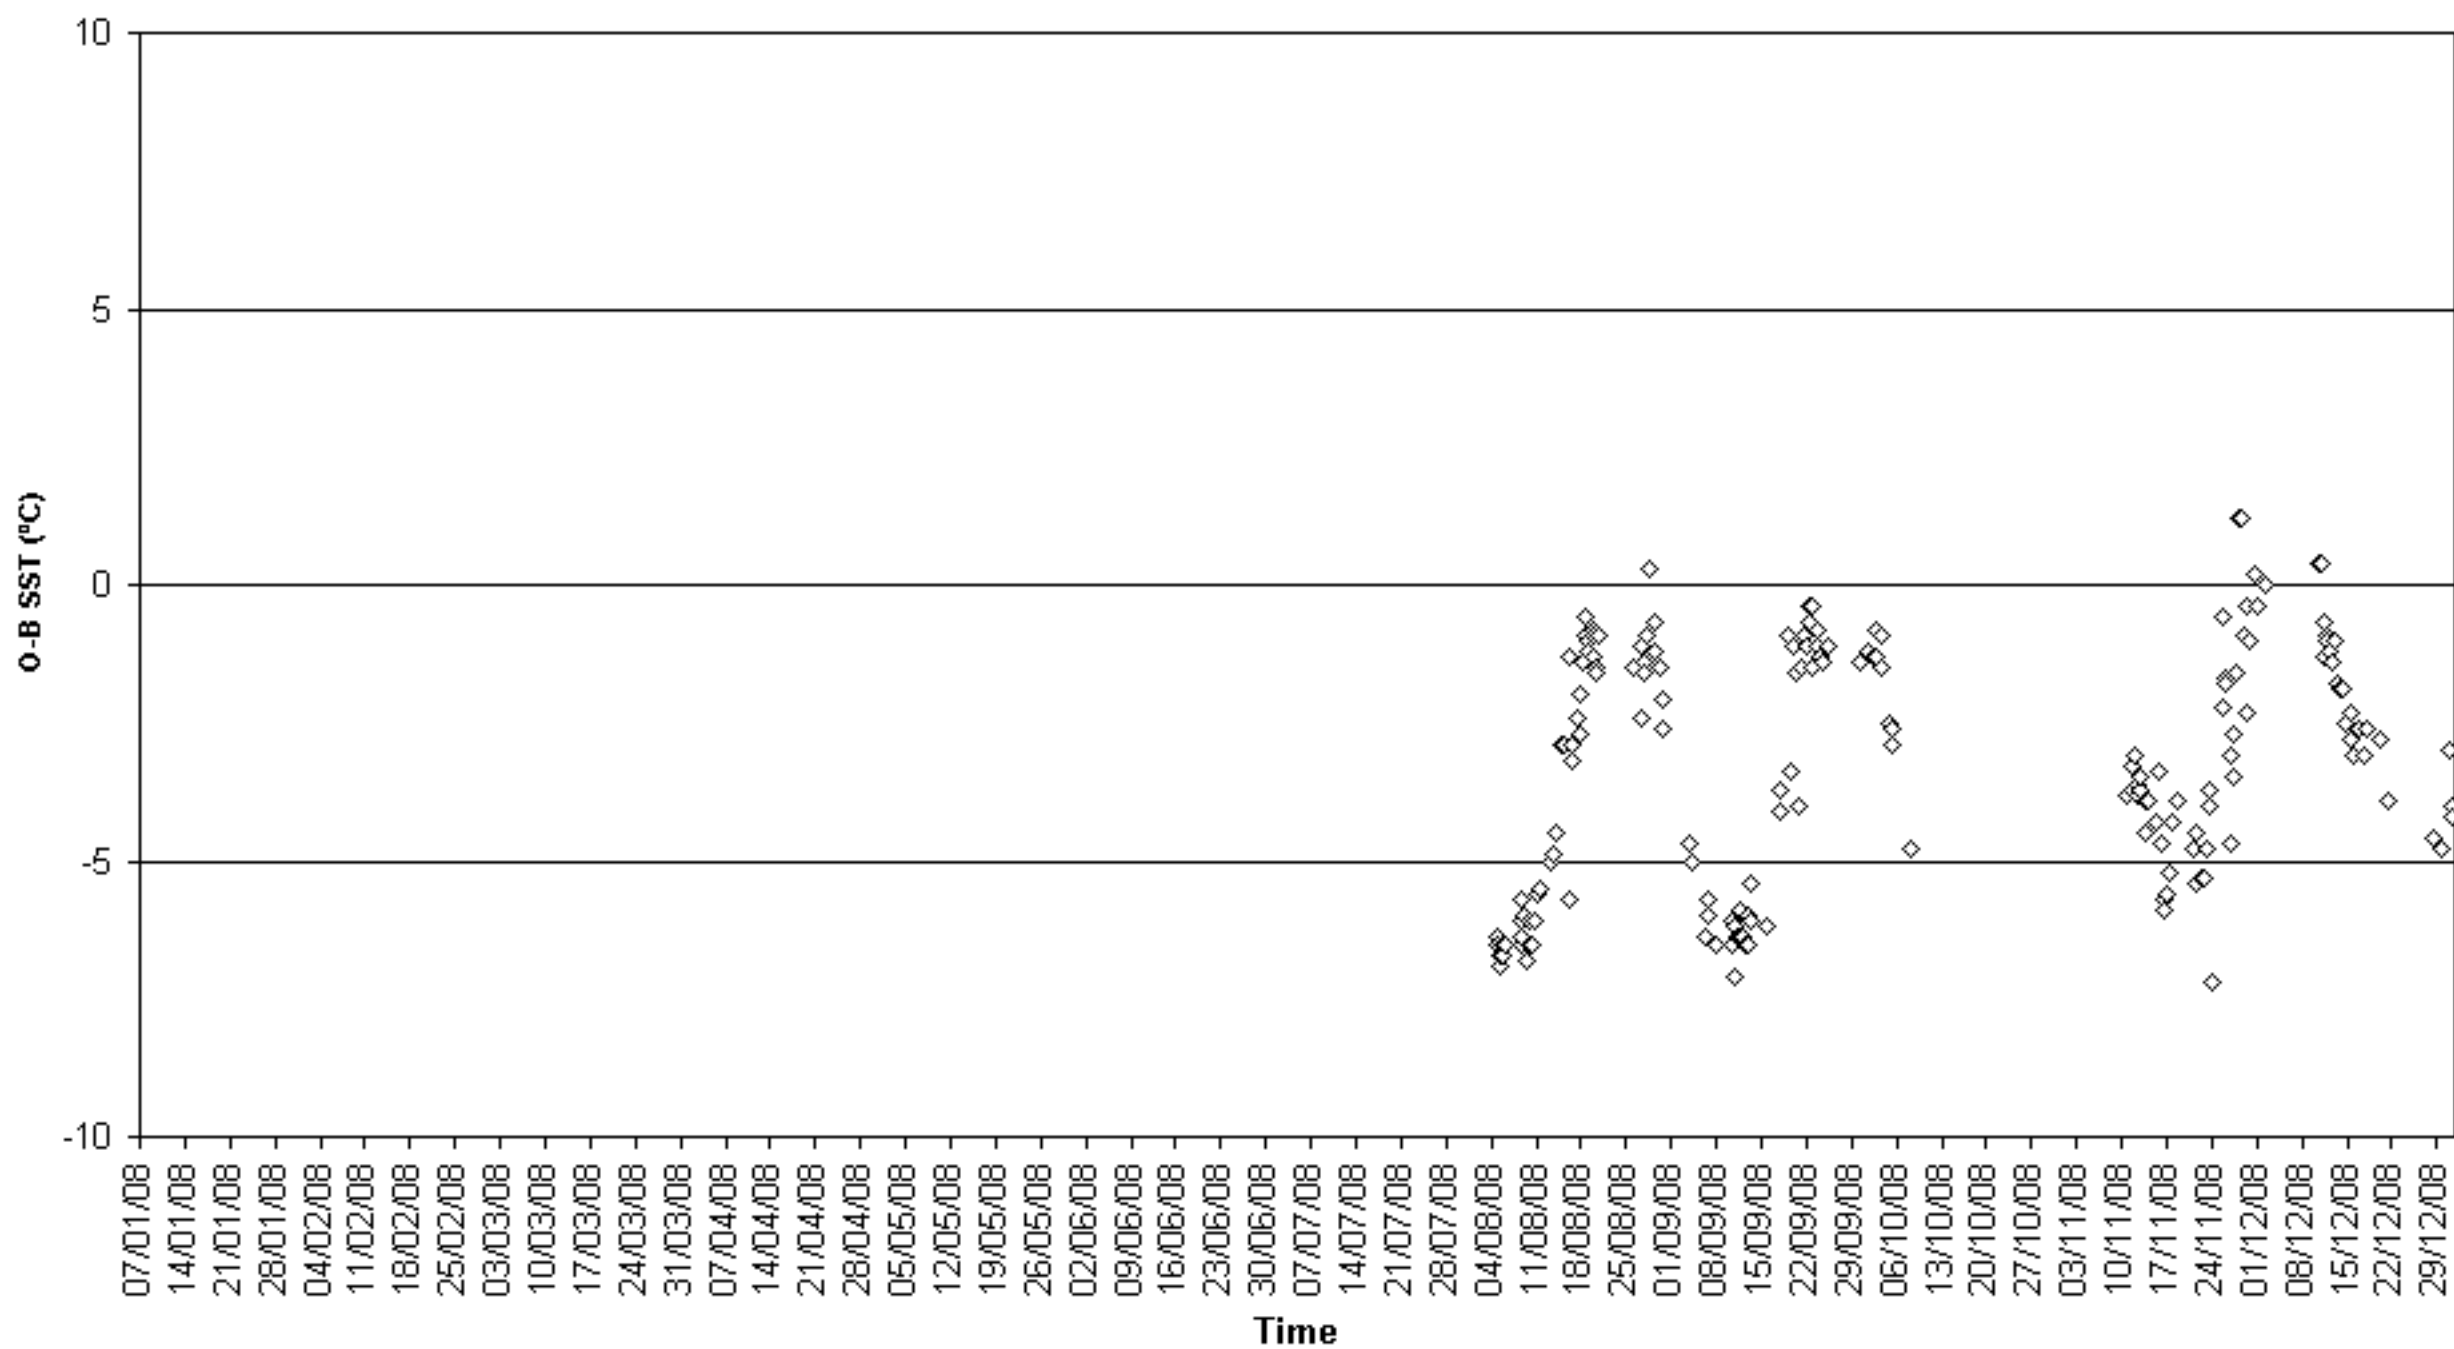





O-B SST (°C) for identifier KS059  
Number of obs. plotted = 62 Number of outliers = 0

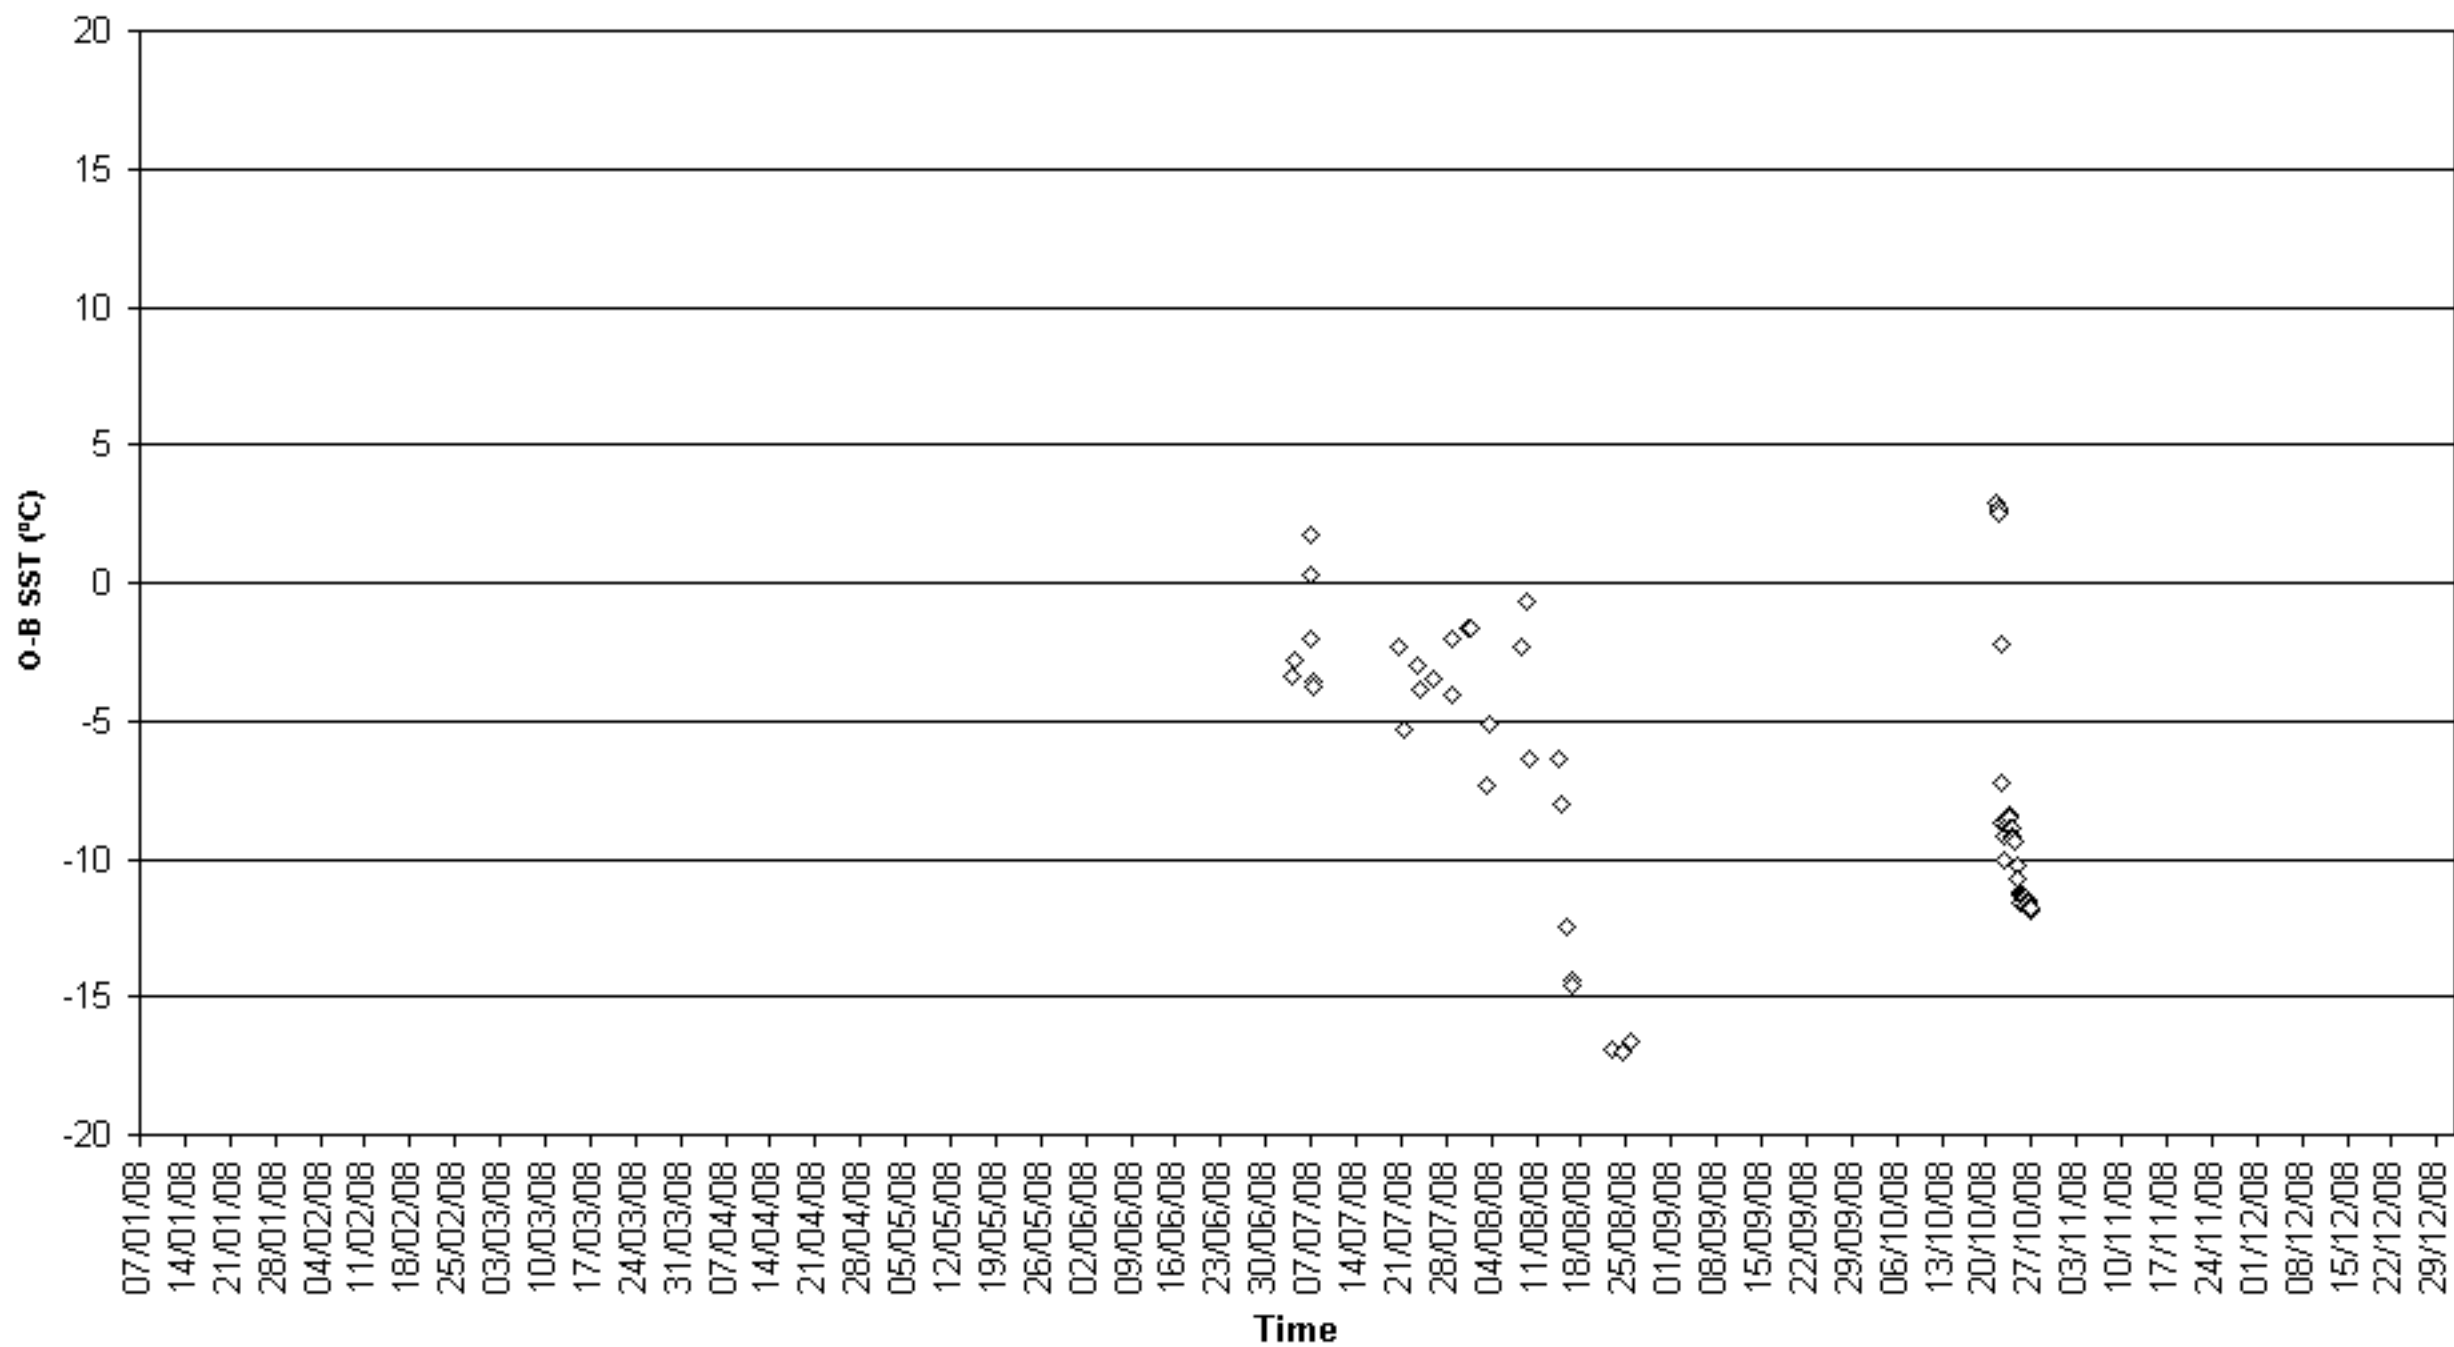


O-B SST (°C) for identifier KS065  
Number of obs. plotted = 67    Number of outliers = 6

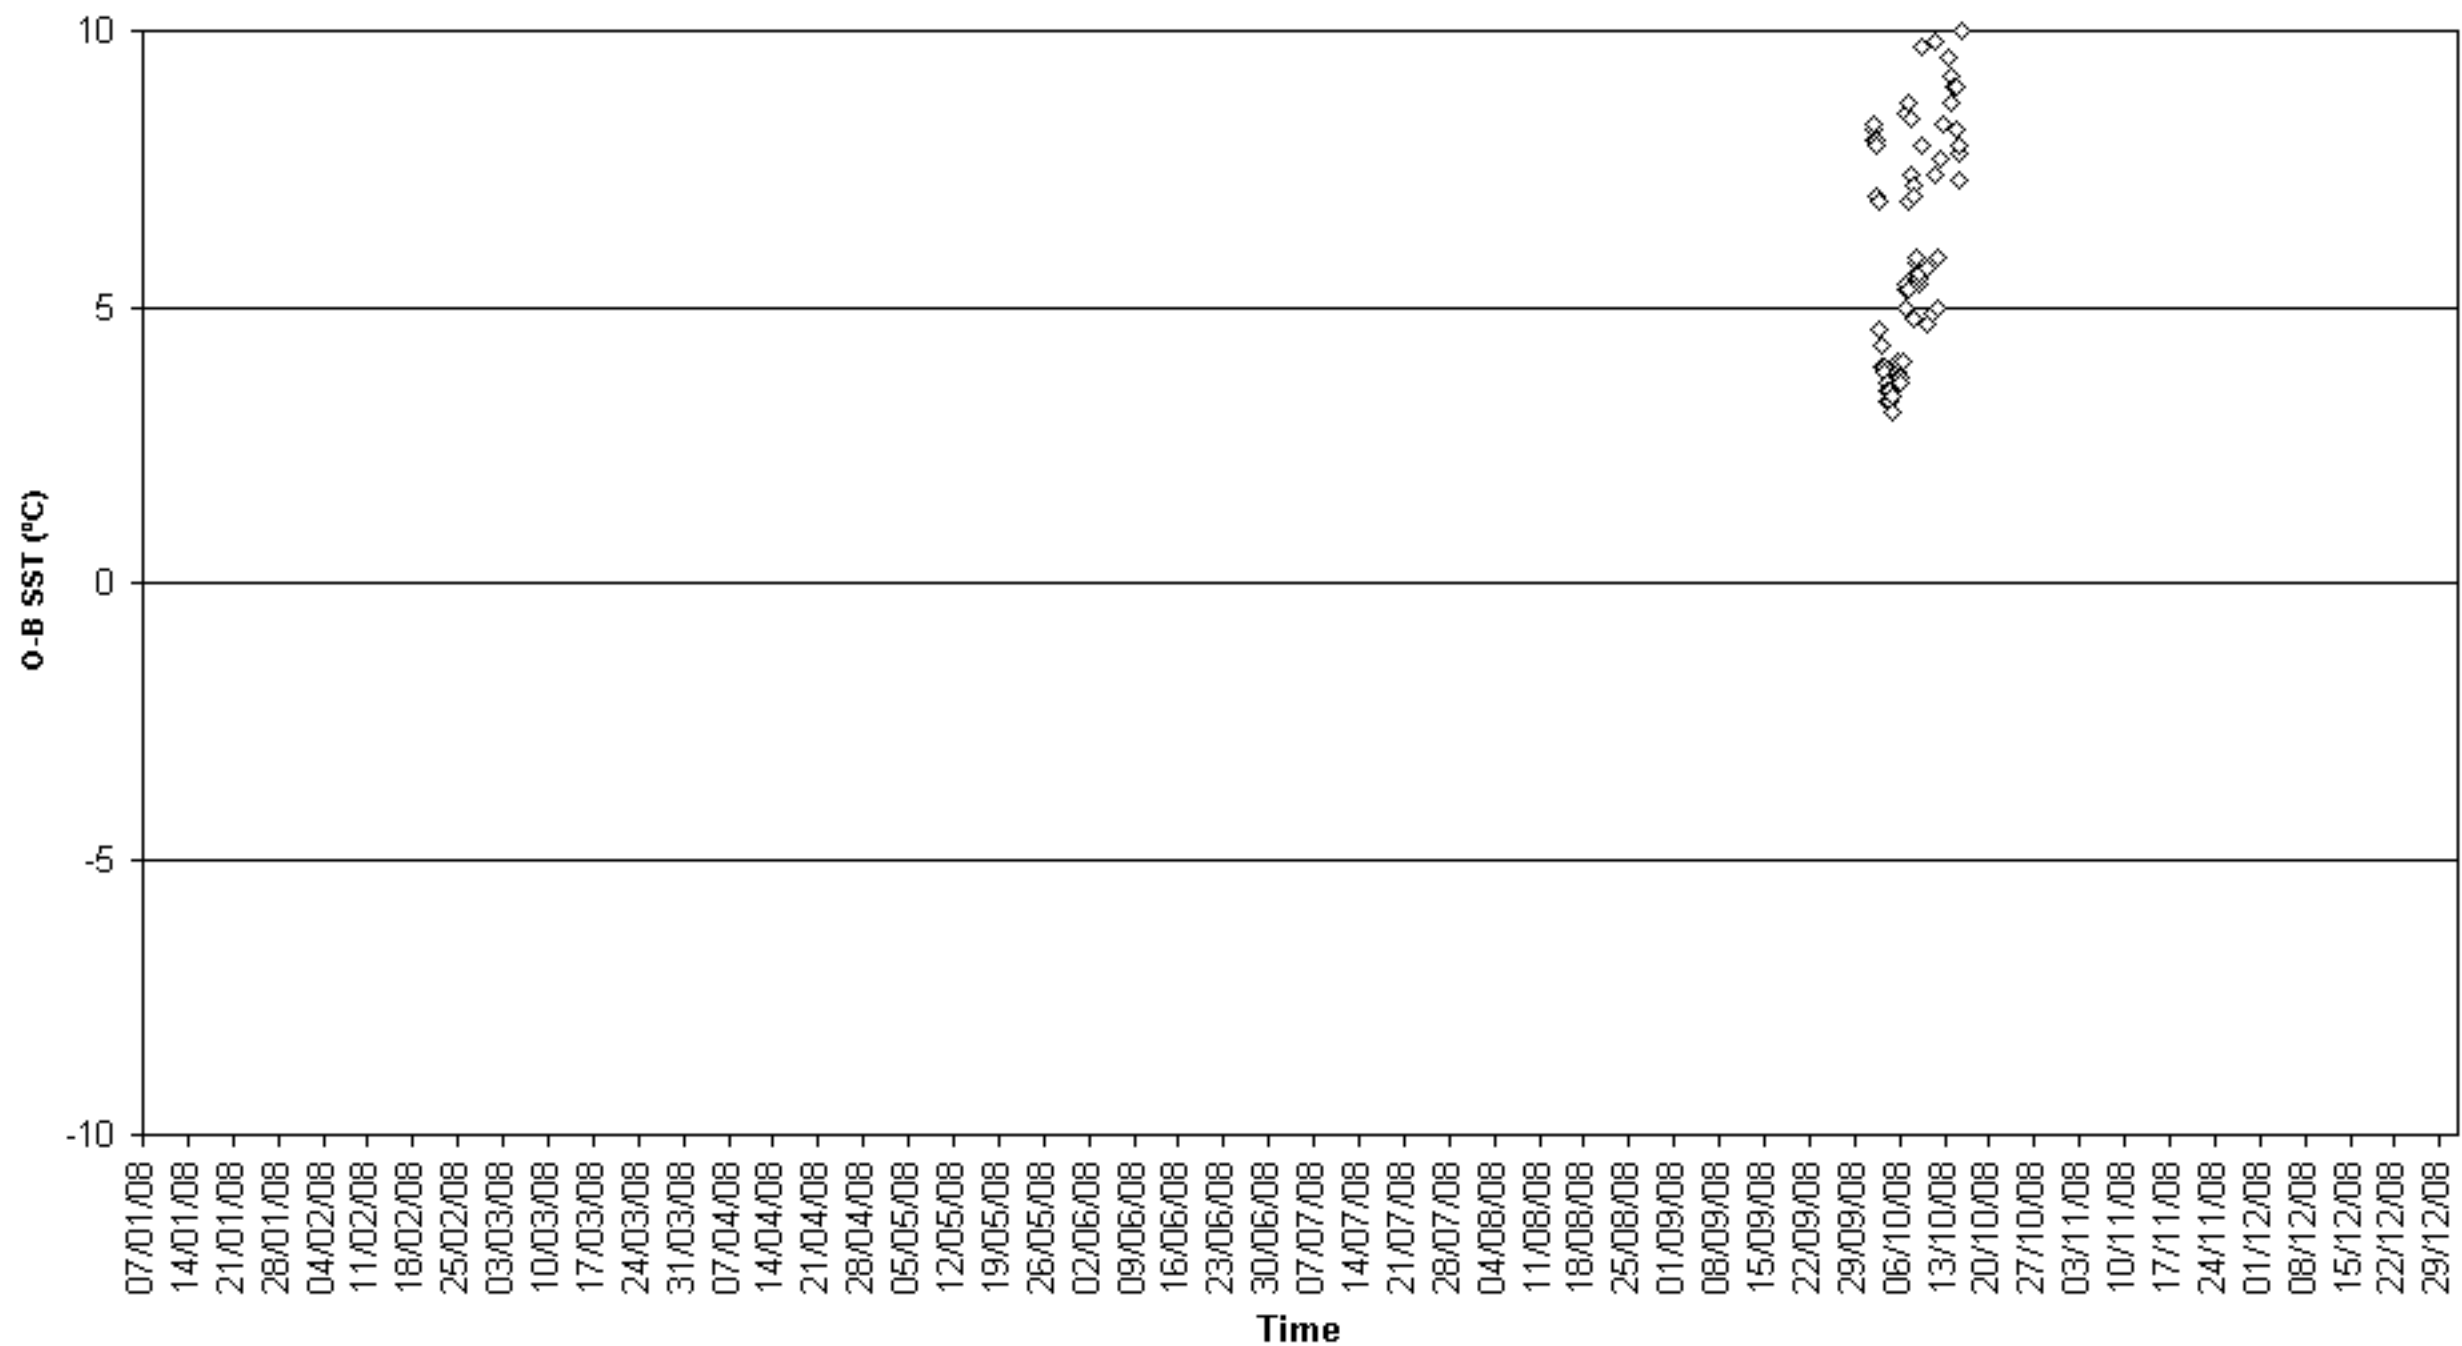


O-B SST (°C) for identifier KS066  
Number of obs. plotted = 103 Number of outliers = 0

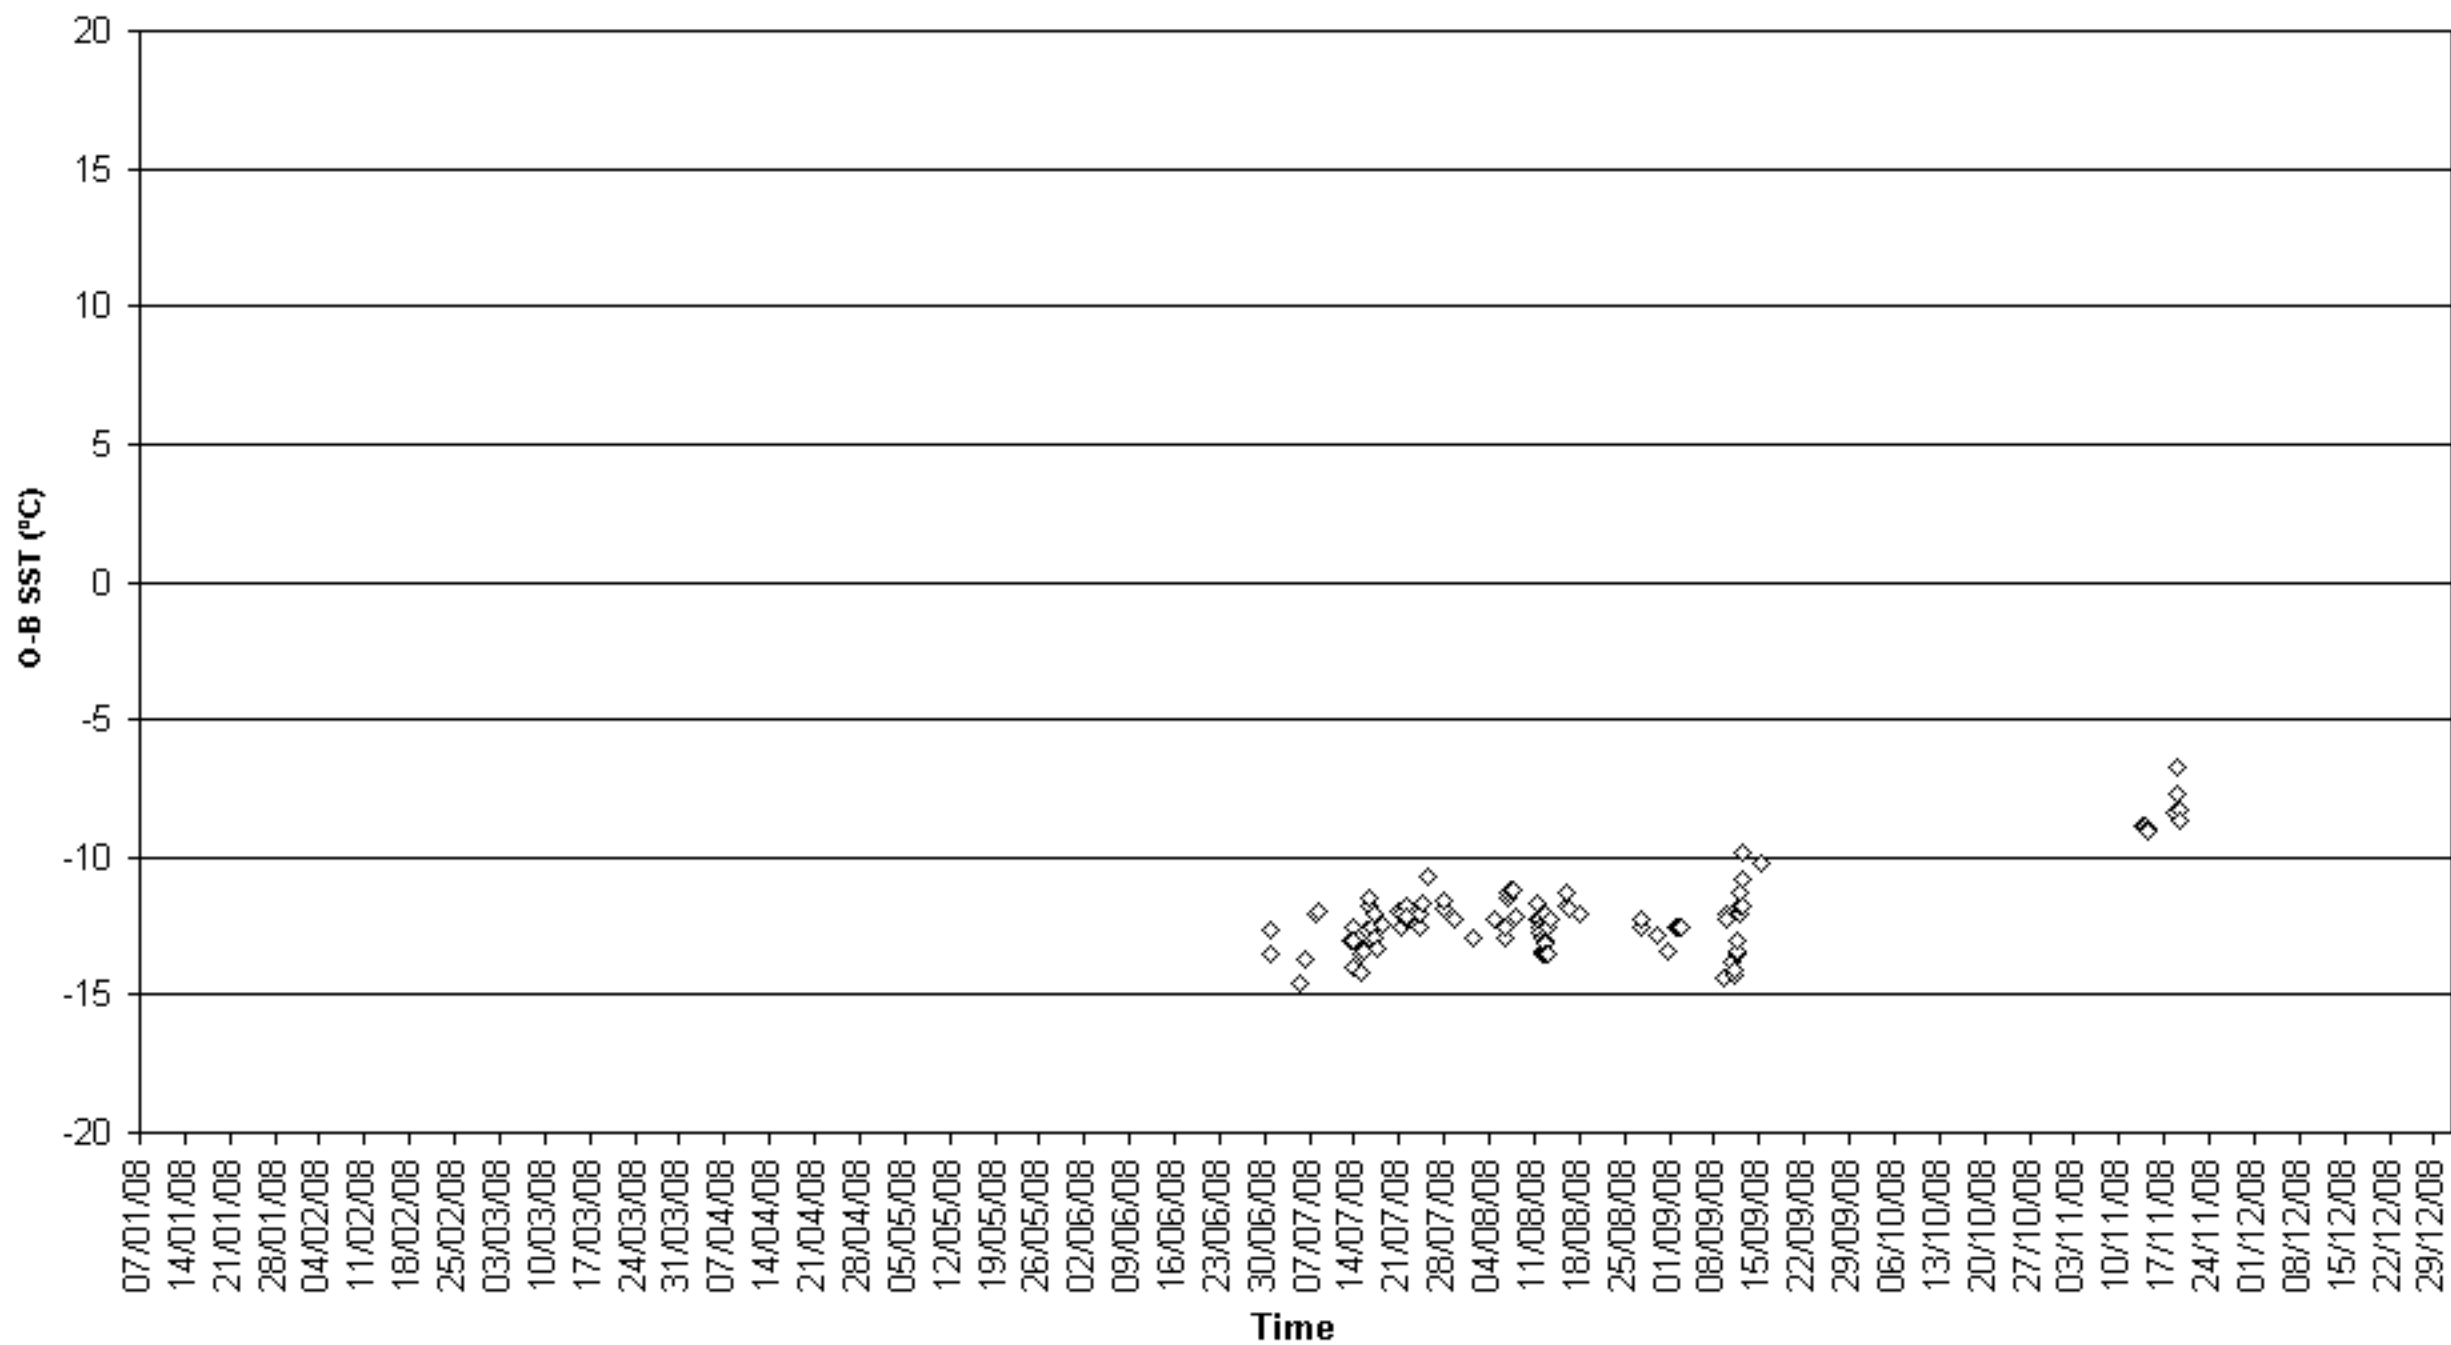


O-B SST (°C) for identifier LADR4  
Number of obs. plotted = 94 Number of outliers = 1

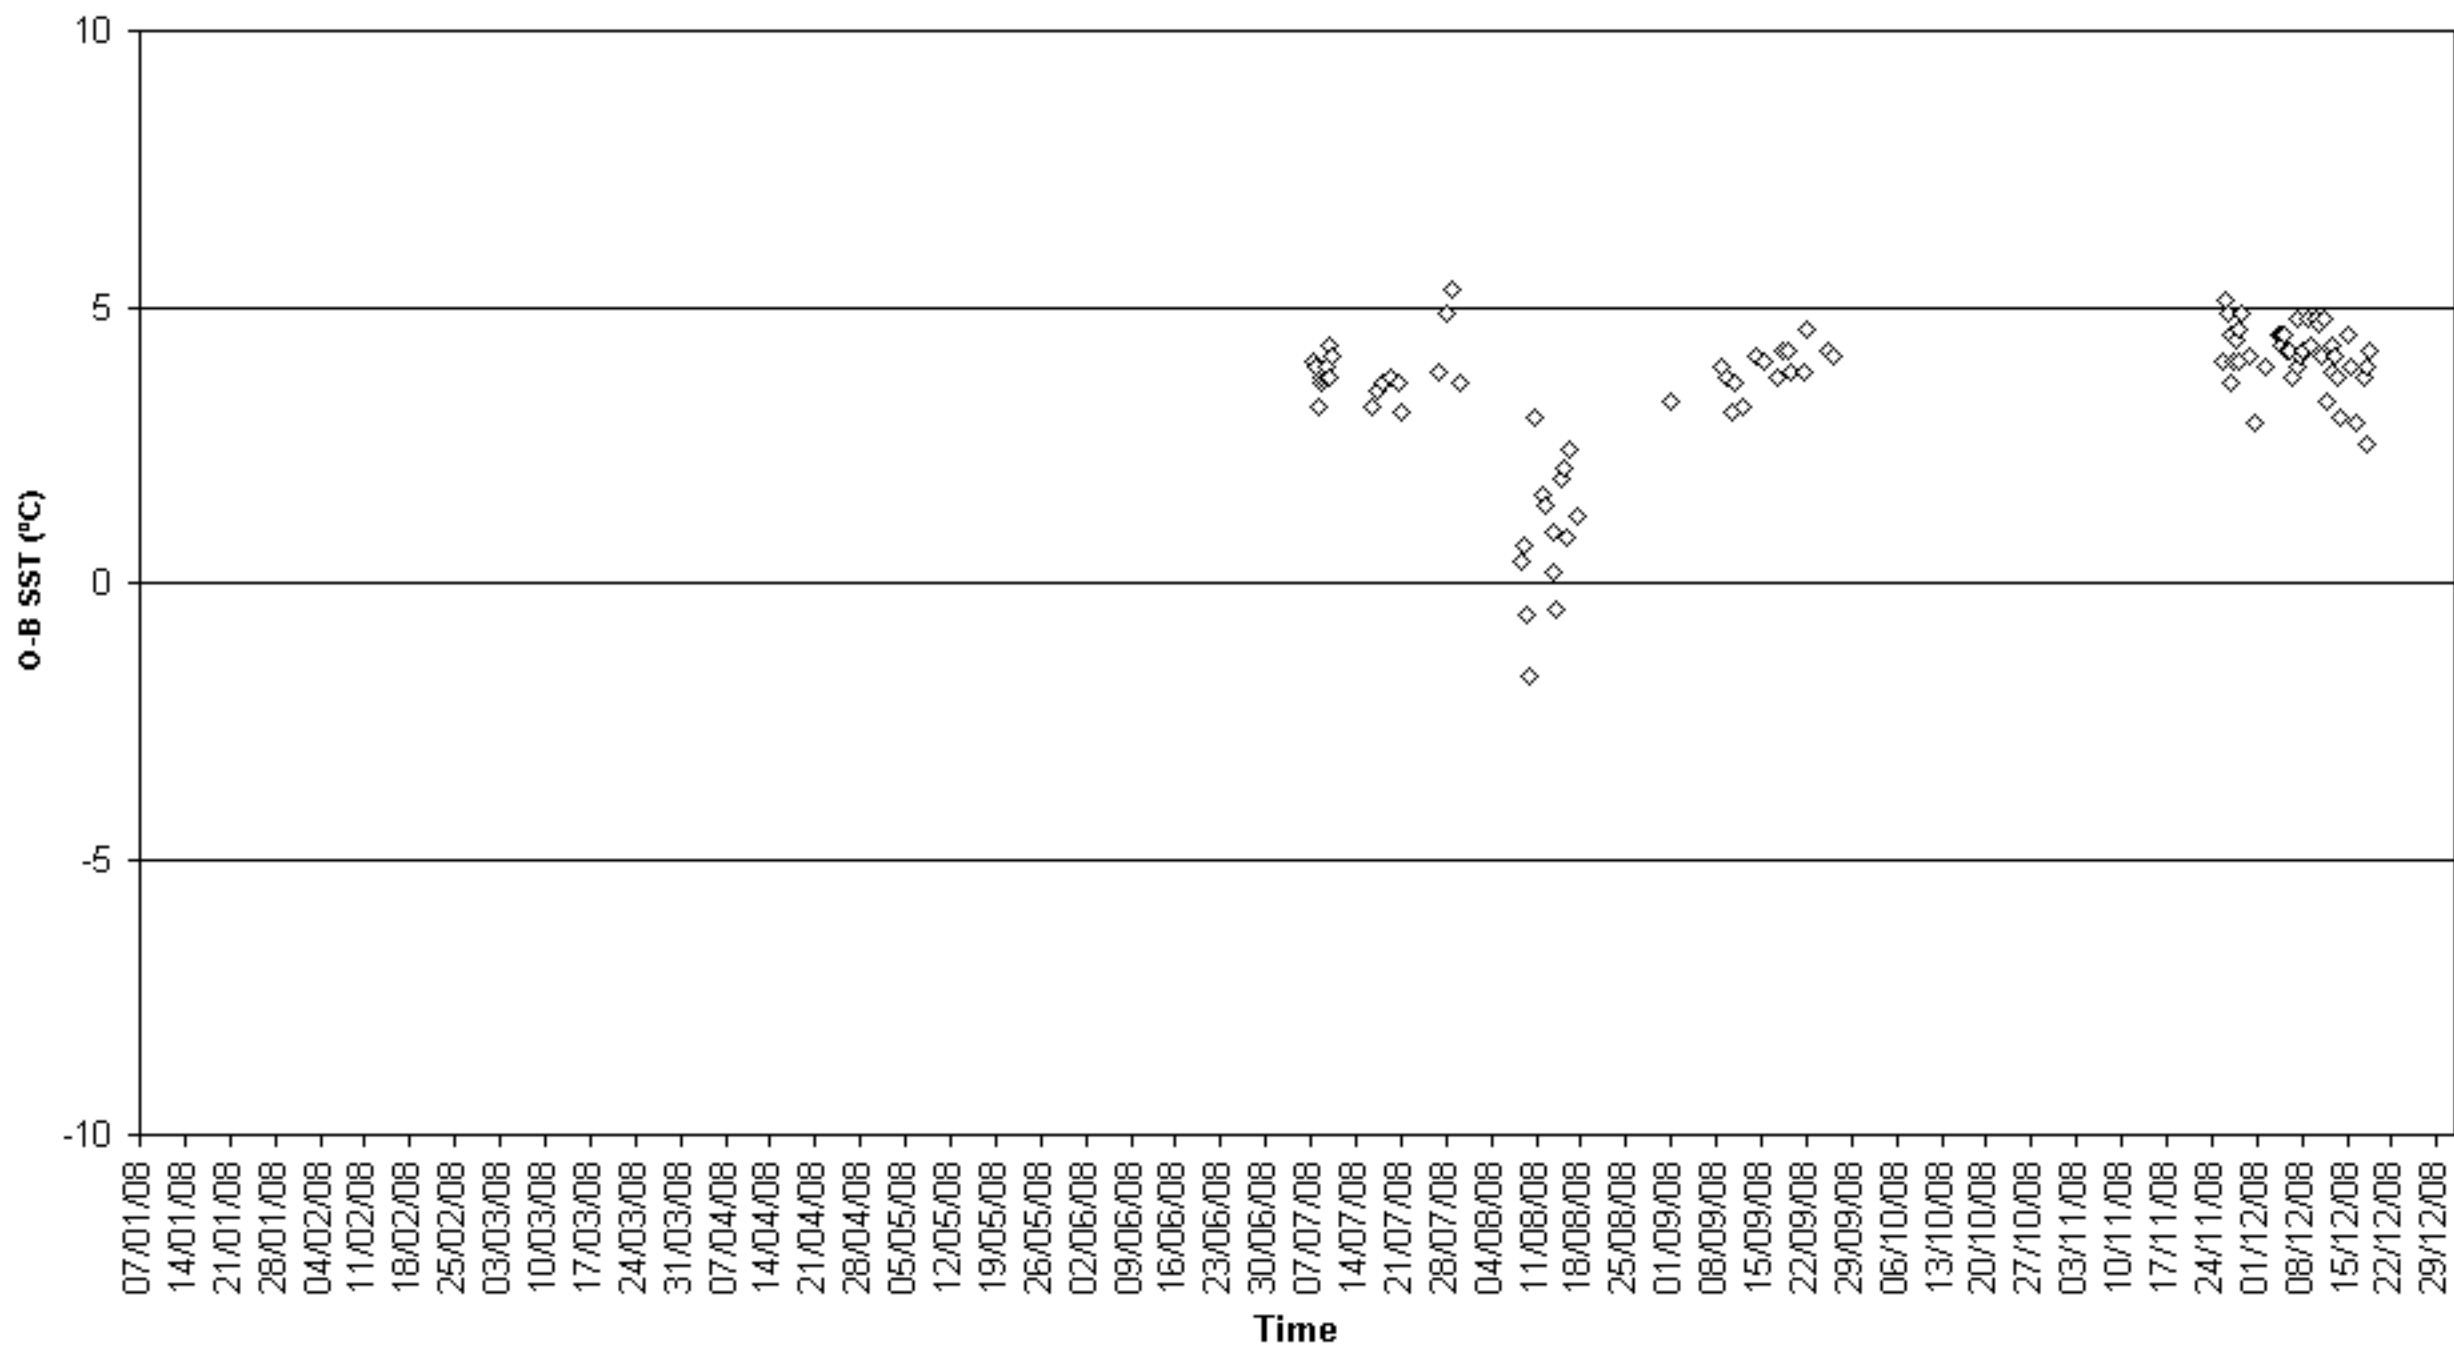


O-B SST (°C) for identifier LAVX4  
Number of obs. plotted = 88 Number of outliers = 0

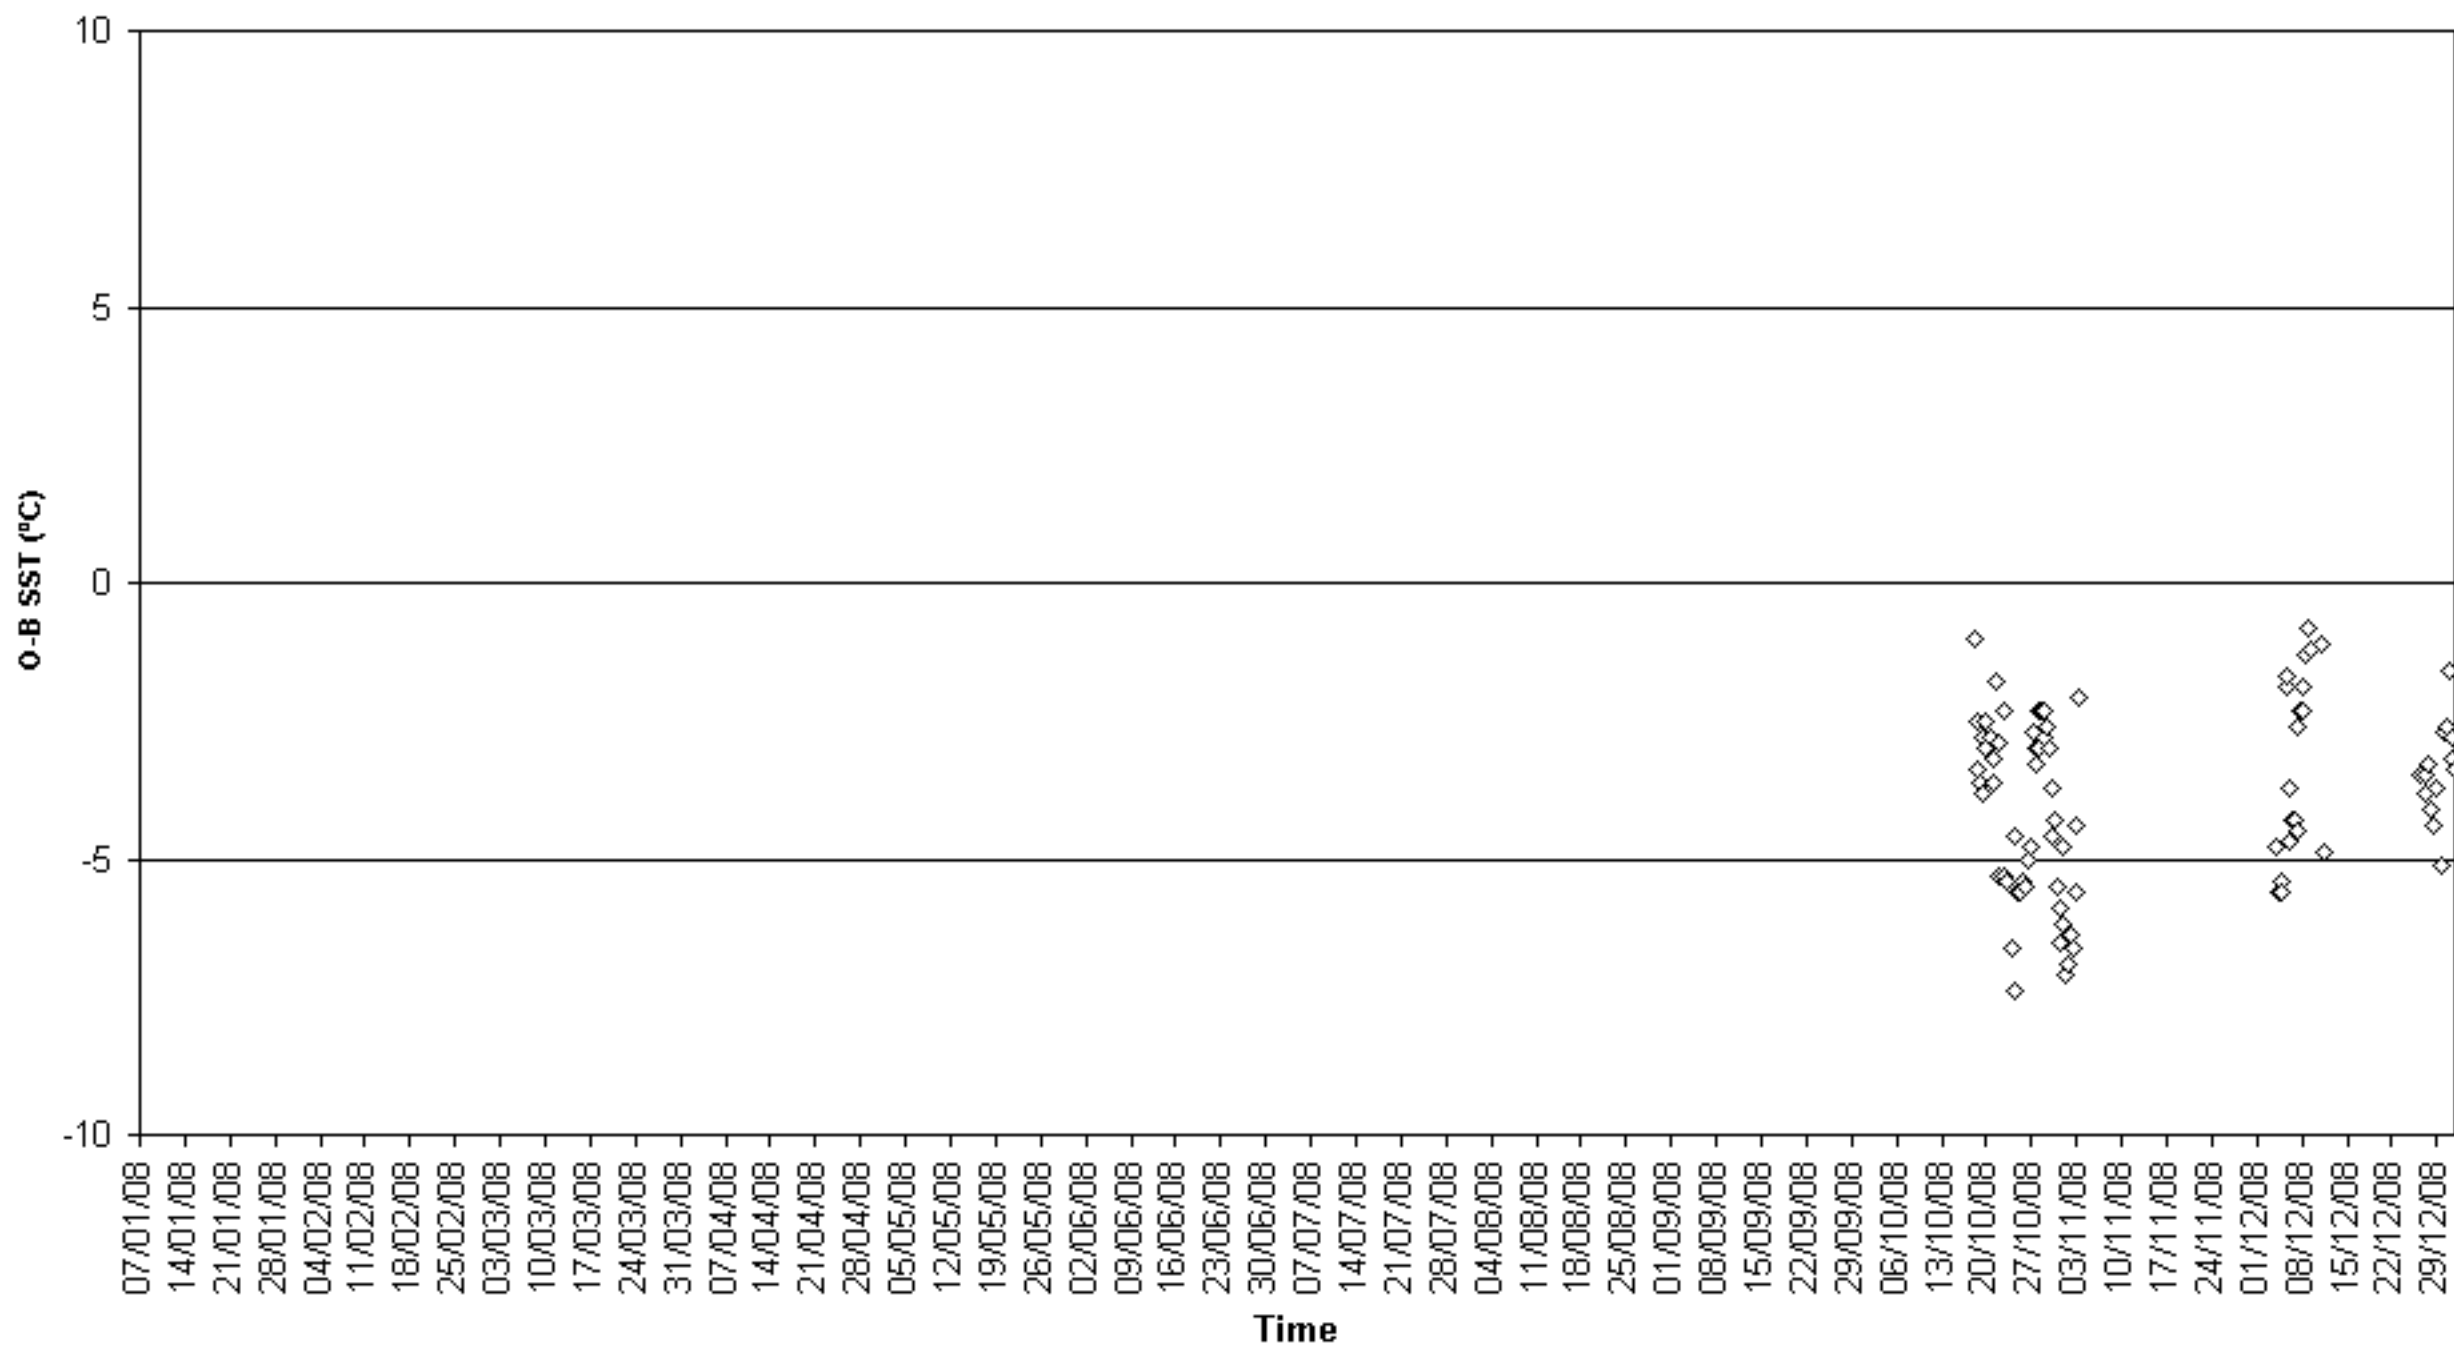


O-B SST (°C) for identifier ONAN  
Number of obs. plotted = 179 Number of outliers = 4

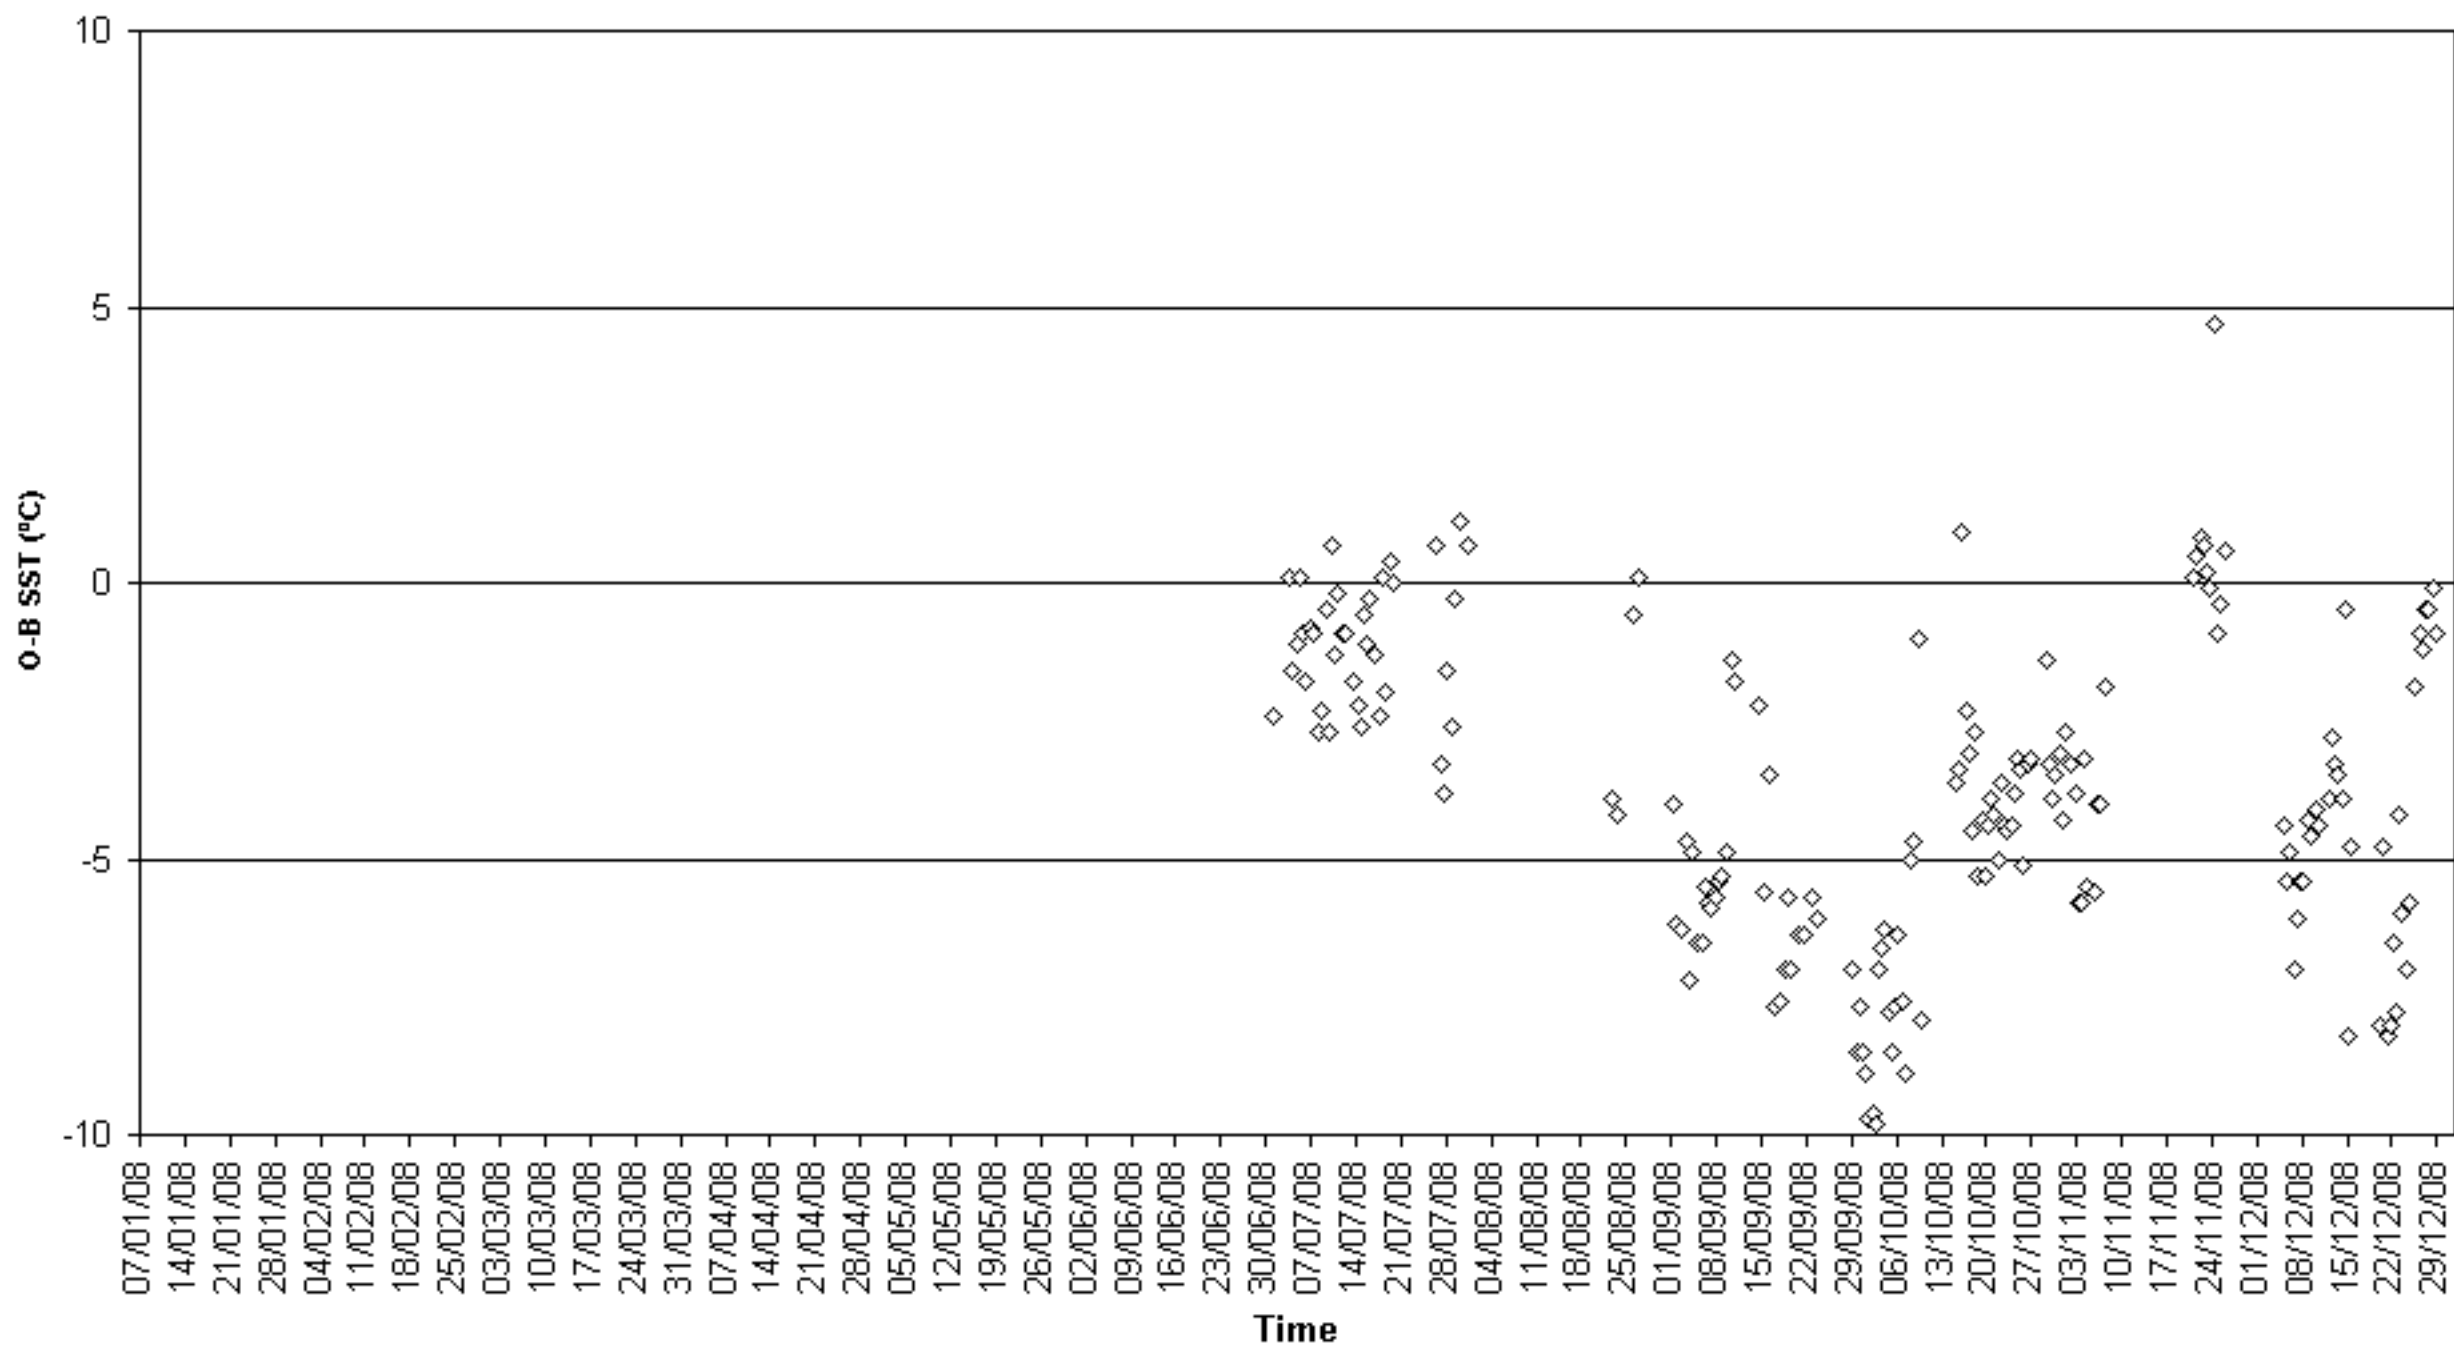

O-B SST (°C) for identifier PHHQ  
Number of obs. plotted = 41 Number of outliers = 0

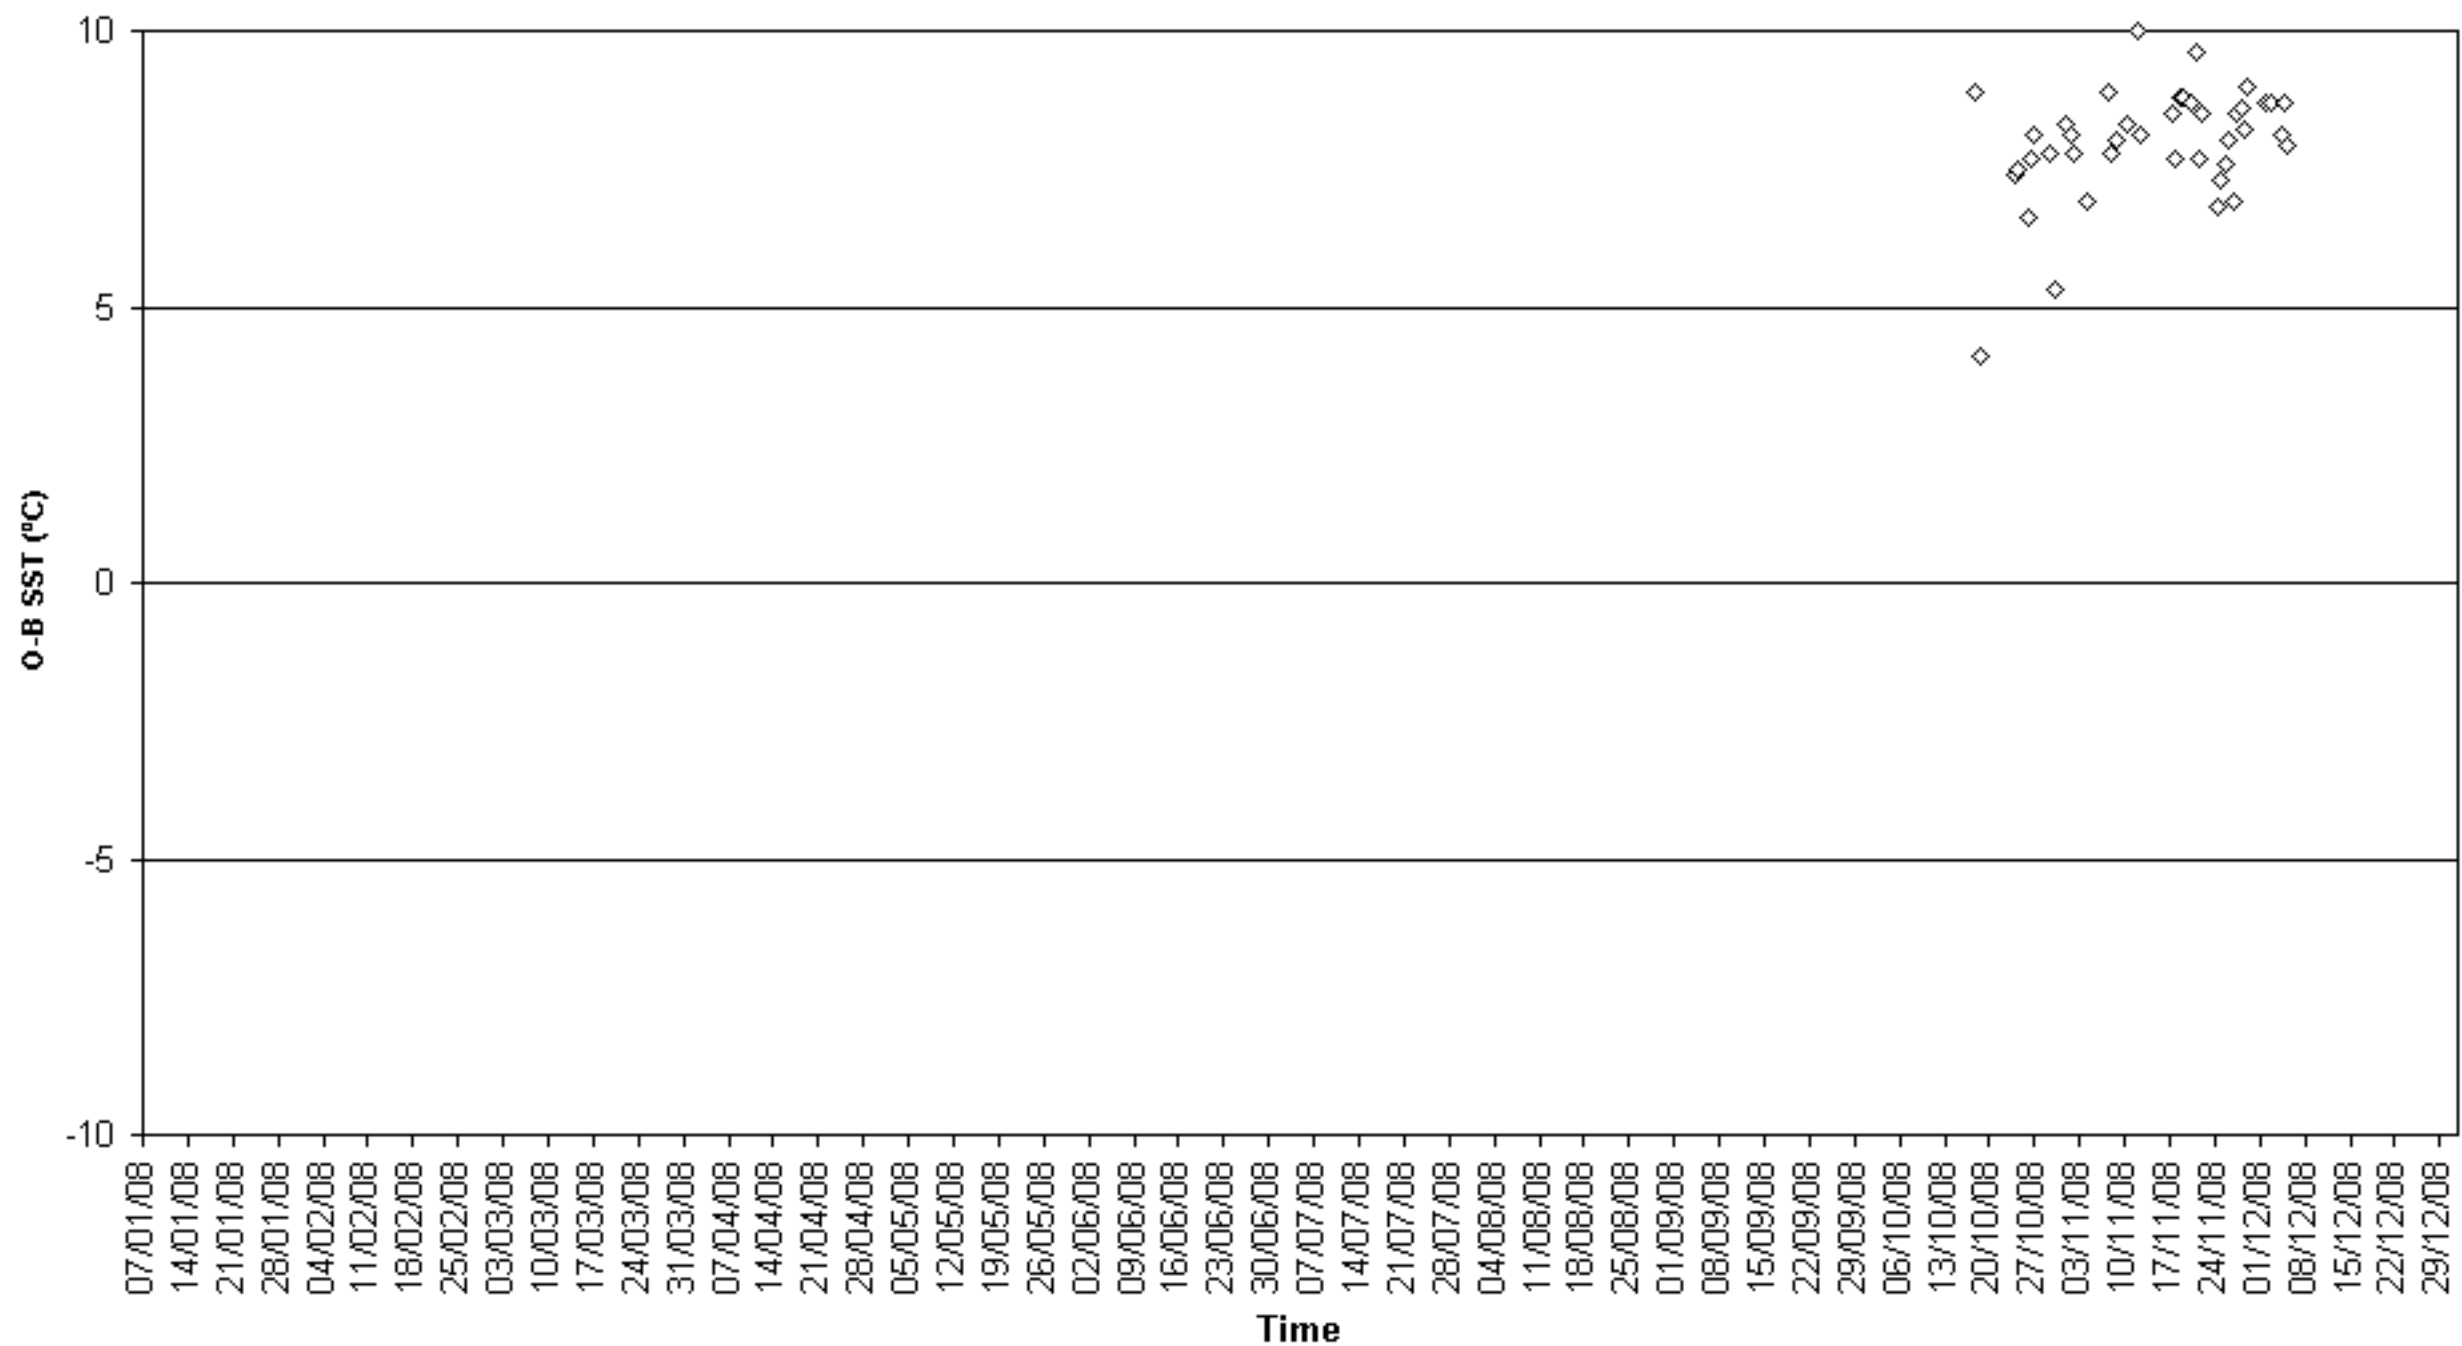


O-B SST (°C) for identifier S6TS  
Number of obs. plotted = 99 Number of outliers = 1

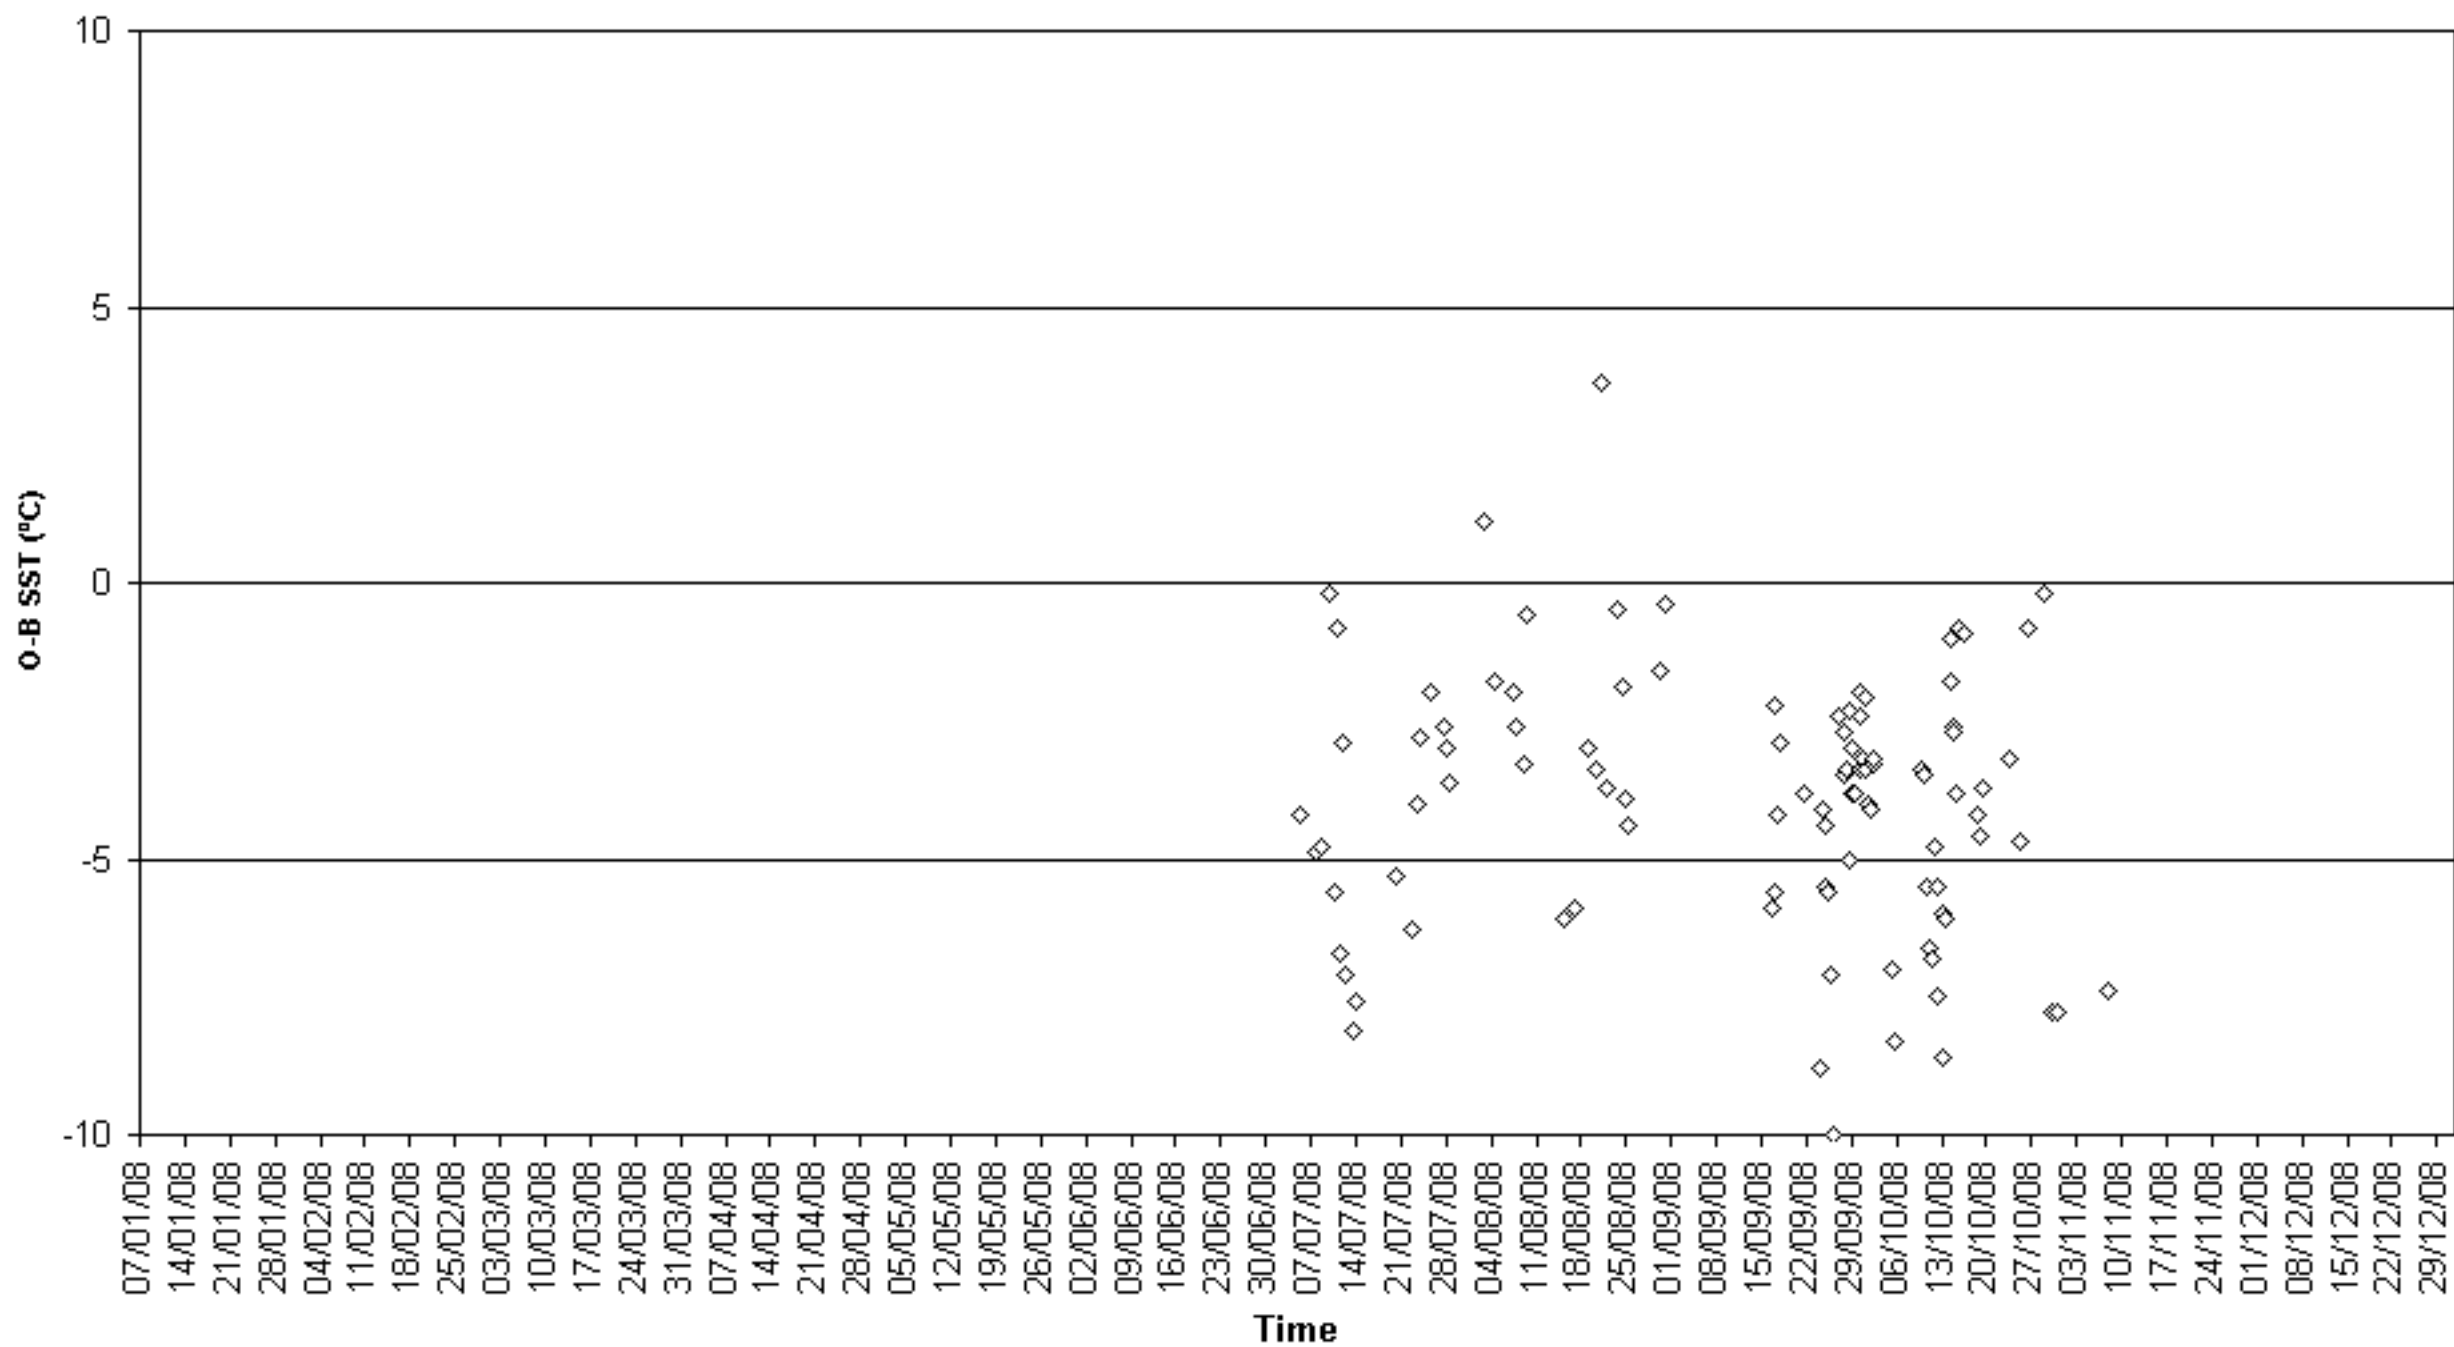





O-B SST (°C) for identifier SGBA  
Number of obs. plotted = 186 Number of outliers = 0

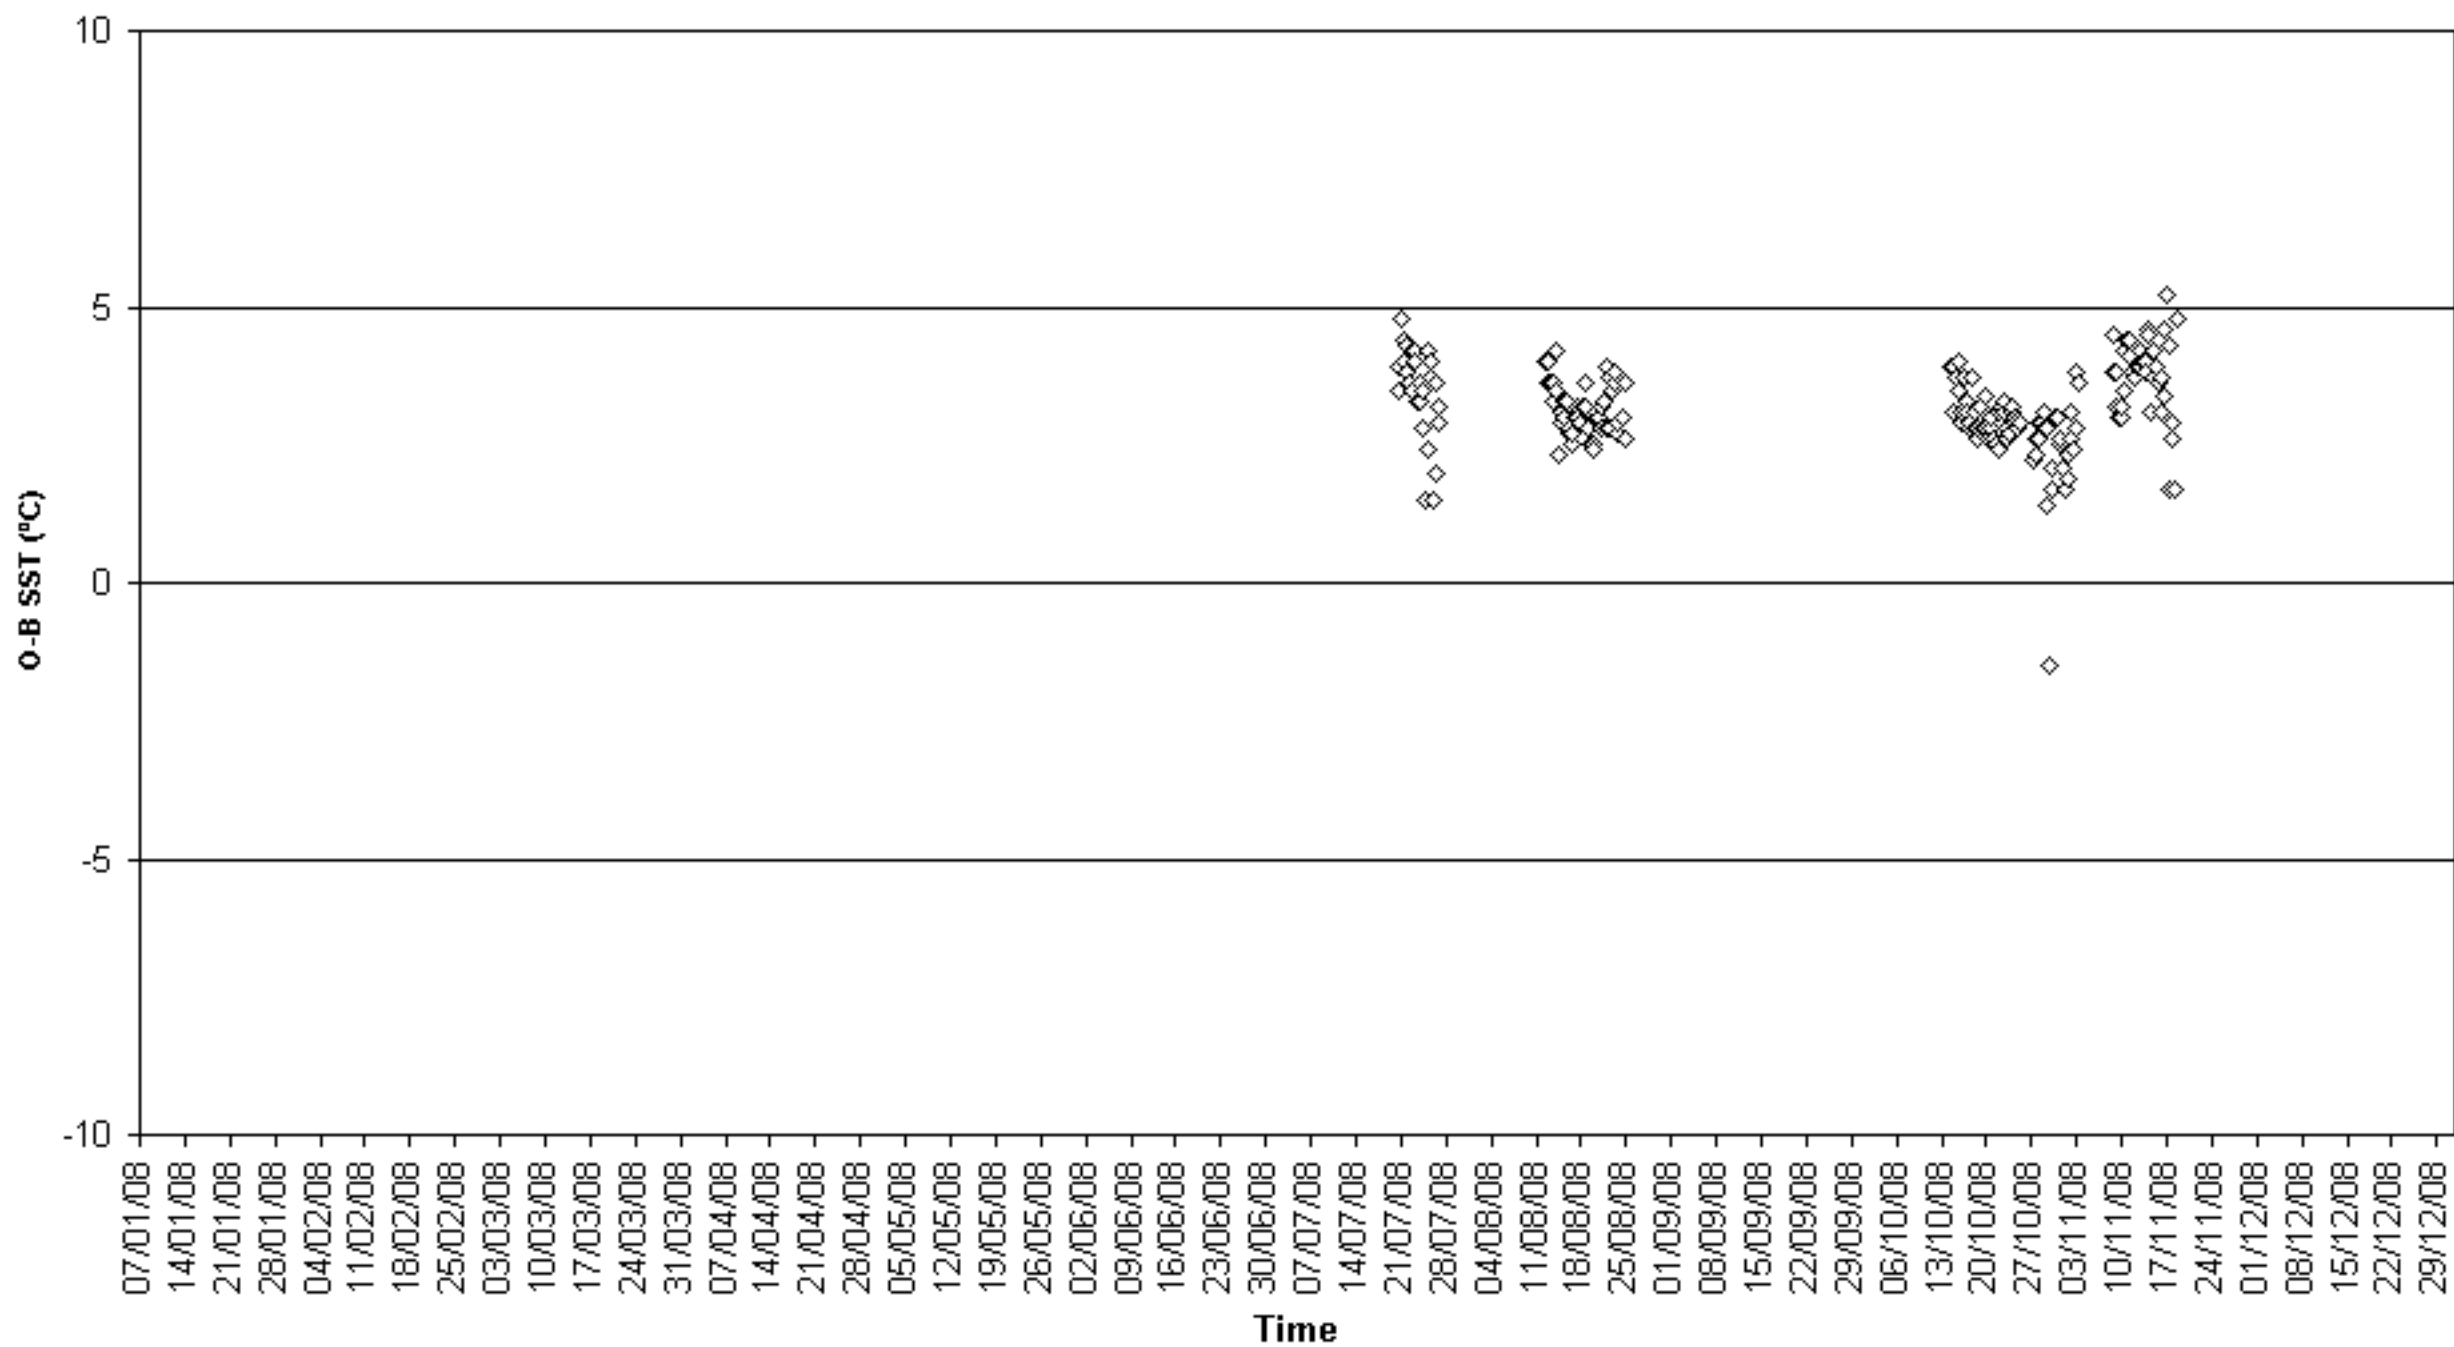


O-B SST (°C) for identifier SLCI  
Number of obs. plotted = 131 Number of outliers = 0

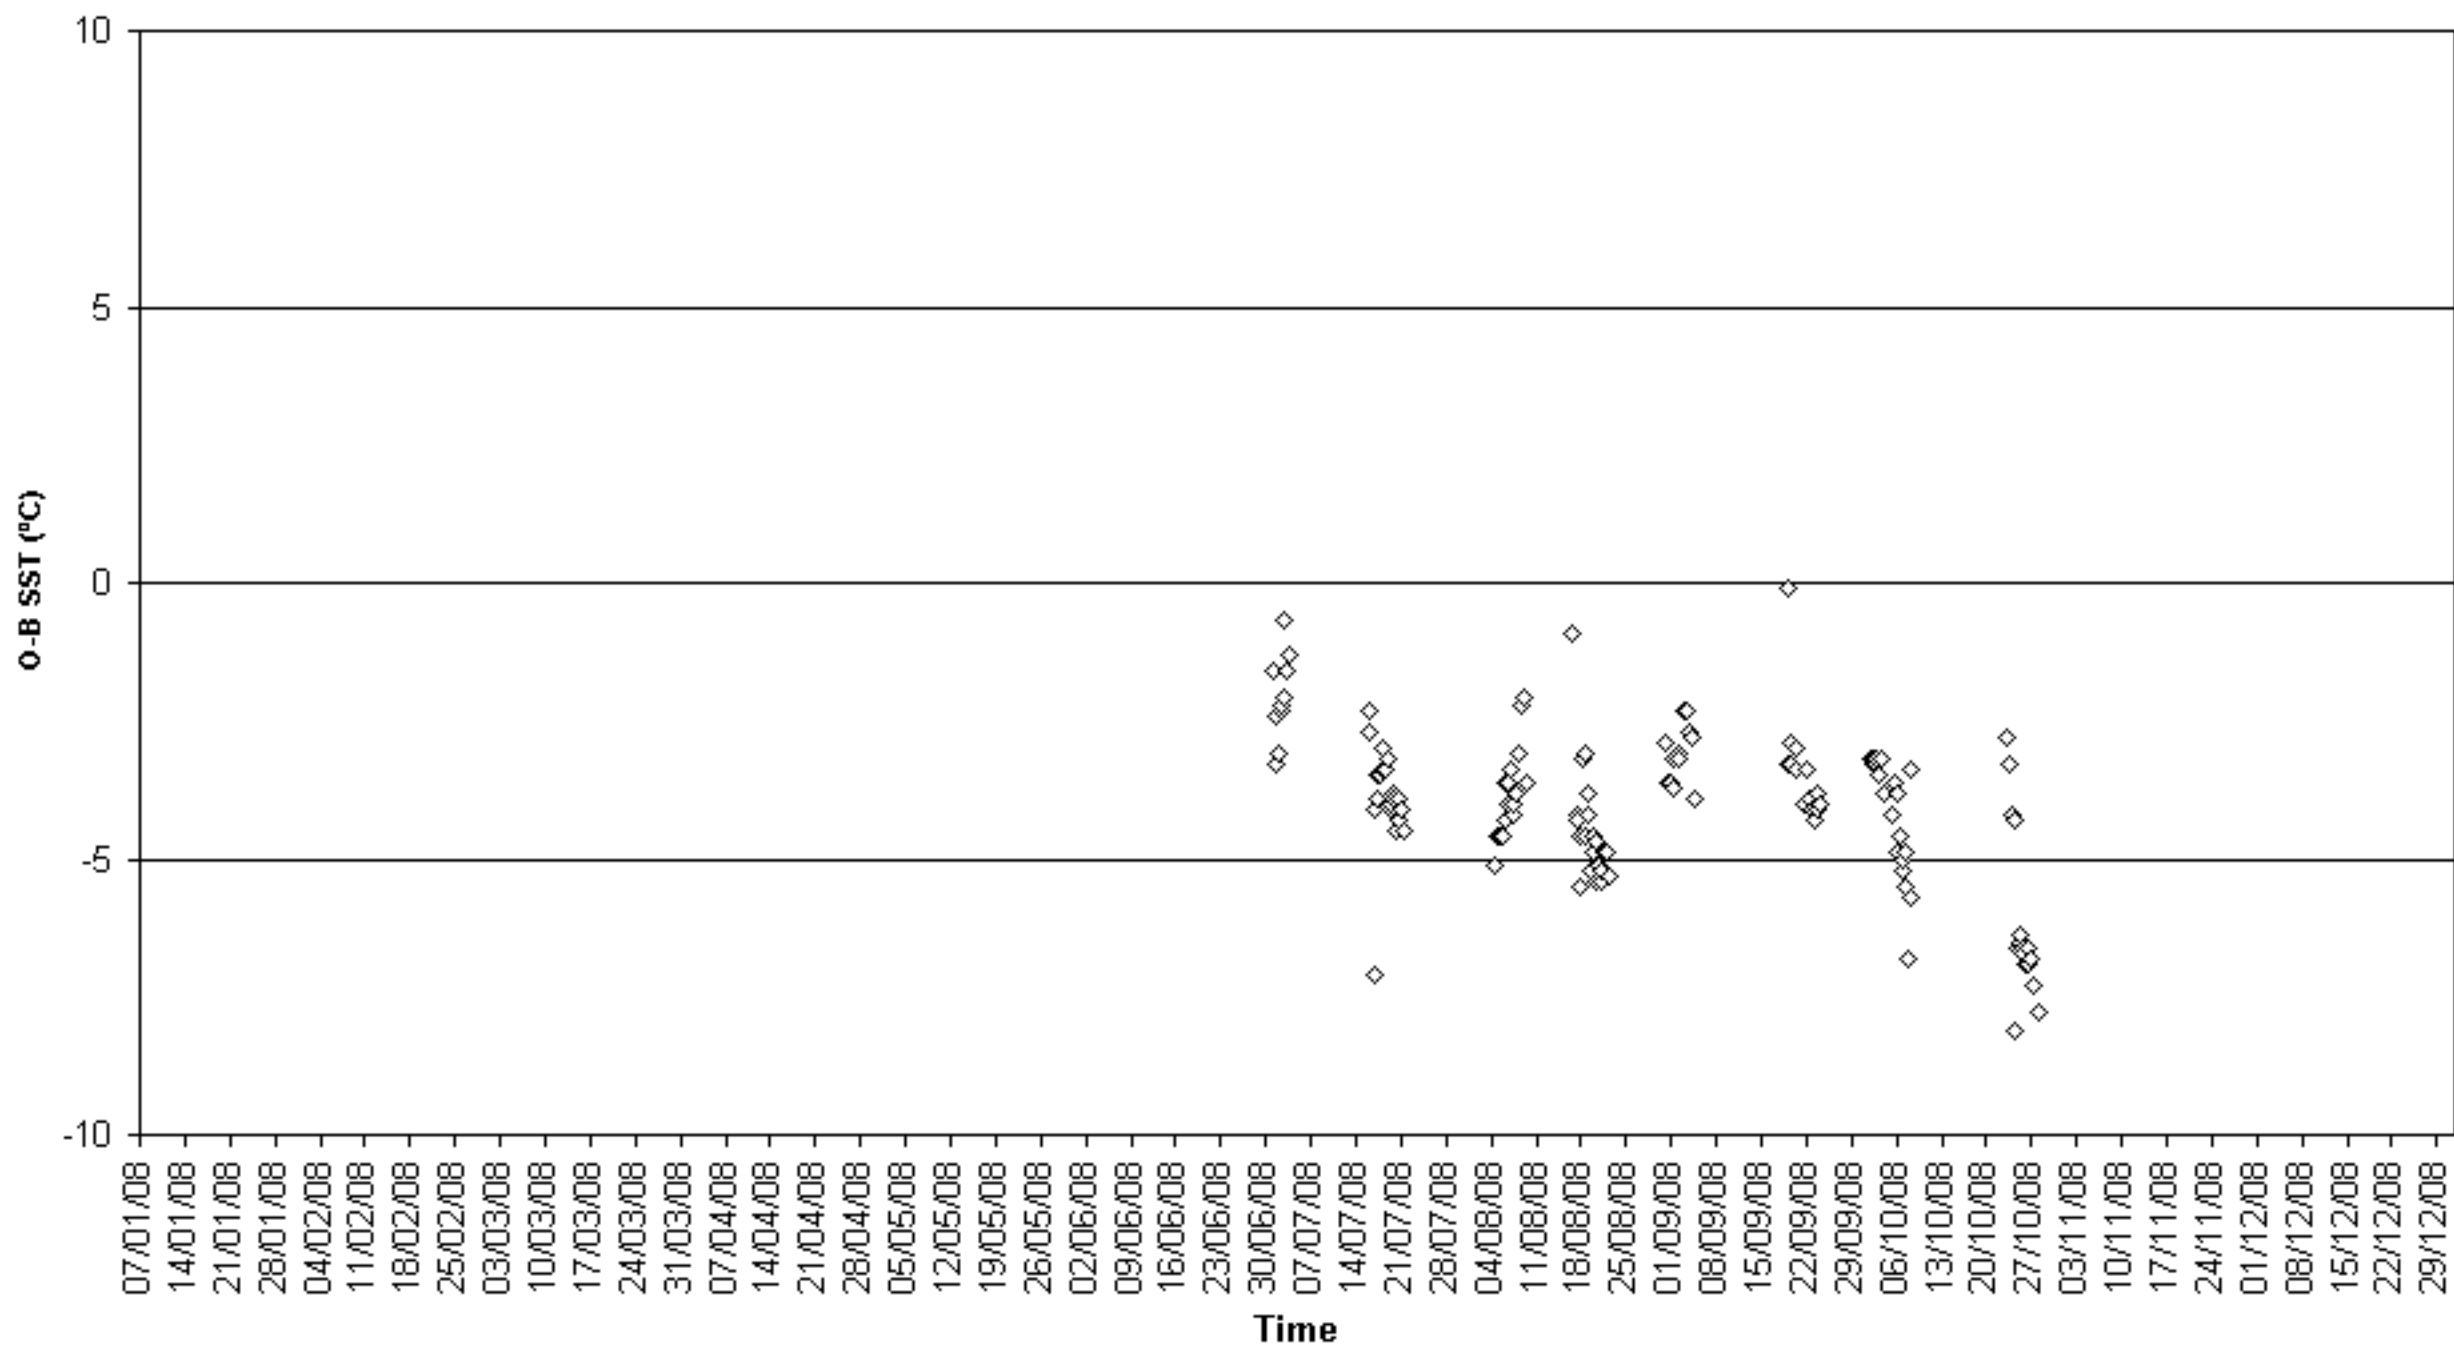


O-B SST (°C) for identifier SVMA  
Number of obs. plotted = 57 Number of outliers = 0

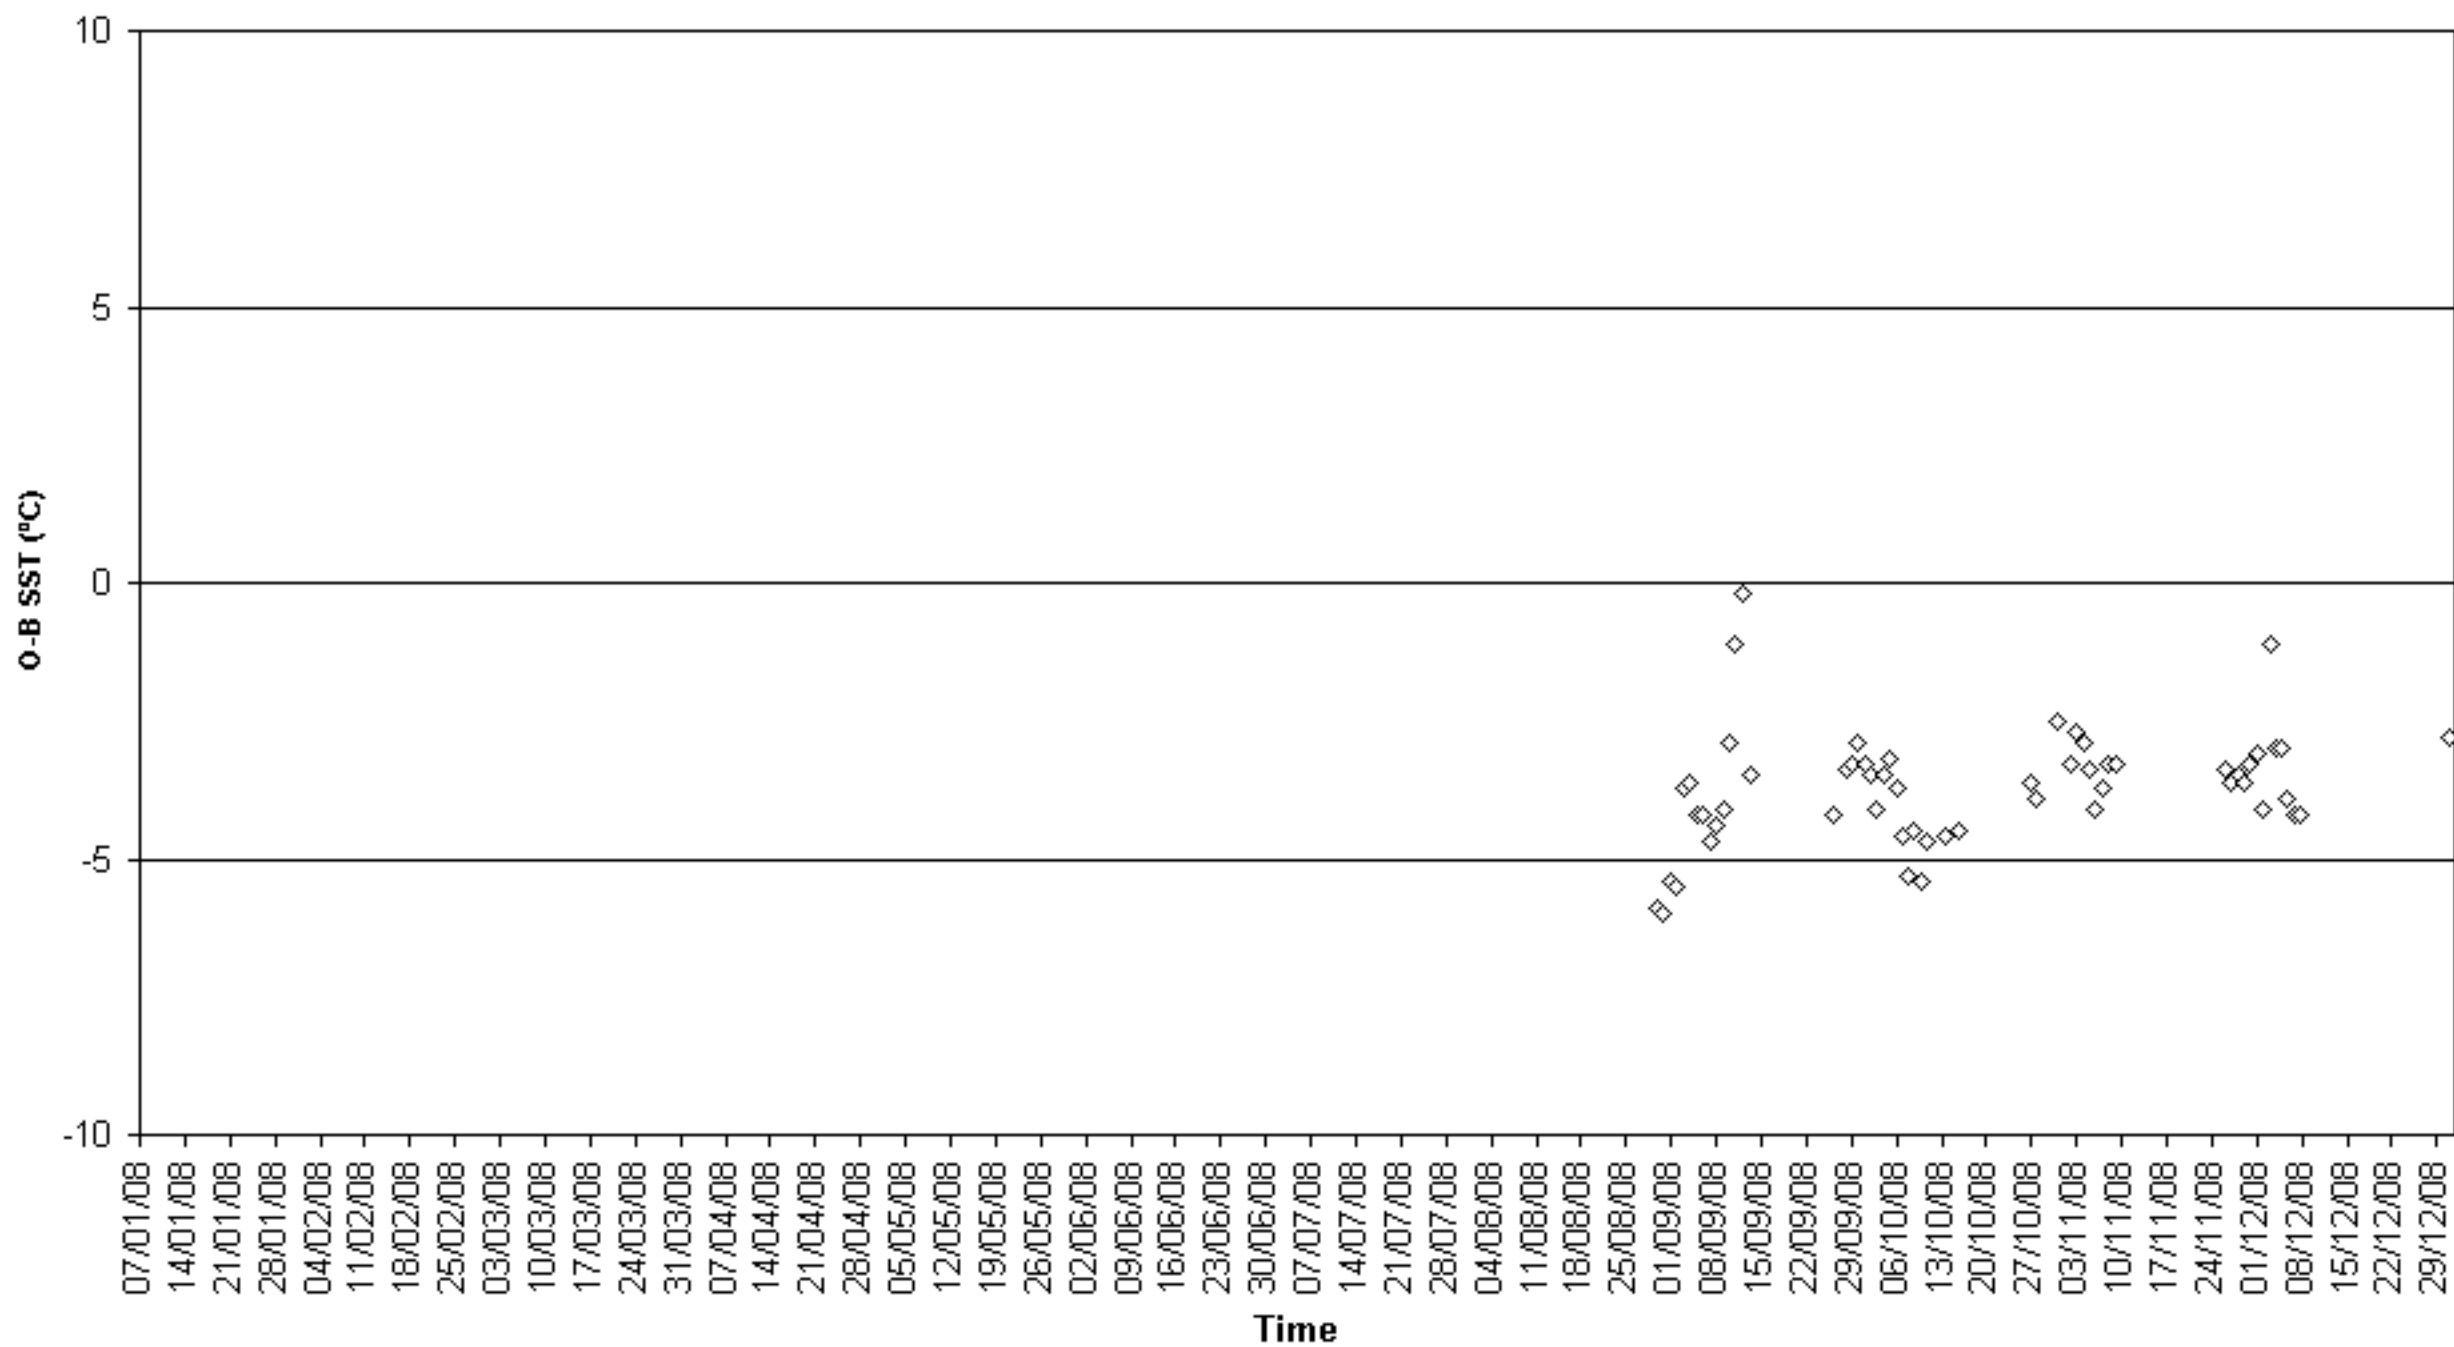


O-B SST (°C) for identifier SYMK  
Number of obs. plotted = 41 Number of outliers = 5

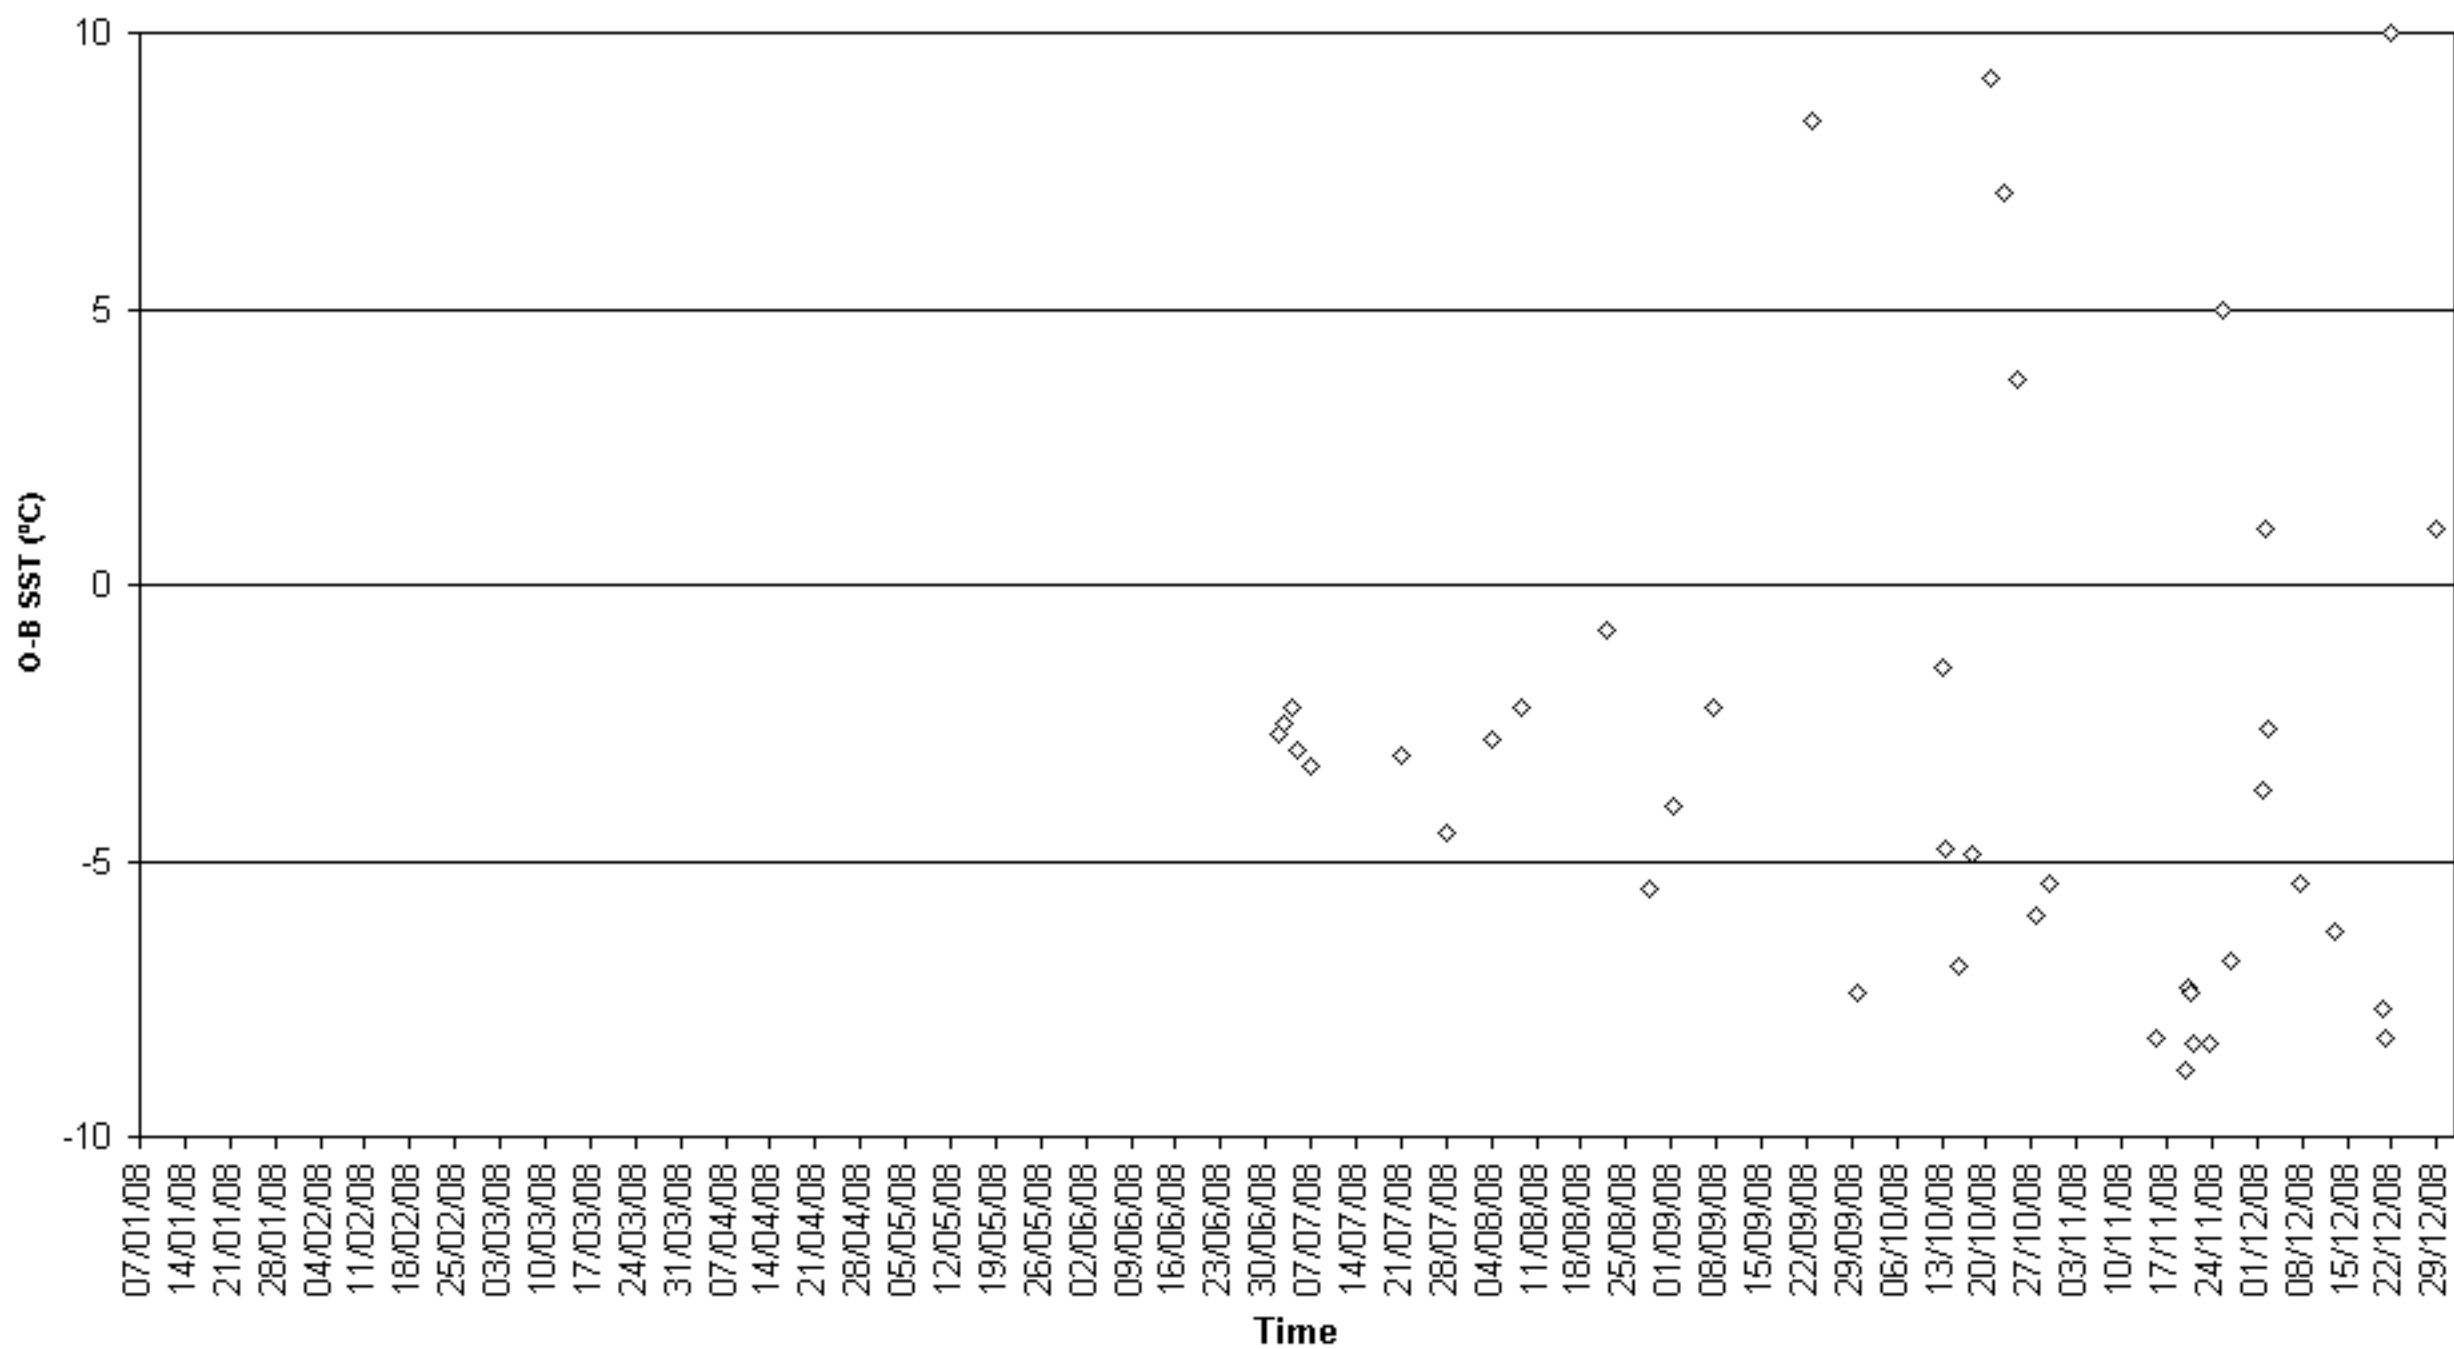


O-B SST (°C) for identifier UACU  
Number of obs. plotted = 95 Number of outliers = 5

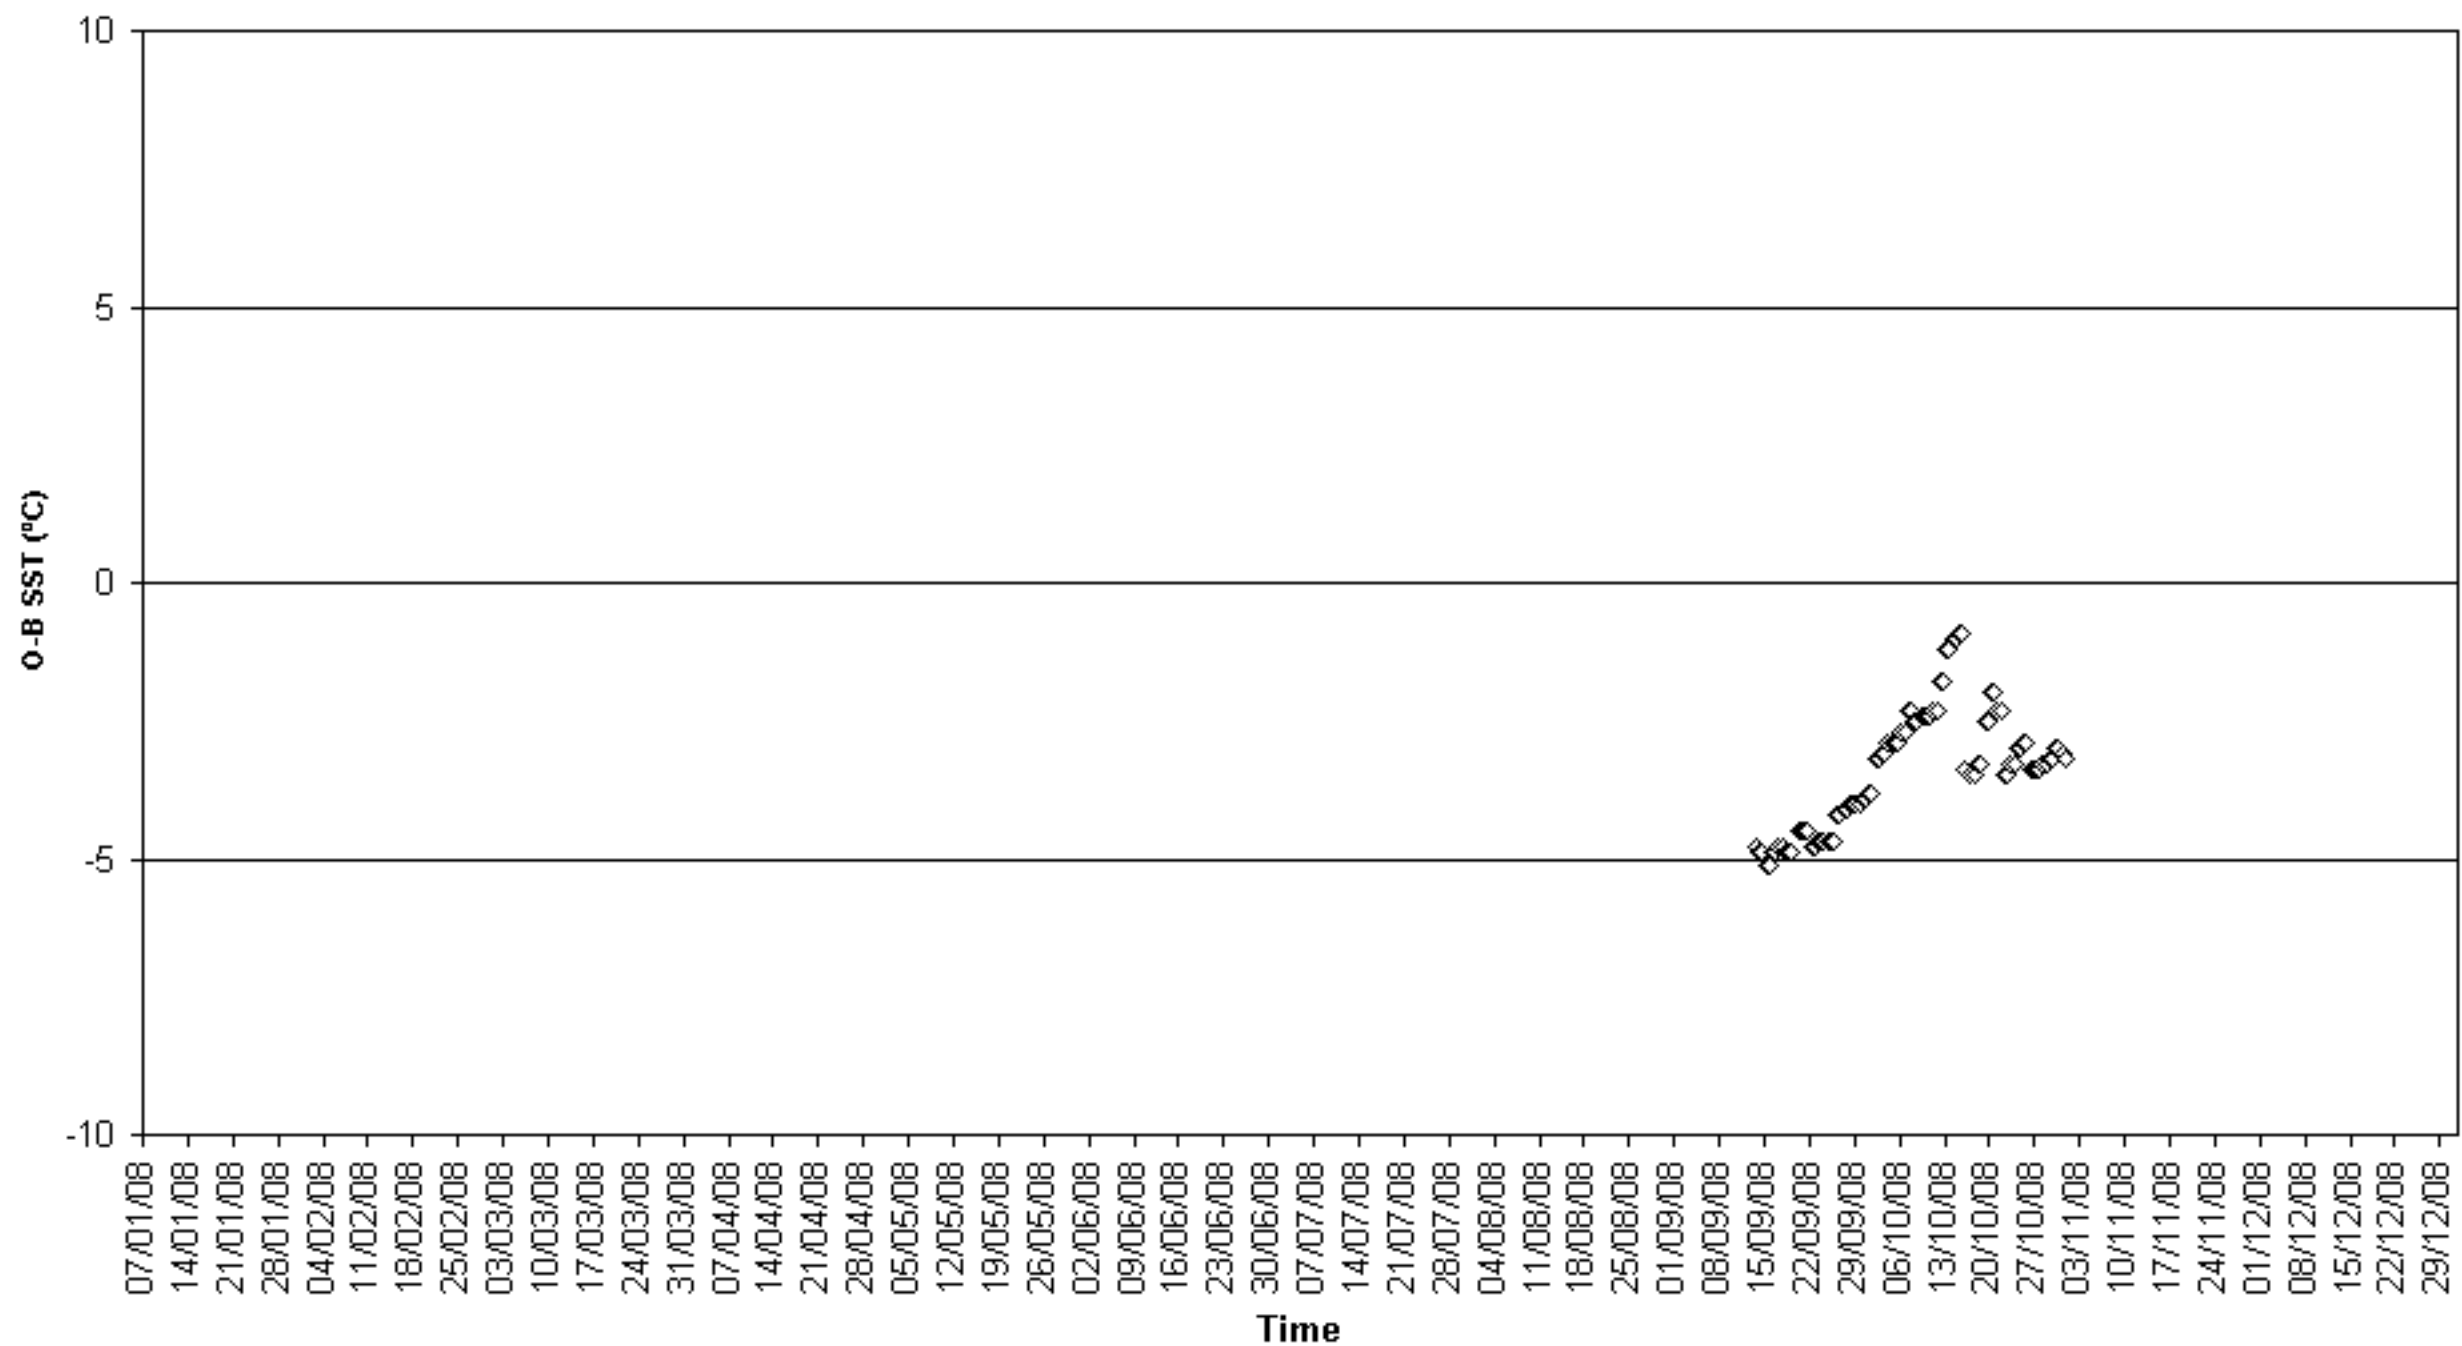


O-B SST (°C) for identifier UCDM  
Number of obs. plotted = 93 Number of outliers = 1

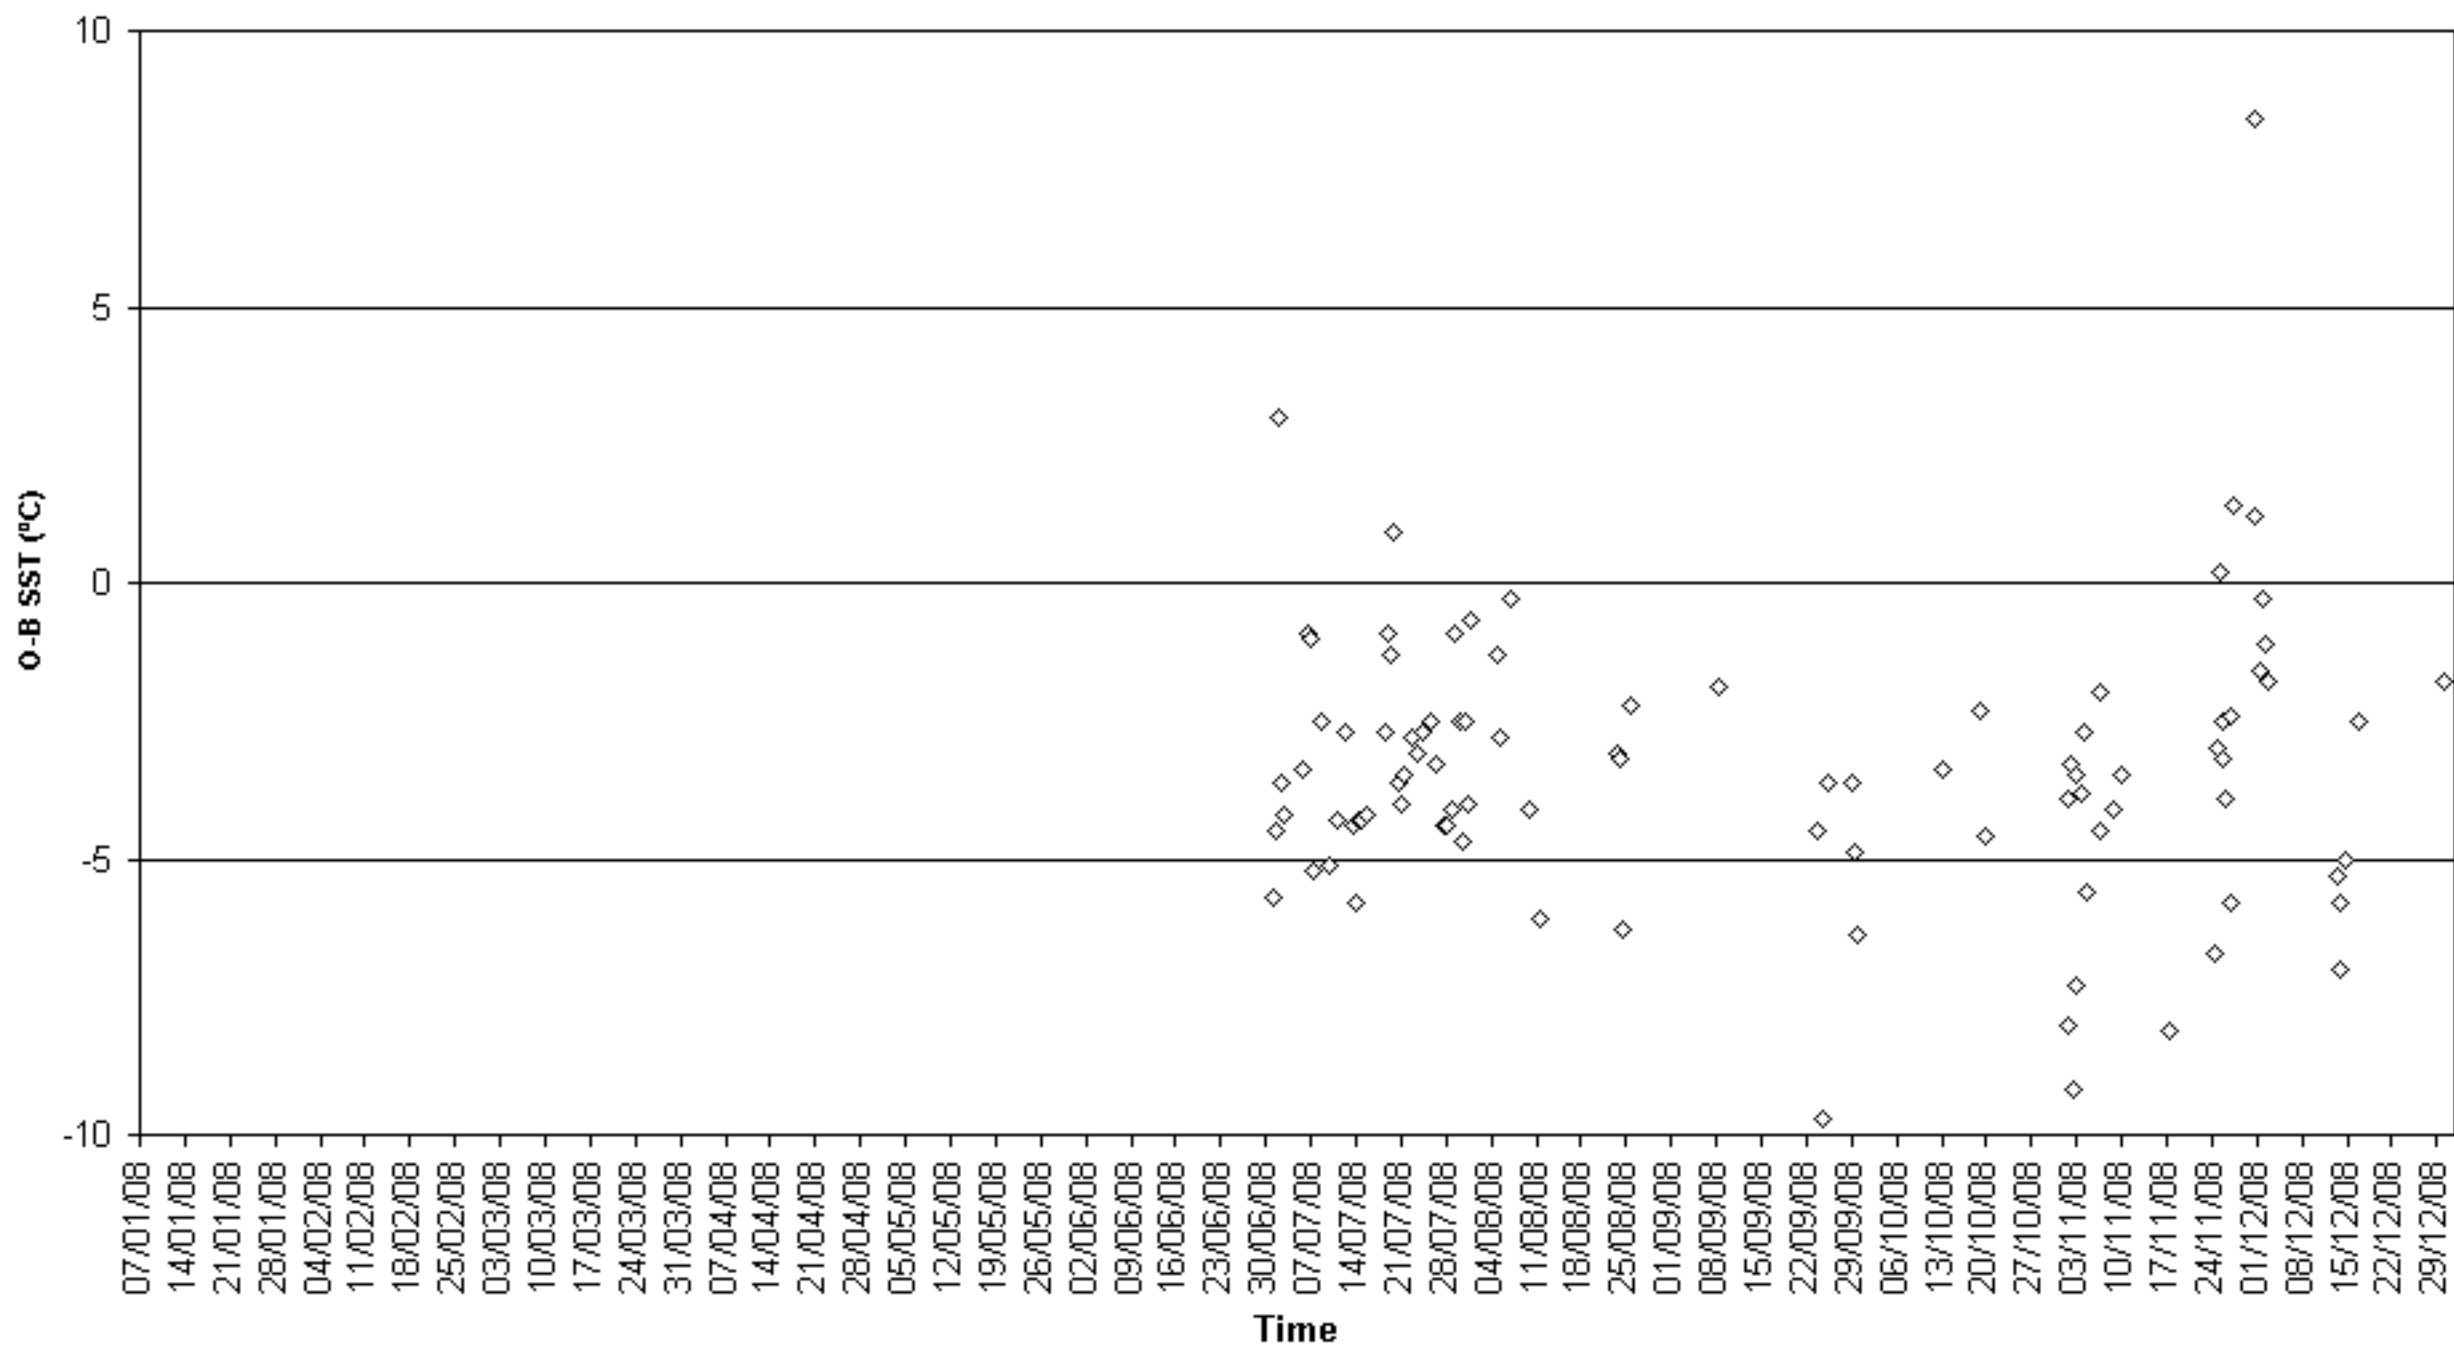

O-B SST (°C) for identifier UELS  
Number of obs. plotted = 56 Number of outliers = 0

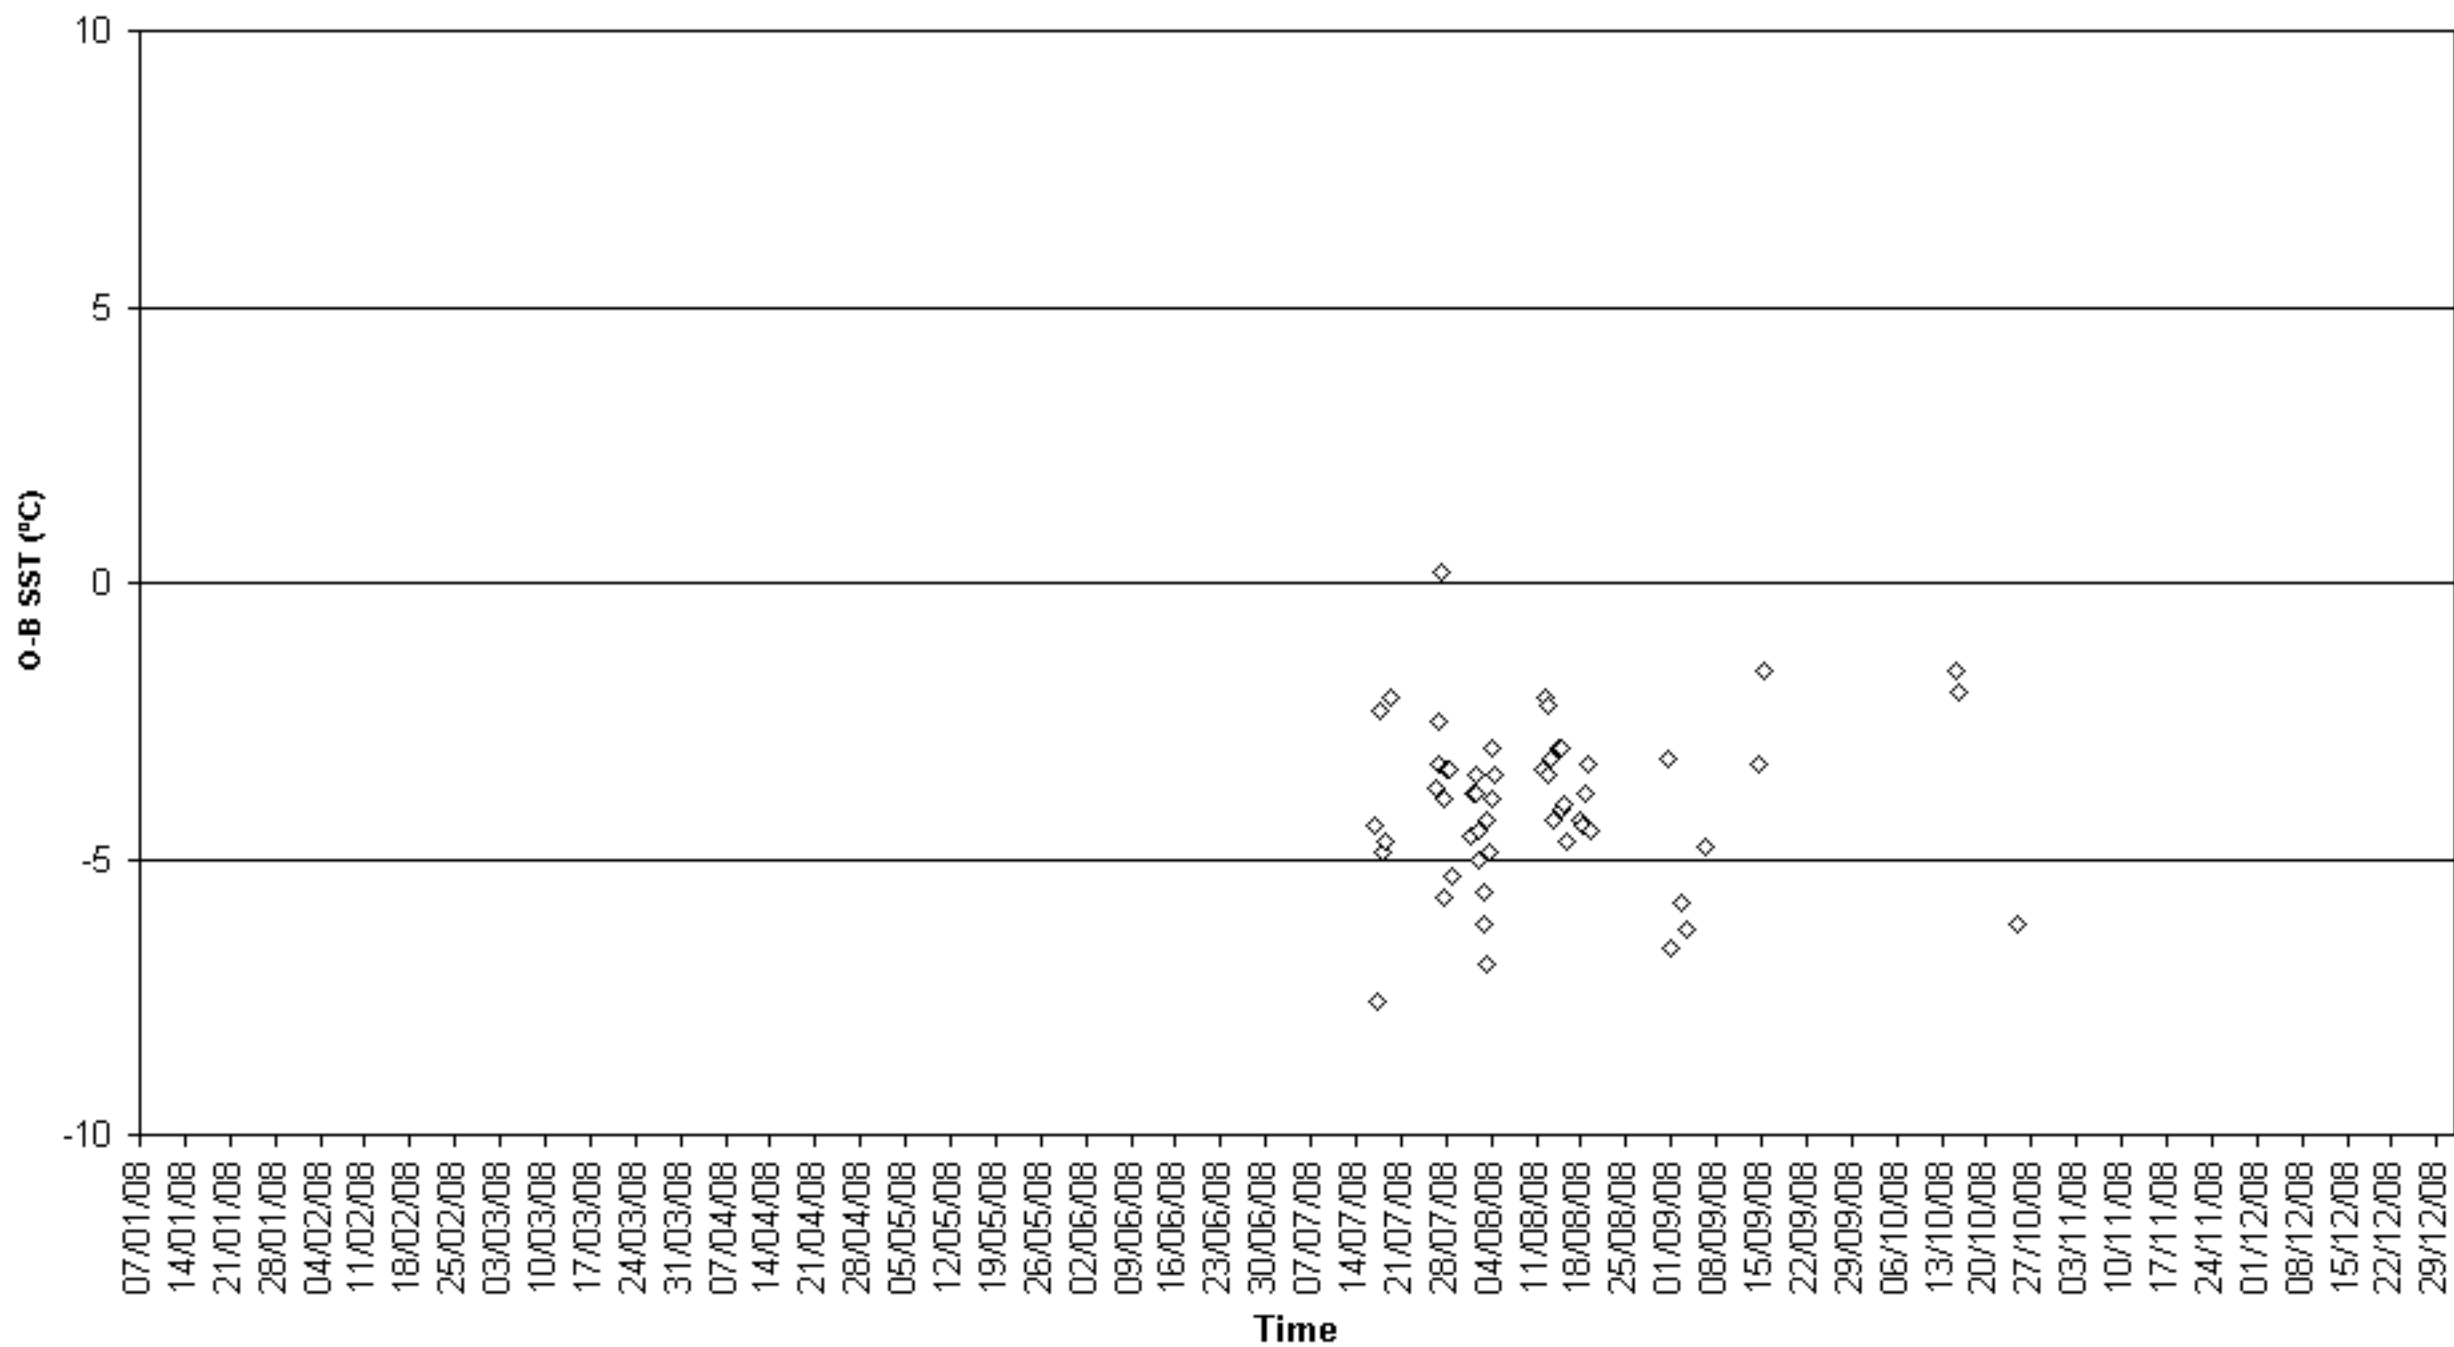


O-B SST (°C) for identifier V2LA8  
Number of obs. plotted = 70 Number of outliers = 0

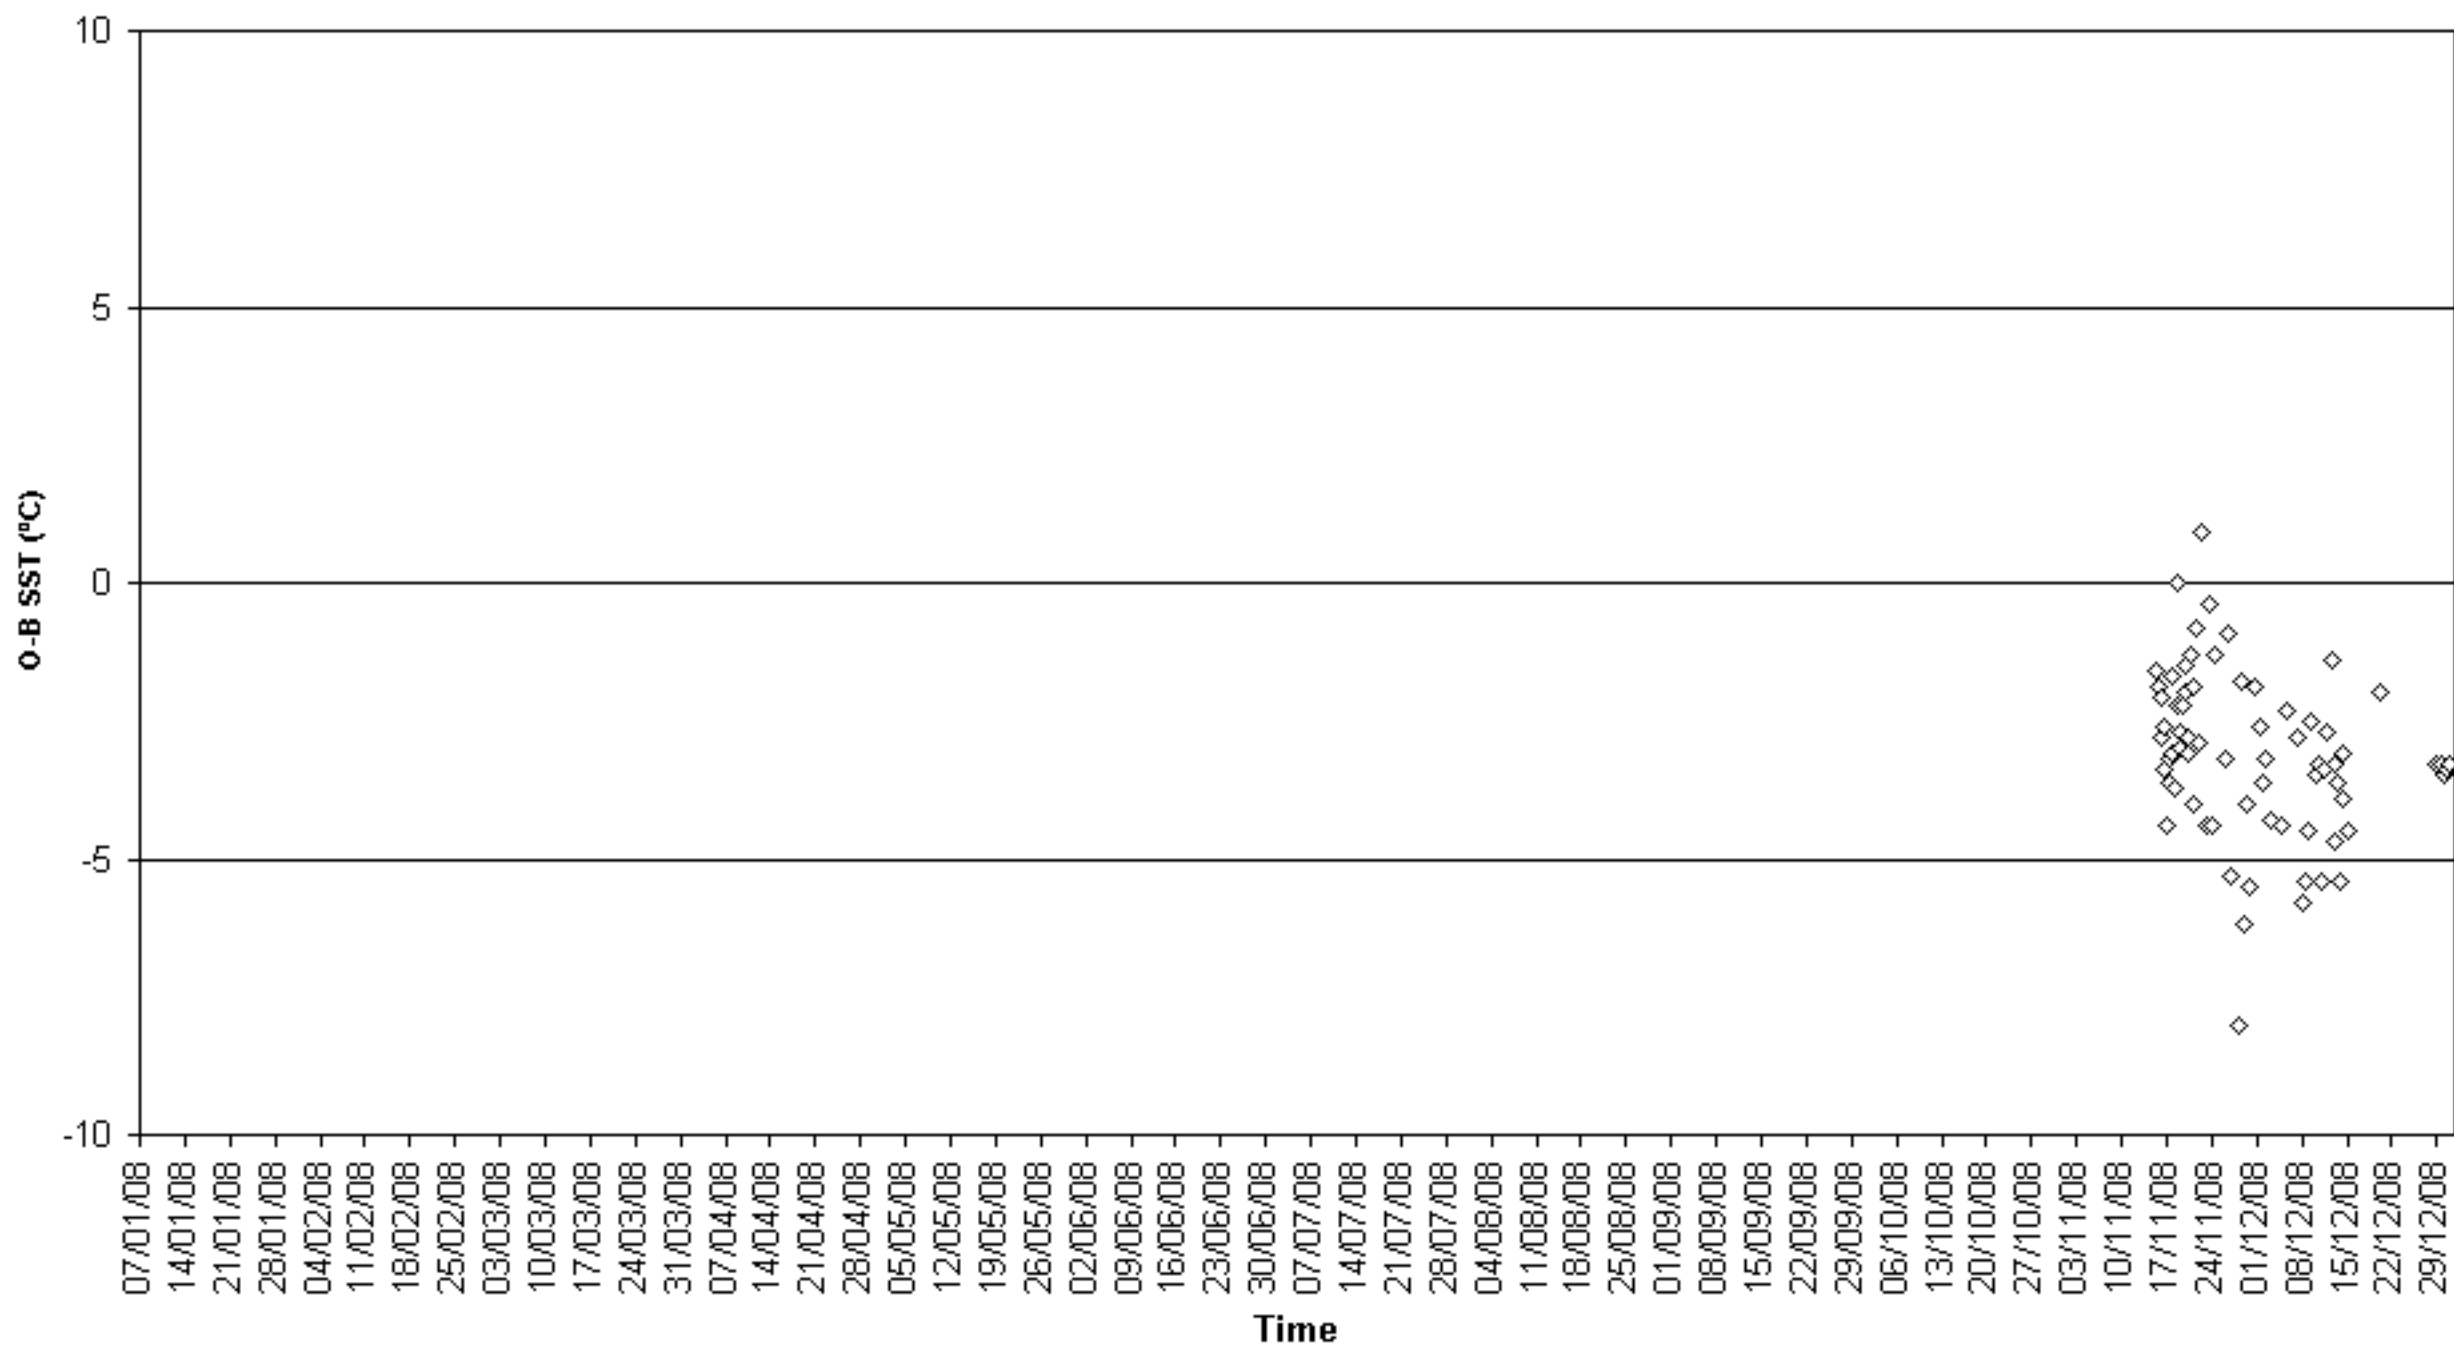





O-B SST (°C) for identifier V7DI7  
Number of obs. plotted = 204 Number of outliers = 0

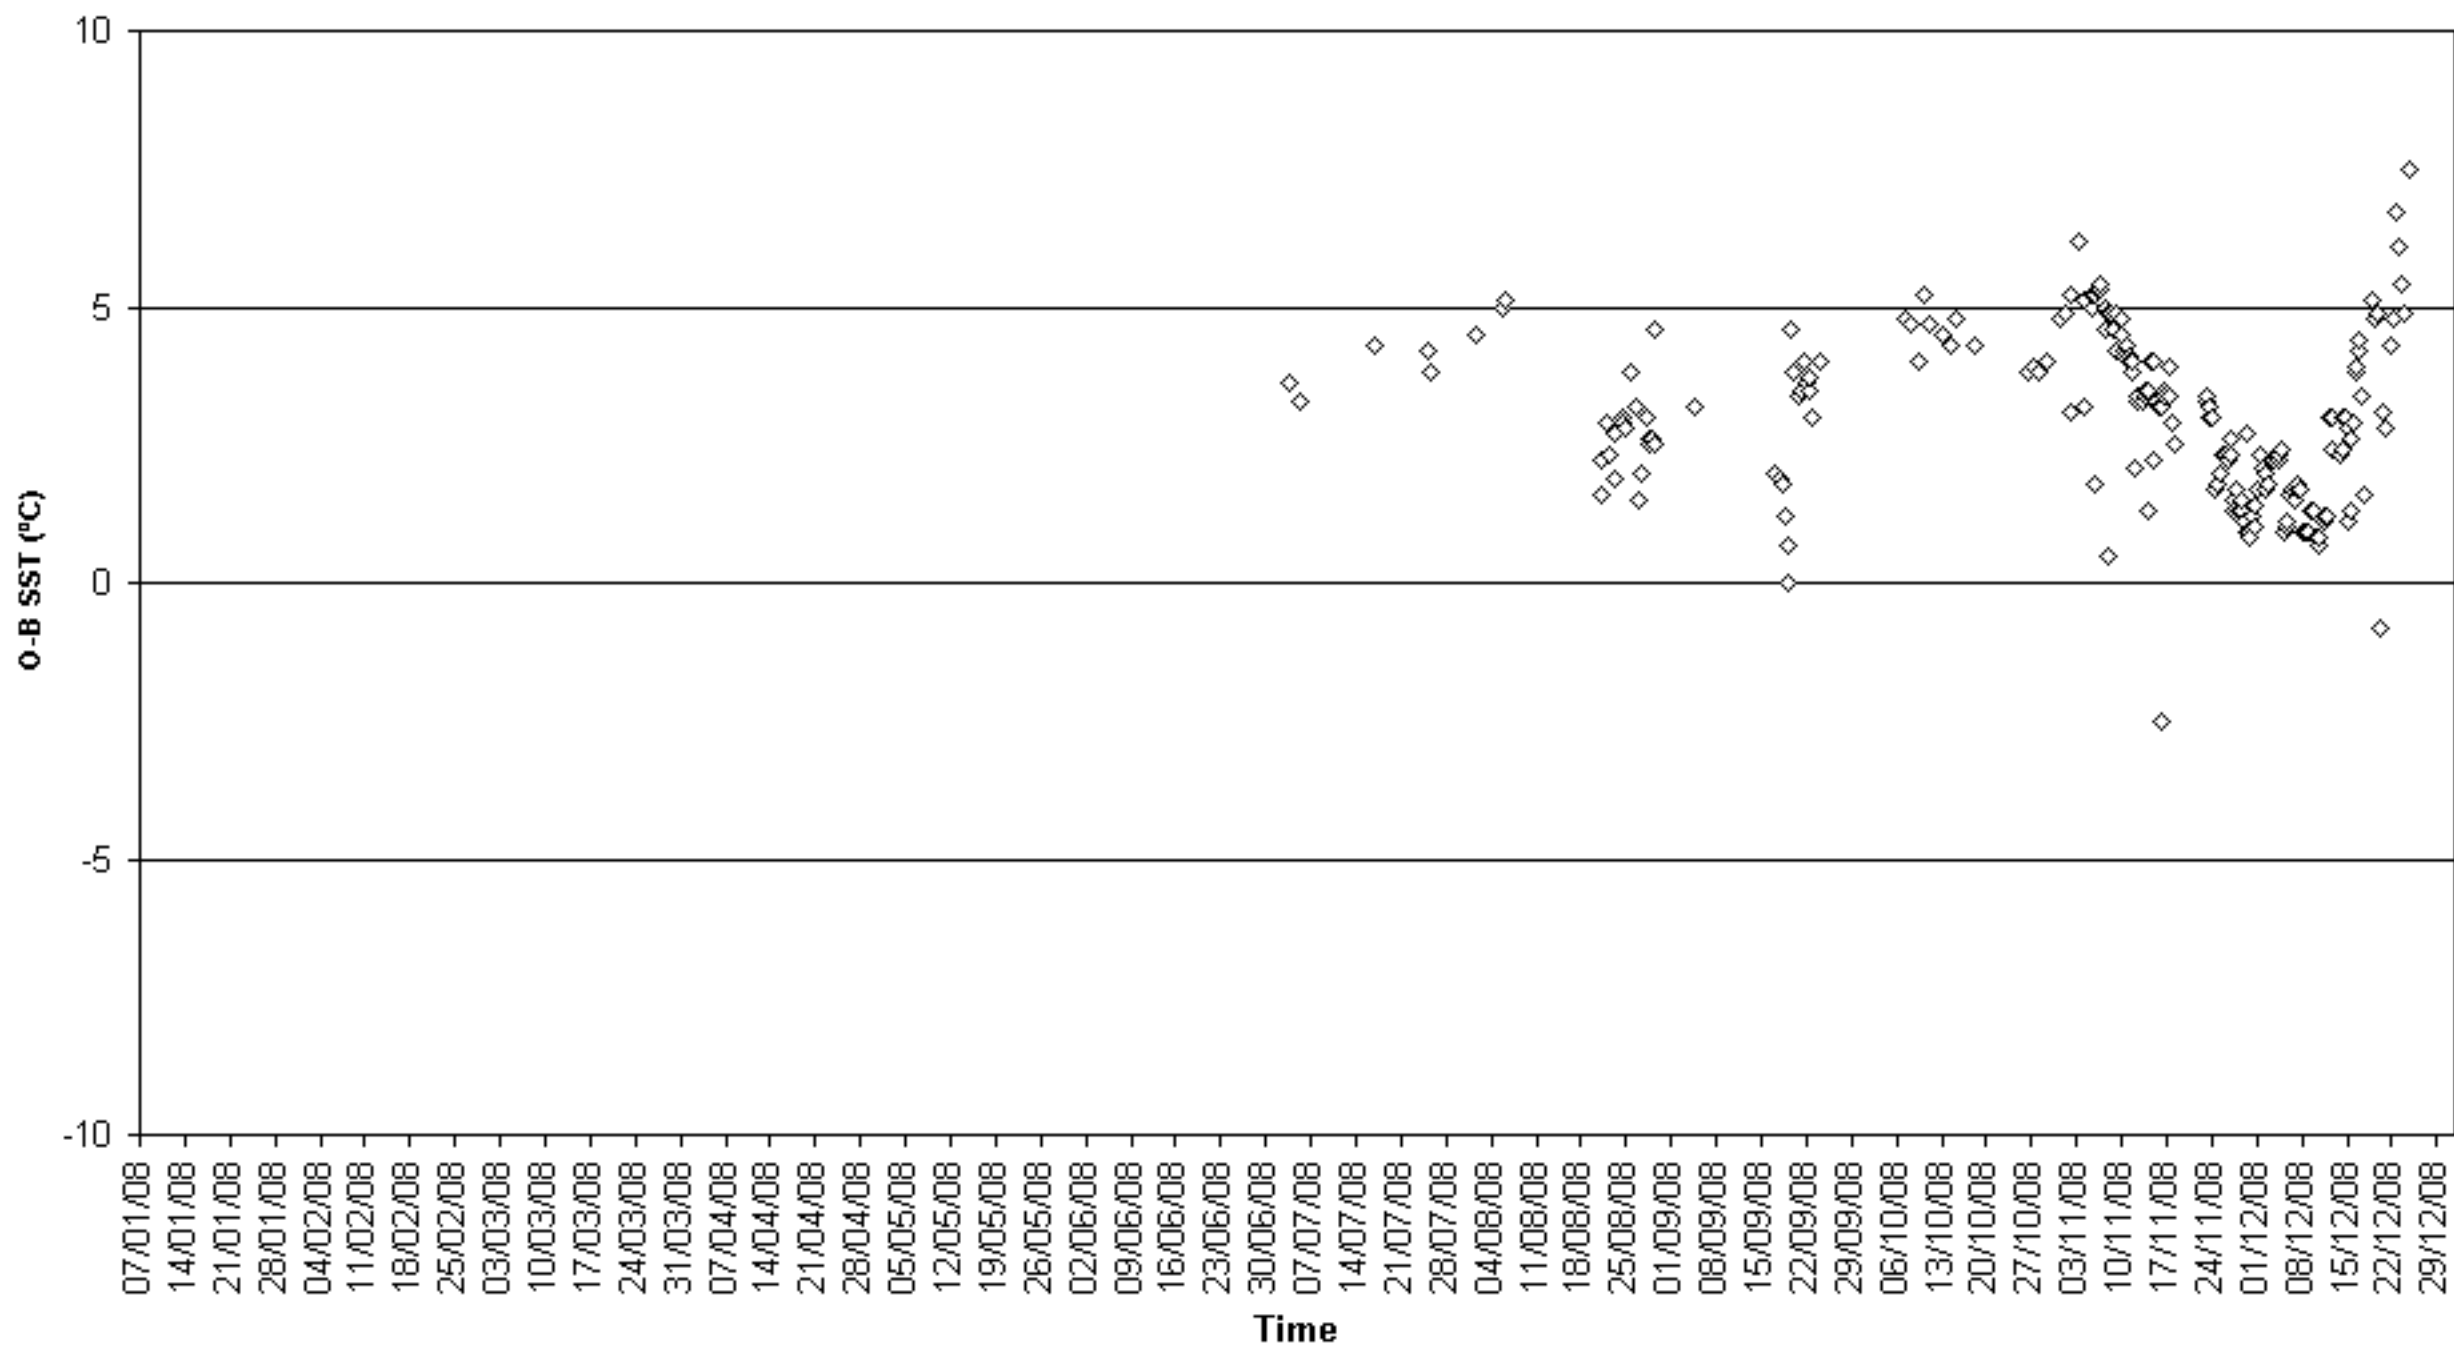


O-B SST (°C) for identifier VGDT  
Number of obs. plotted = 41 Number of outliers = 0

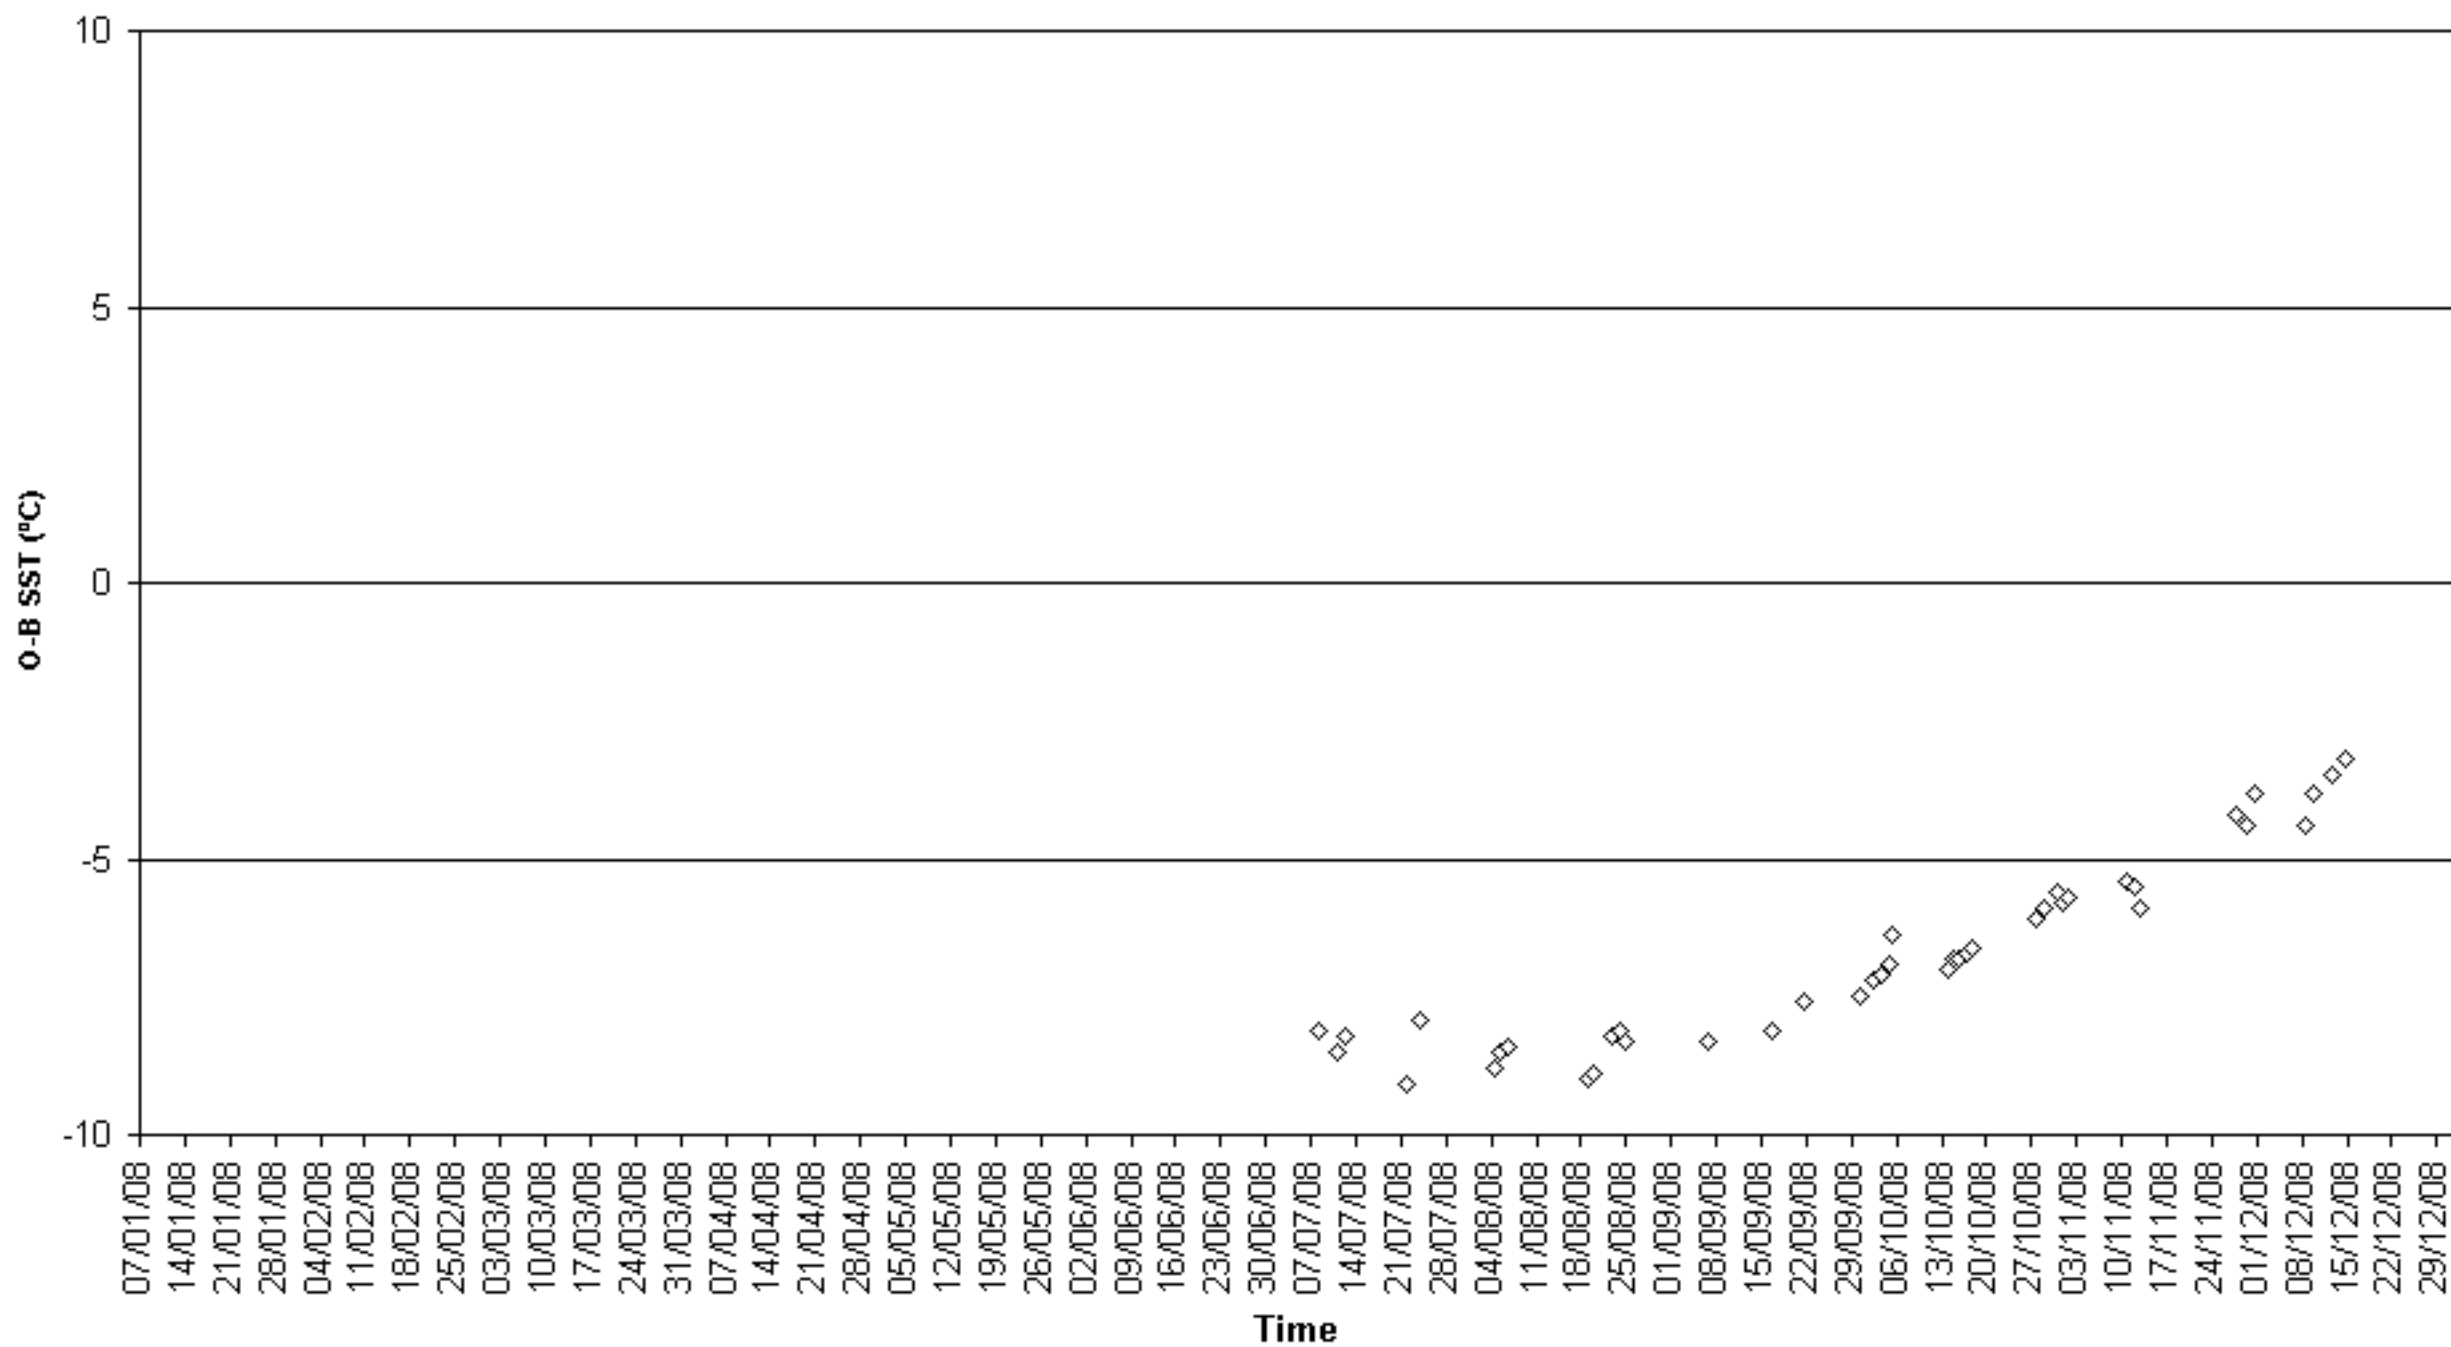


O-B SST (°C) for identifier VRCJ9  
Number of obs. plotted = 55 Number of outliers = 1

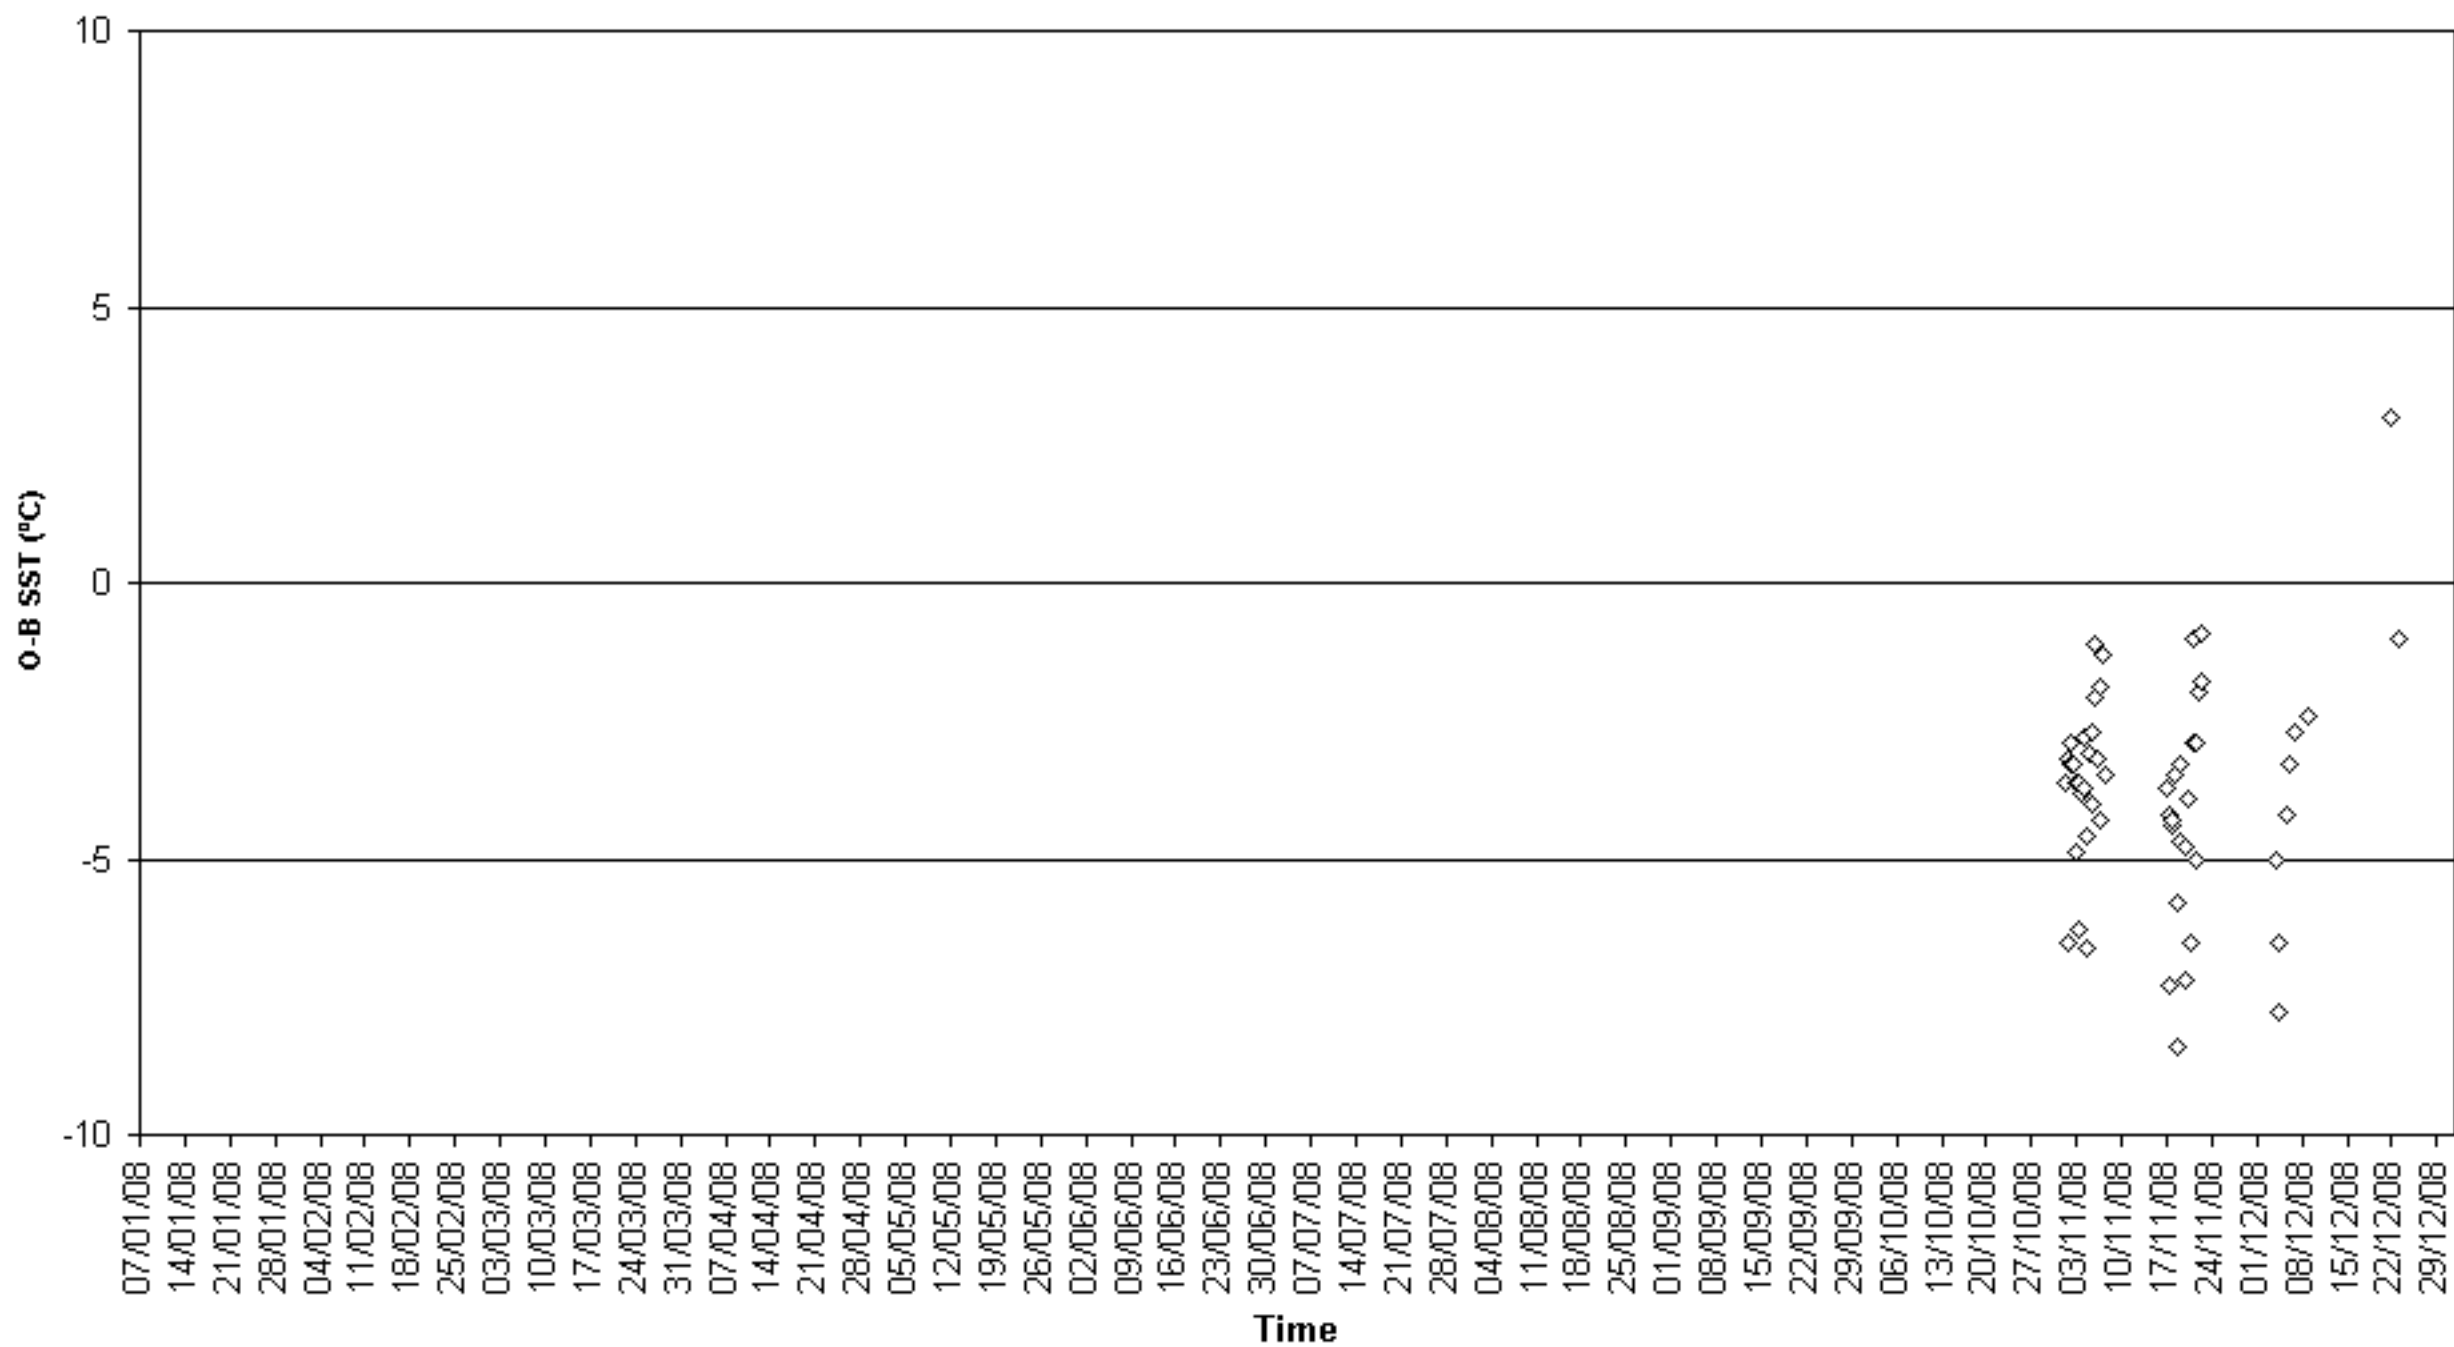


O-B SST (°C) for identifier VRCU7  
Number of obs. plotted = 56 Number of outliers = 1

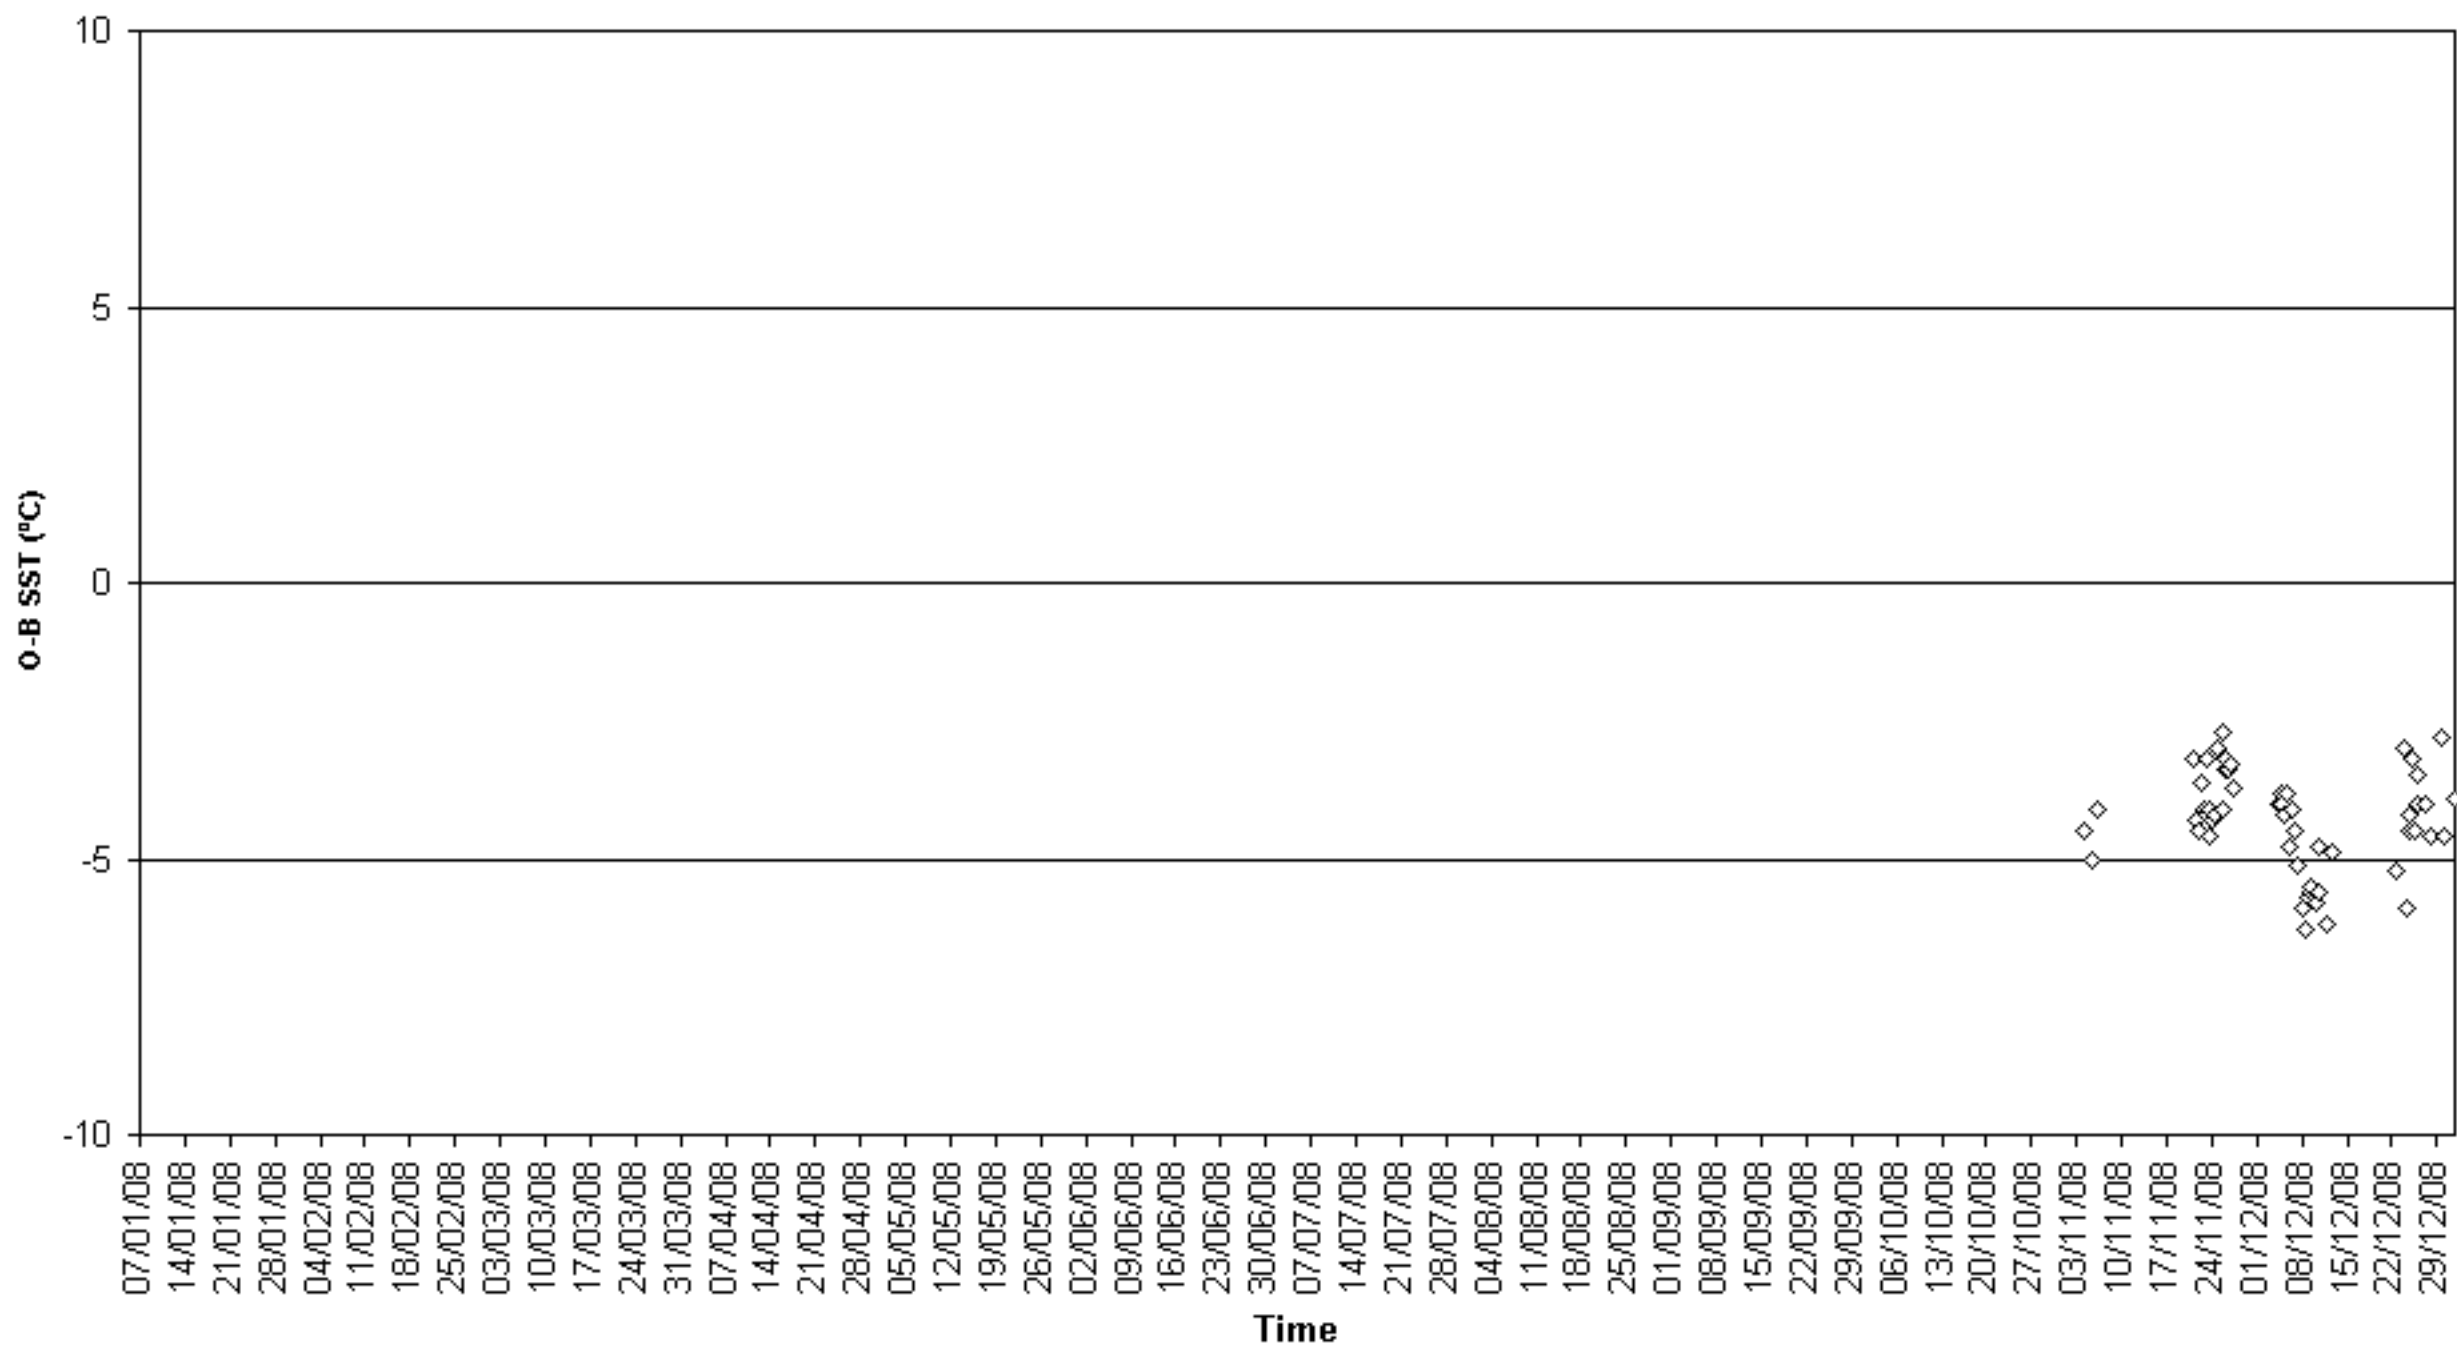


O-B SST (°C) for identifier VRXK9  
Number of obs. plotted = 26 Number of outliers = 69

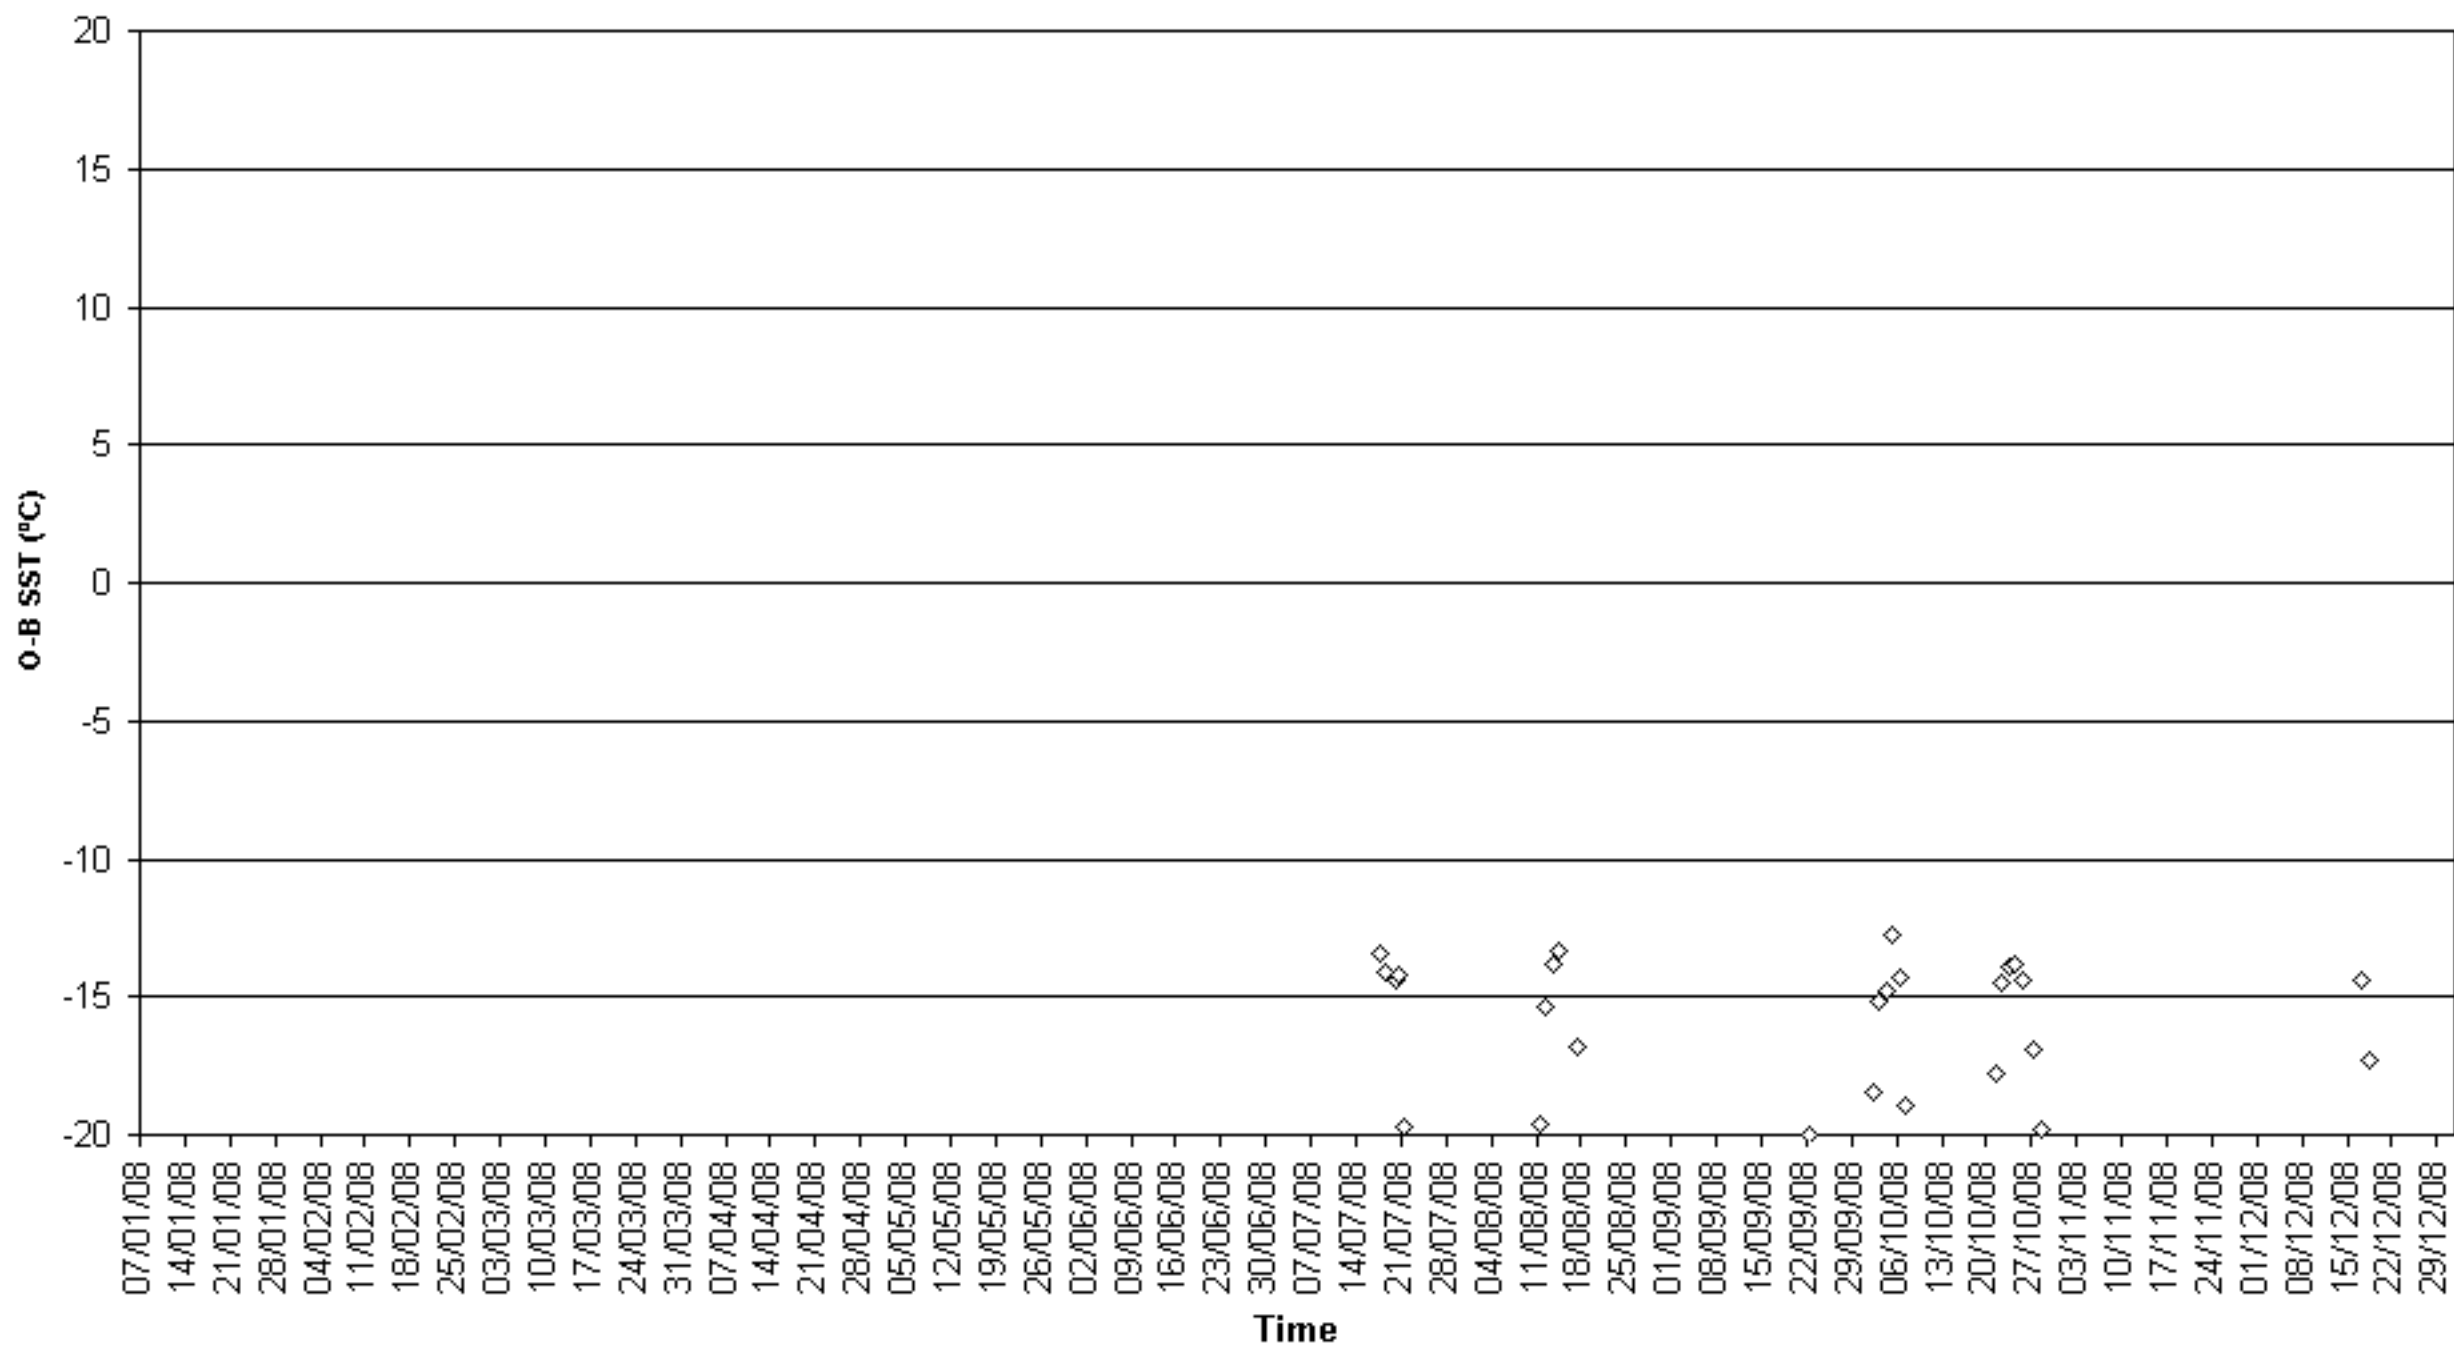


O-B SST (°C) for identifier VRZT8  
Number of obs. plotted = 177 Number of outliers = 103

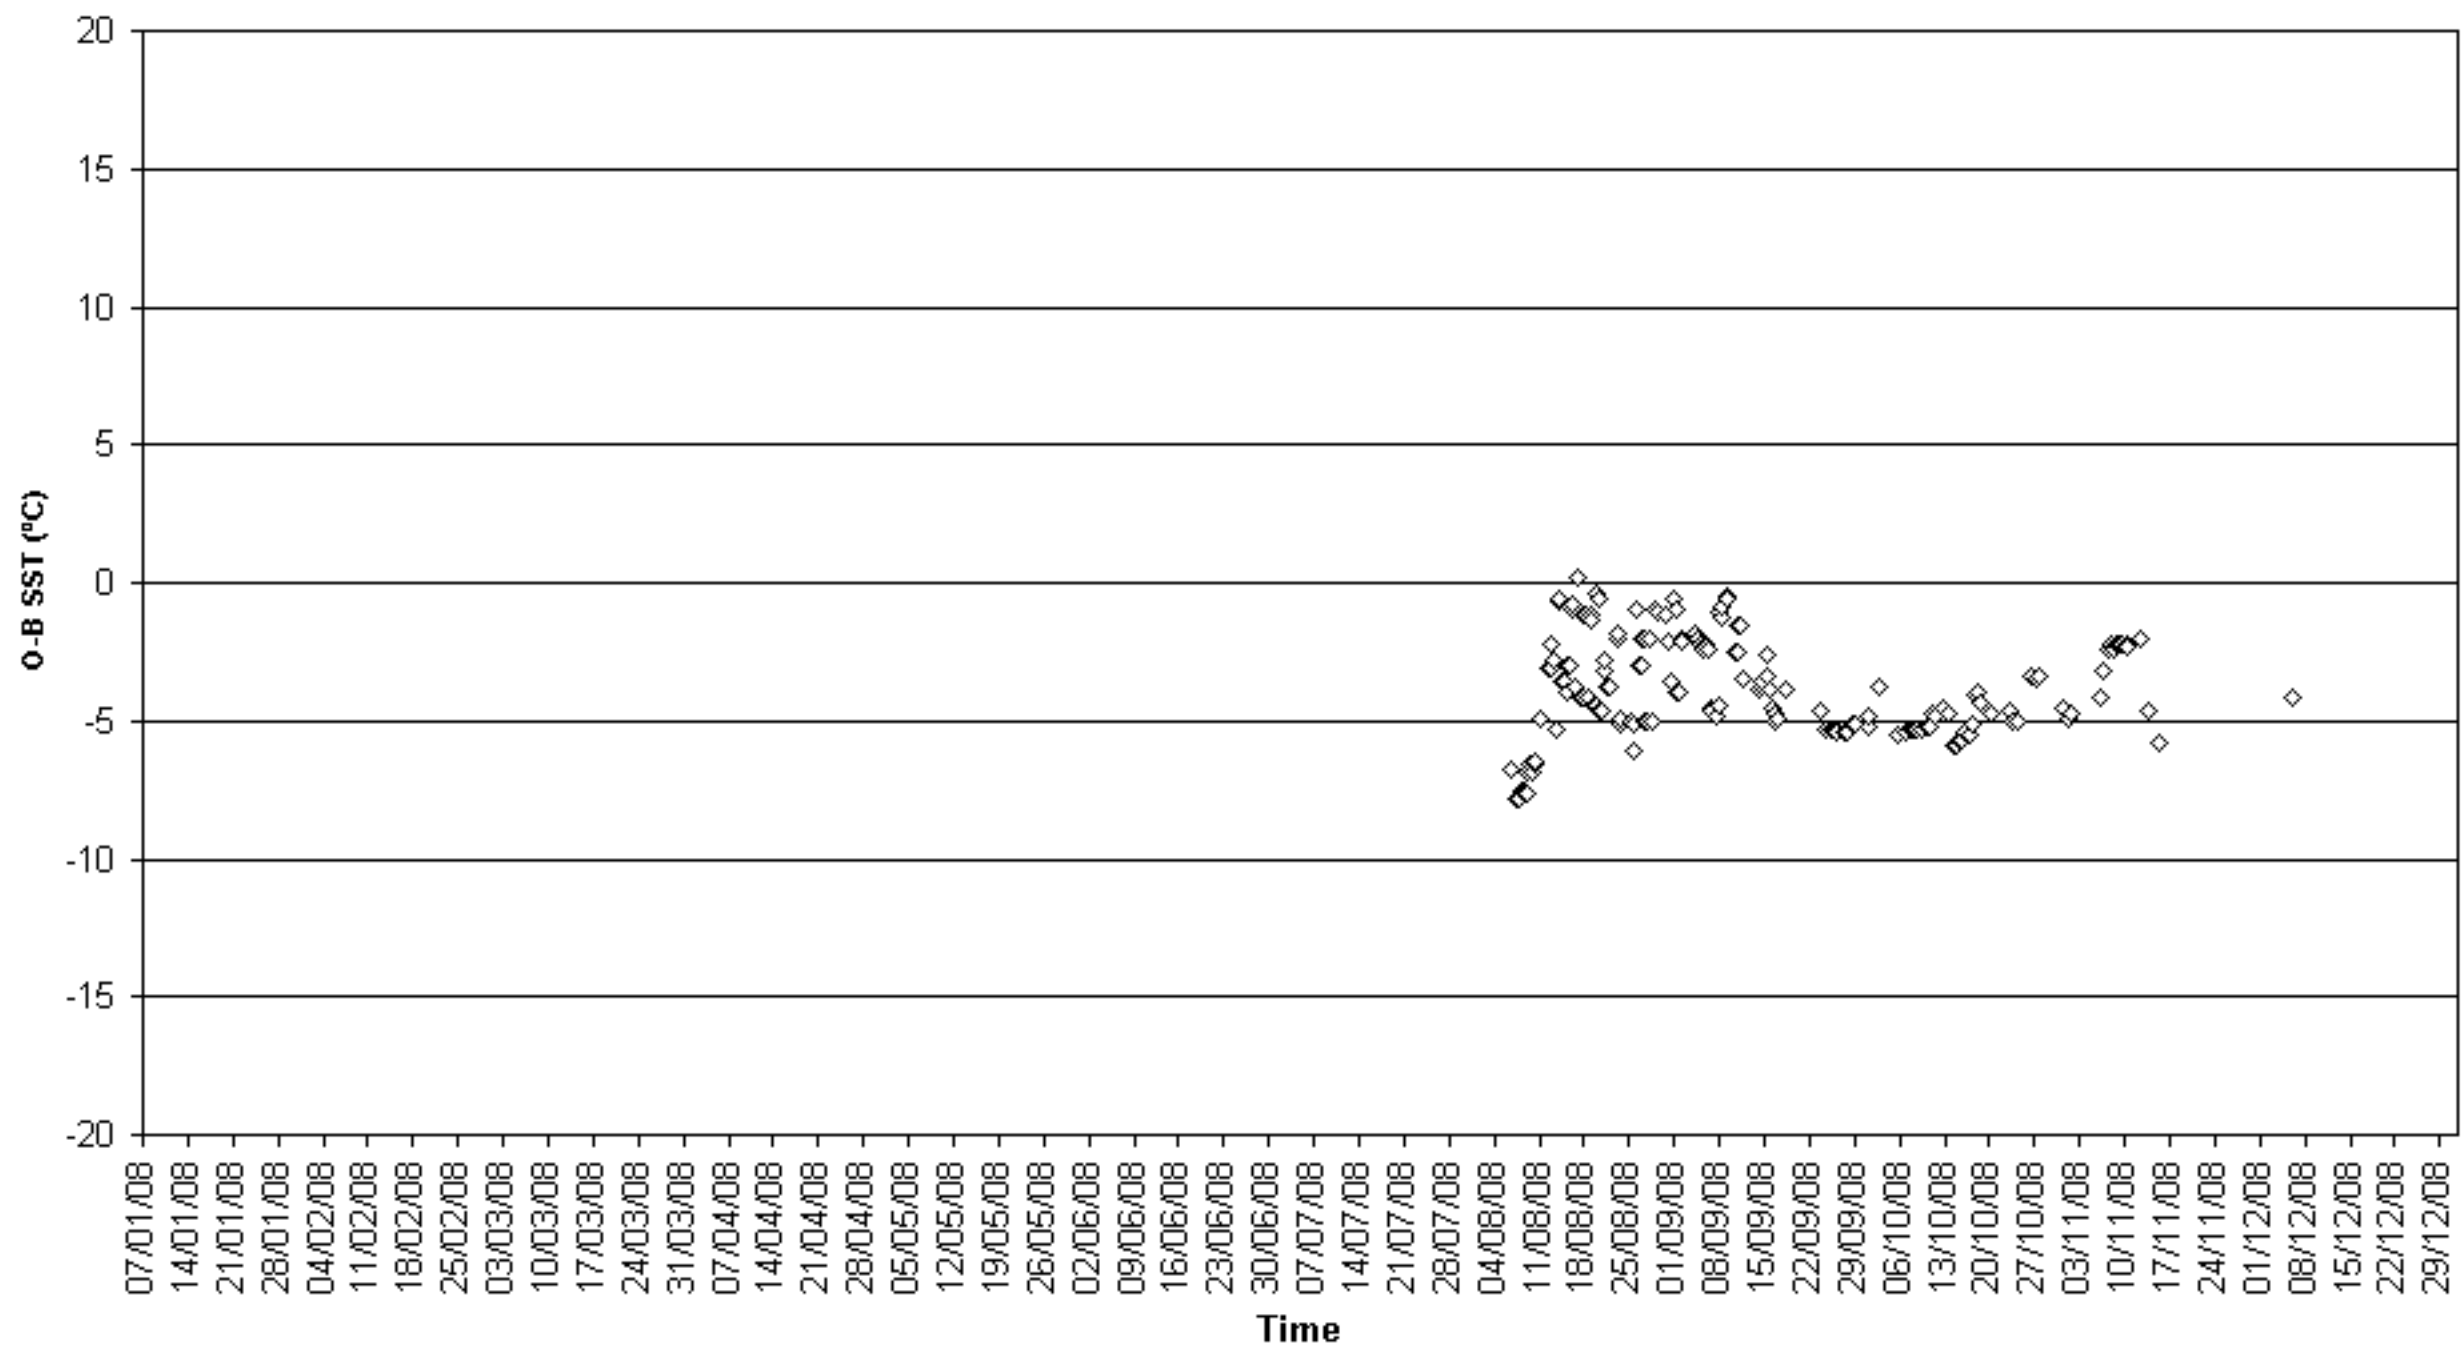

O-B SST (°C) for identifier VVJT  
Number of obs. plotted = 80 Number of outliers = 0

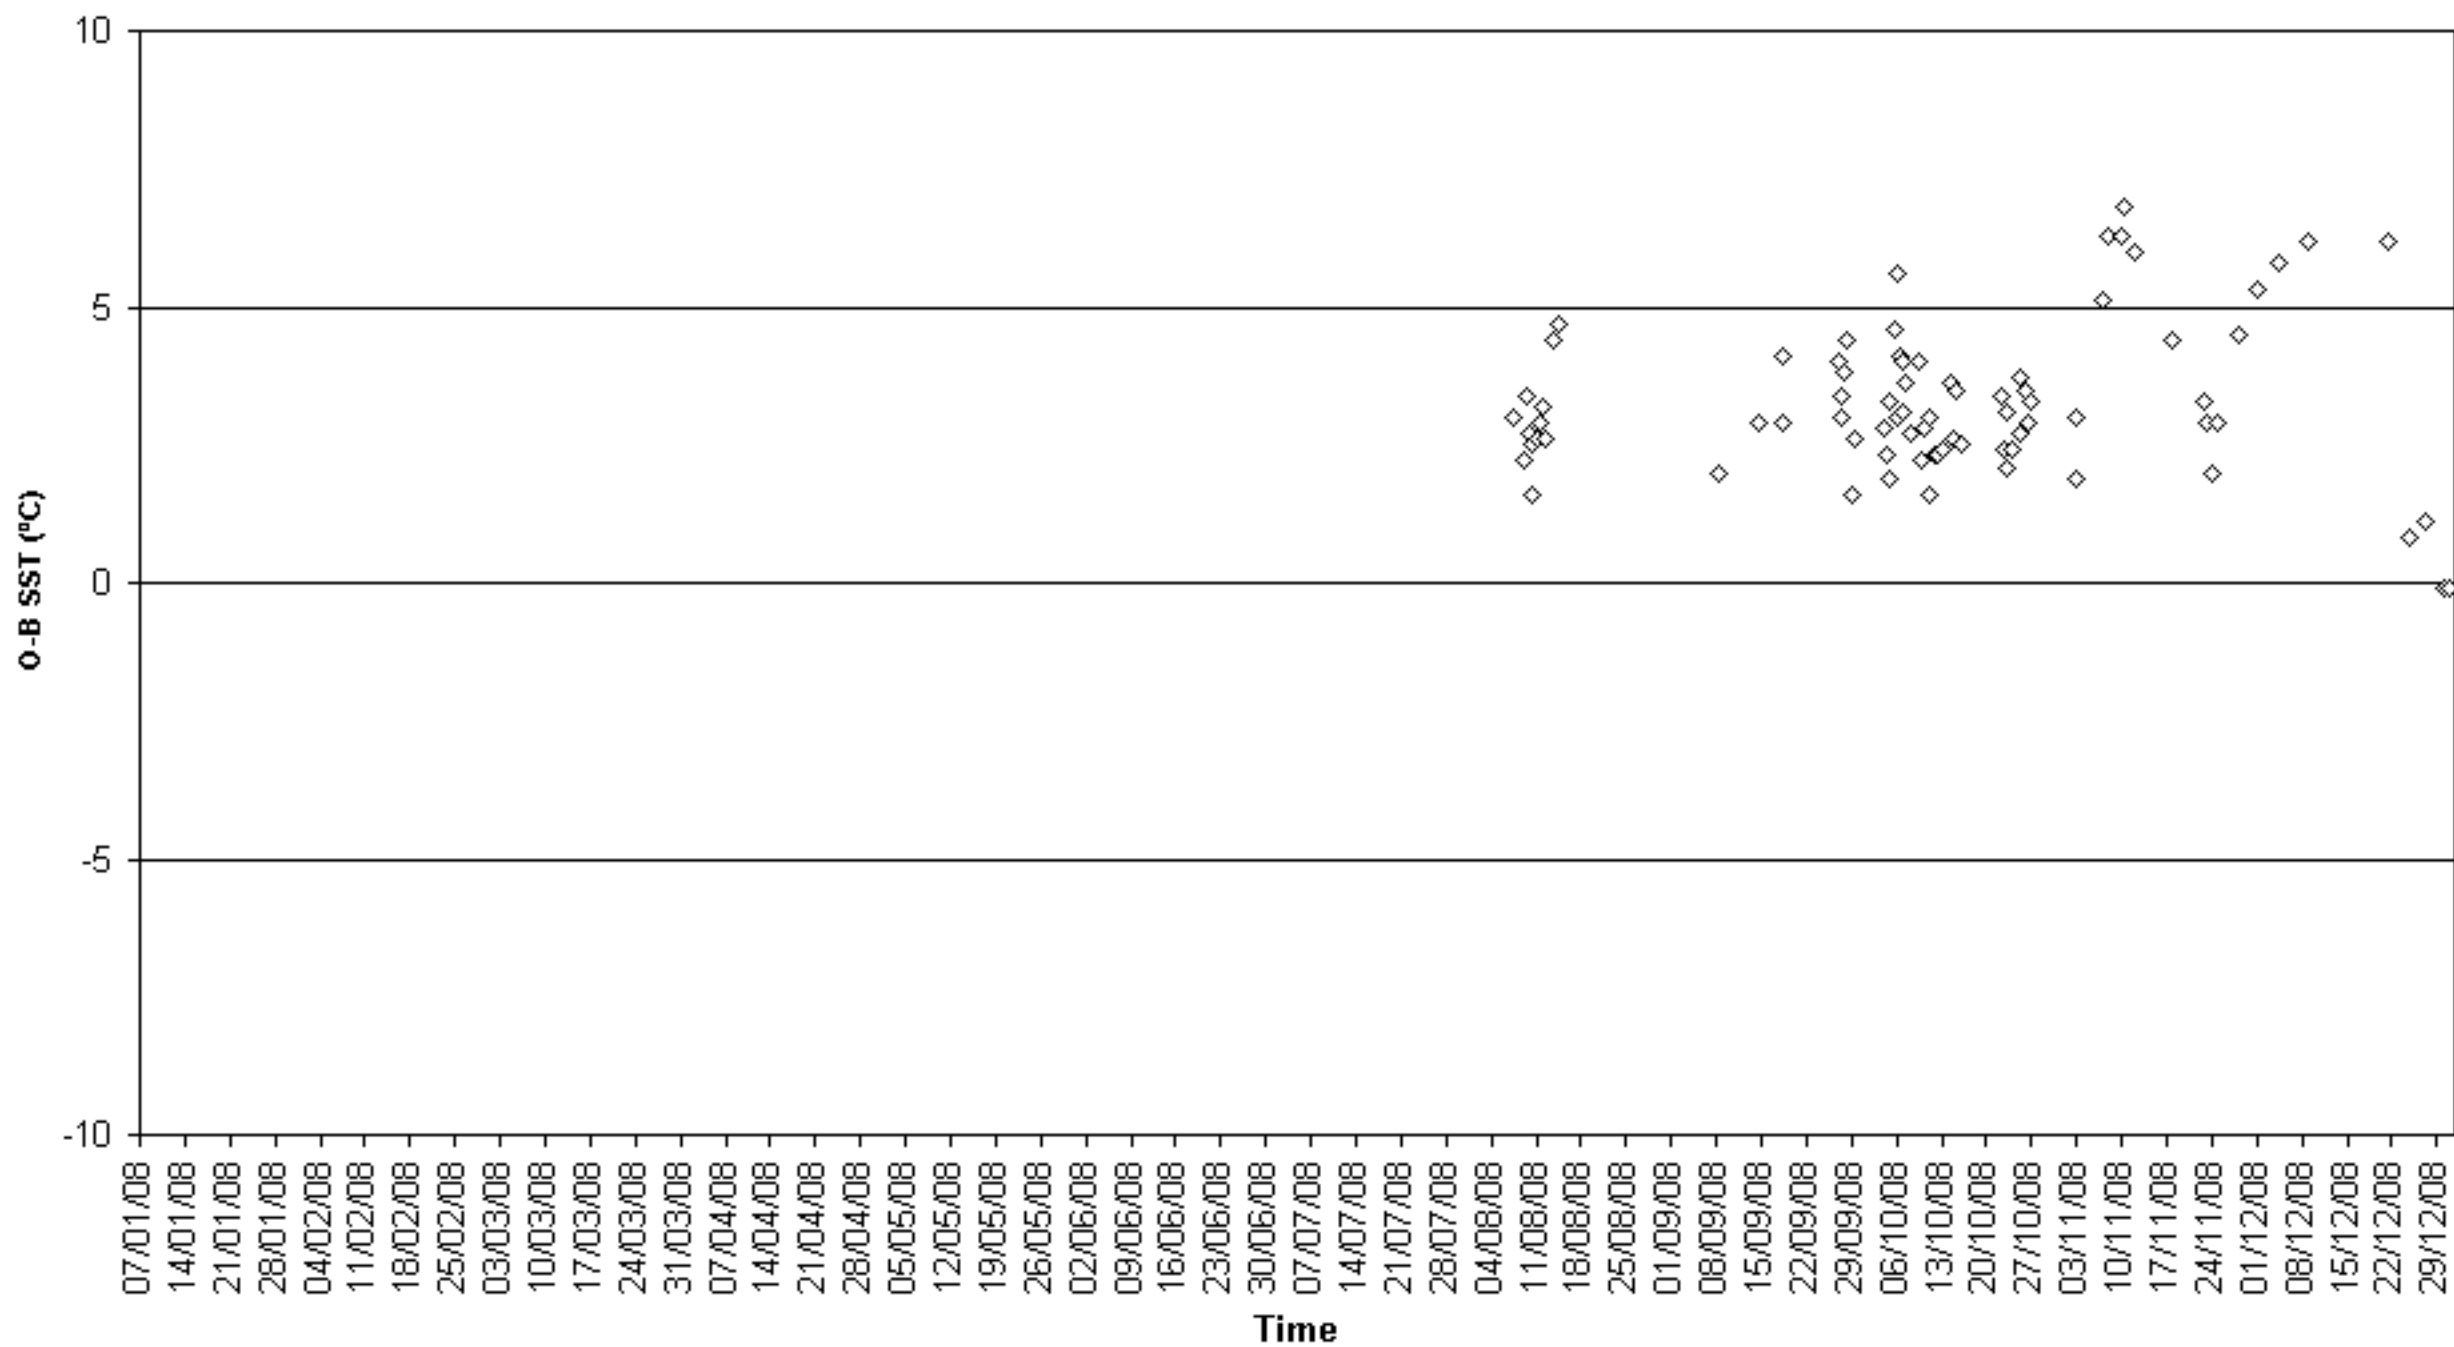


O-B SST (°C) for identifier WAAH  
Number of obs. plotted = 588 Number of outliers = 0

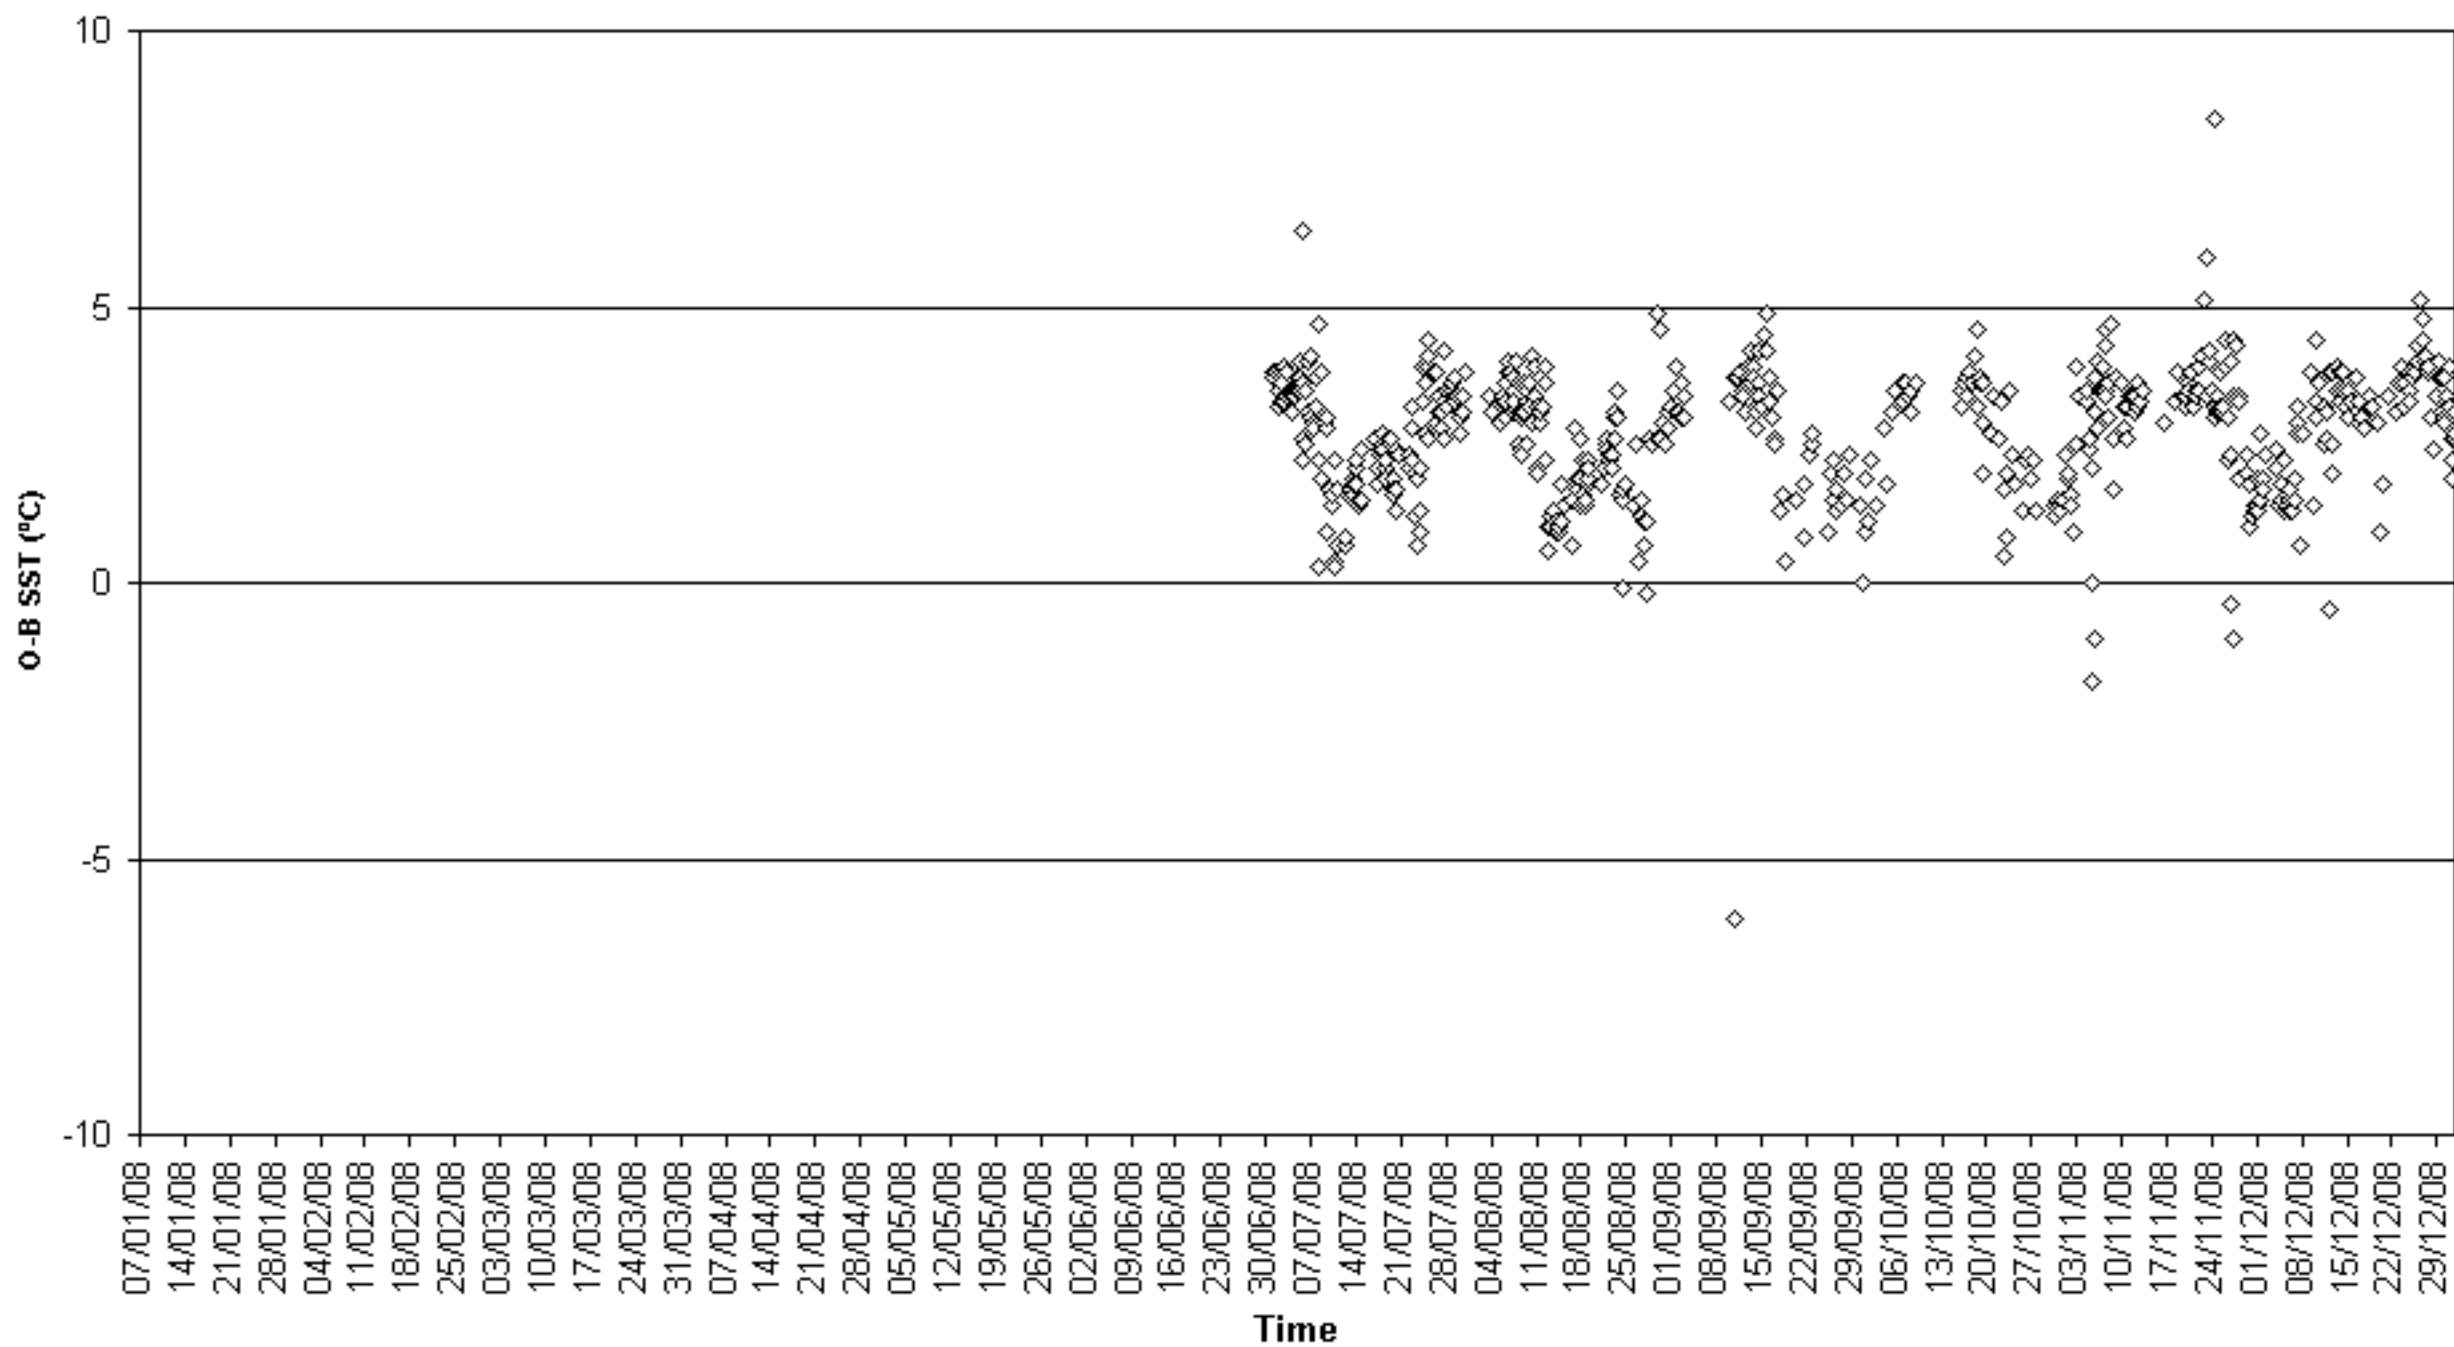



O-B SST (°C) for identifier WMLH  
Number of obs. plotted = 100 Number of outliers = 0

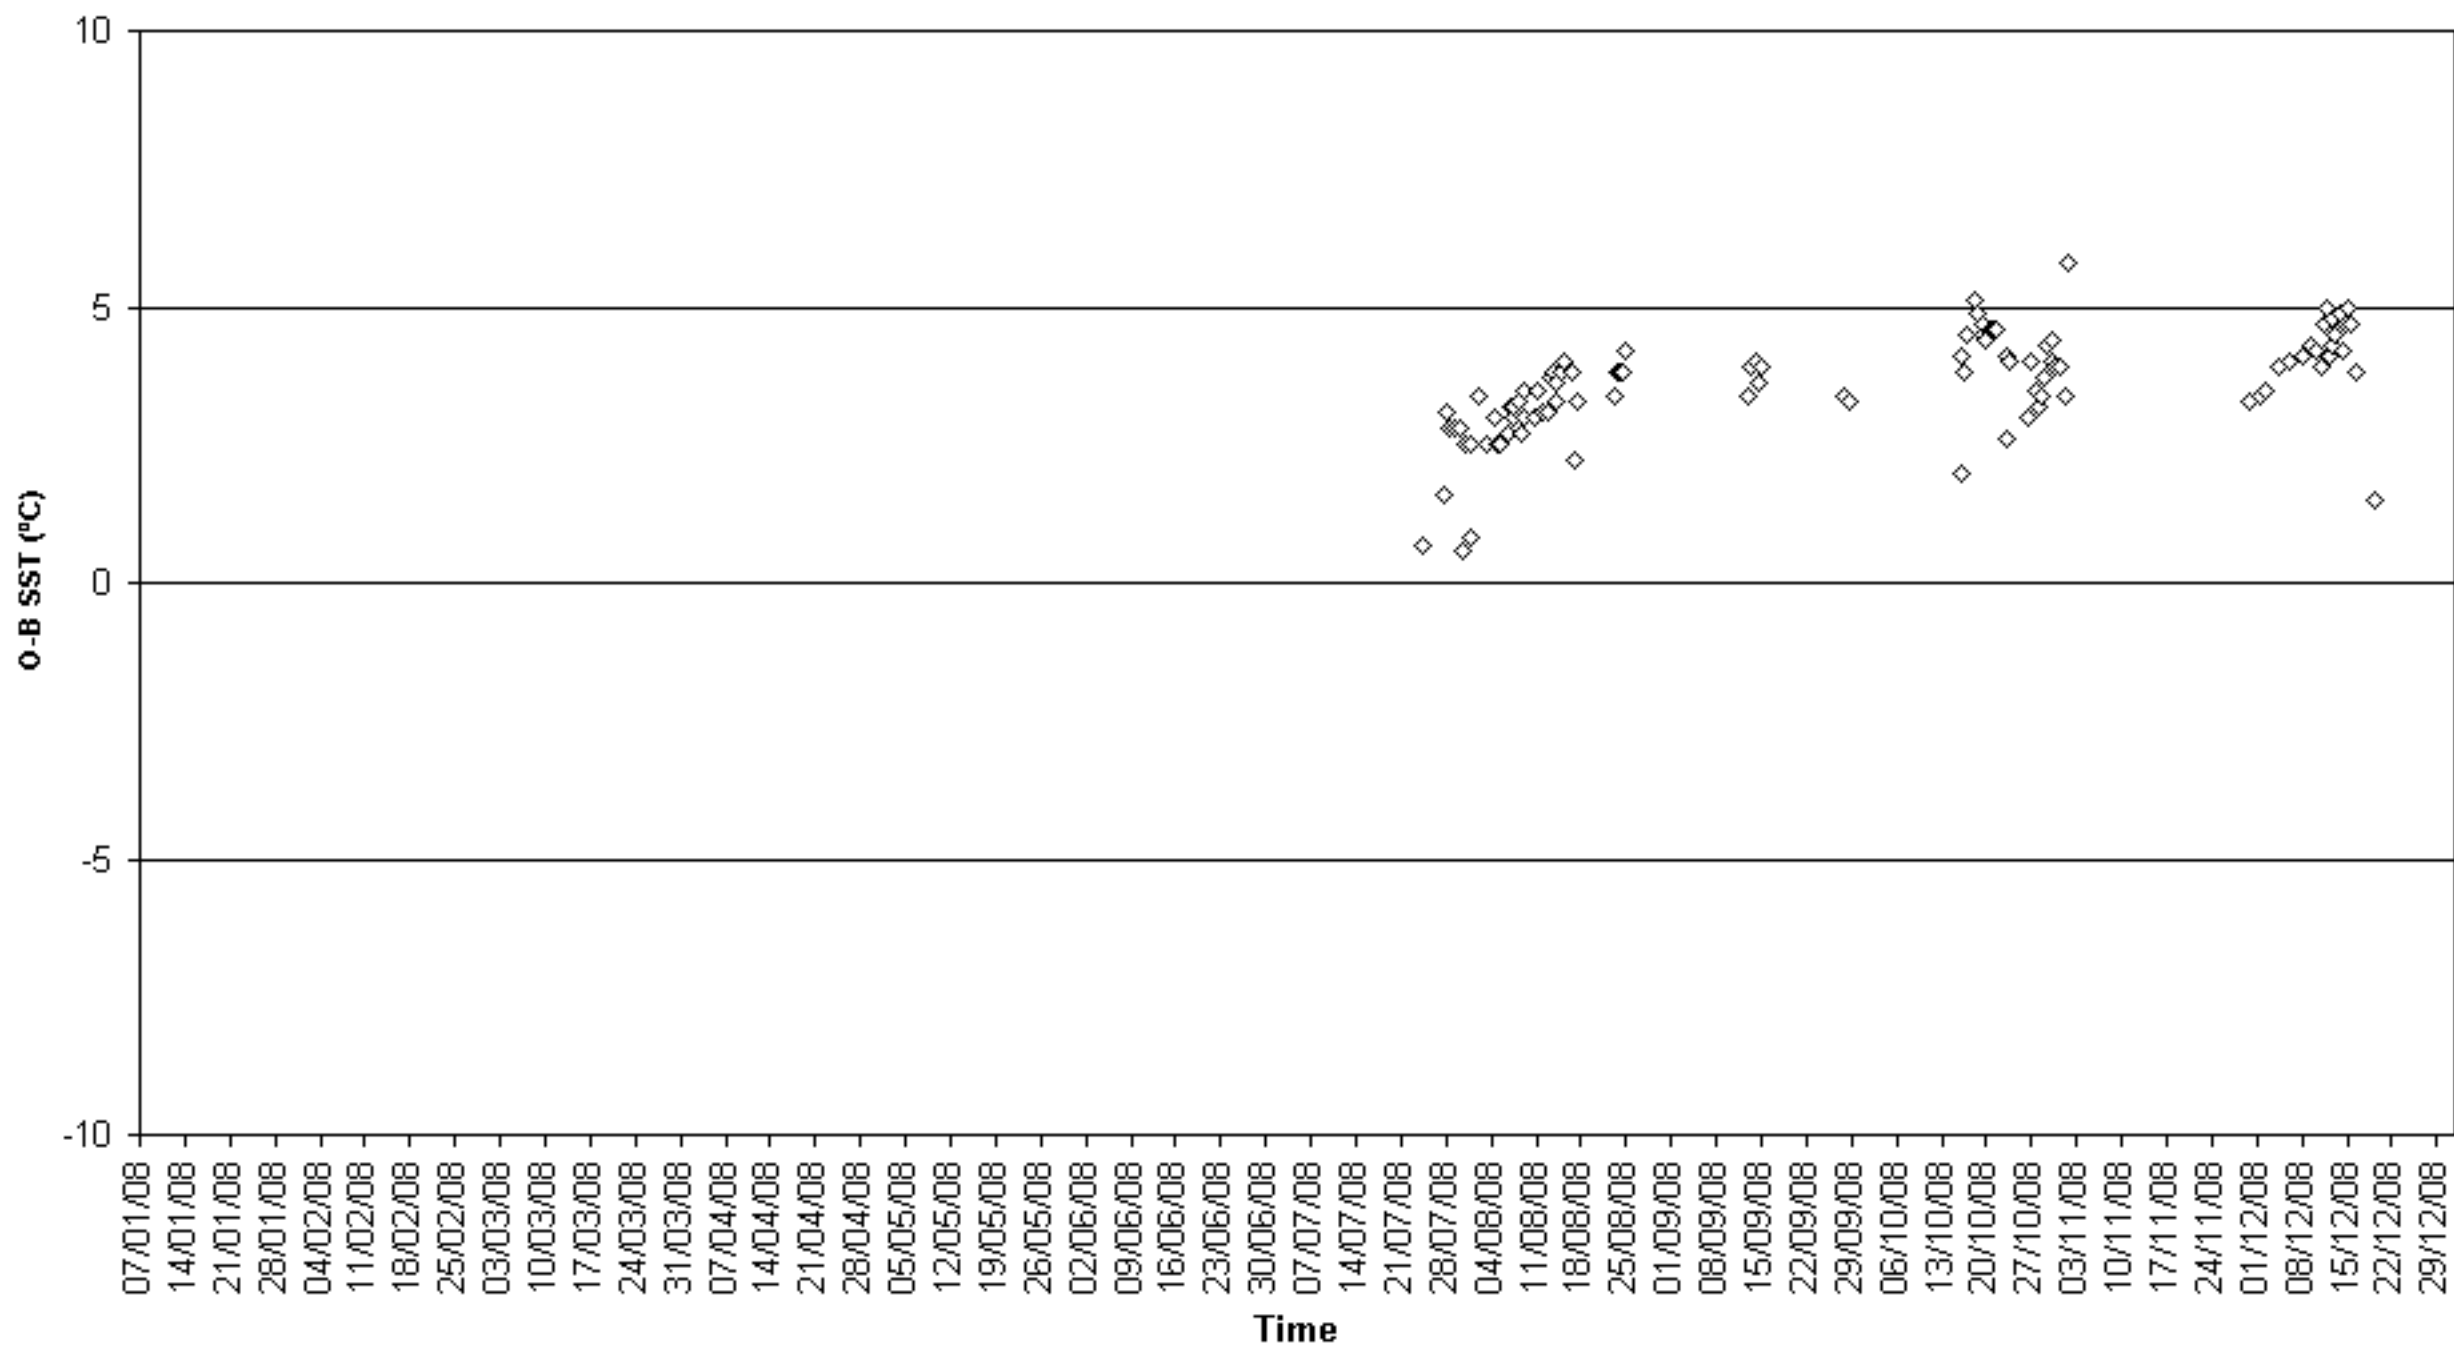

O-B SST (°C) for identifier WSRH  
Number of obs. plotted = 87 Number of outliers = 1

