




O-B SST (°C) for identifier 21544  
Number of obs. plotted = 227    Number of outliers = 124

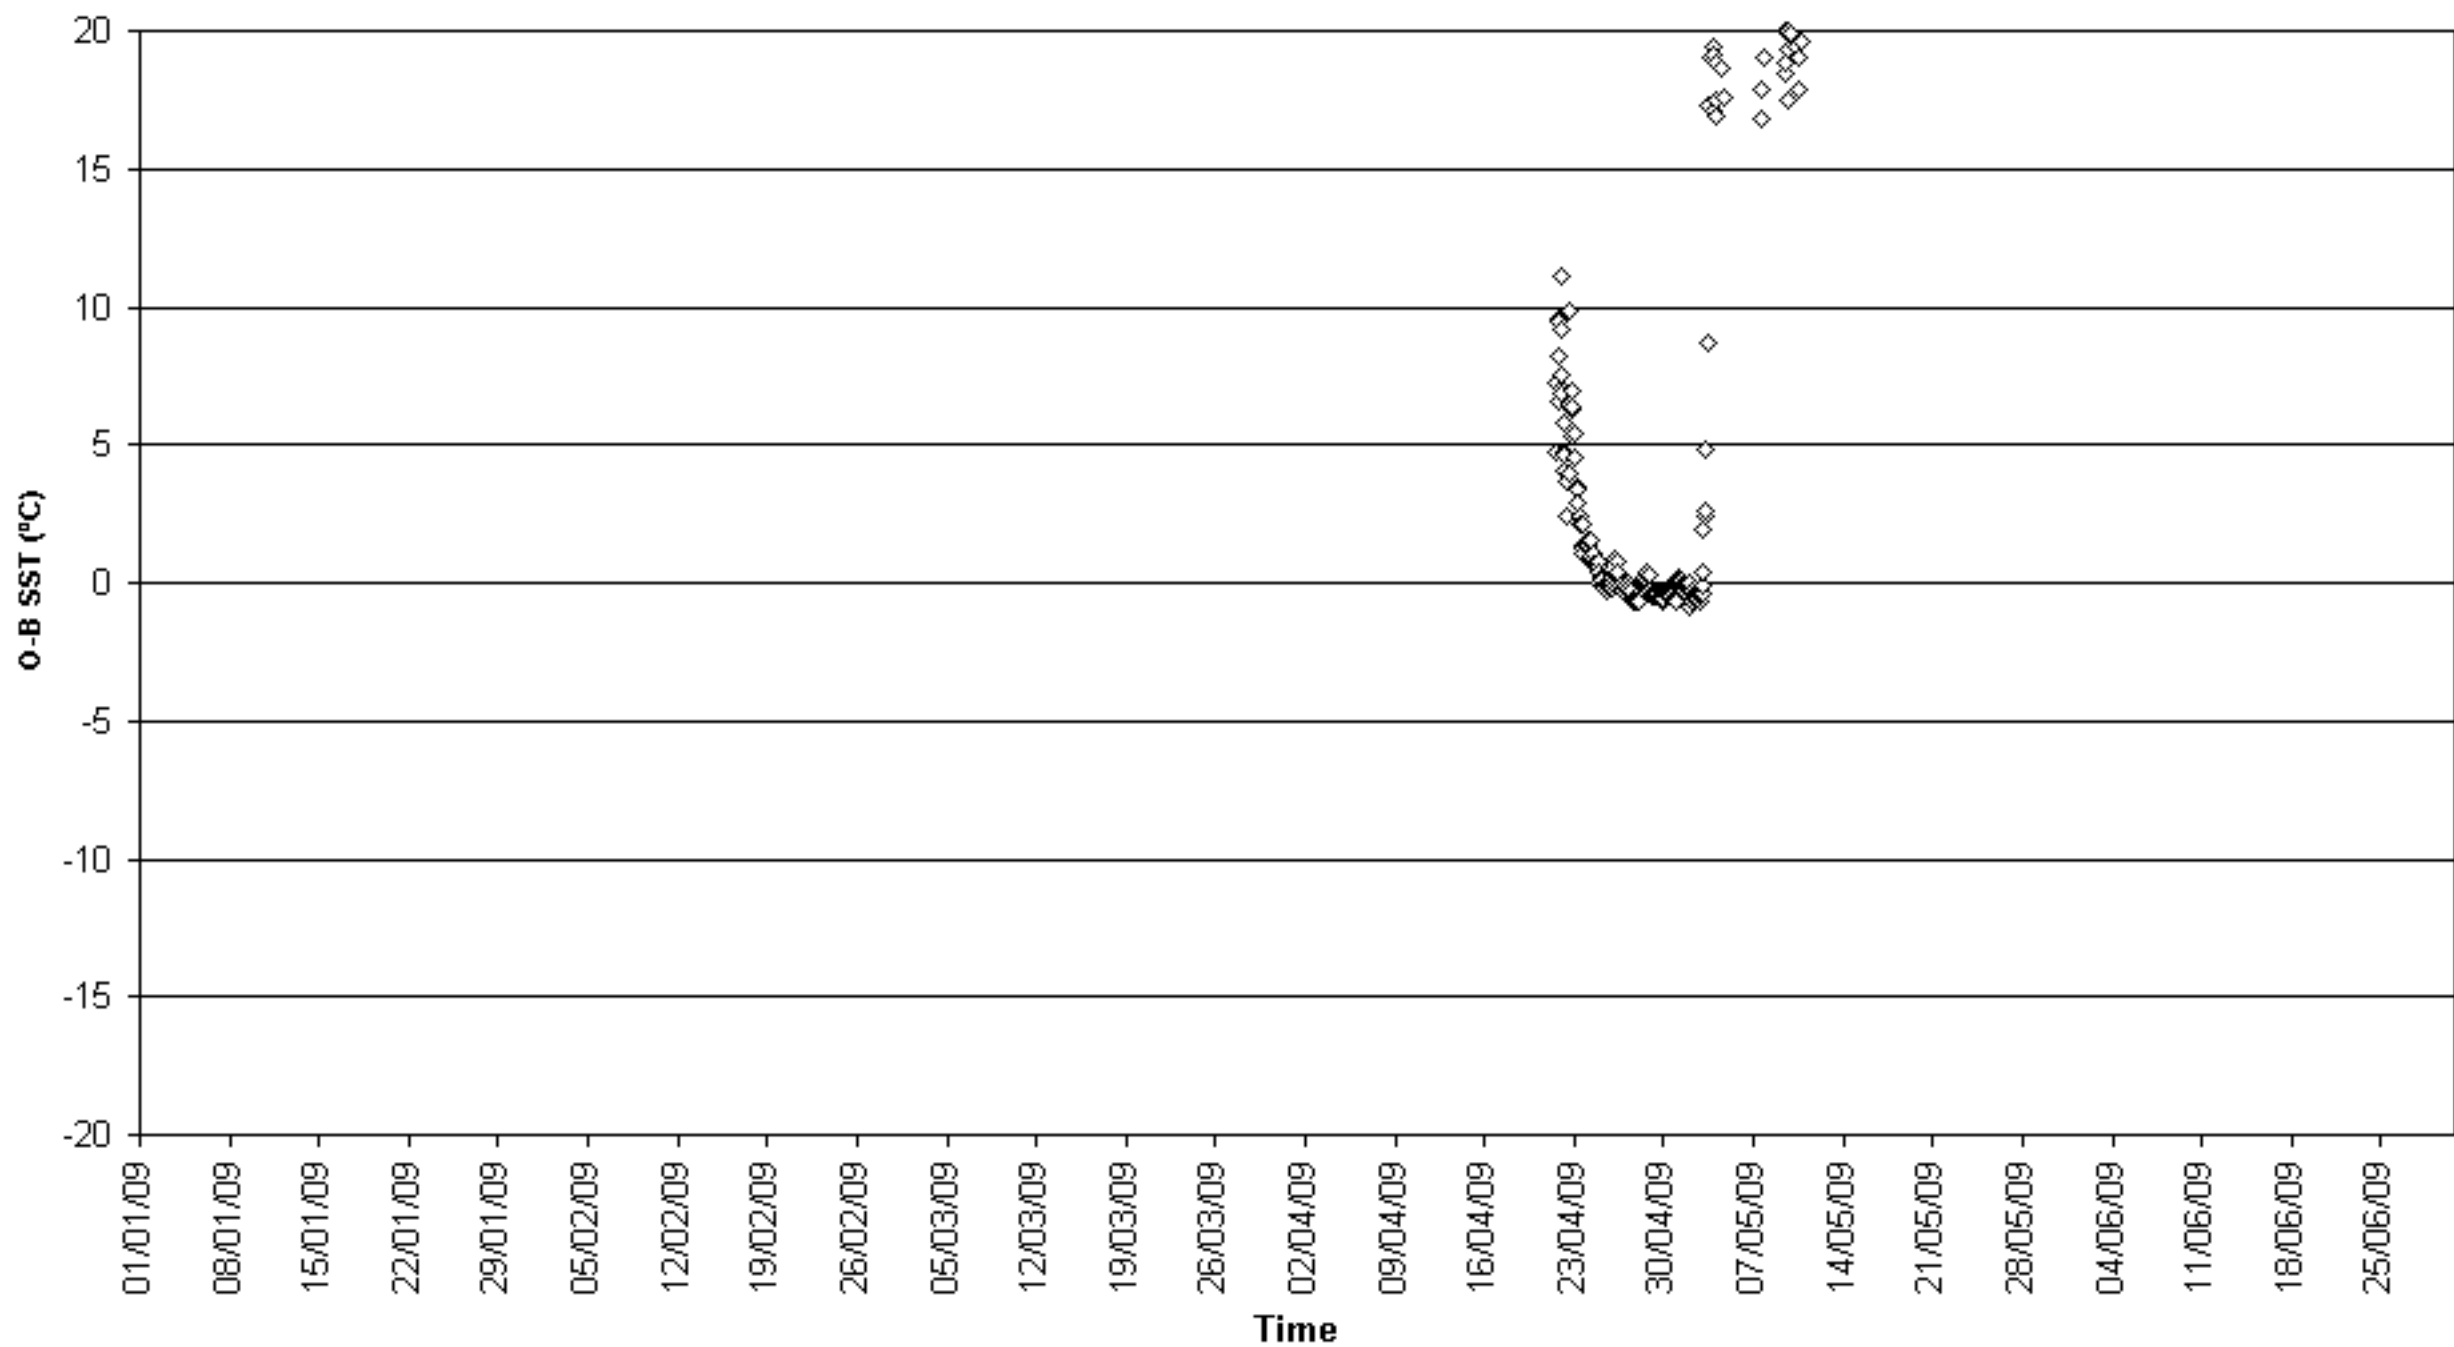


O-B SST (°C) for identifier 21938  
Number of obs. plotted = 149 Number of outliers = 0

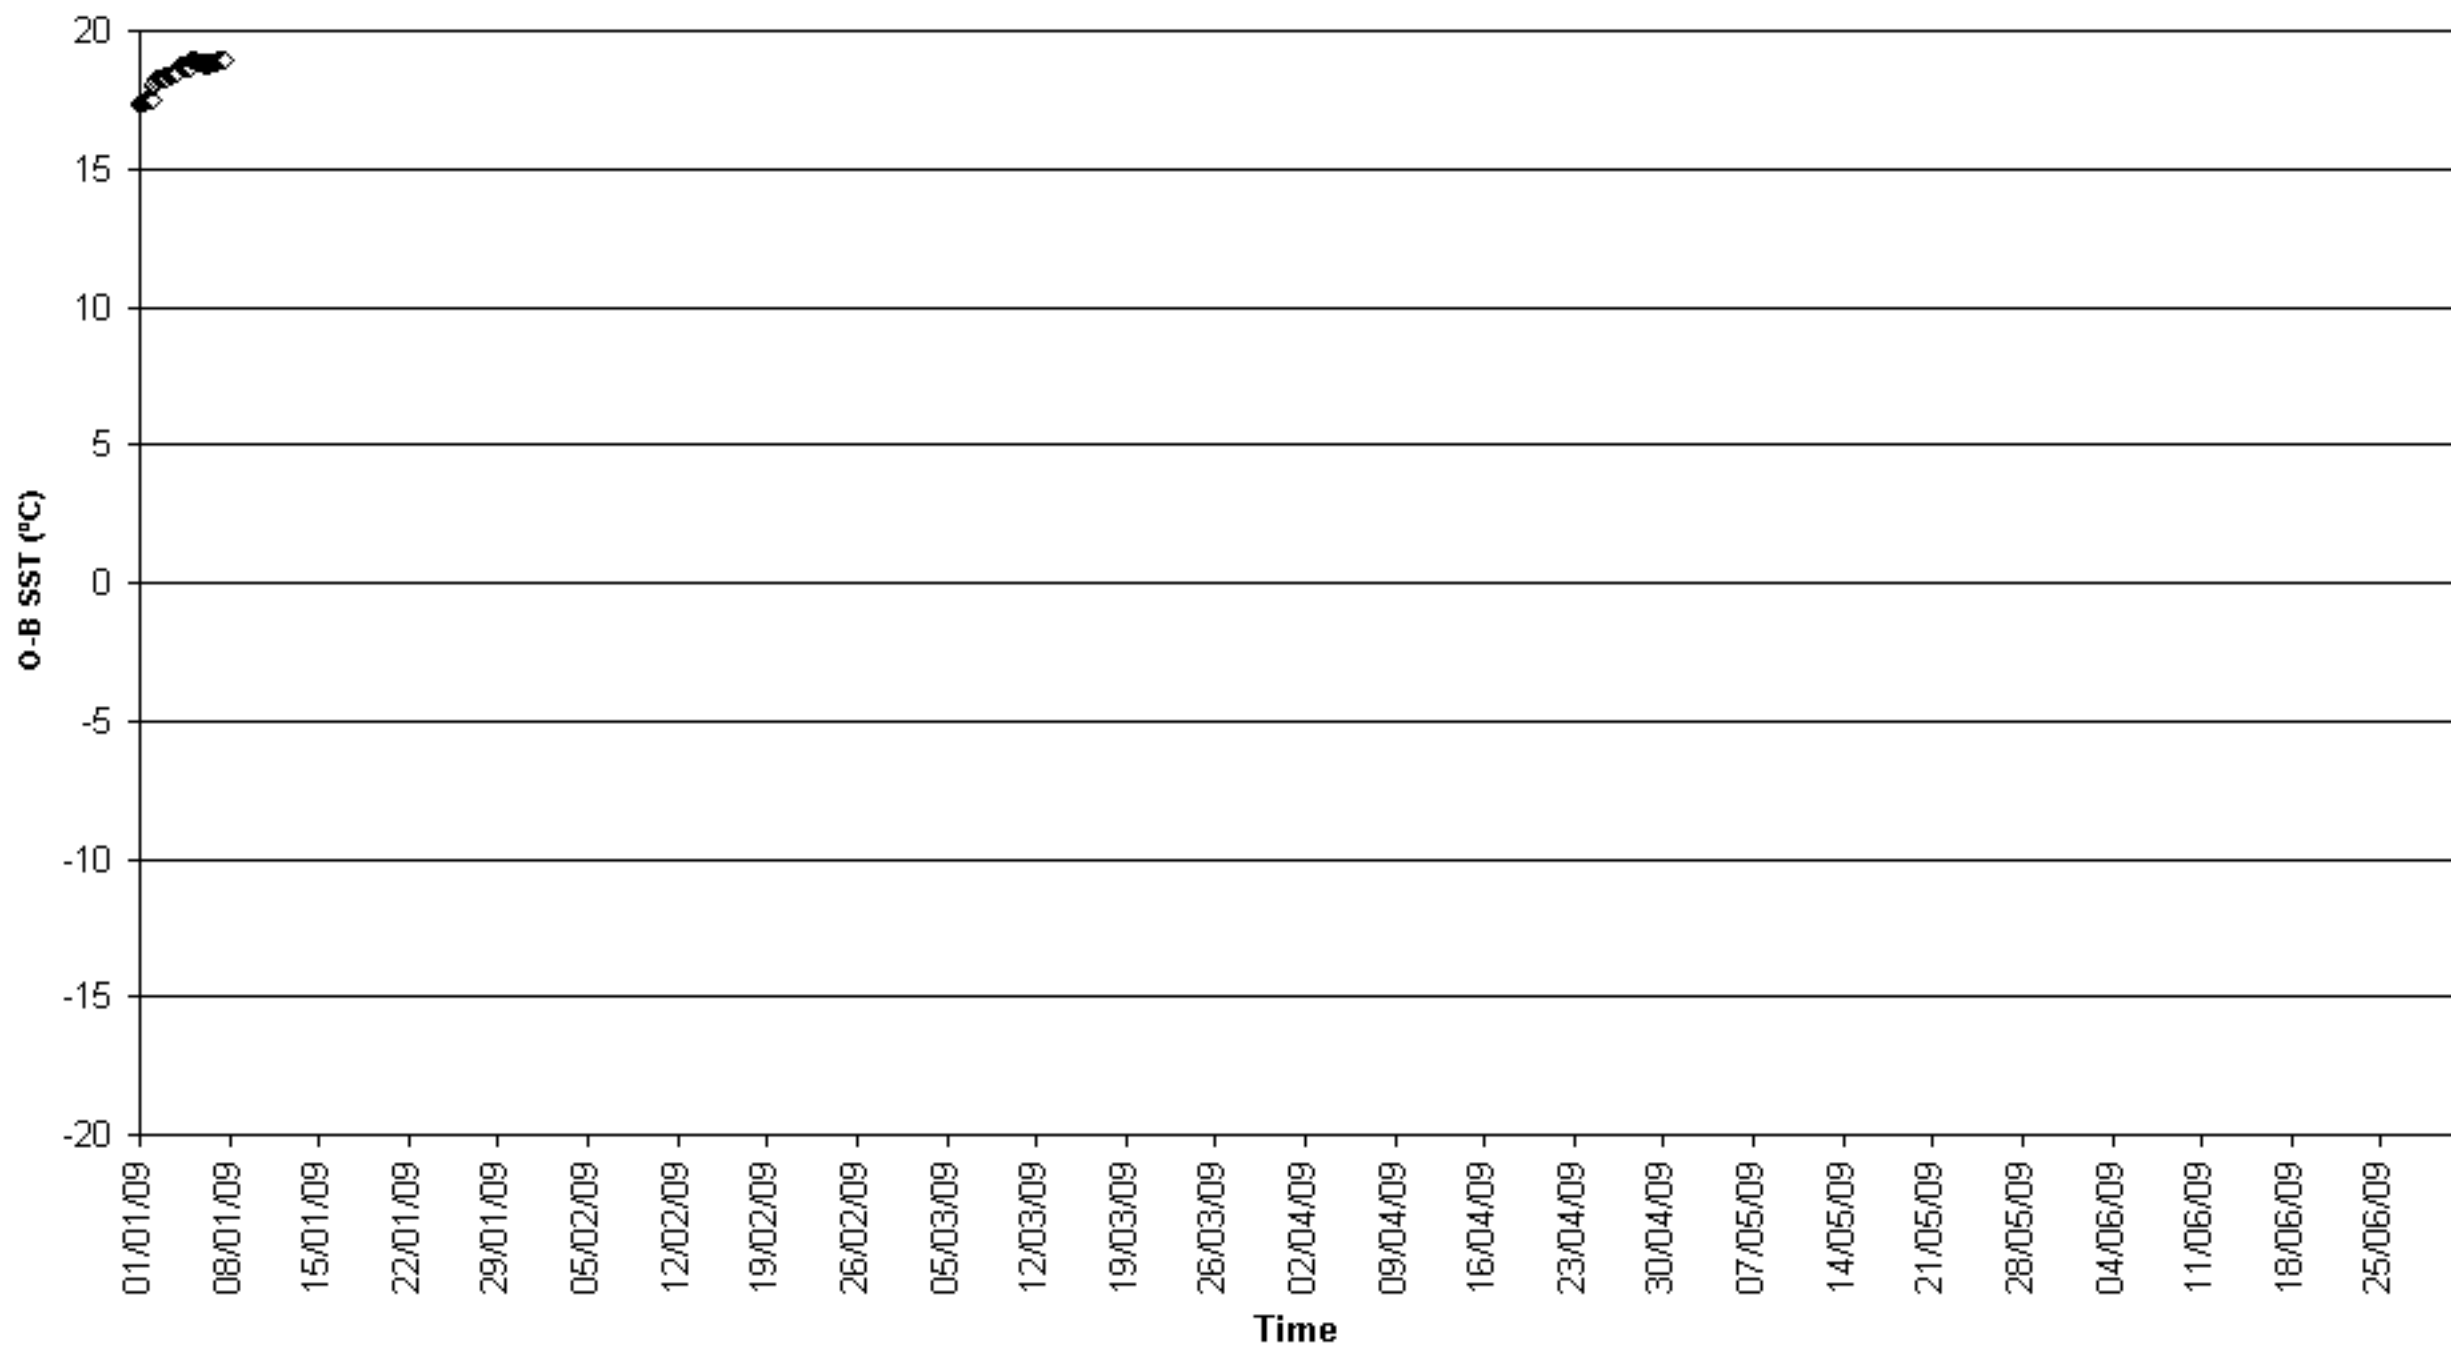


O-B SST (°C) for identifier 31733  
Number of obs. plotted = 1534 Number of outliers = 94

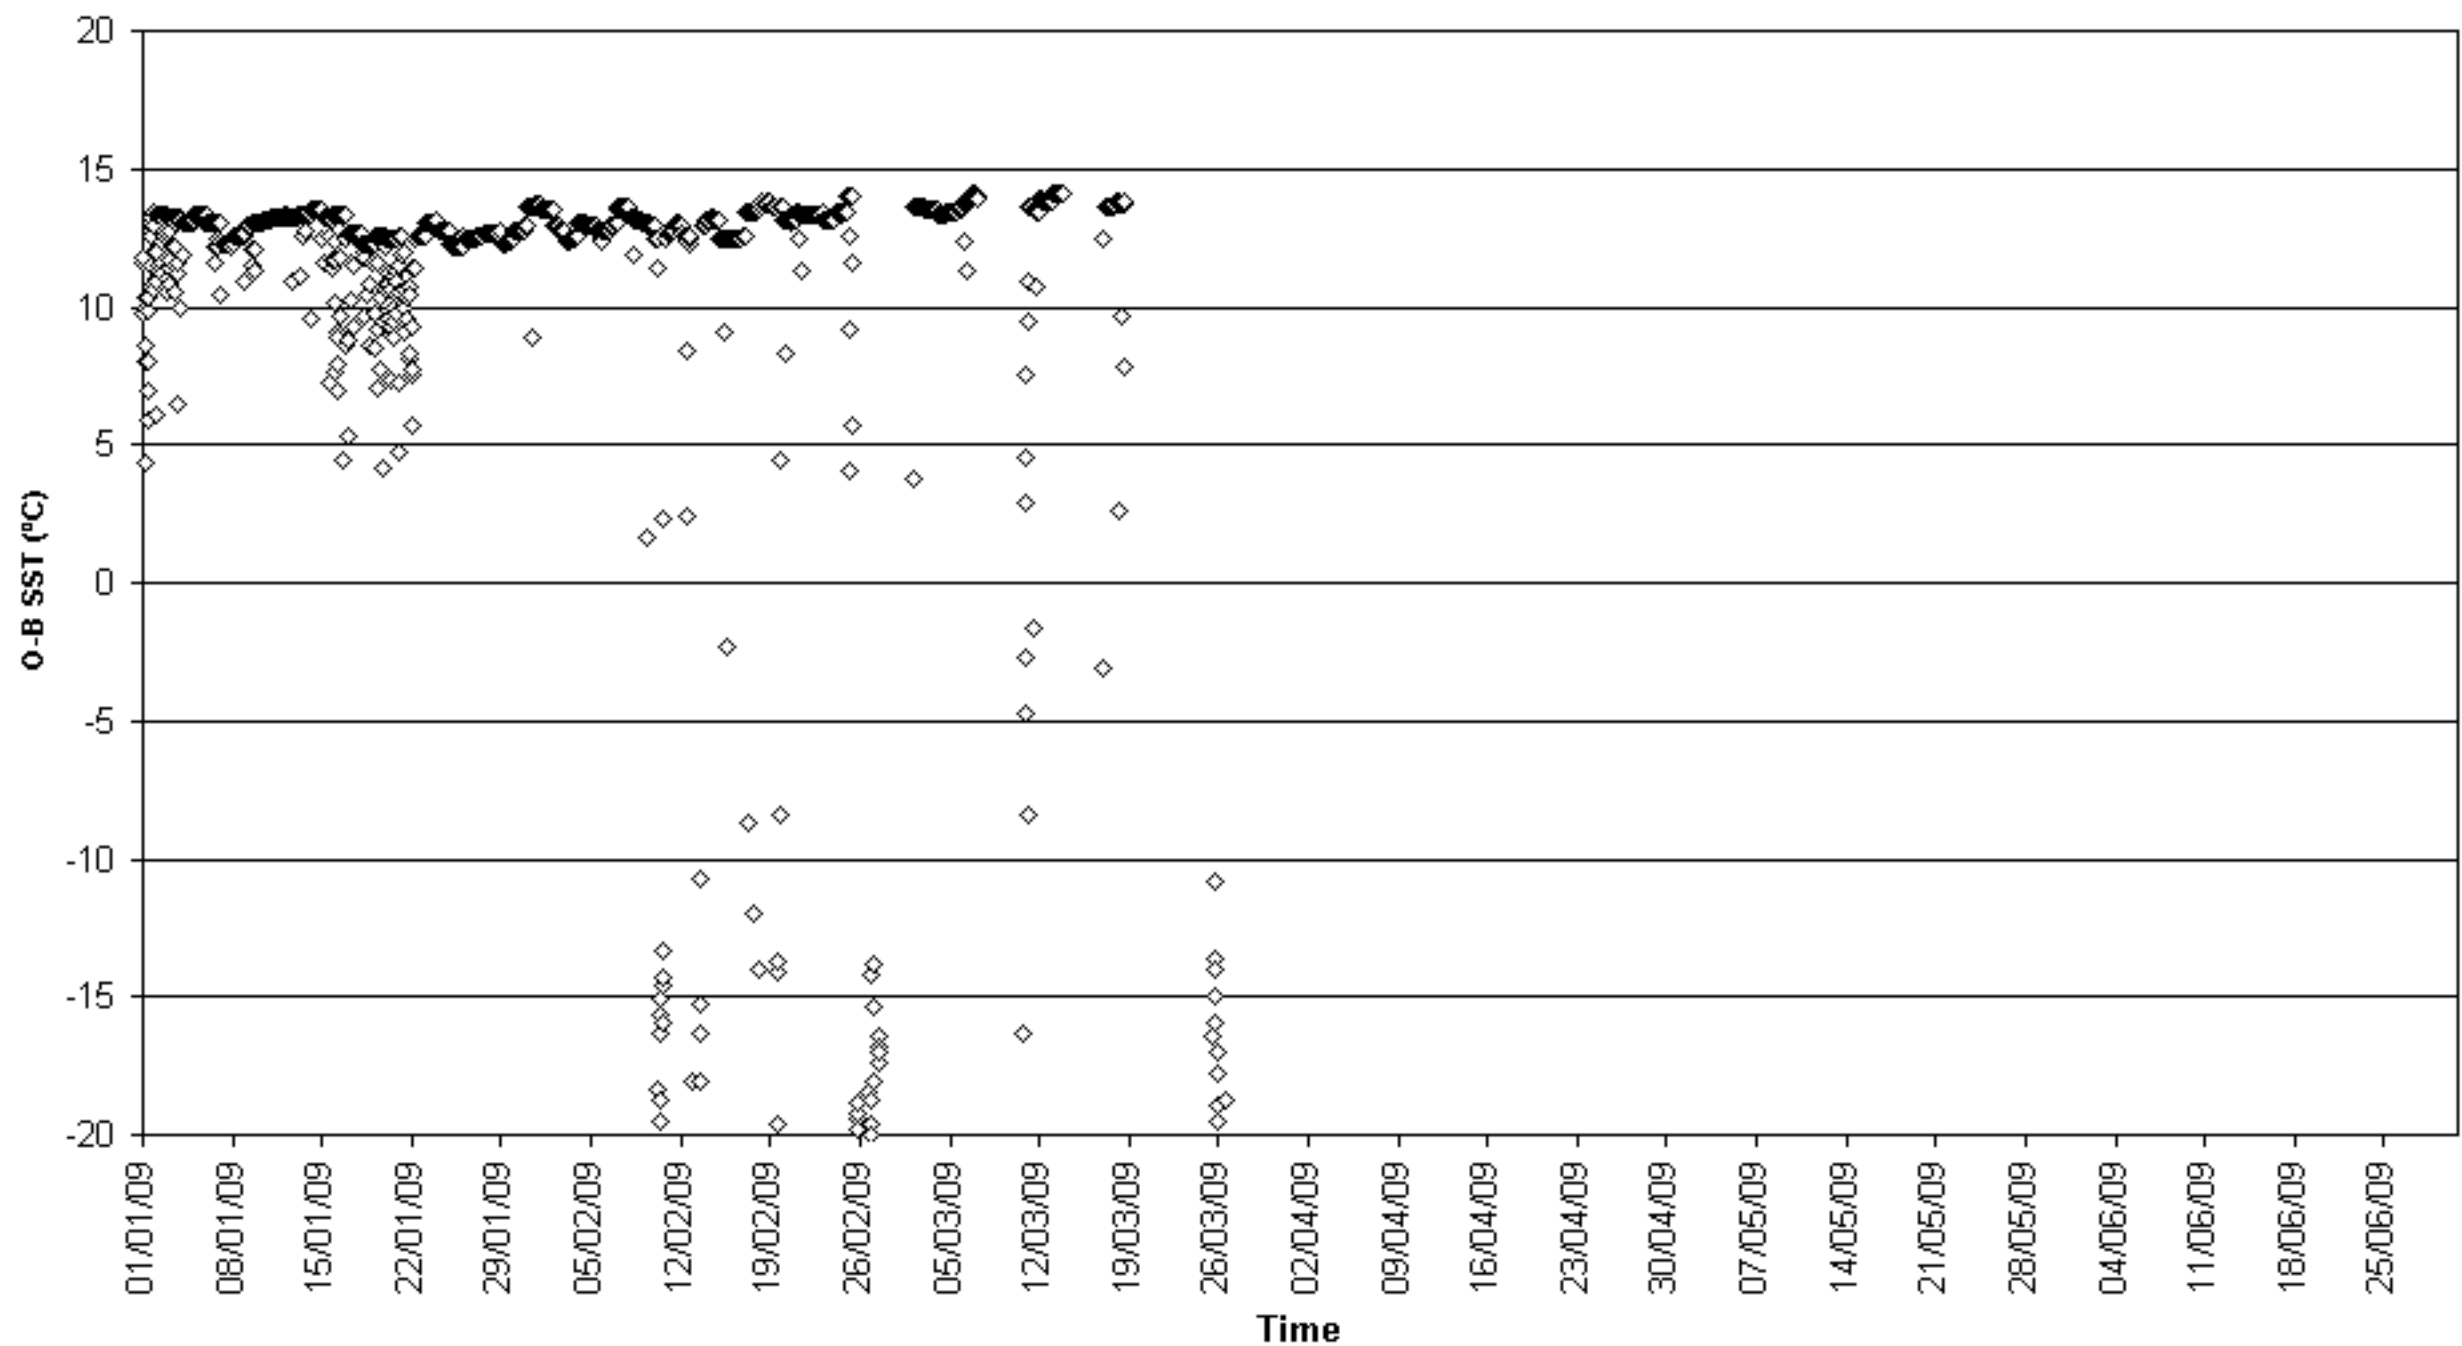


O-B SST (°C) for identifier 44503  
Number of obs. plotted = 1124 Number of outliers = 1

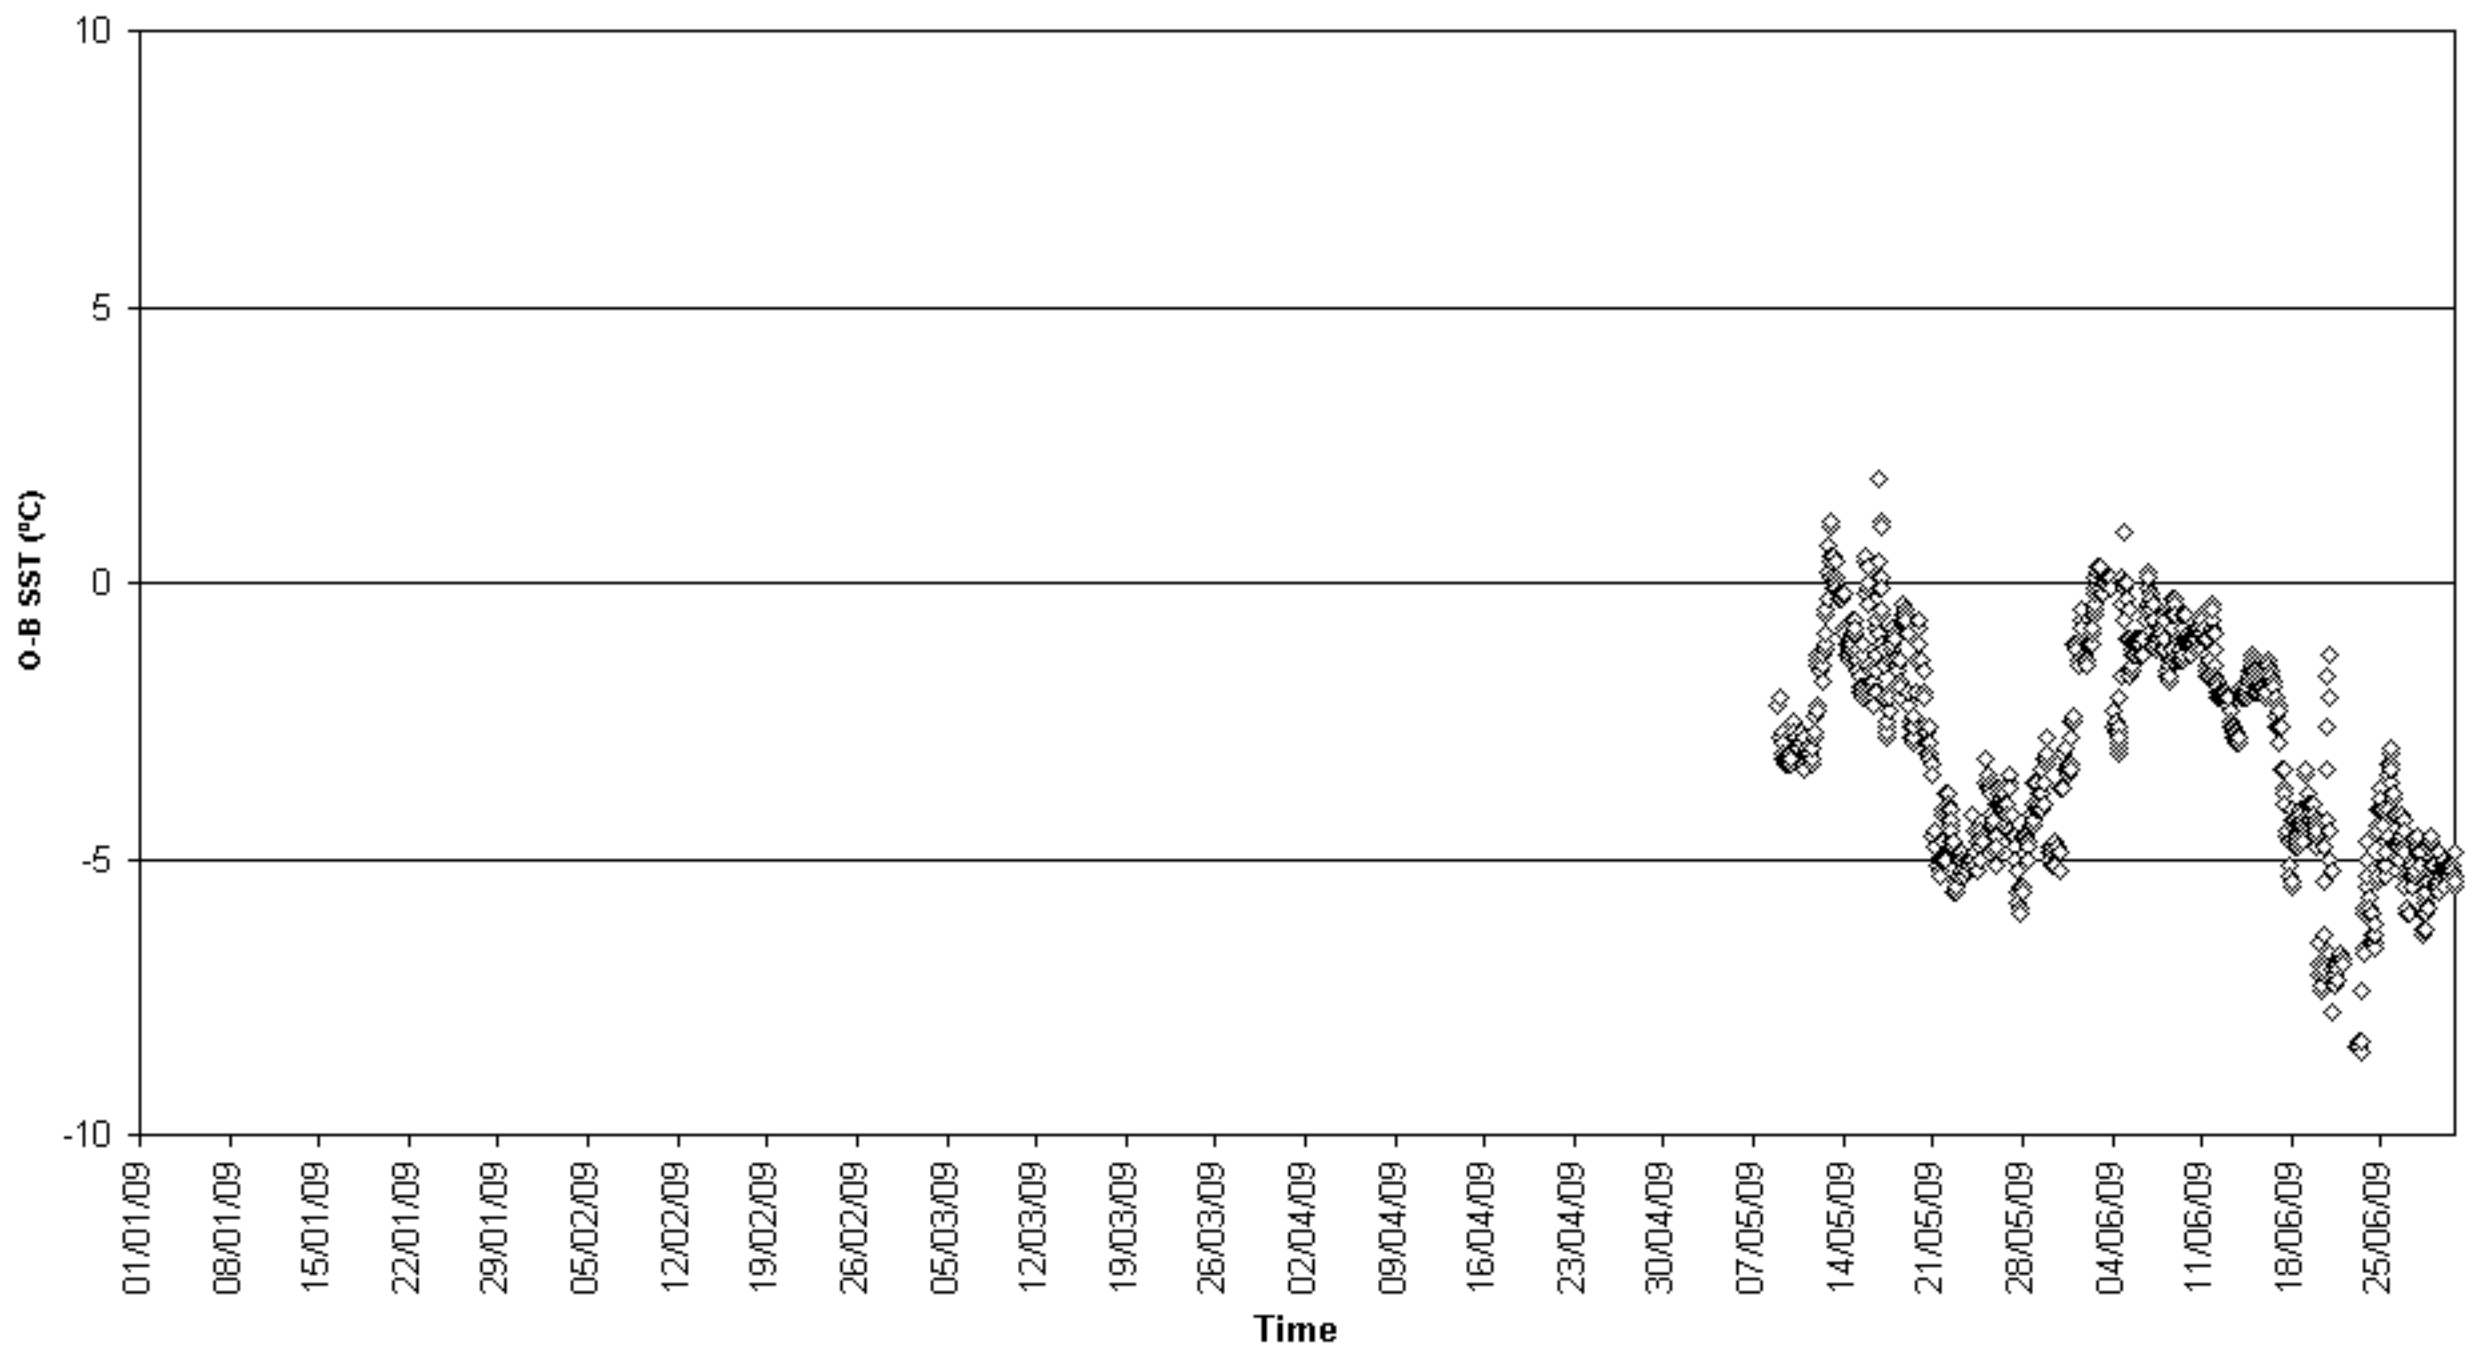


O-B SST (°C) for identifier 44622  
Number of obs. plotted = 193 Number of outliers = 0

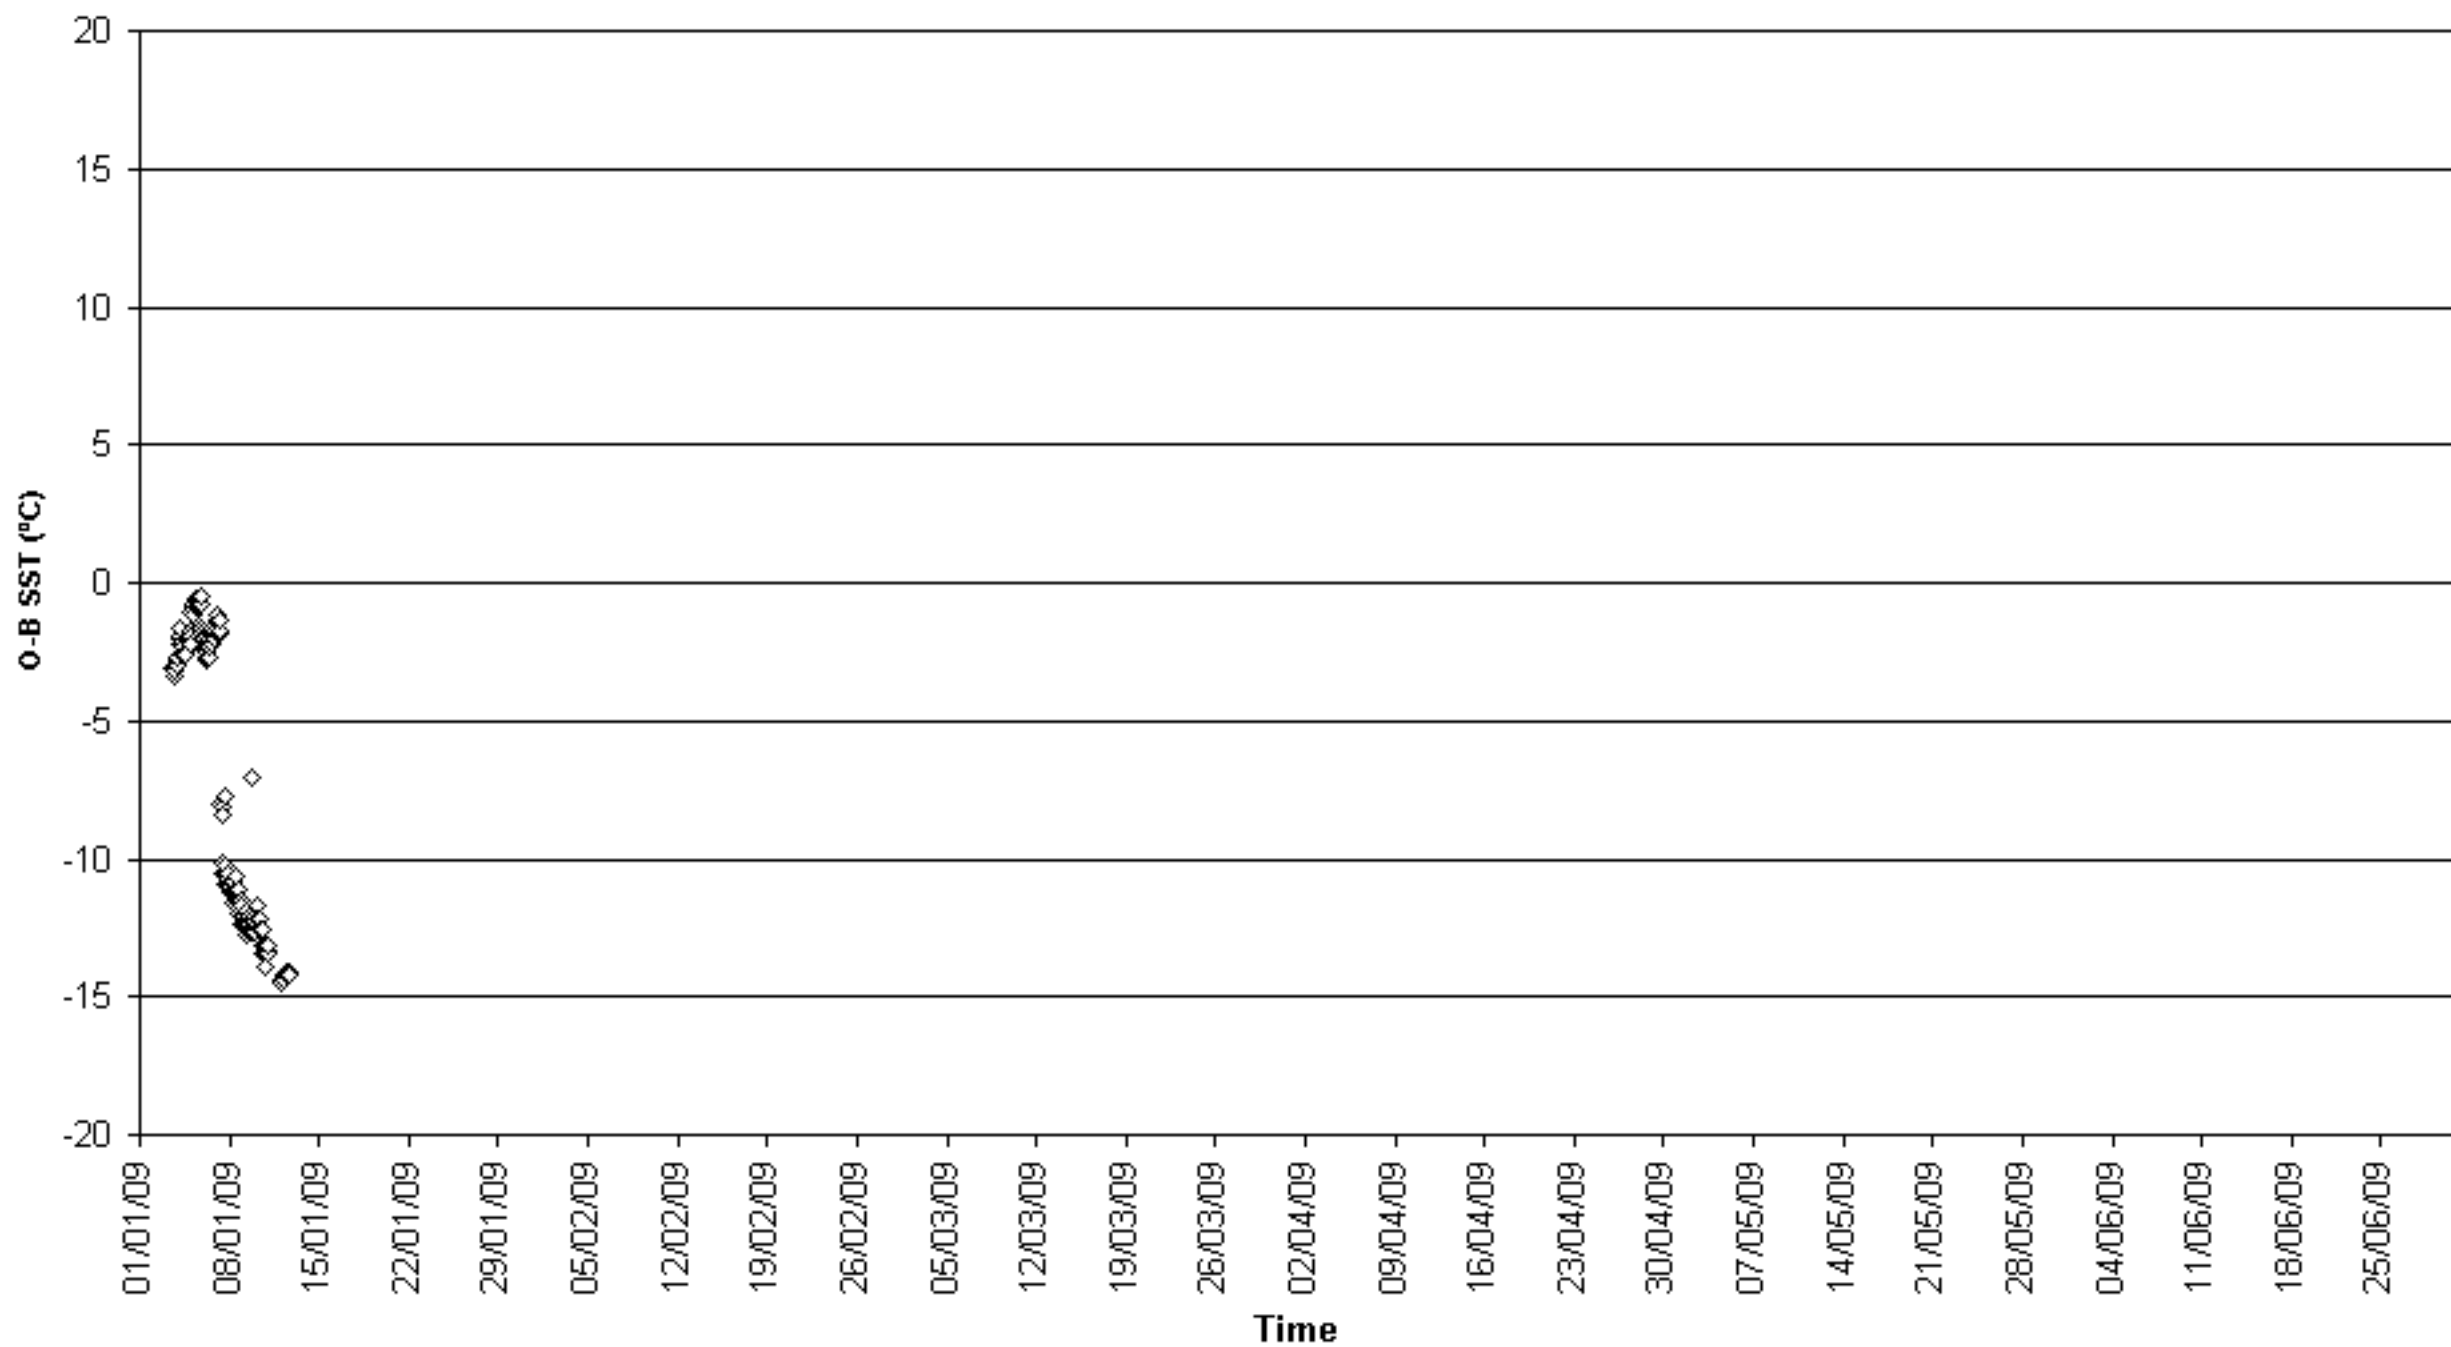


O-B SST (°C) for identifier 46634  
Number of obs. plotted = 1499 Number of outliers = 0

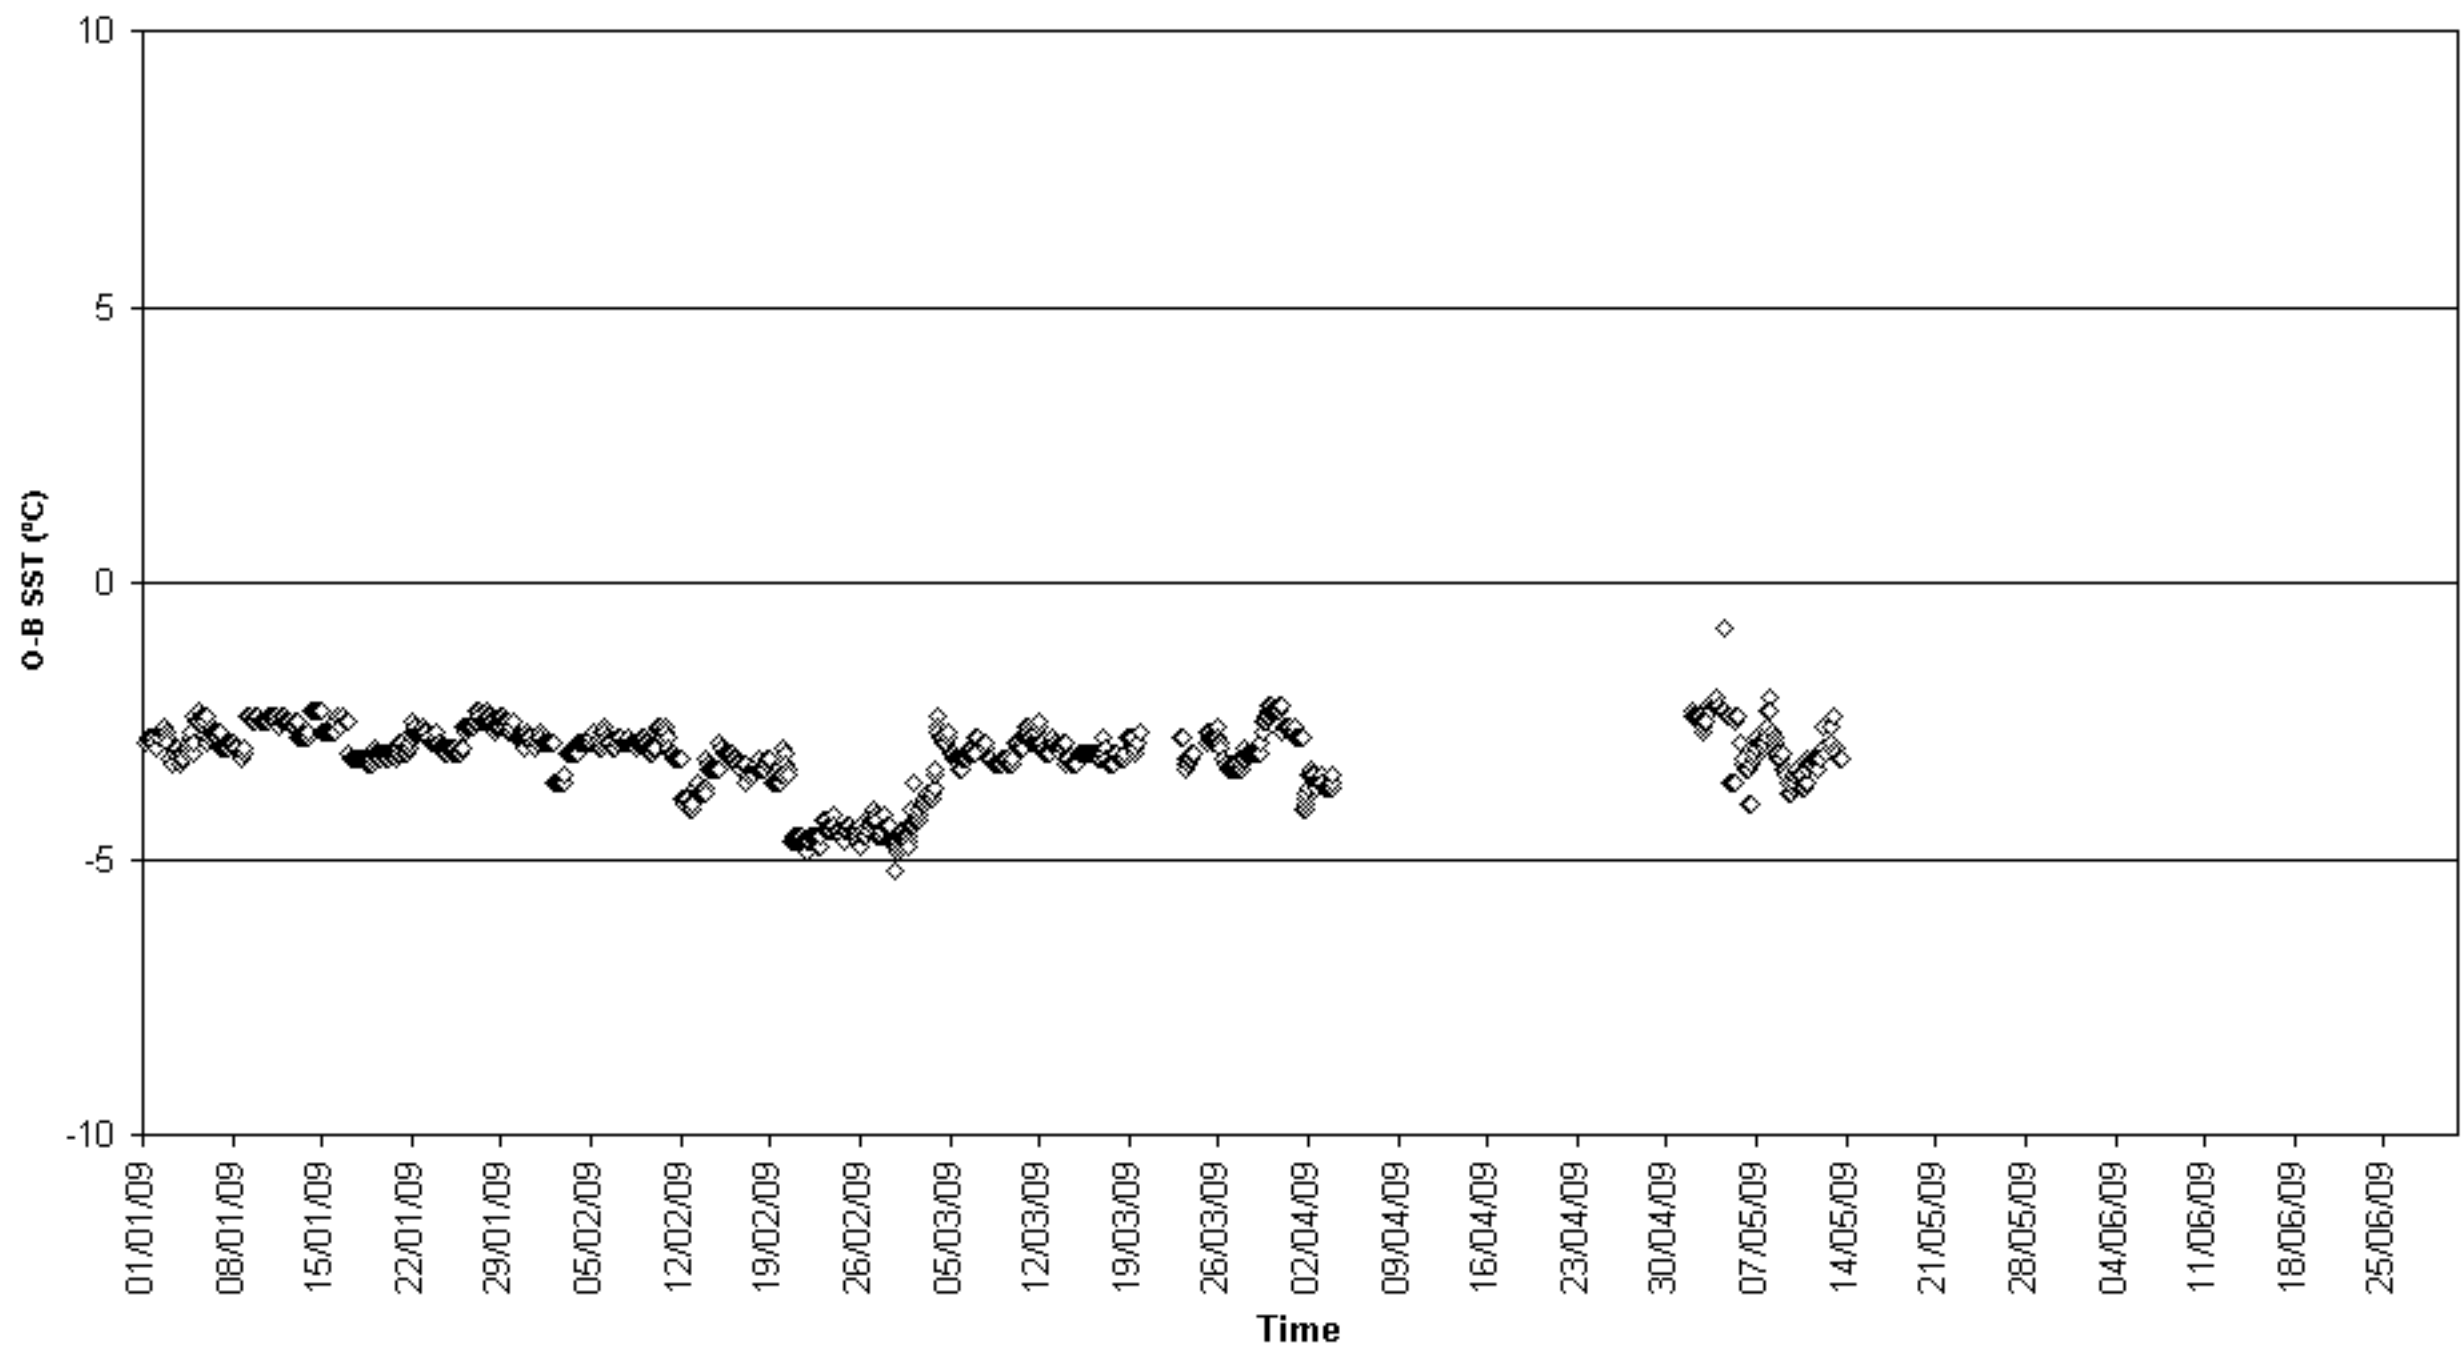

O-B SST (°C) for identifier 53964  
Number of obs. plotted = 164 Number of outliers = 15

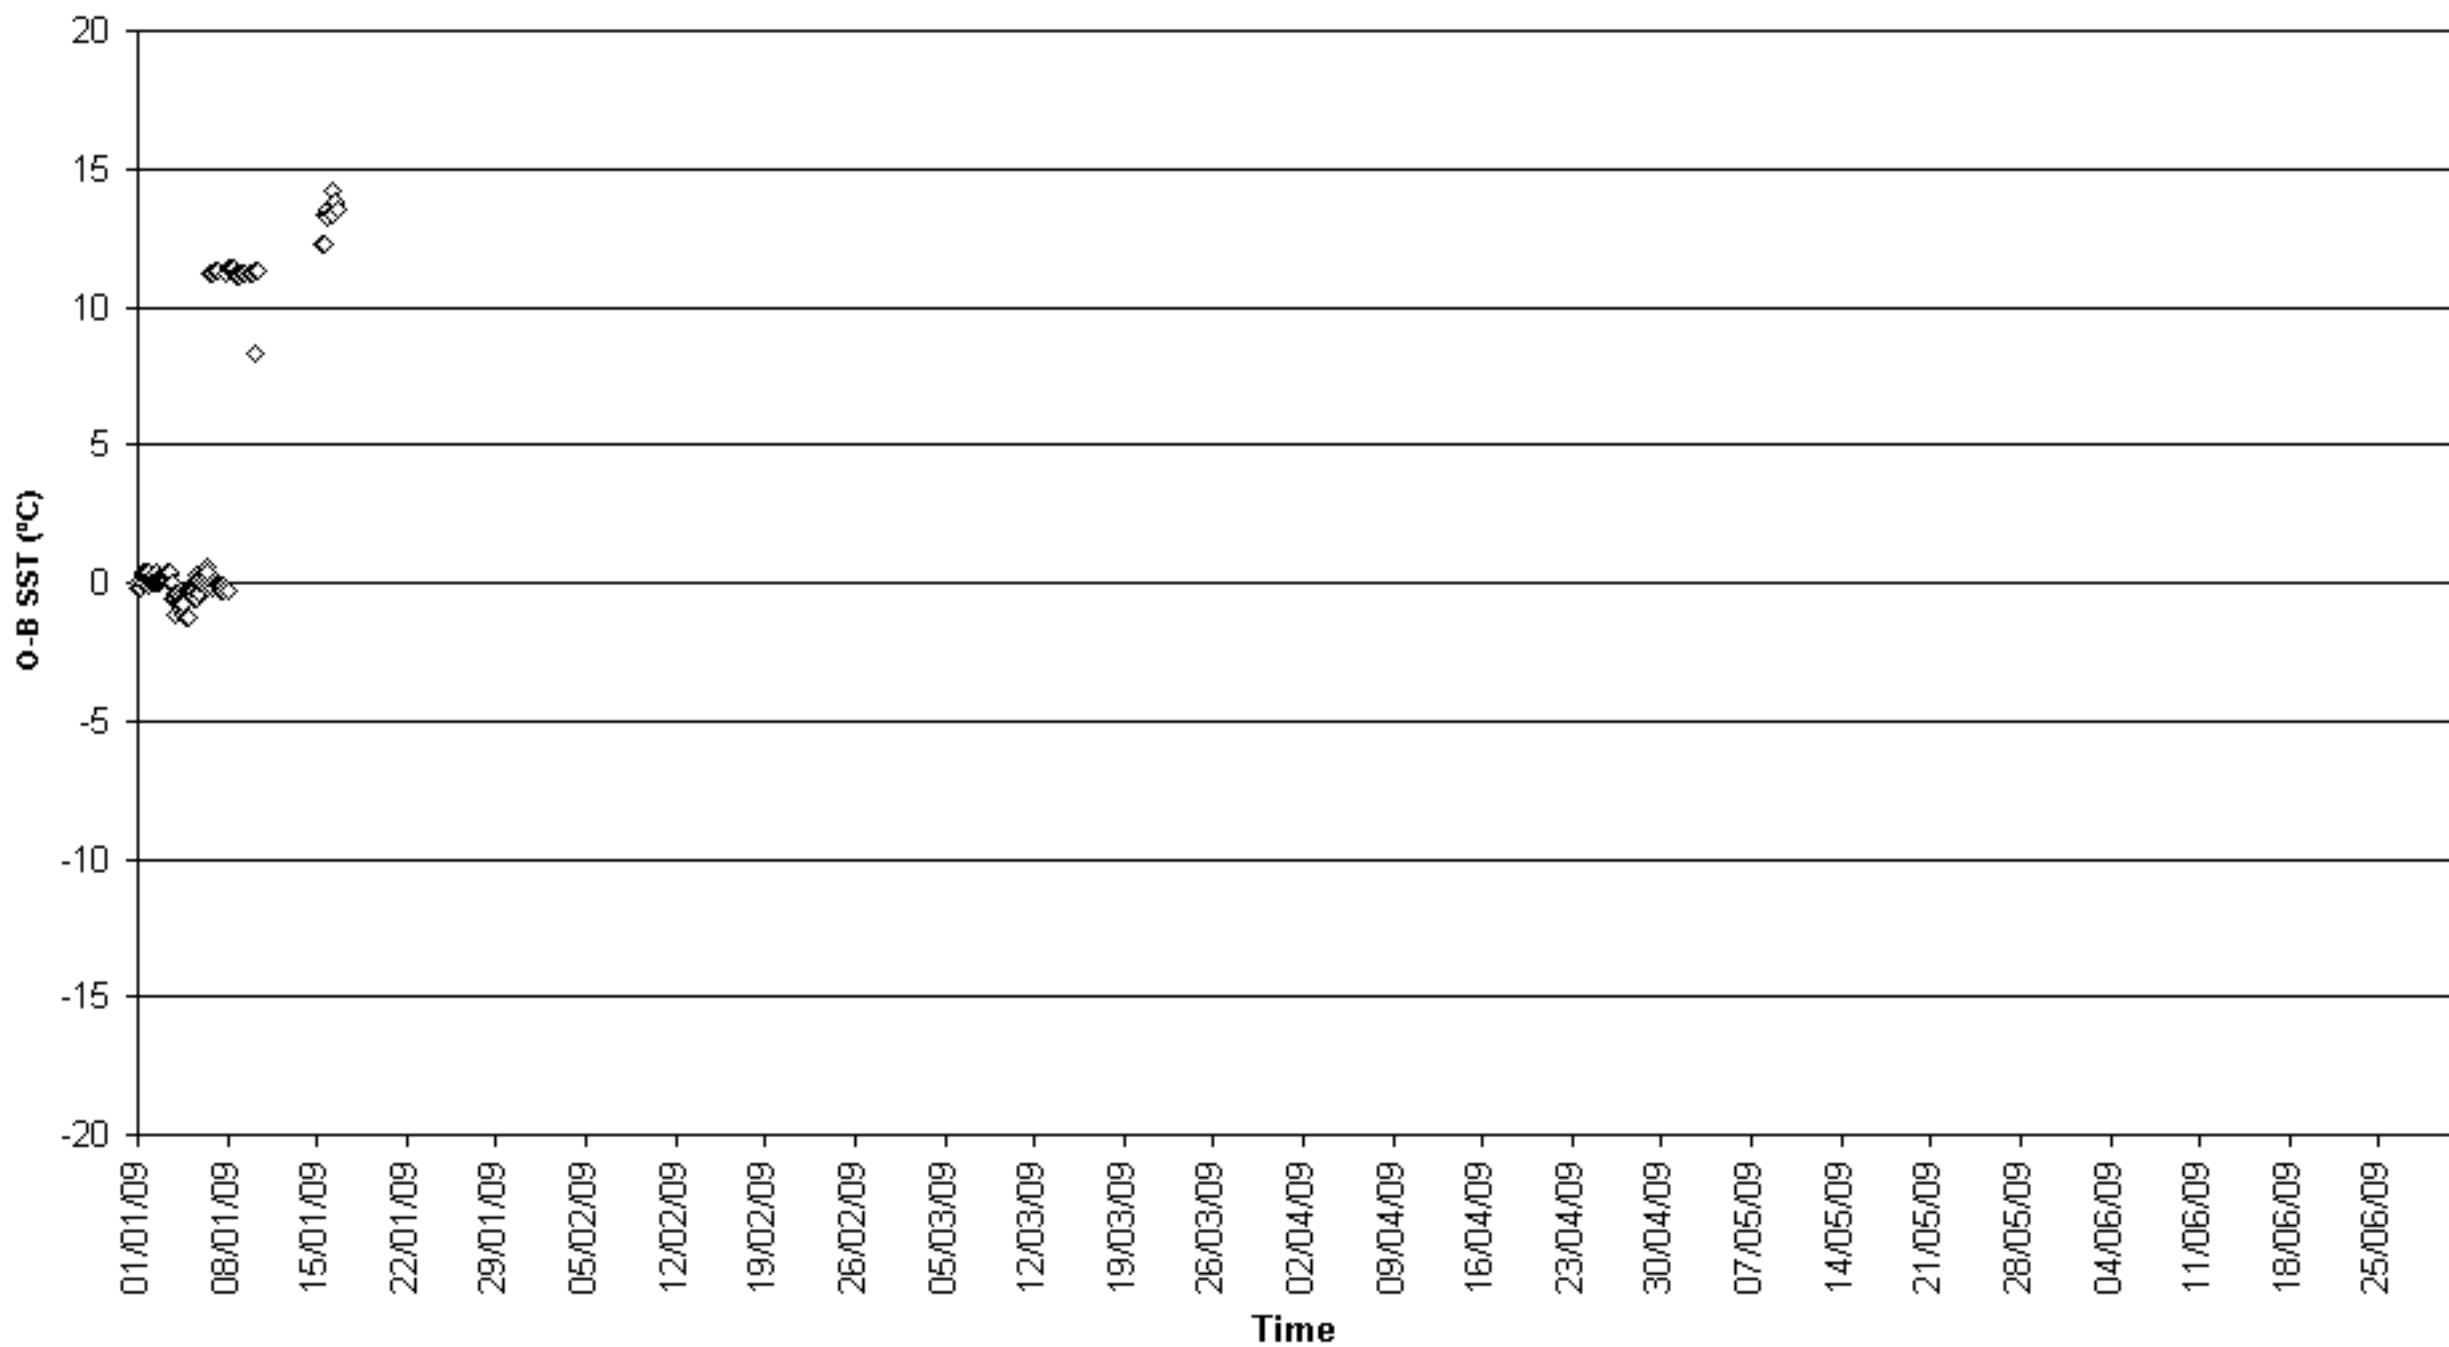


O-B SST (°C) for identifier 56528  
Number of obs. plotted = 529 Number of outliers = 0

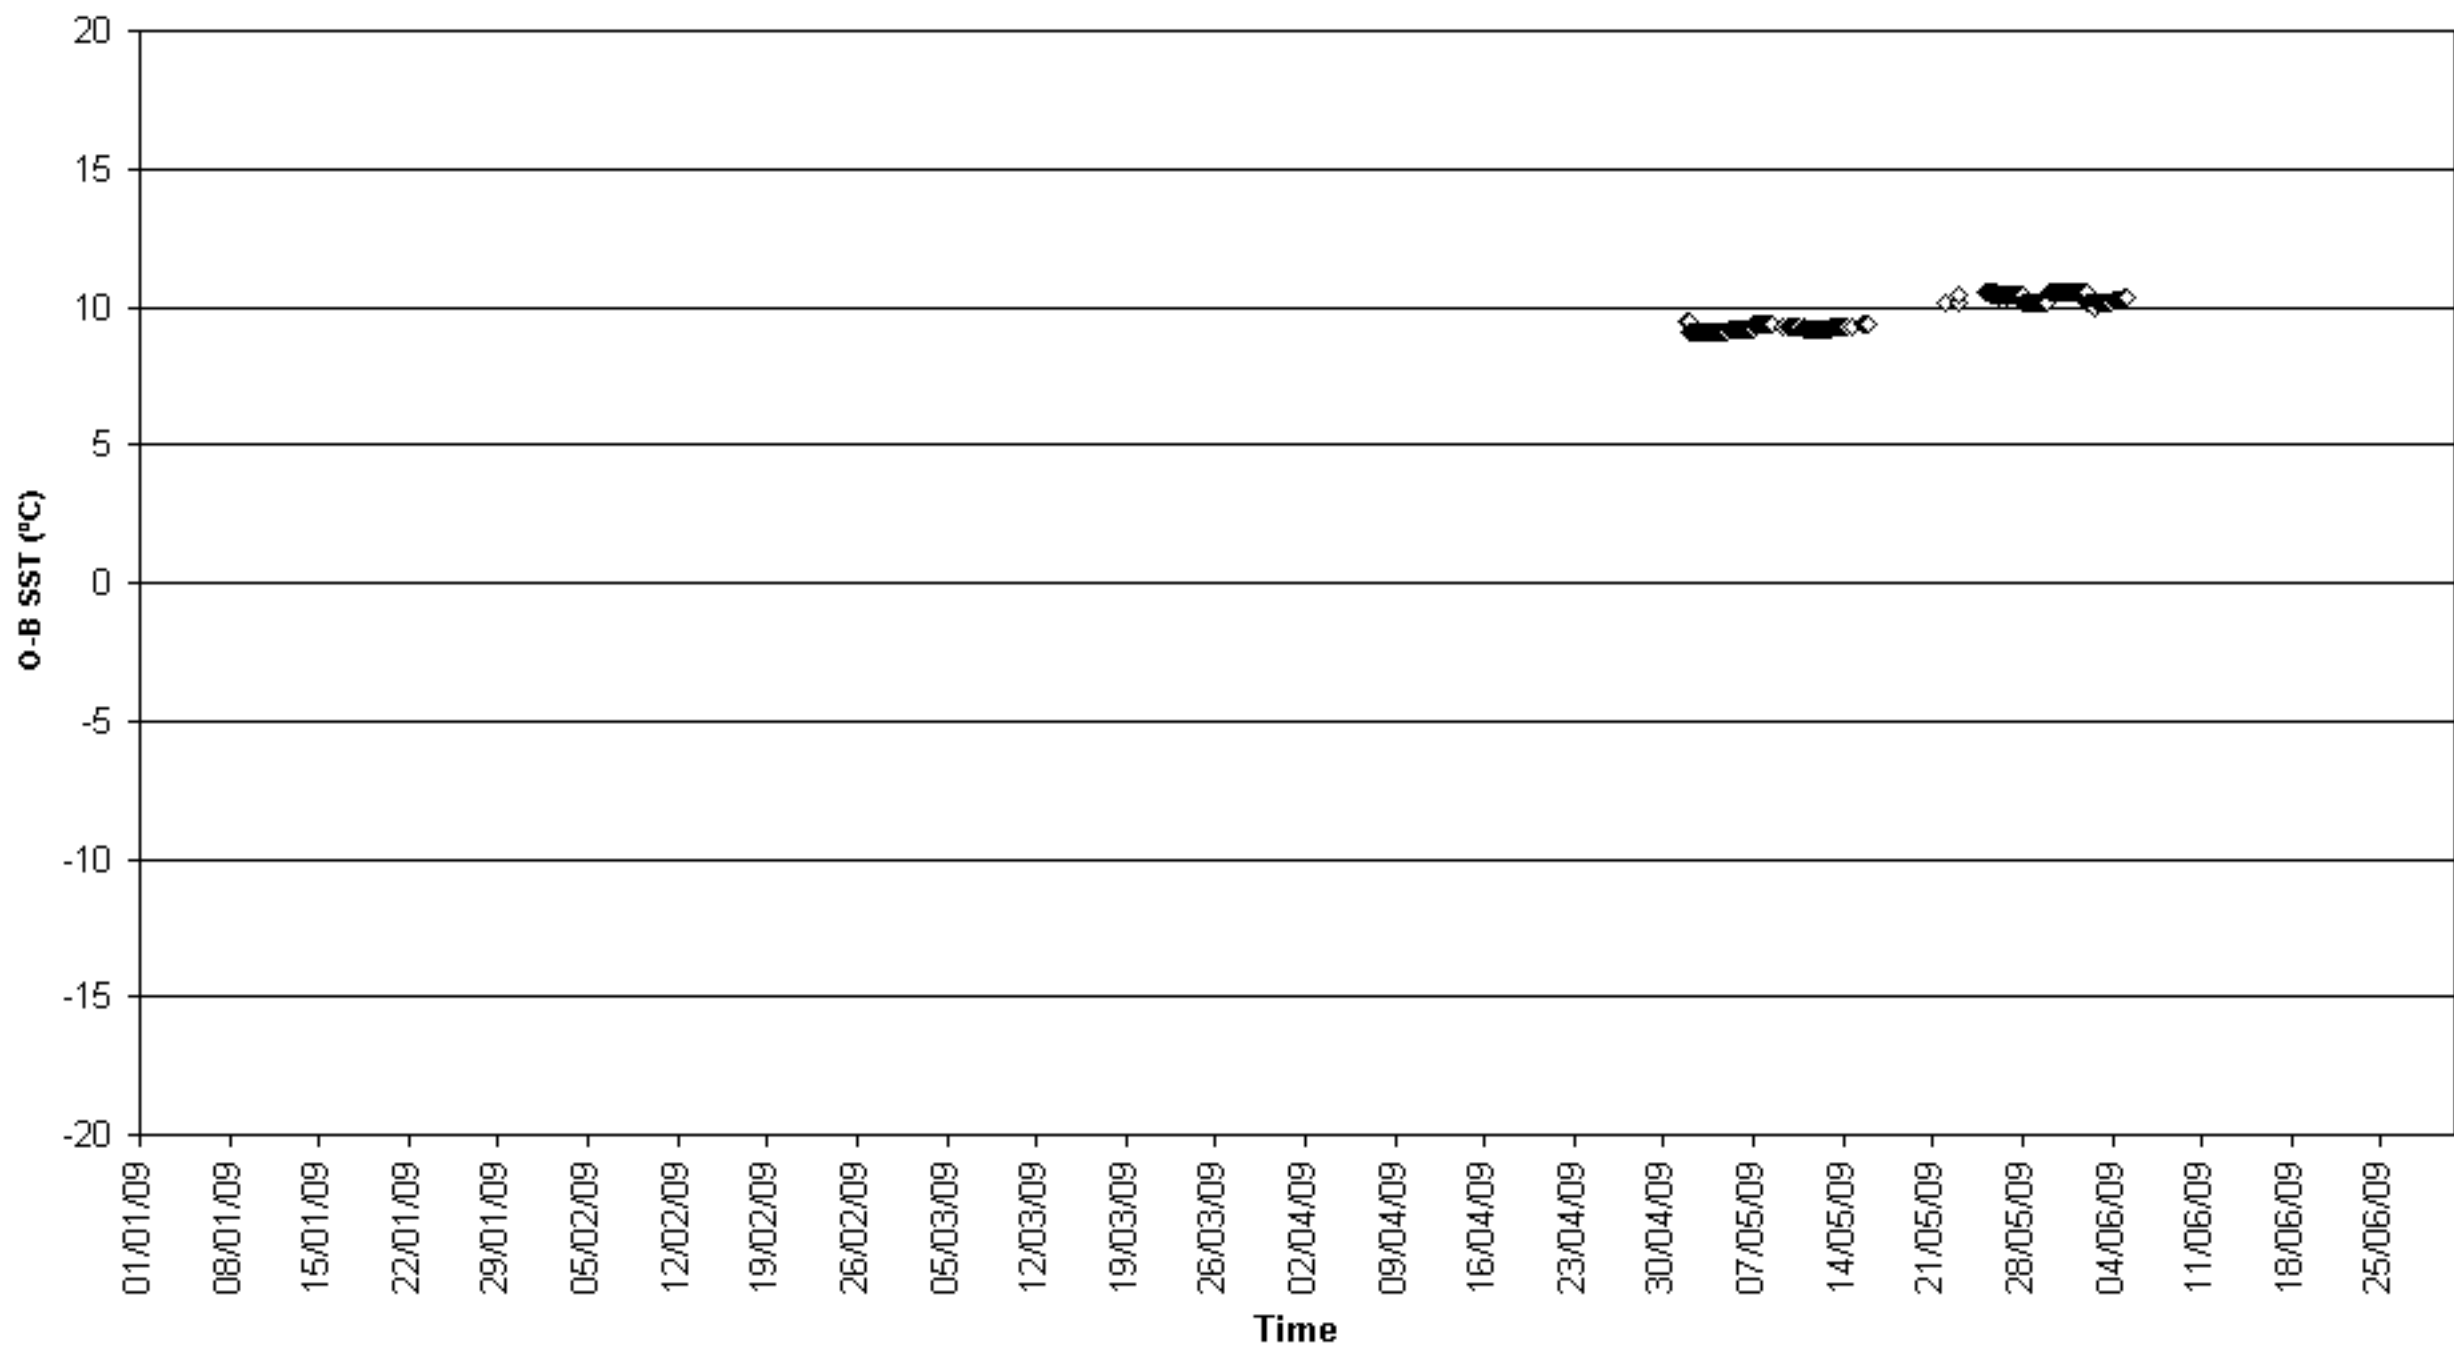





O-B SST (°C) for identifier 63941  
Number of obs. plotted = 168 Number of outliers = 14

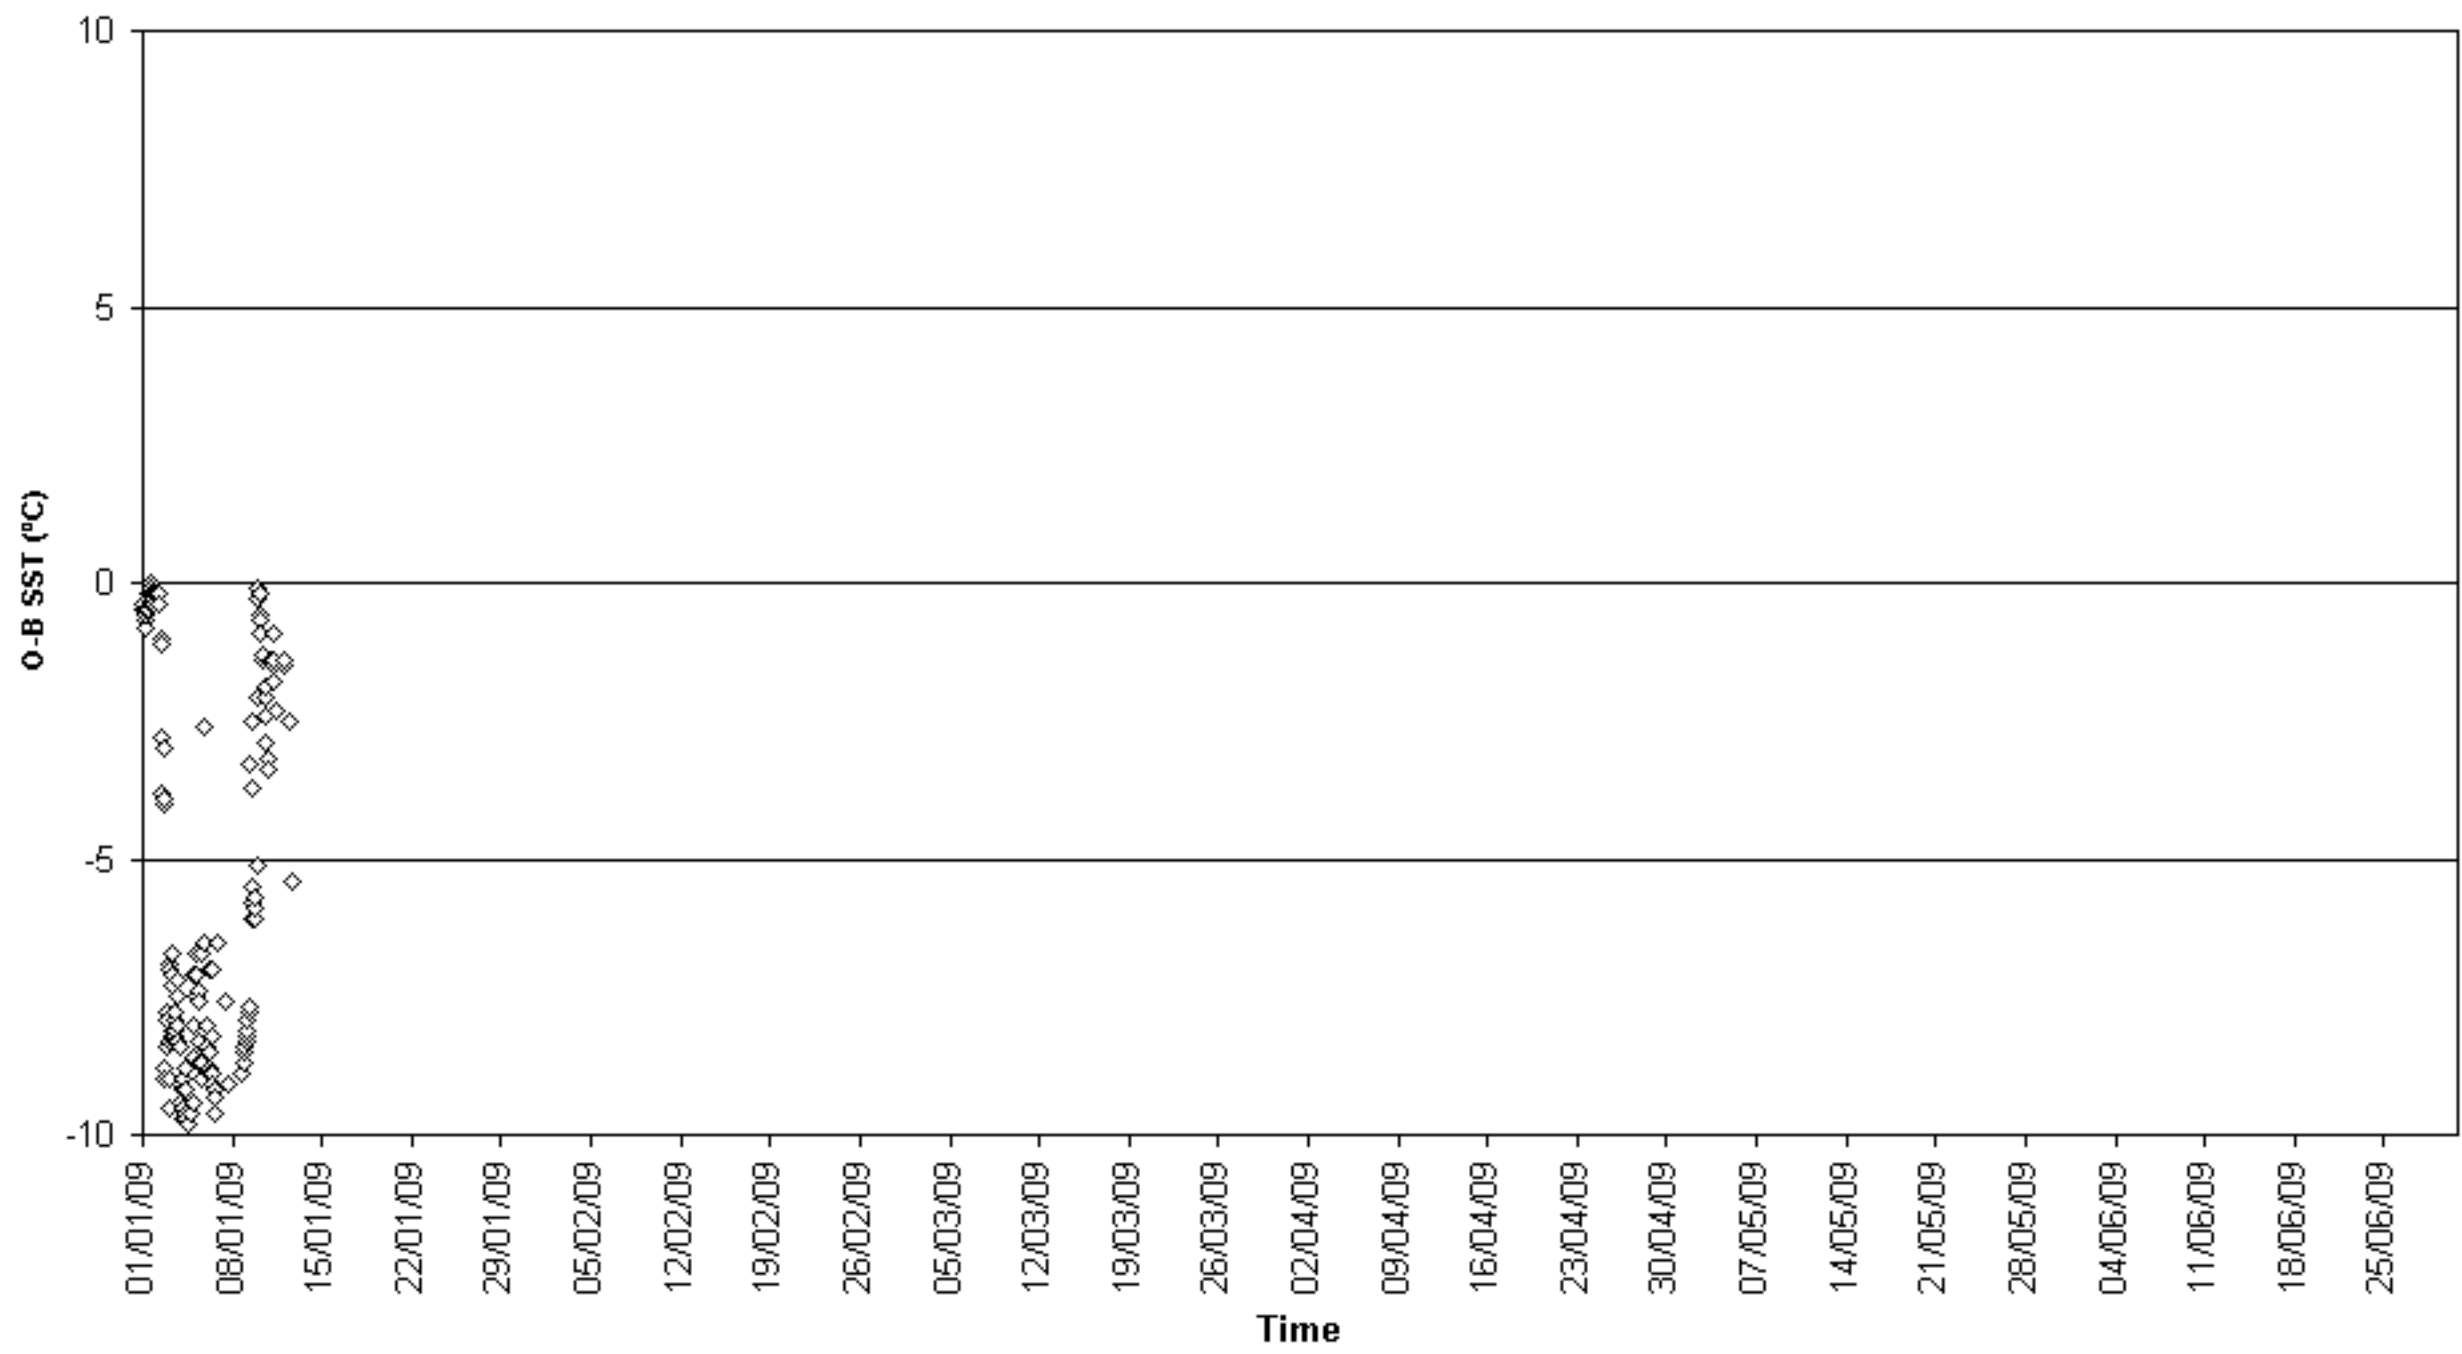


O-B SST (°C) for identifier 65581  
Number of obs. plotted = 240 Number of outliers = 4

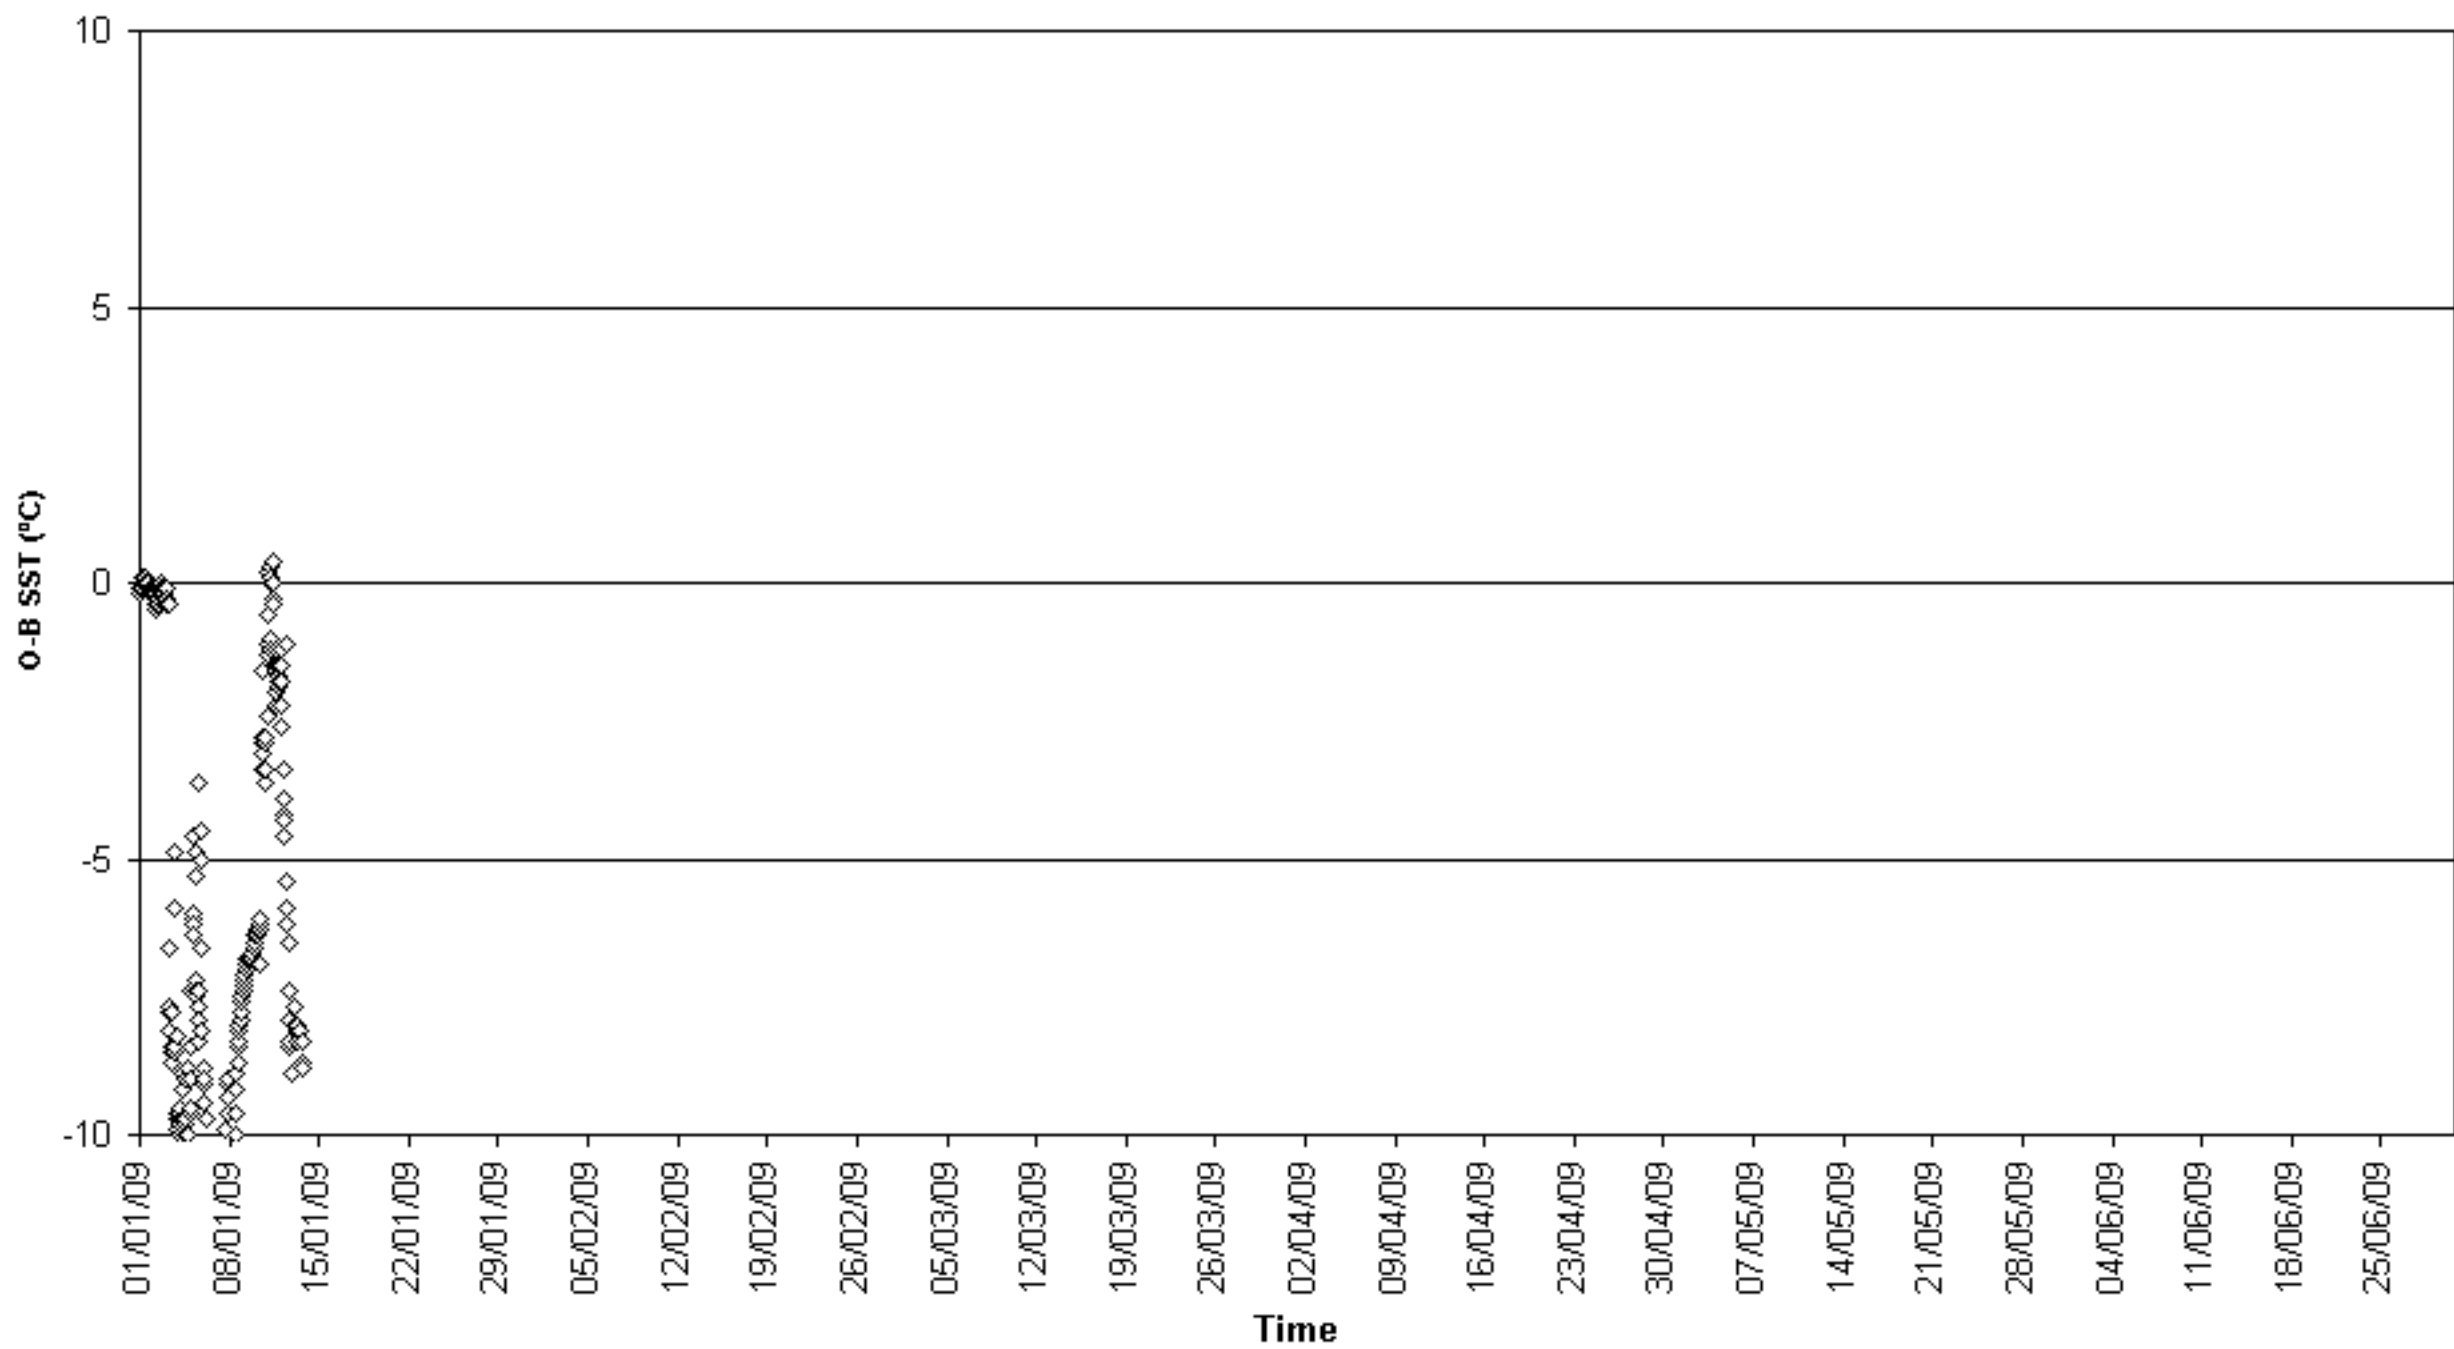


O-B SST (°C) for identifier 9HJB9  
Number of obs. plotted = 618 Number of outliers = 995

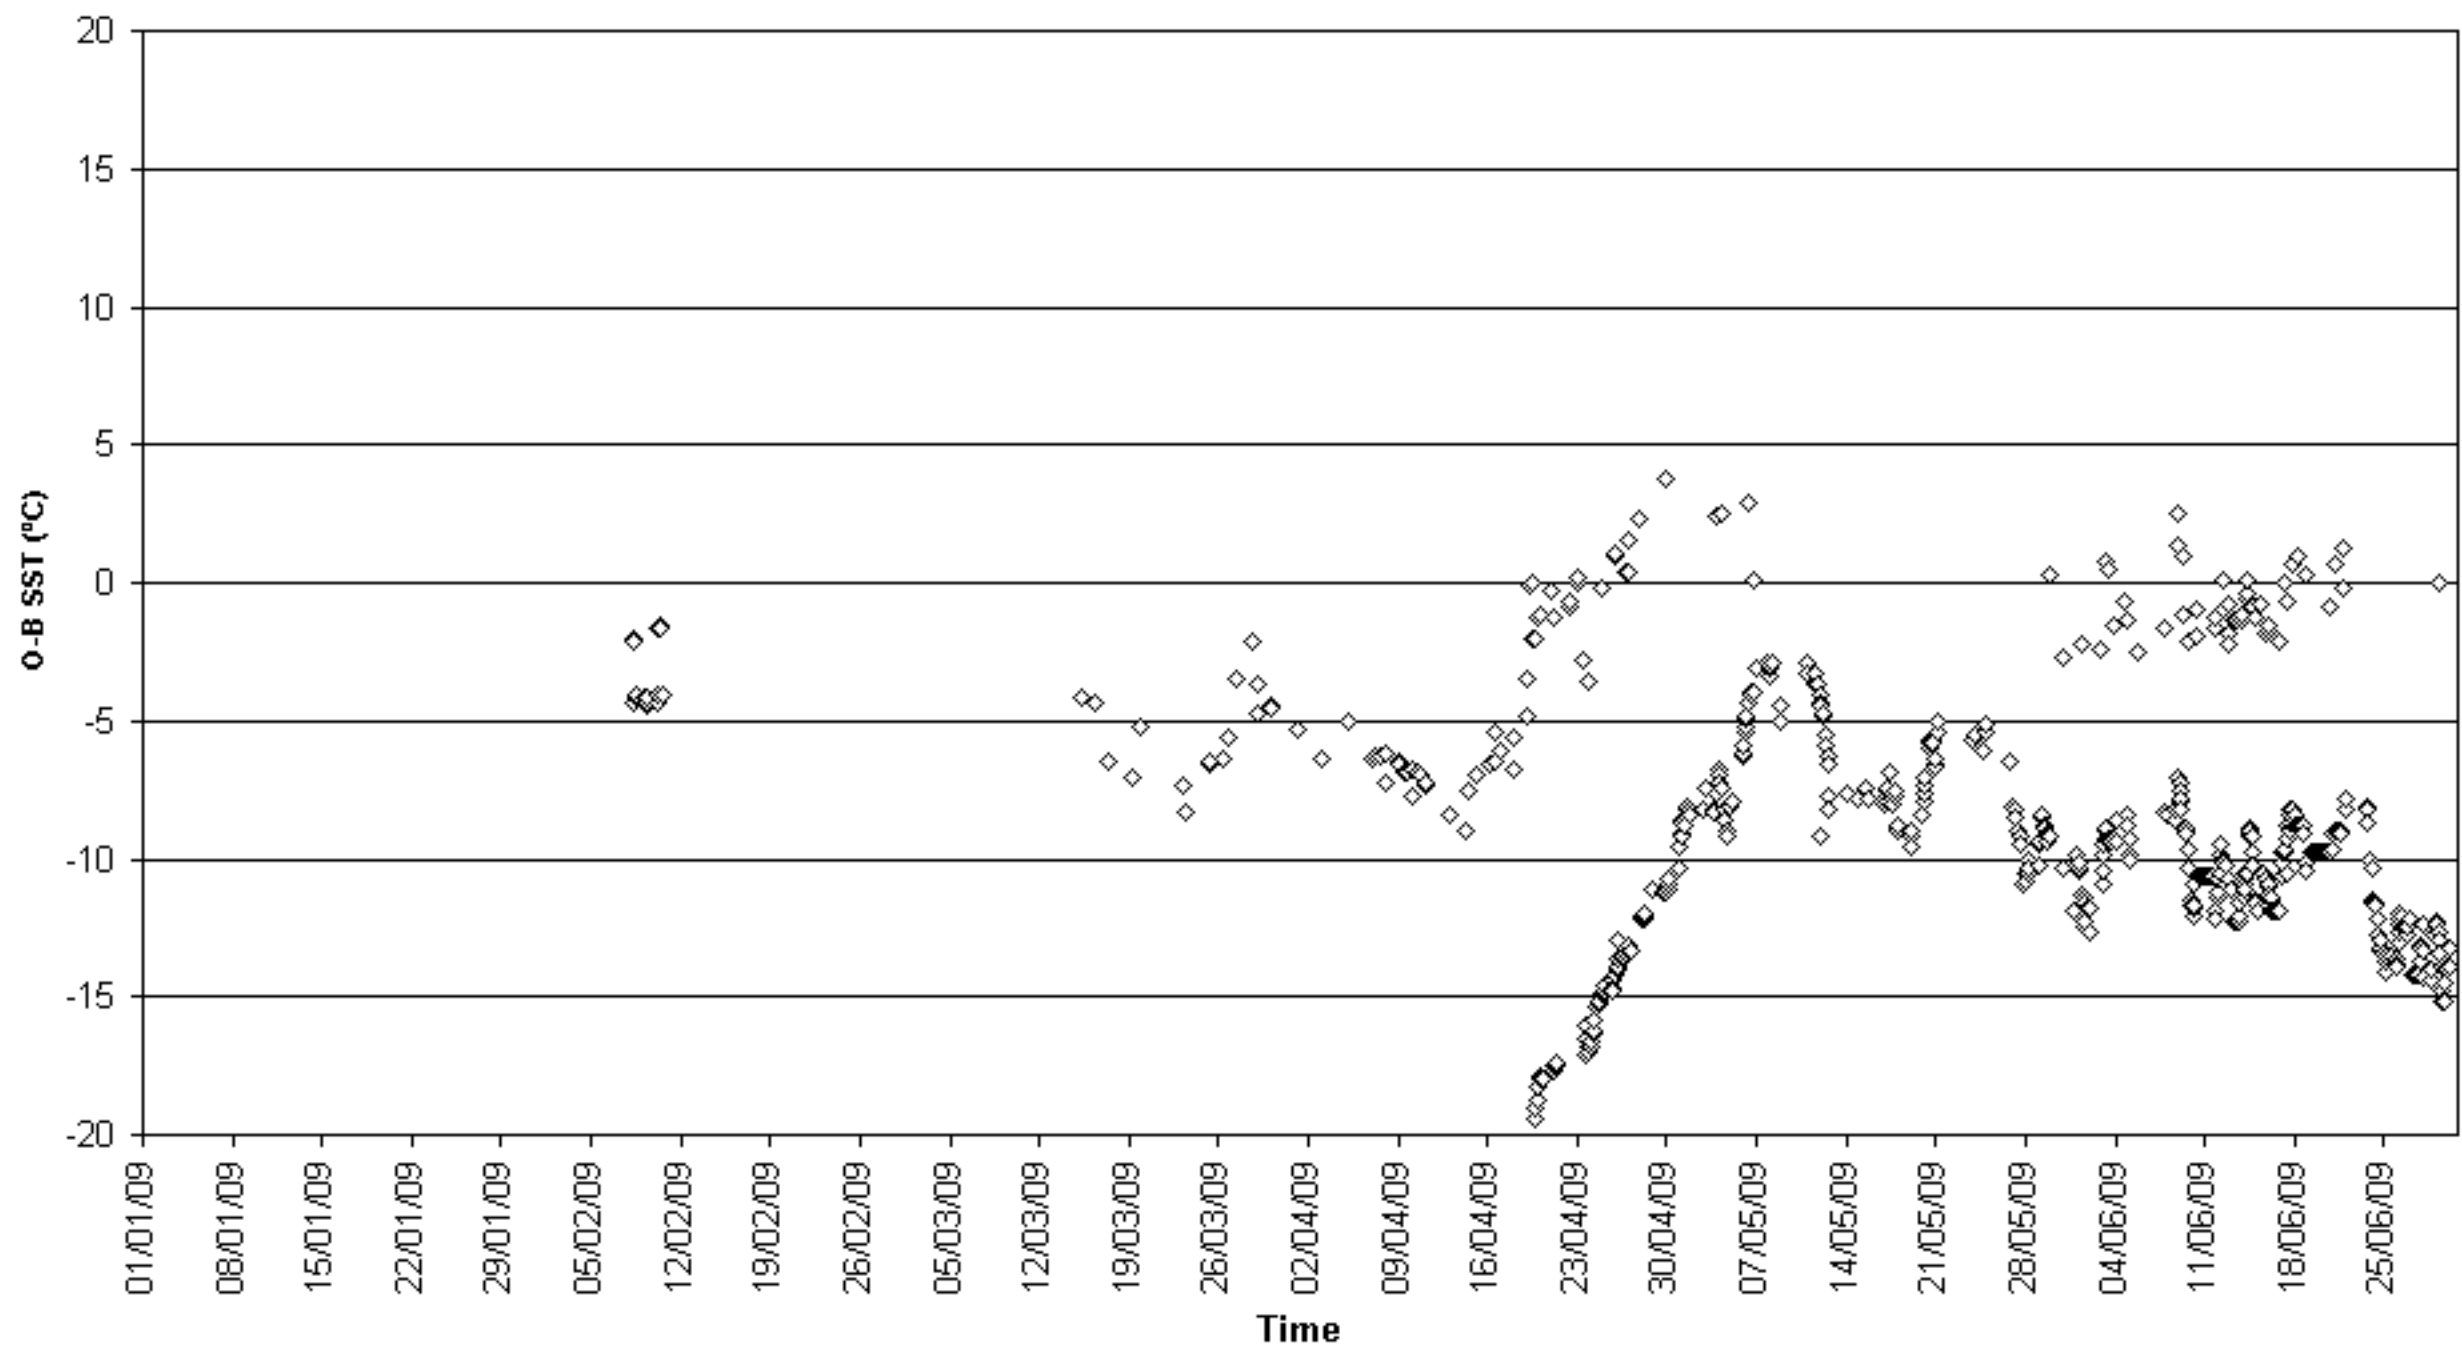


O-B SST (°C) for identifier 9KKS  
Number of obs. plotted = 296 Number of outliers = 0

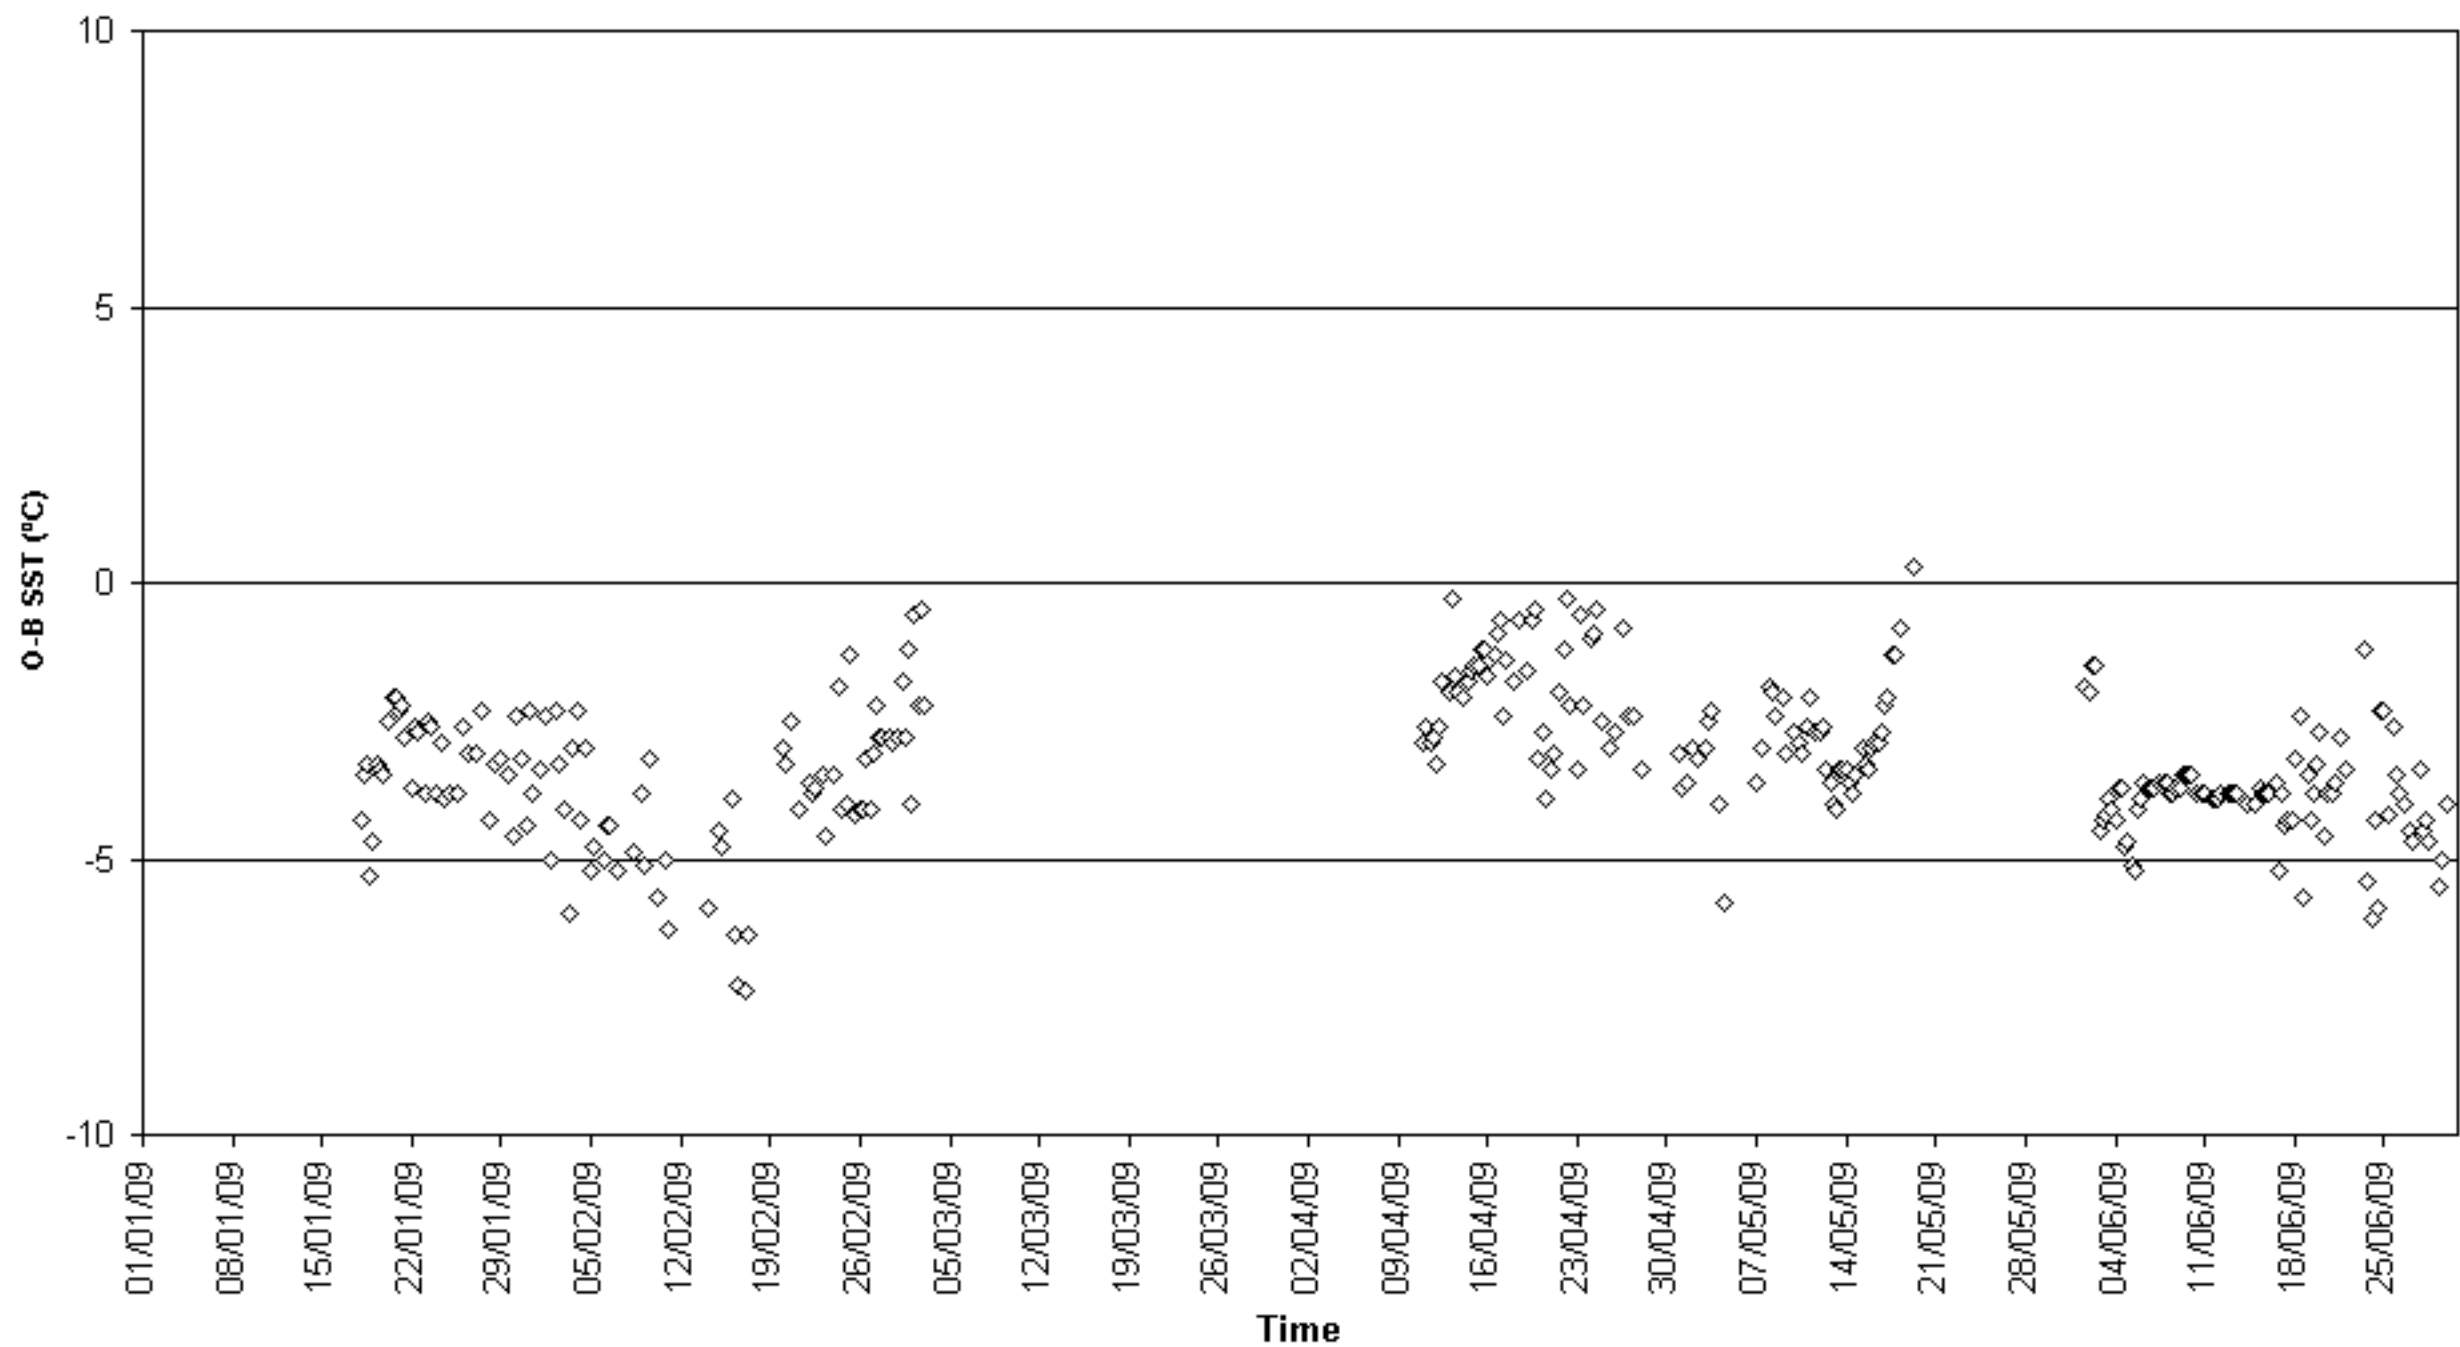


O-B SST (°C) for identifier 9VAH  
Number of obs. plotted = 84 Number of outliers = 14

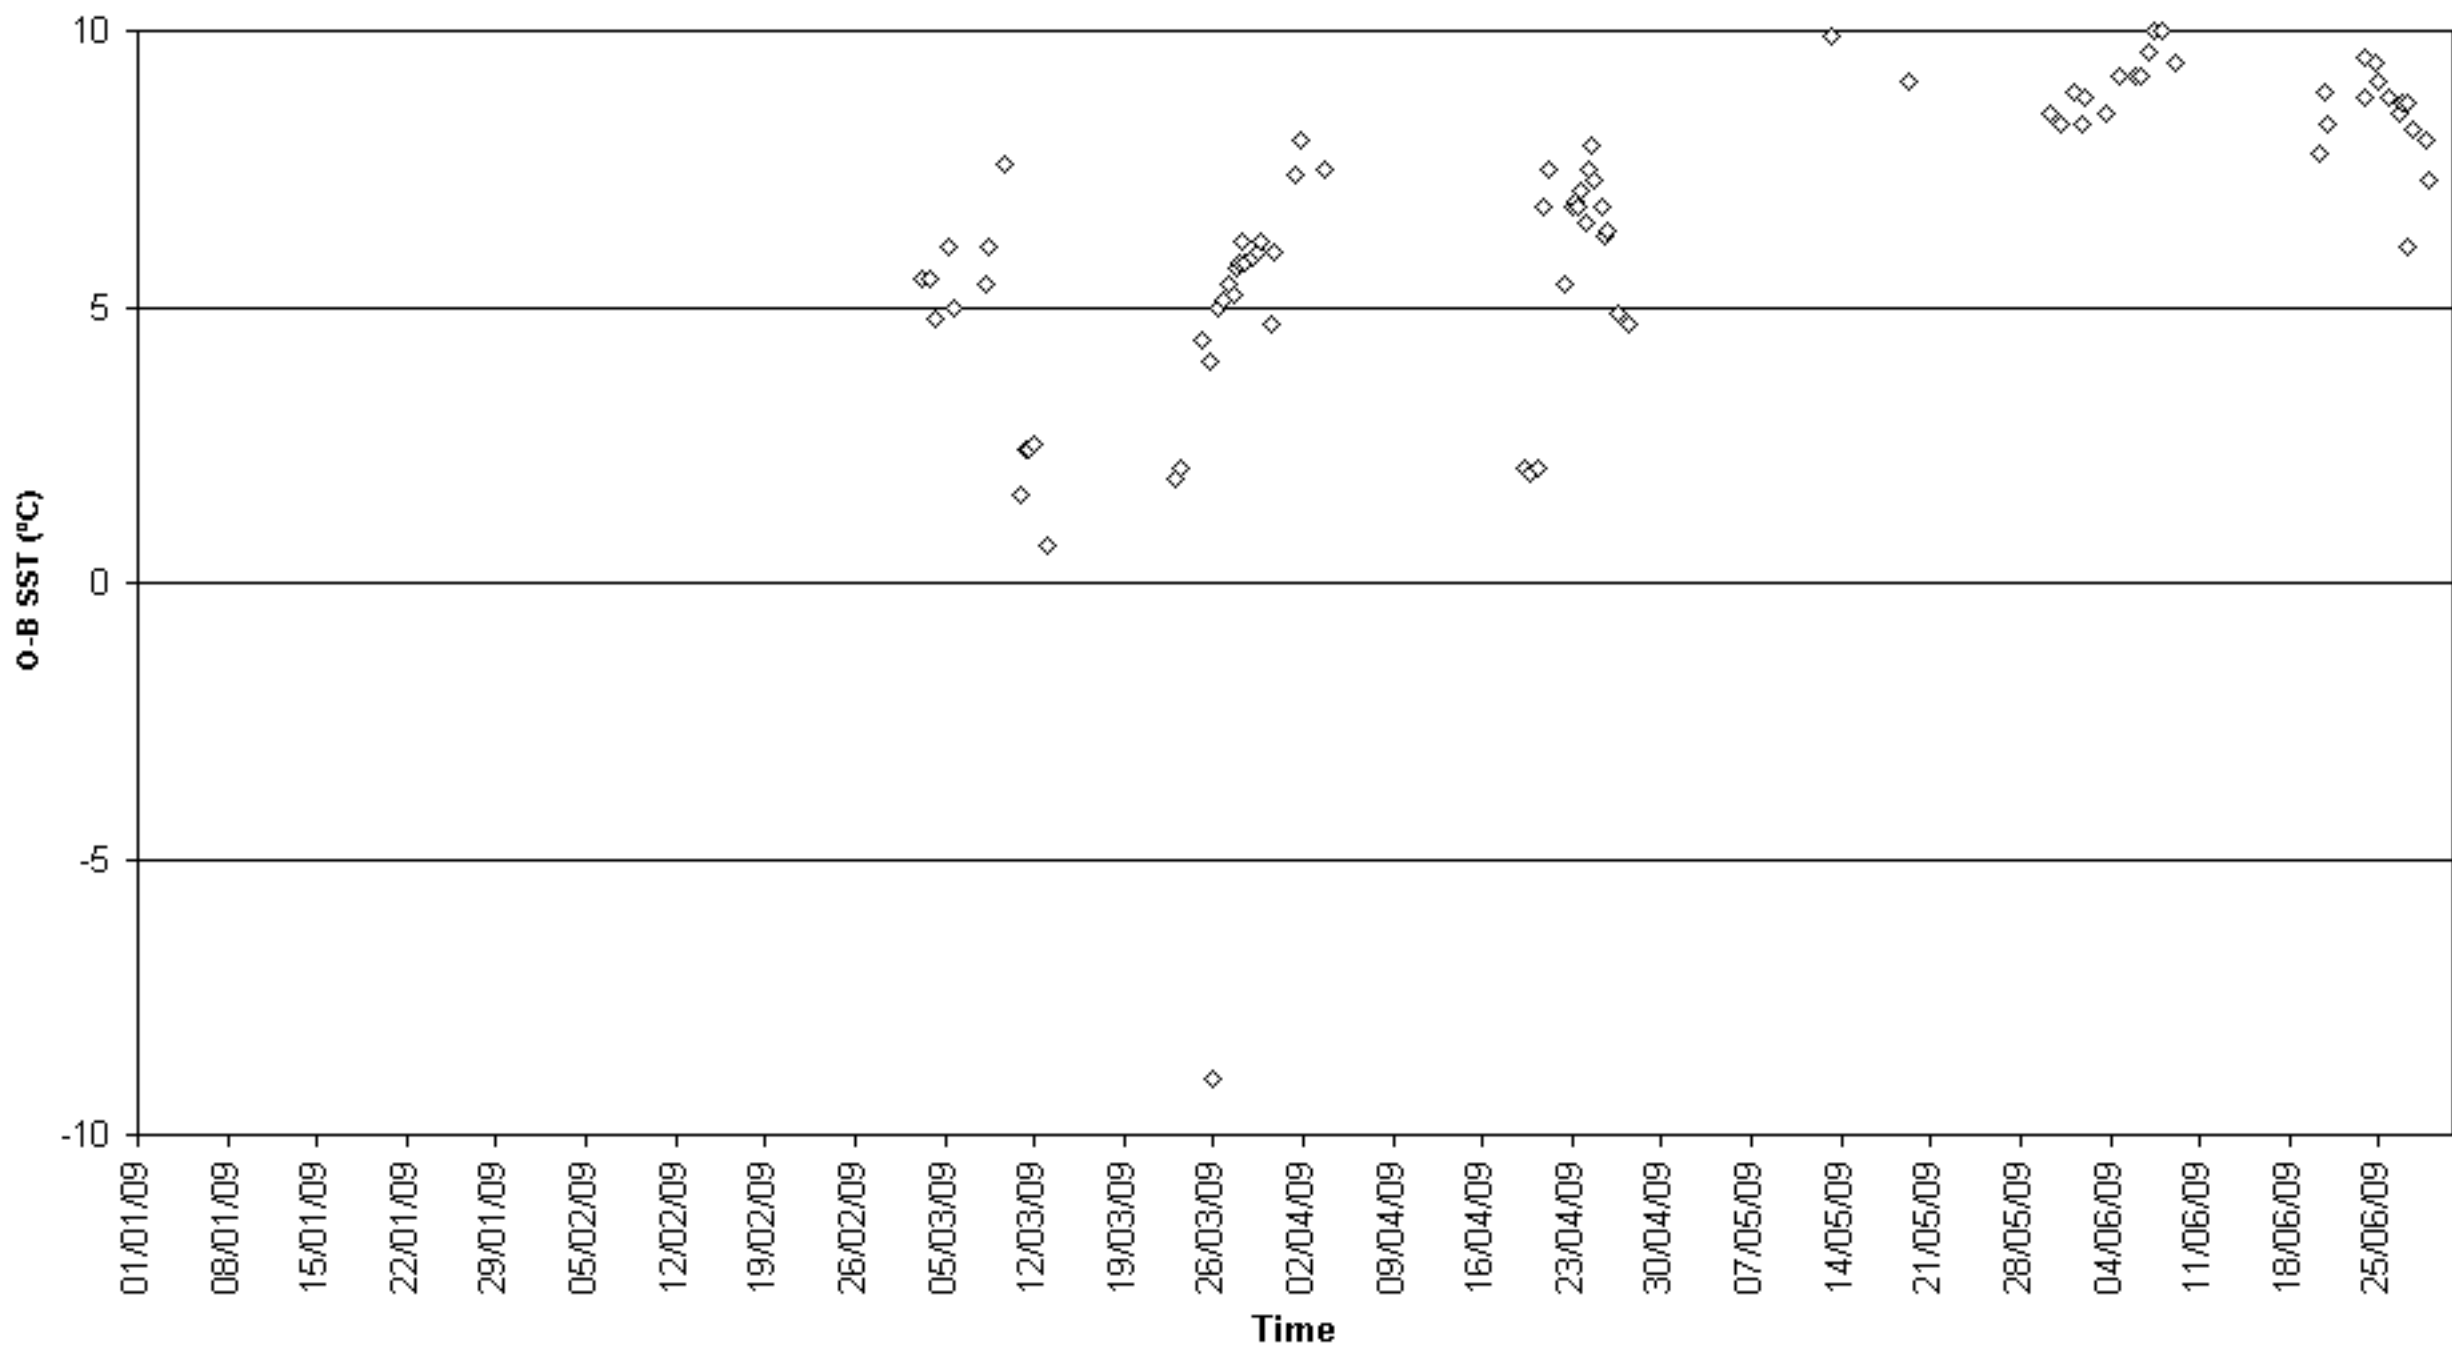


O-B SST (°C) for identifier 9VEN5  
Number of obs. plotted = 161 Number of outliers = 5

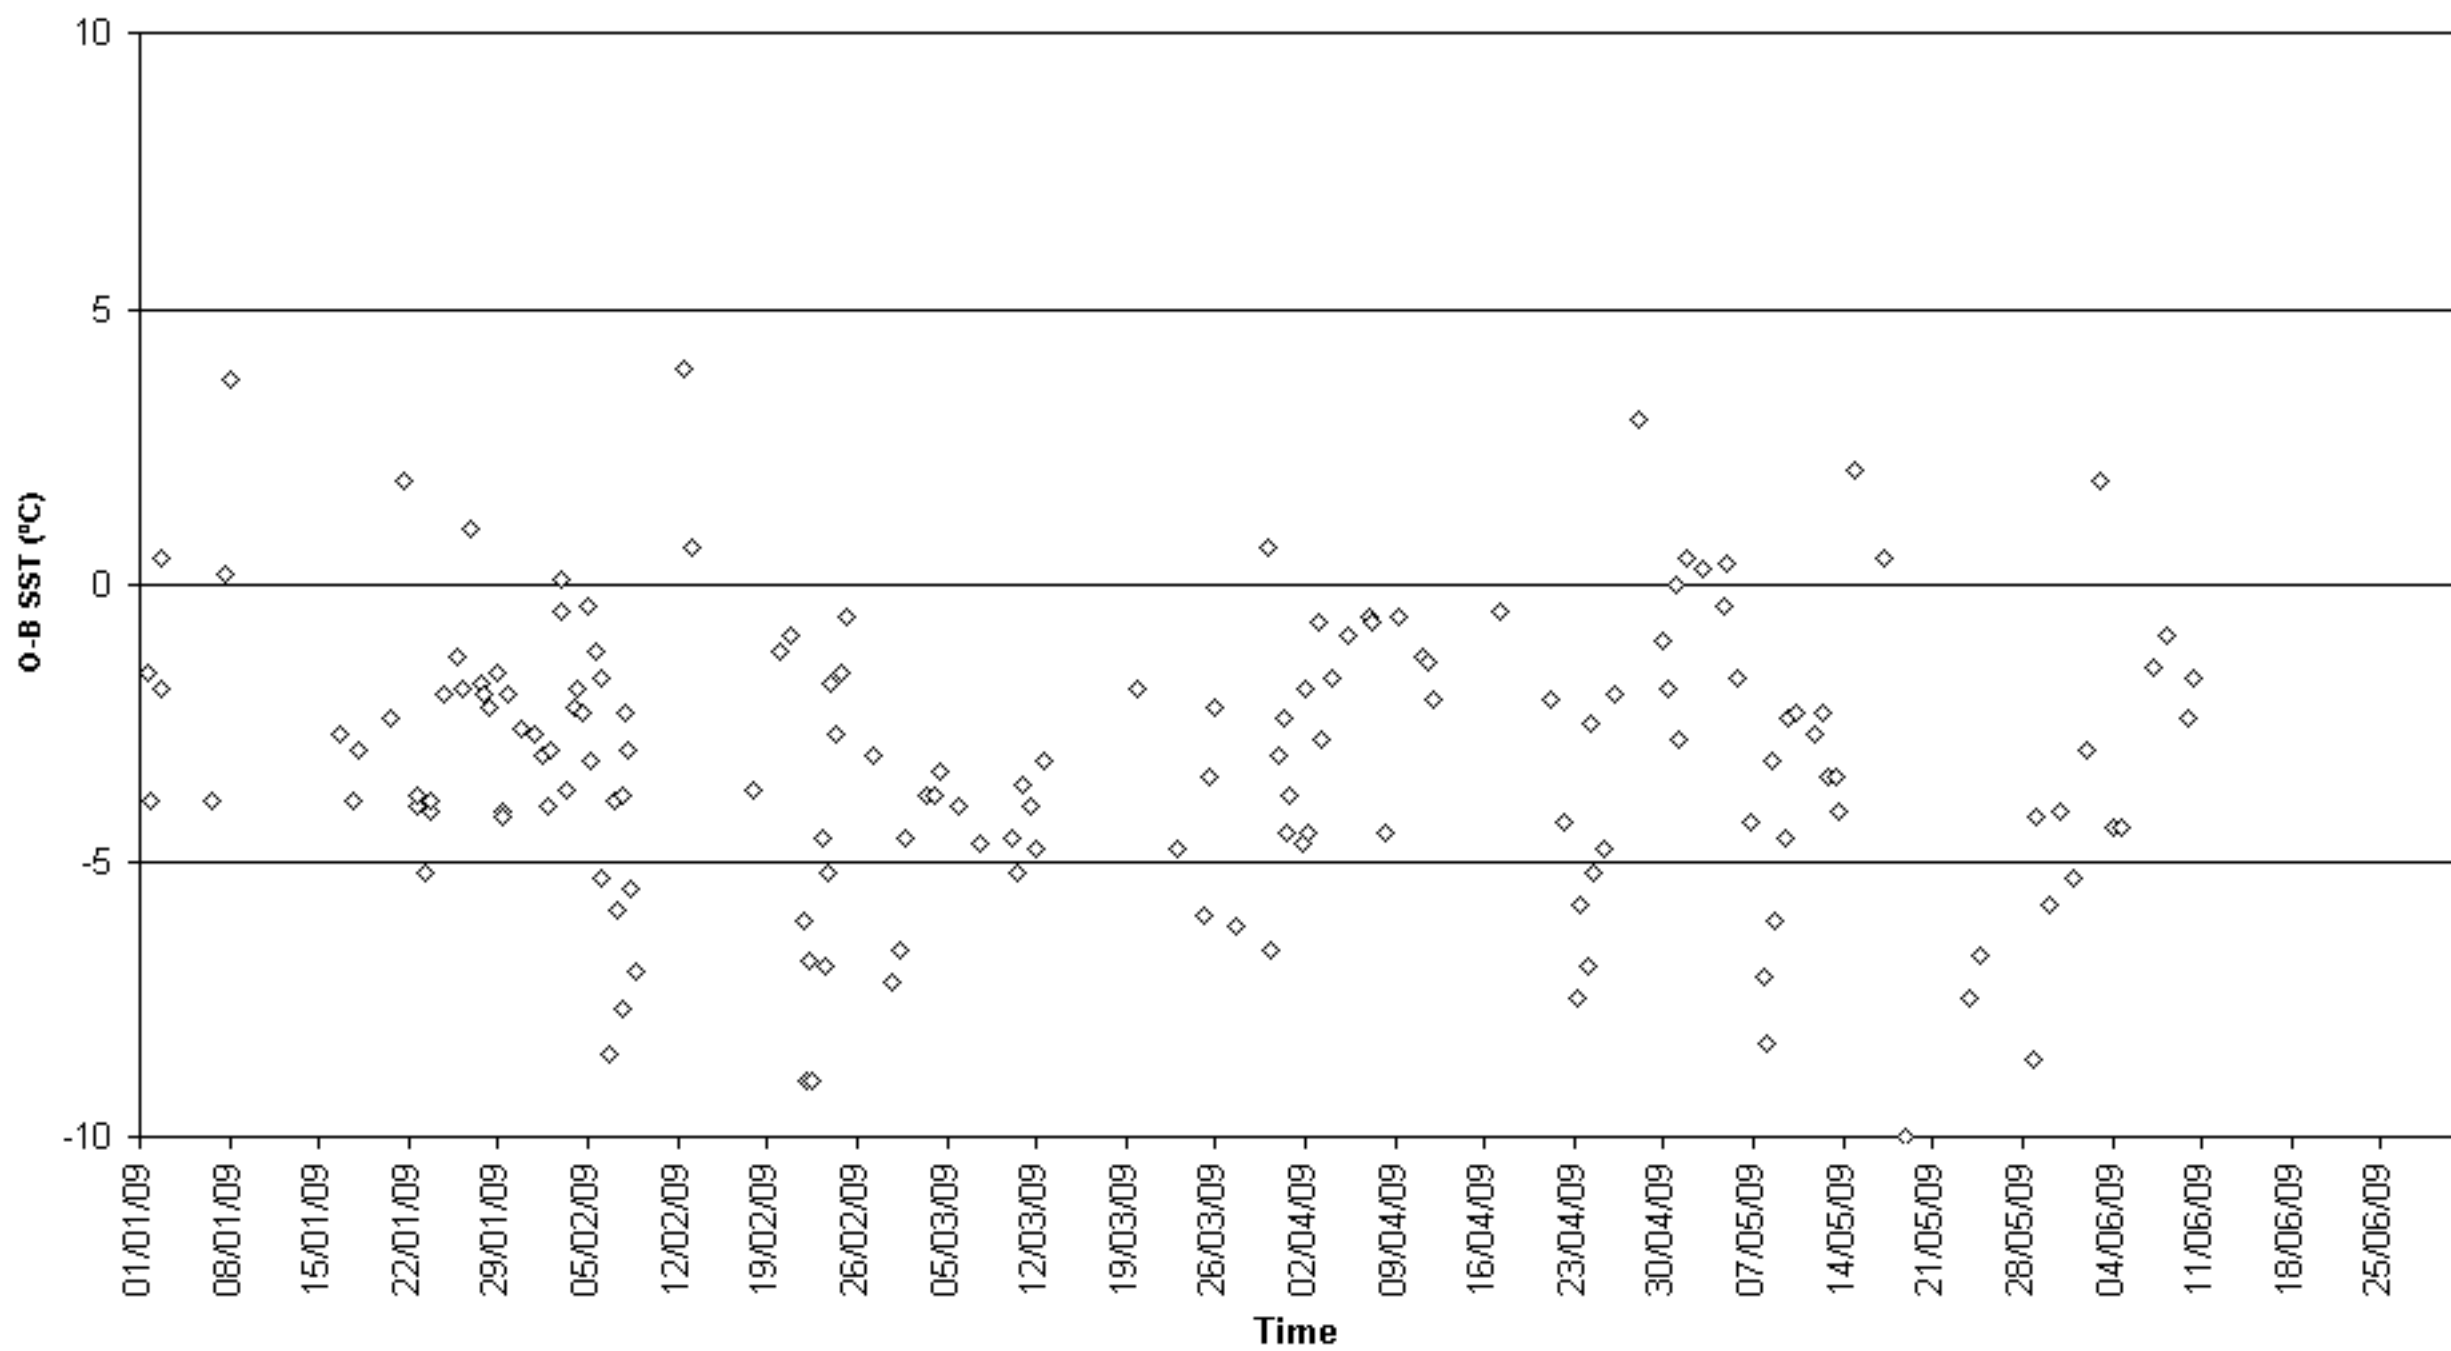

O-B SST (°C) for identifier A8HF6  
Number of obs. plotted = 174 Number of outliers = 4

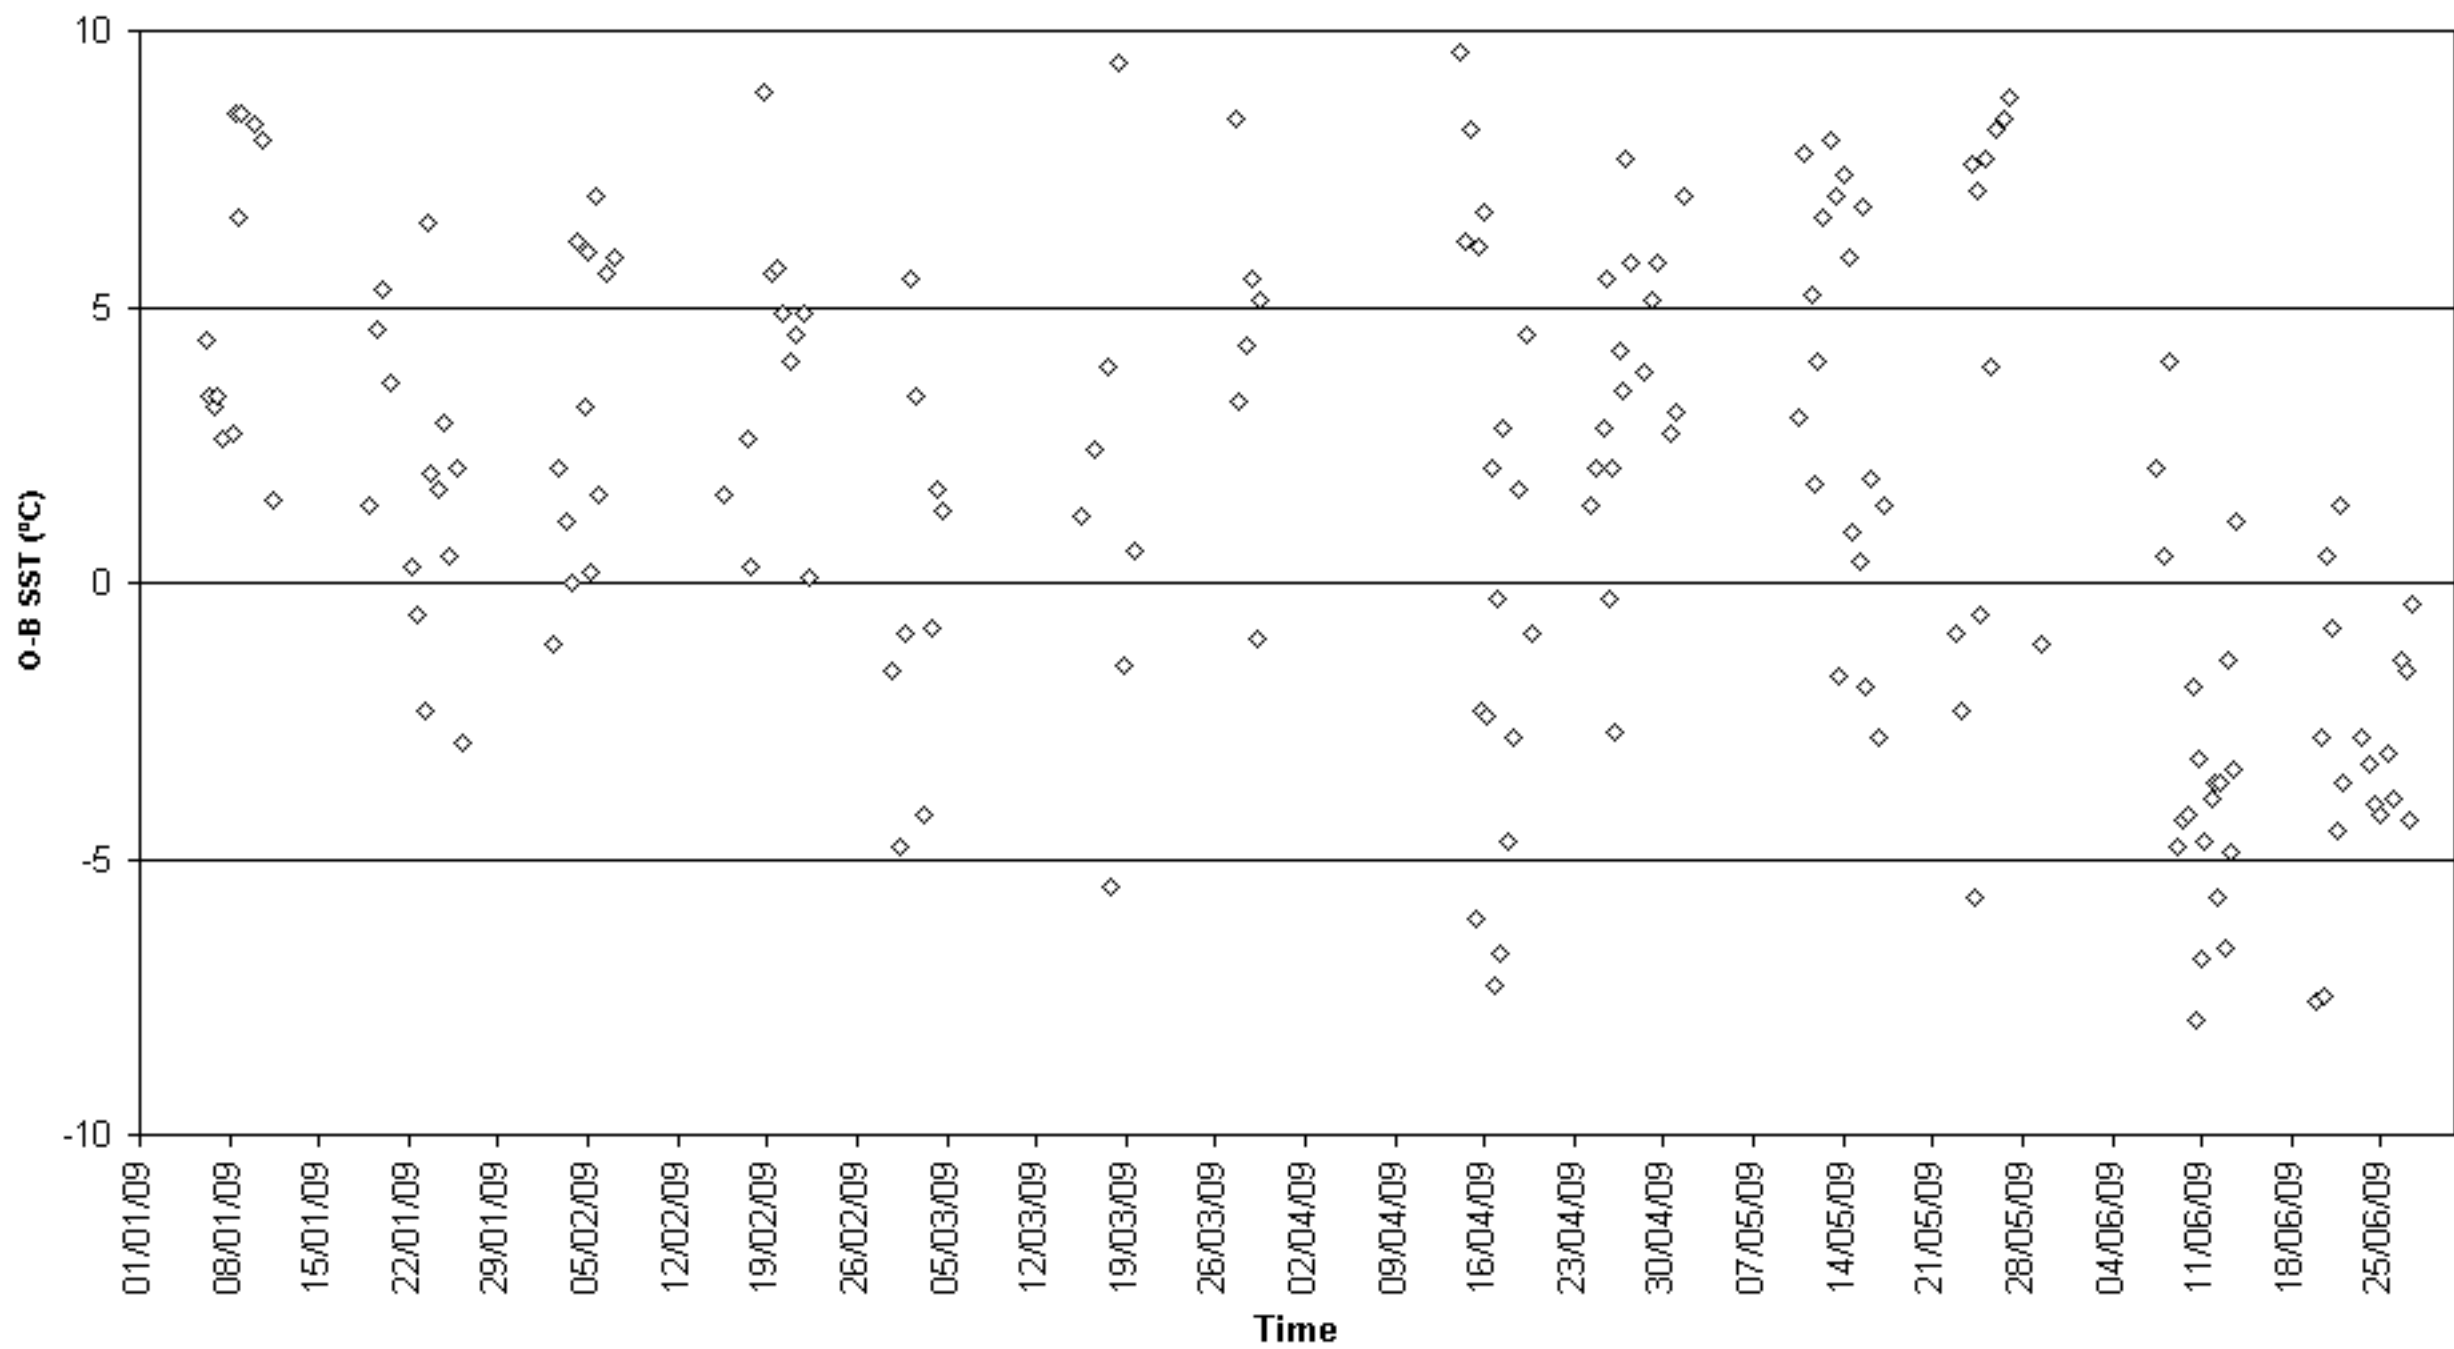


O-B SST (°C) for identifier A8IX8  
Number of obs. plotted = 145    Number of outliers = 0

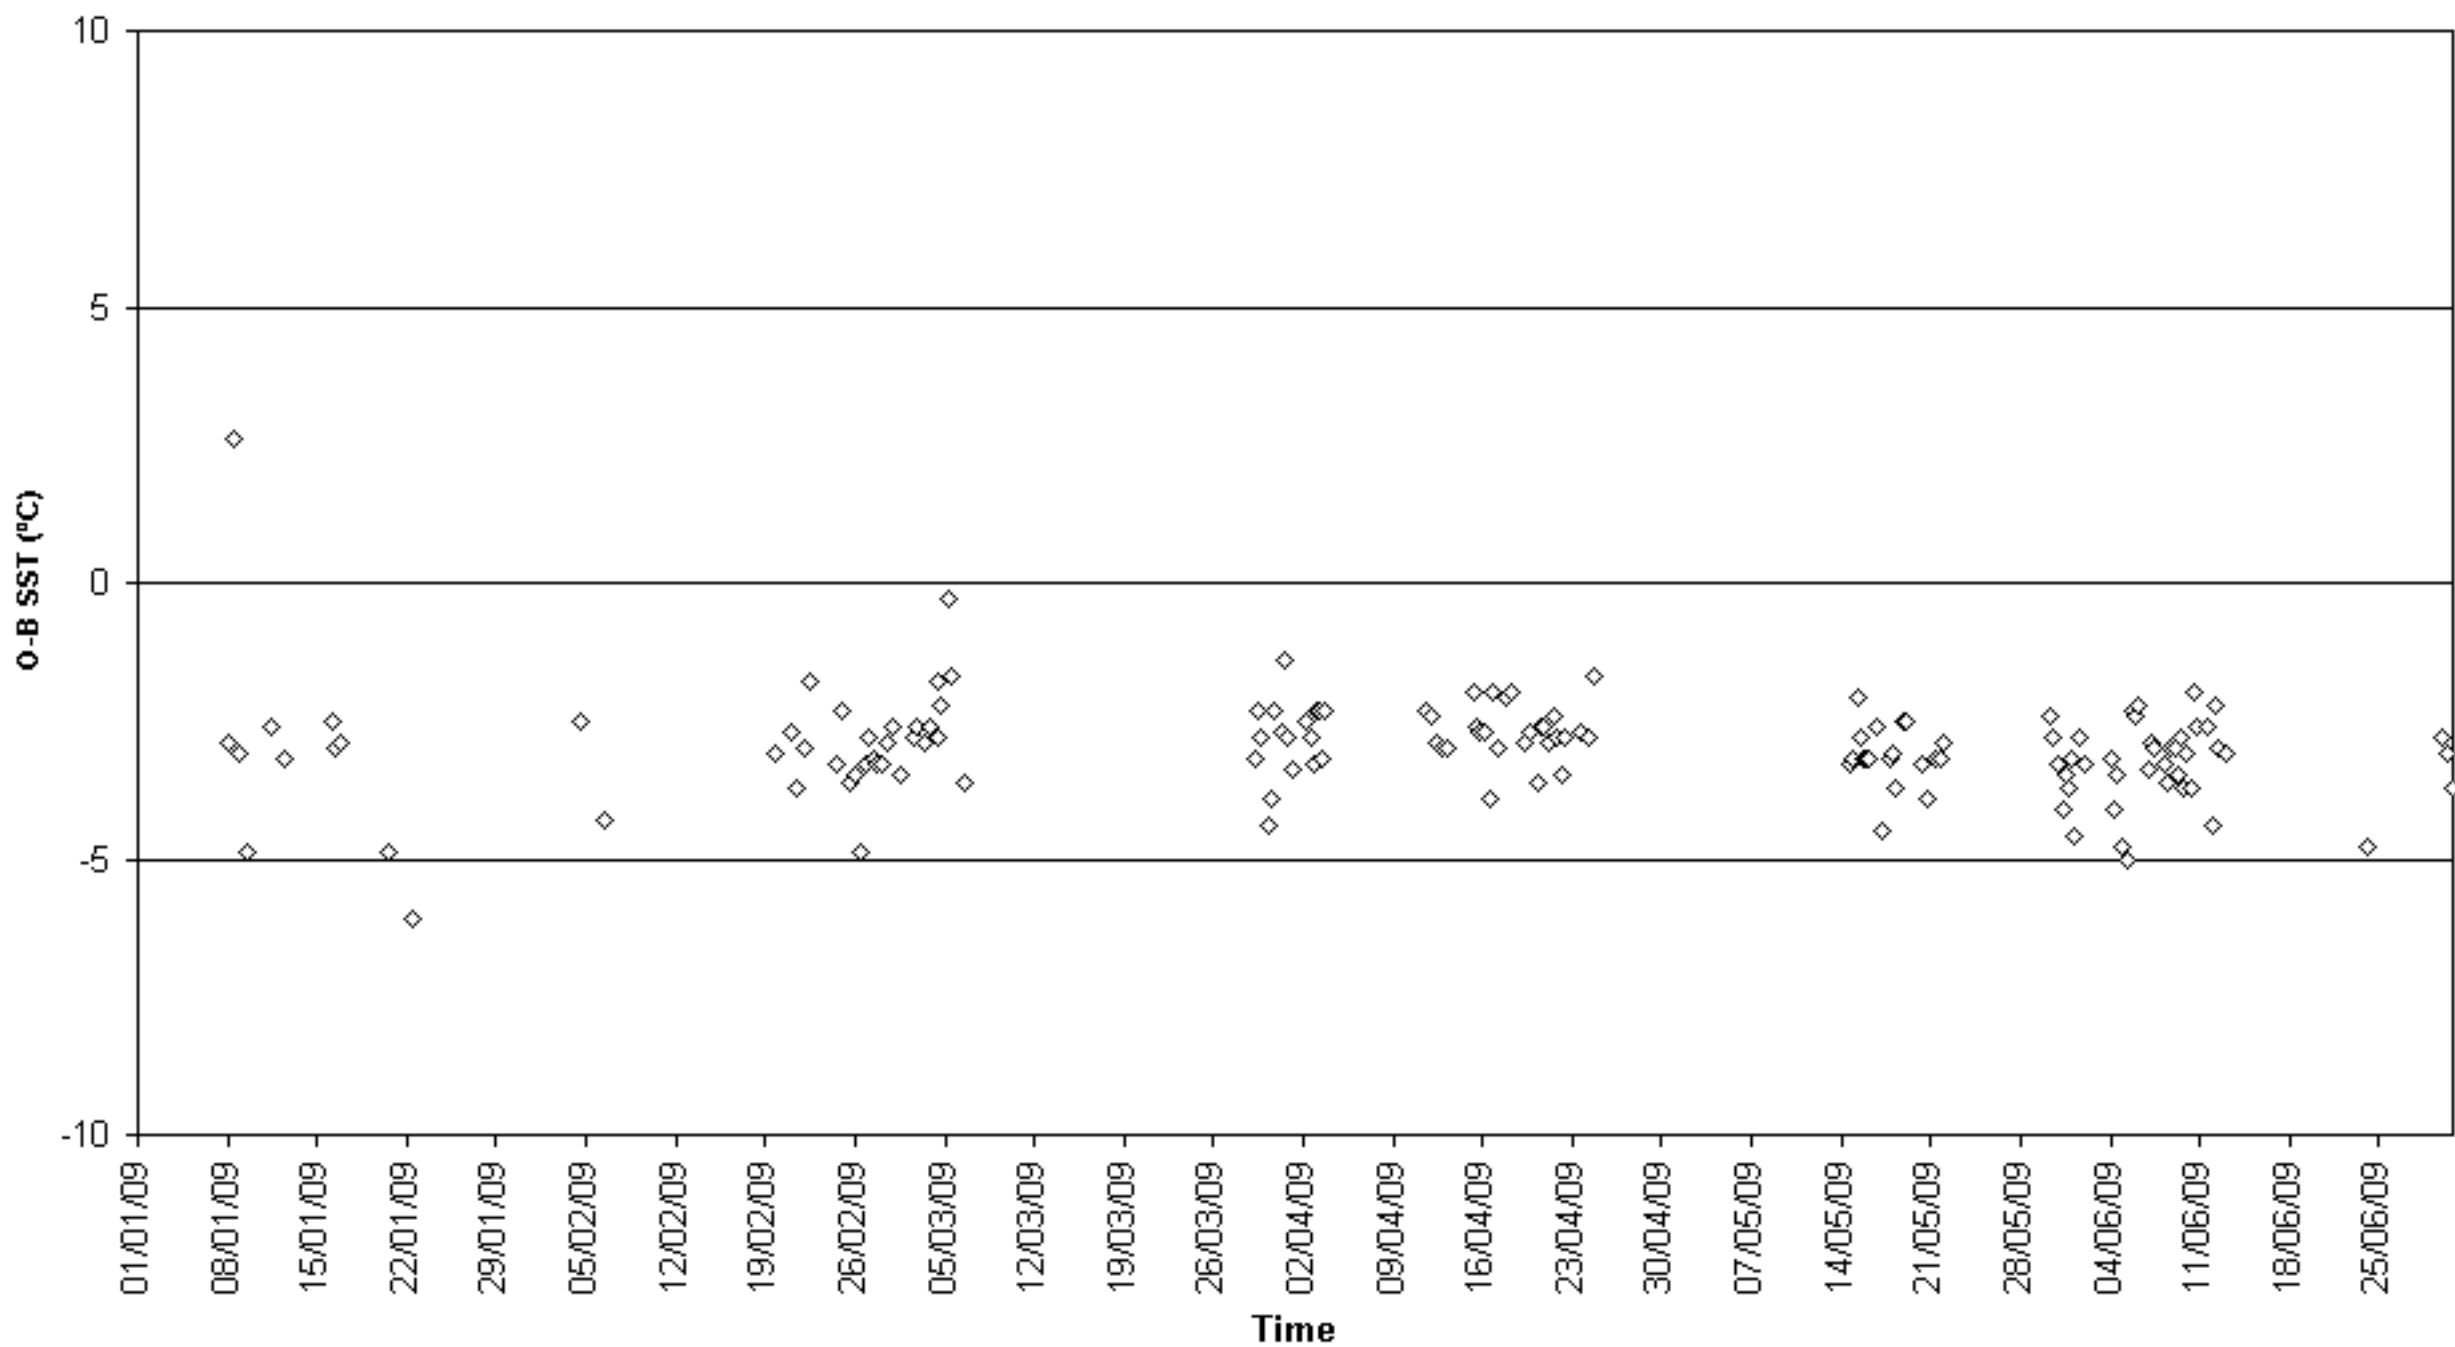





O-B SST (°C) for identifier DAJL  
Number of obs. plotted = 41 Number of outliers = 0

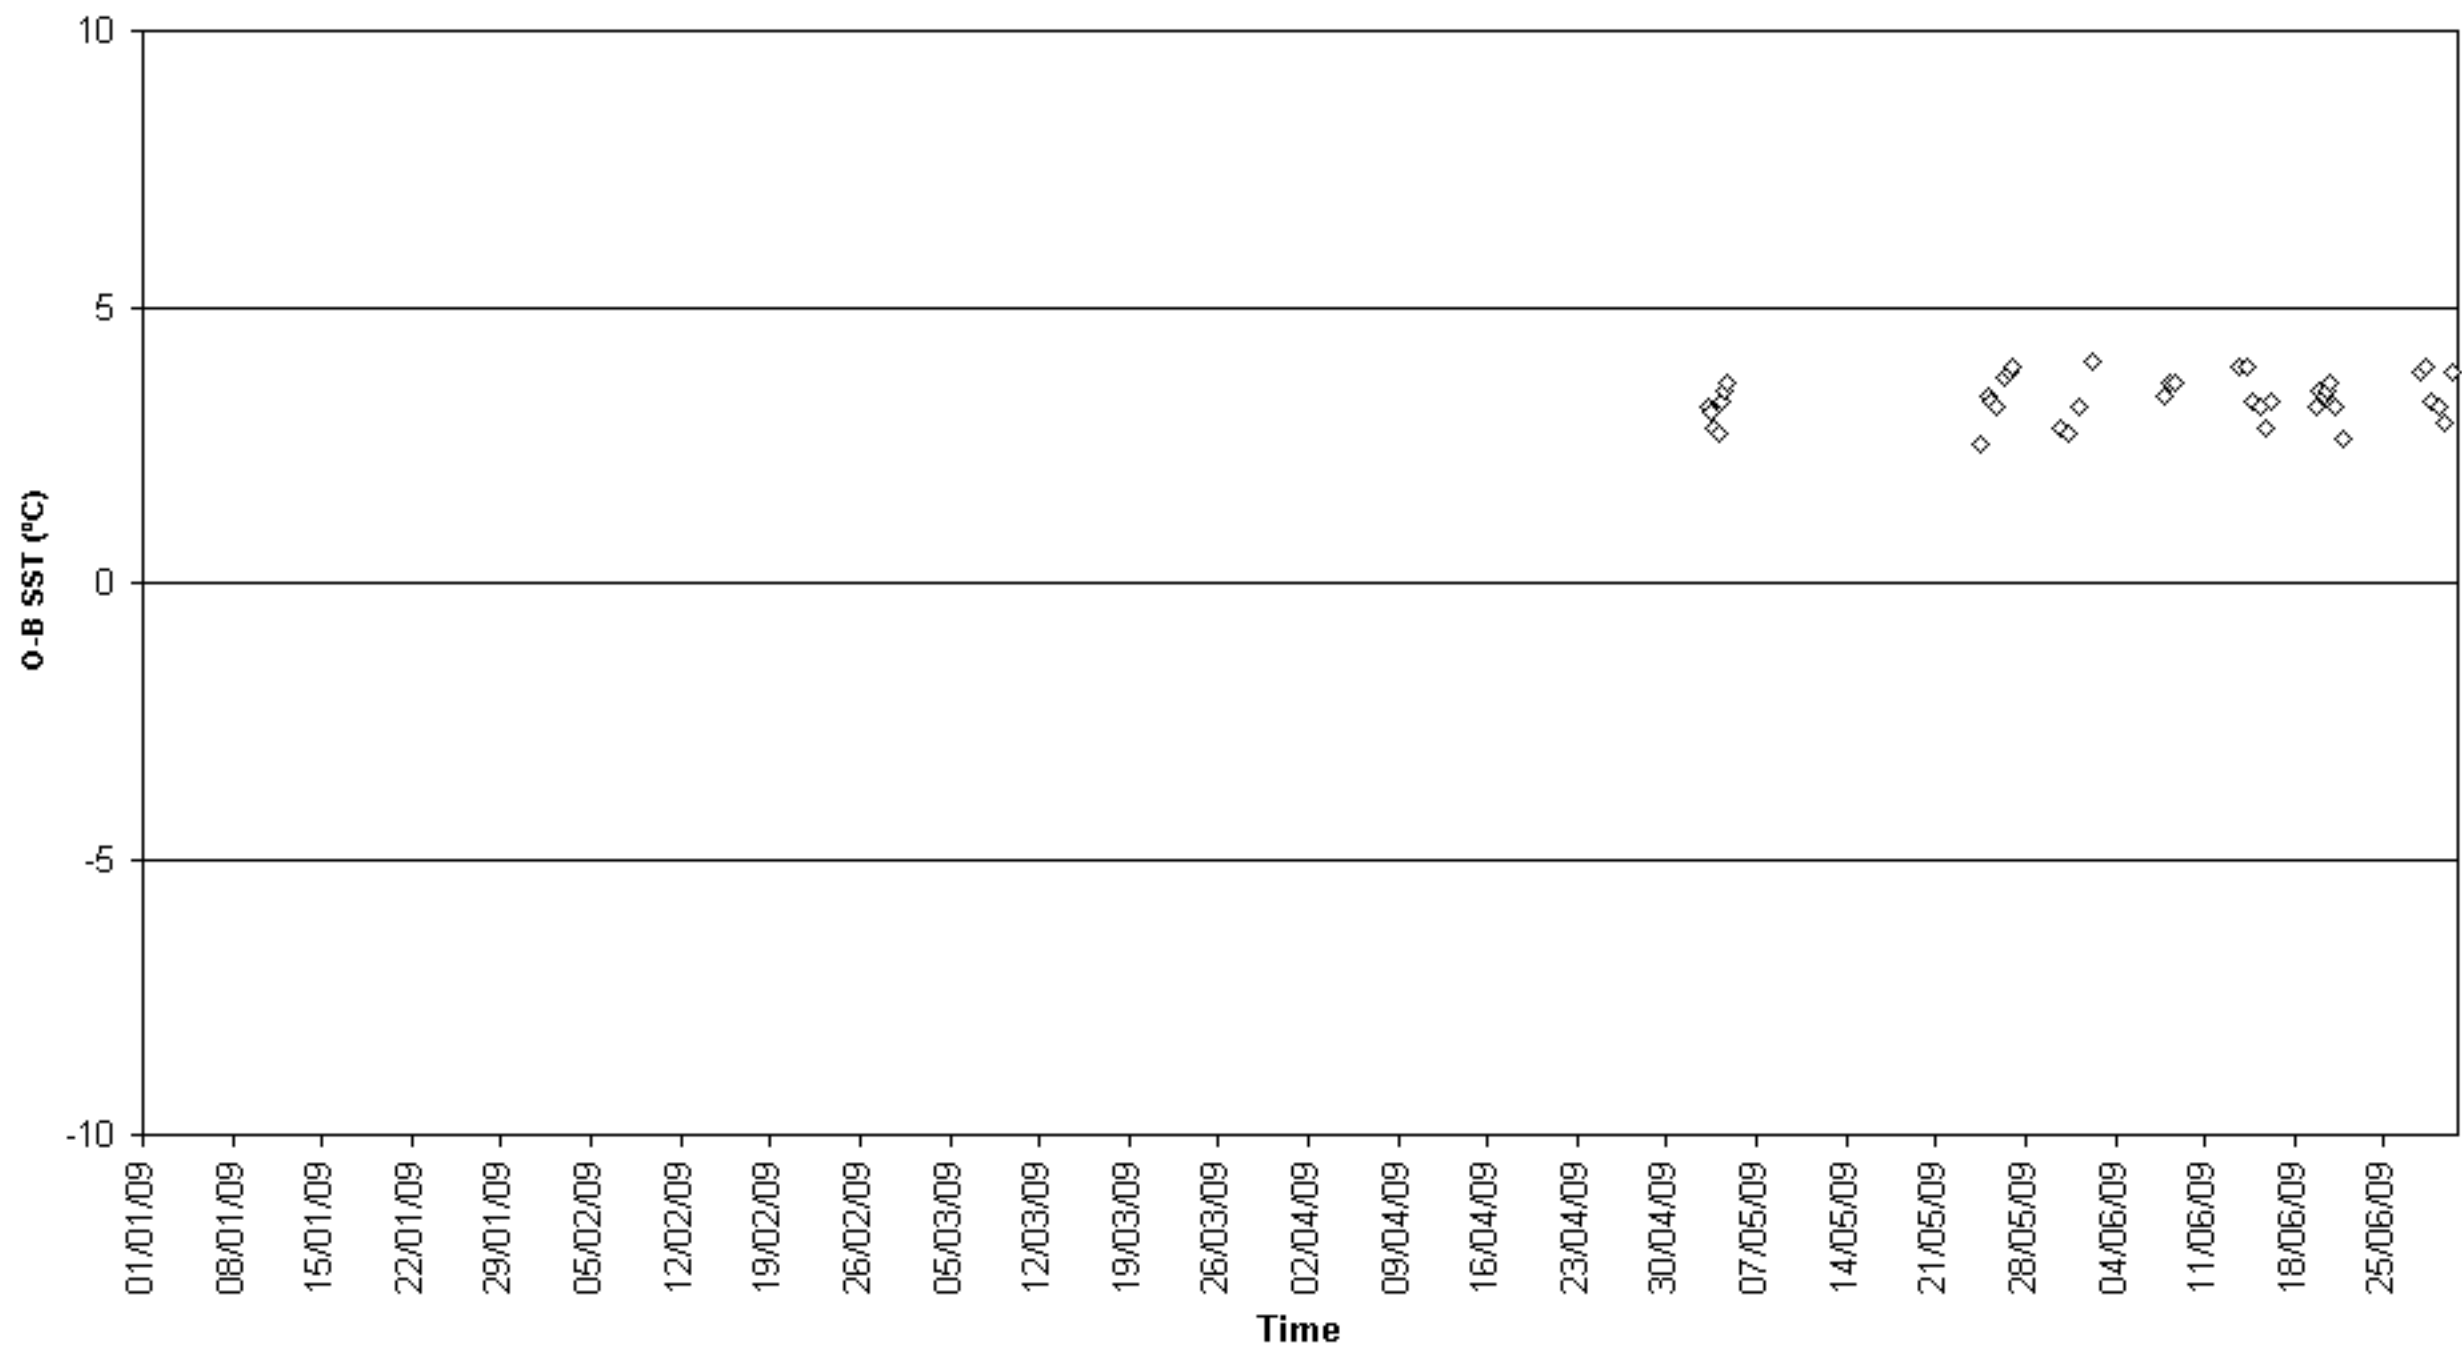


O-B SST (°C) for identifier DEAL  
Number of obs. plotted = 79 Number of outliers = 0

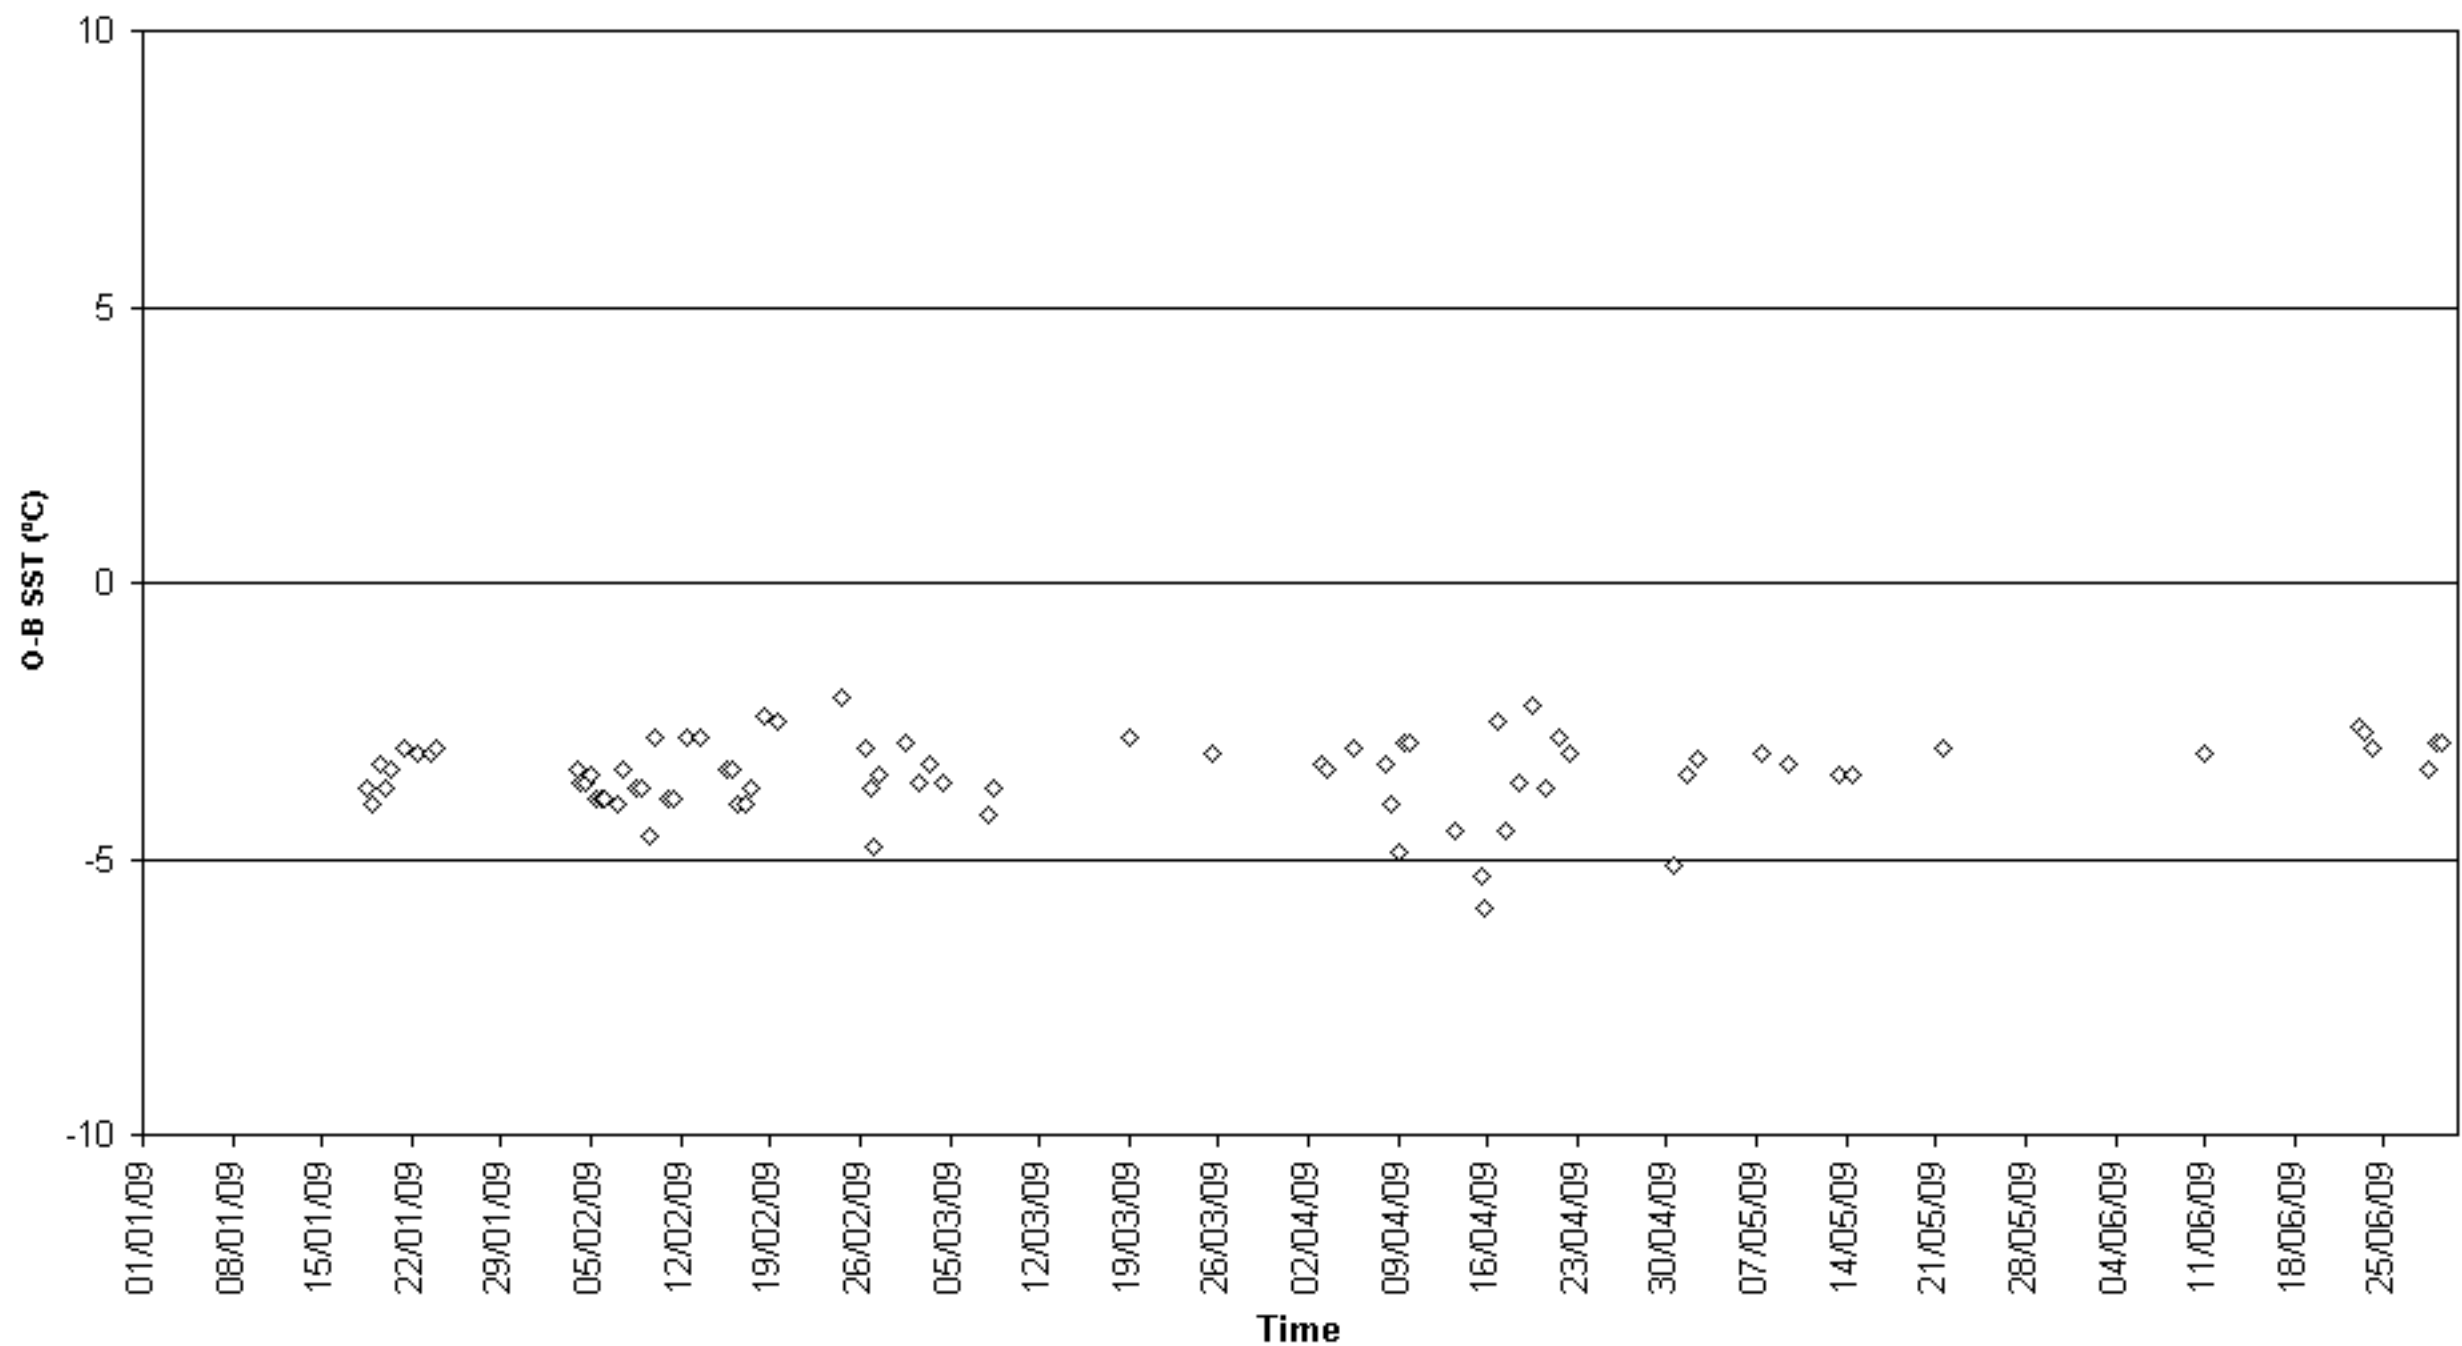


O-B SST (°C) for identifier DGTX  
Number of obs. plotted = 127 Number of outliers = 0

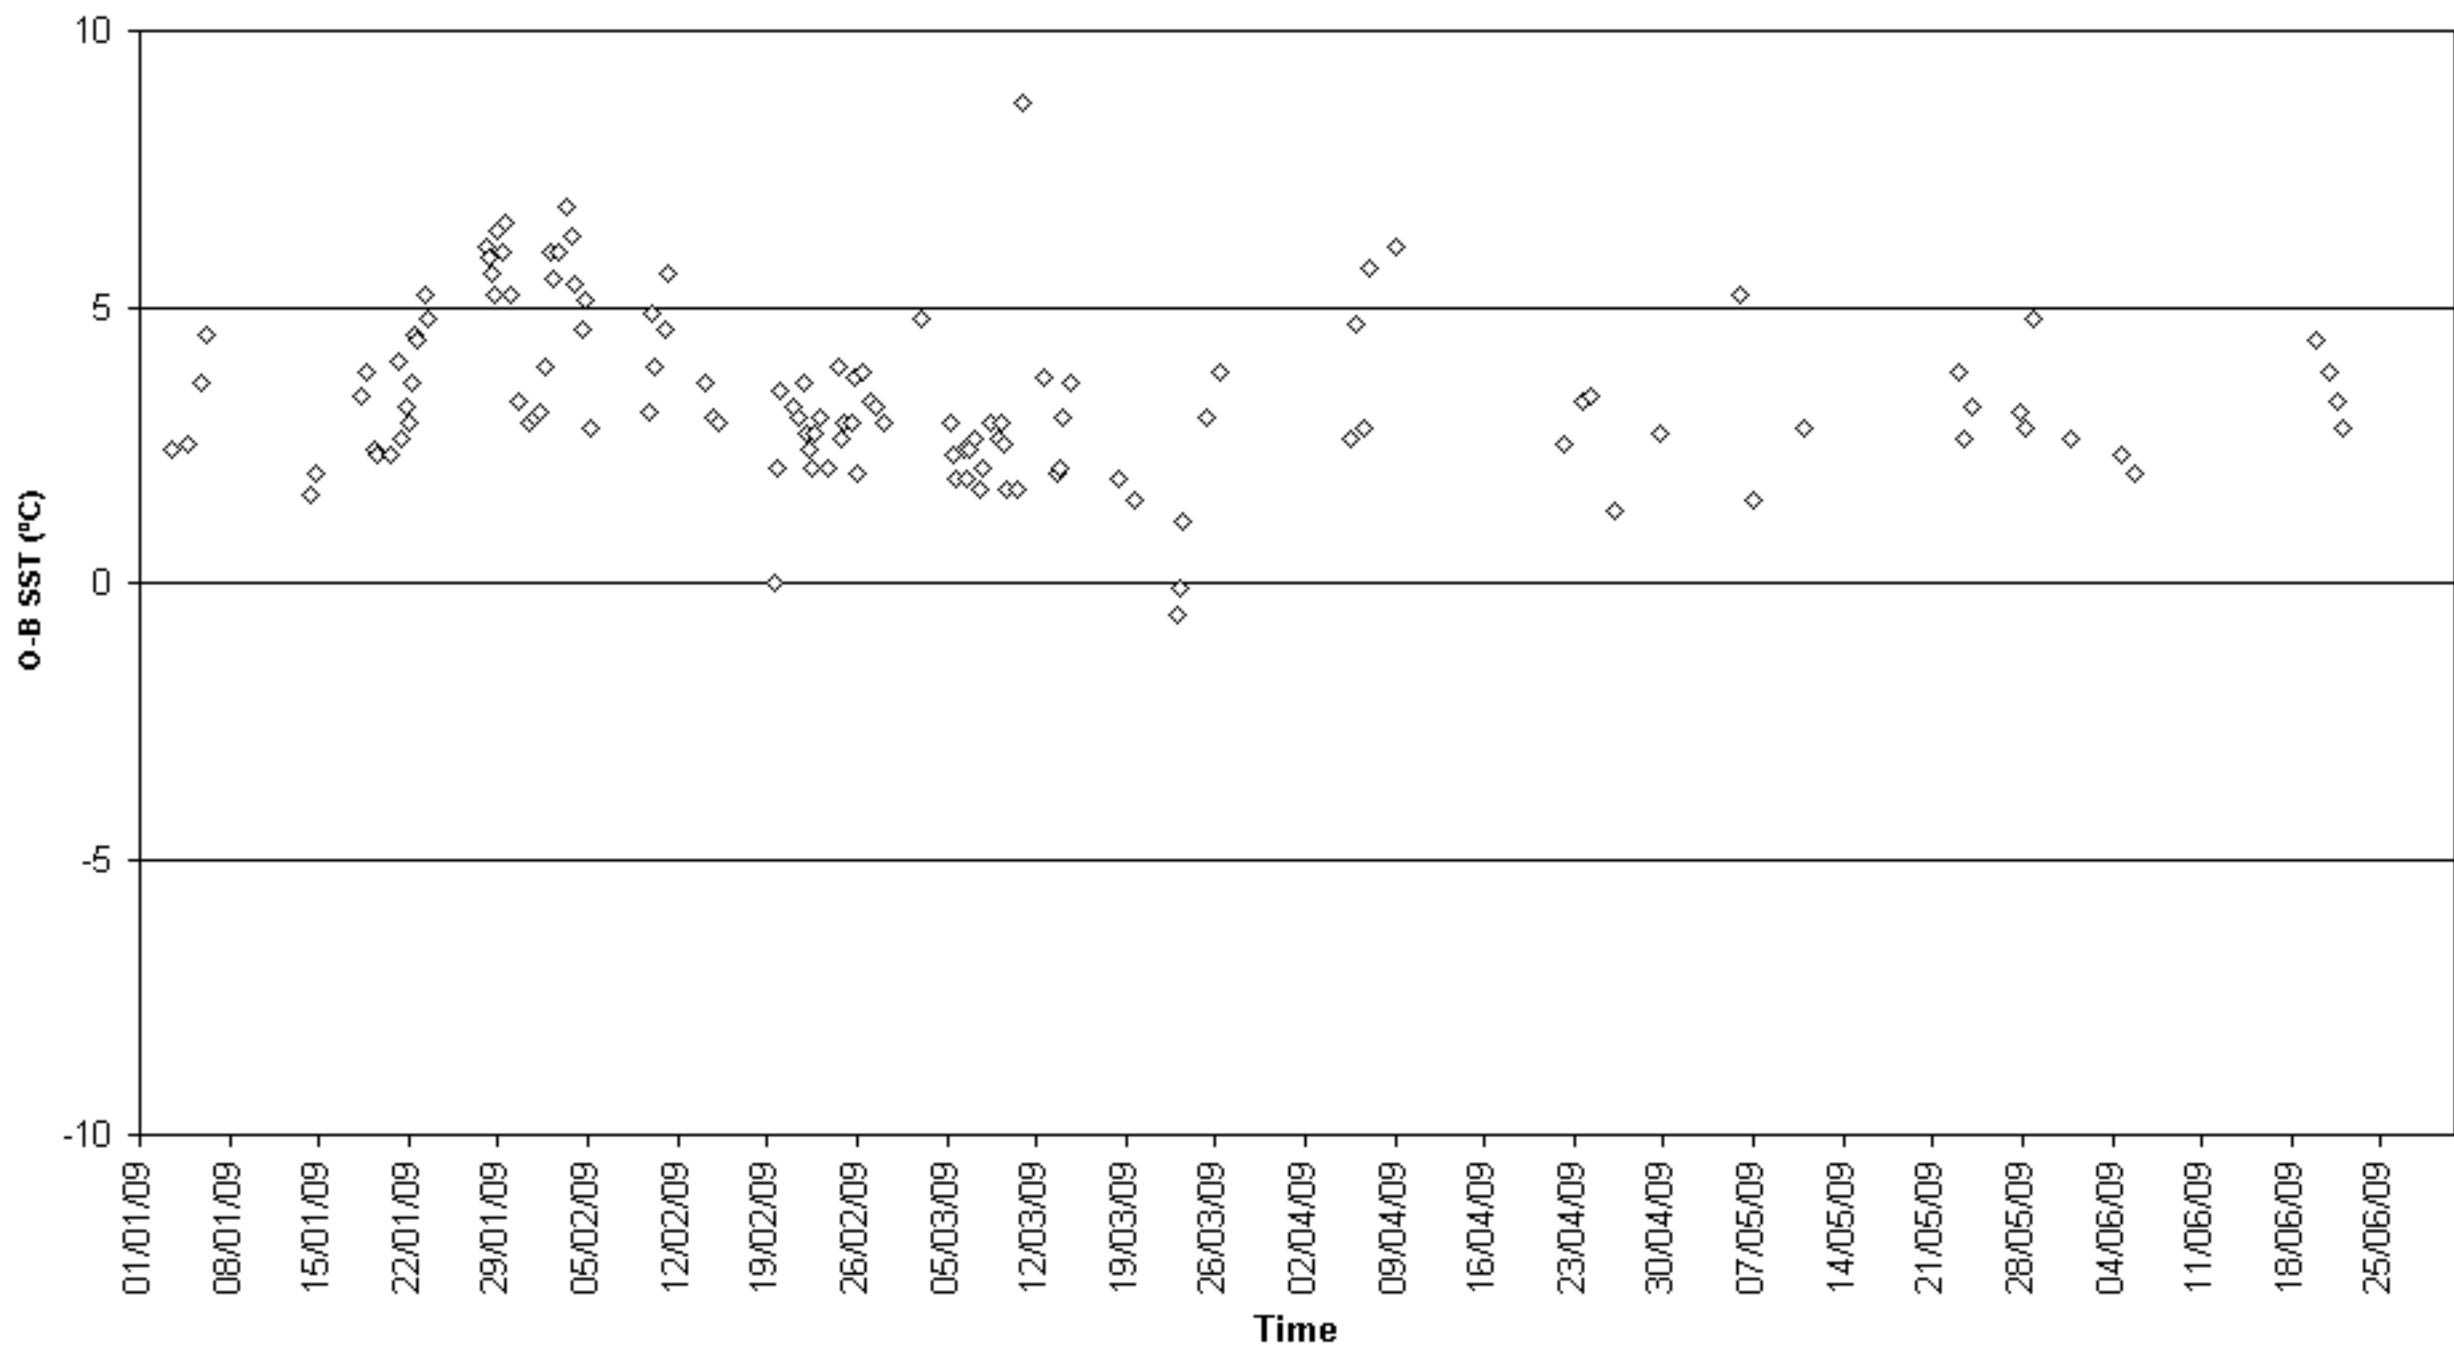


O-B SST (°C) for identifier DIBZ  
Number of obs. plotted = 75 Number of outliers = 0

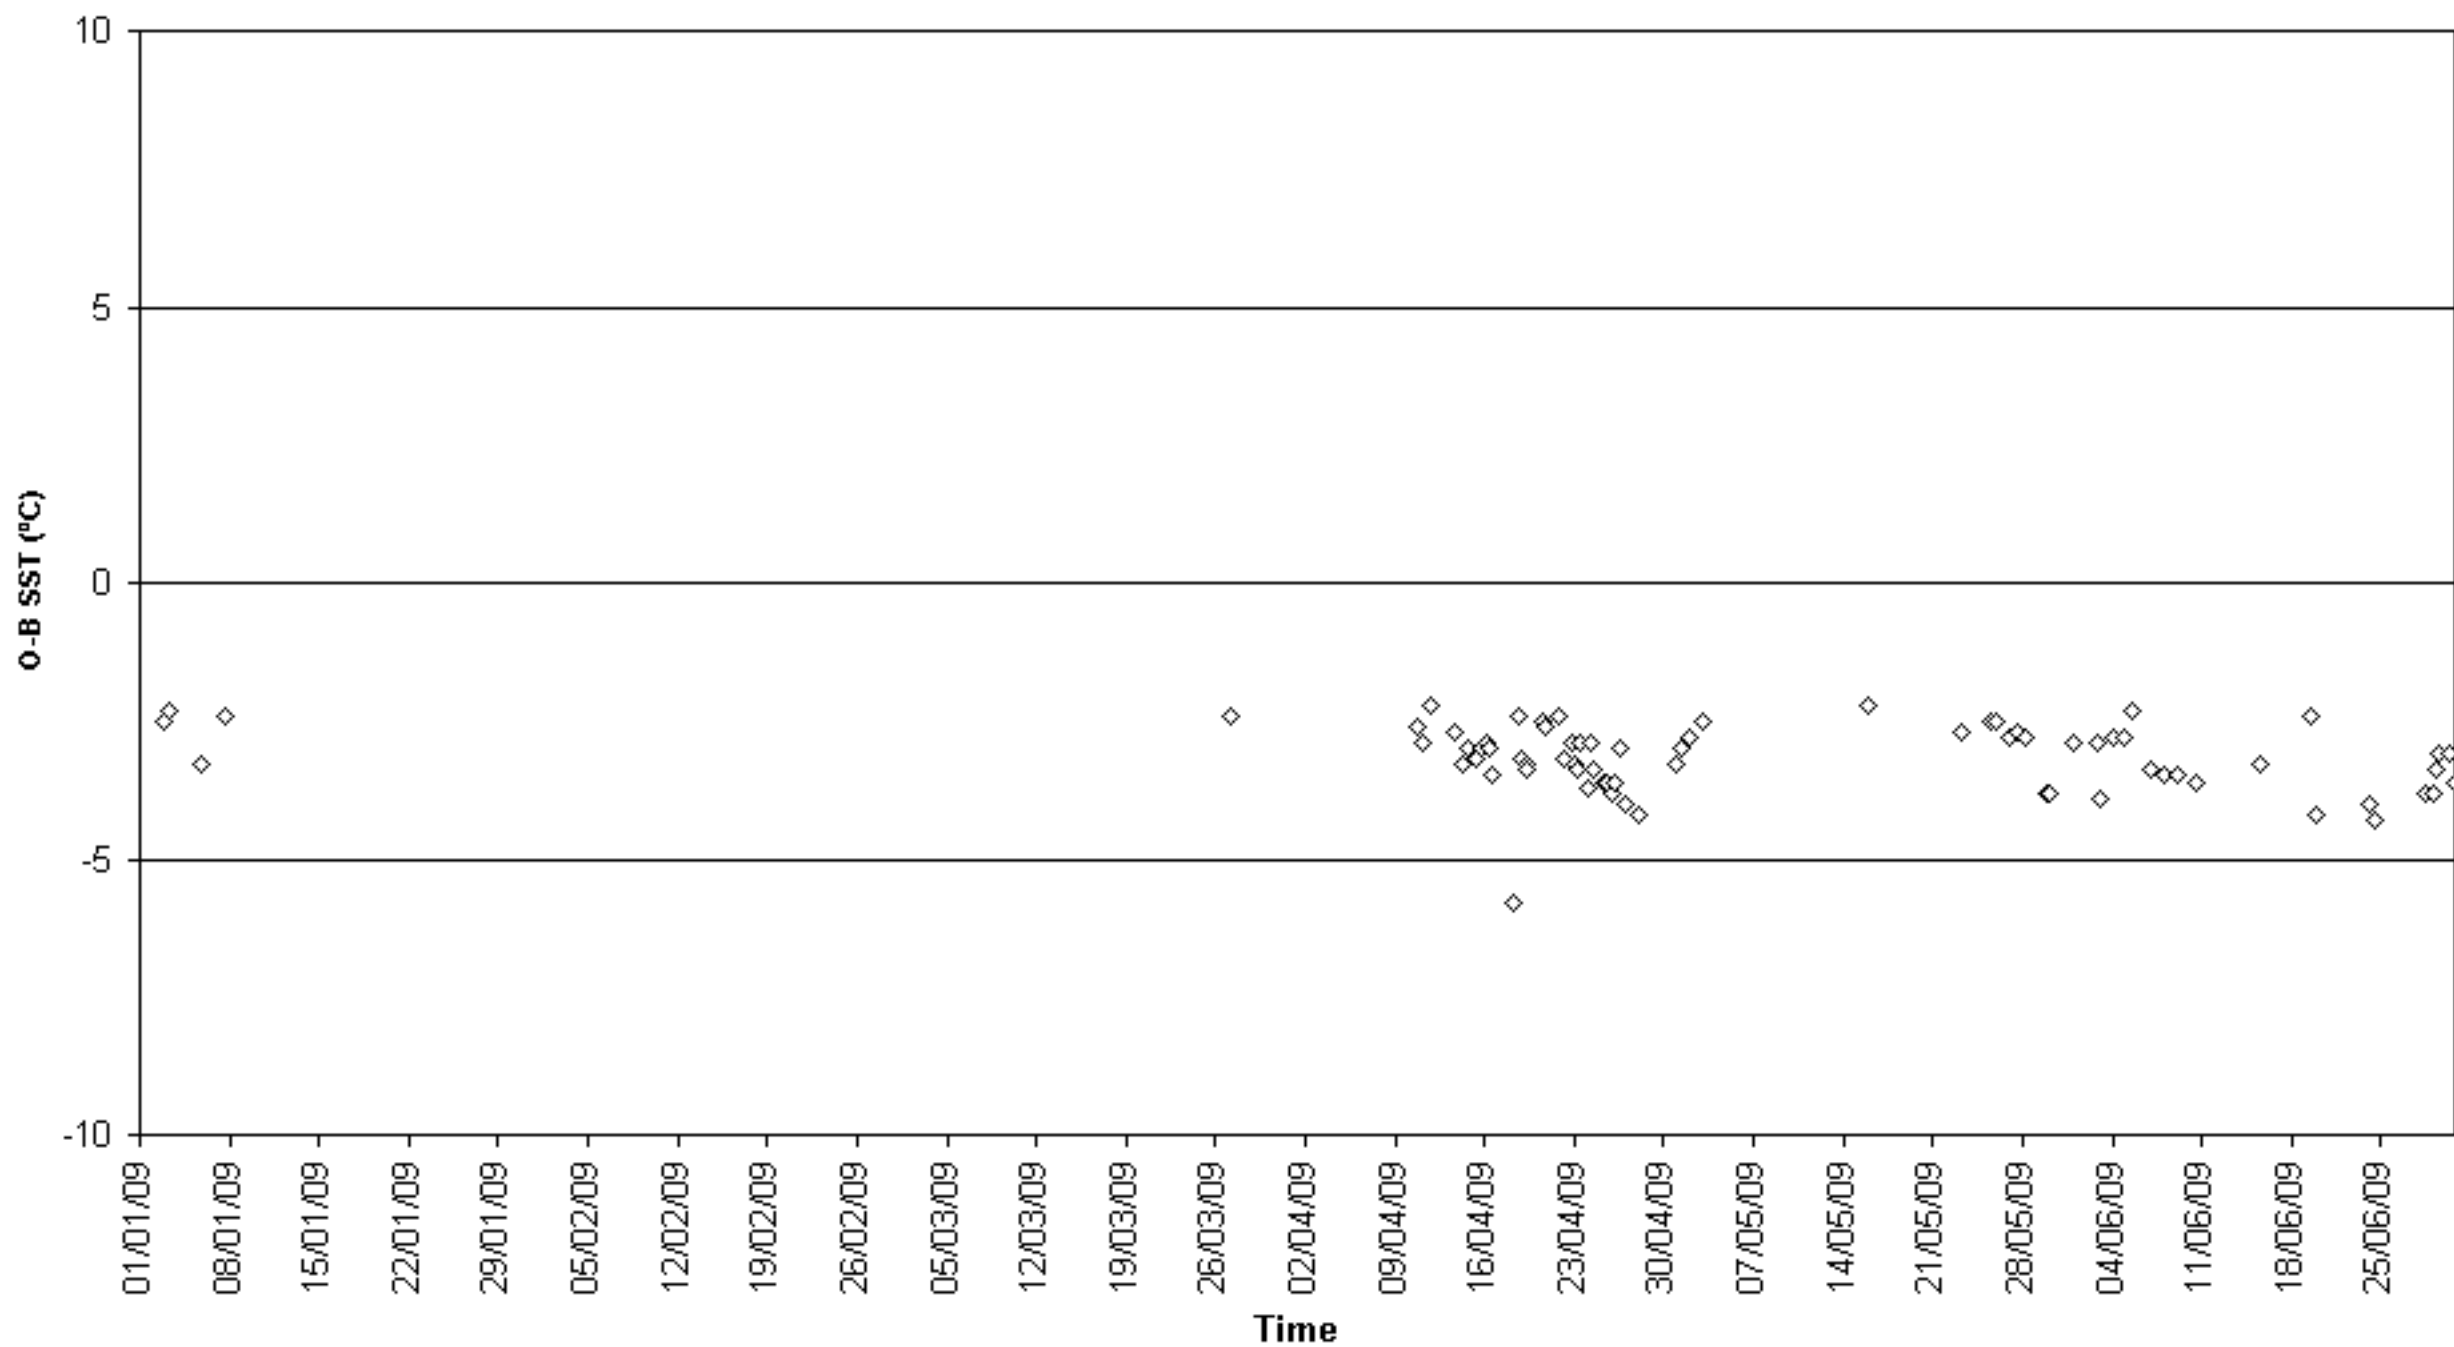


O-B SST (°C) for identifier KHRC  
Number of obs. plotted = 93 Number of outliers = 0

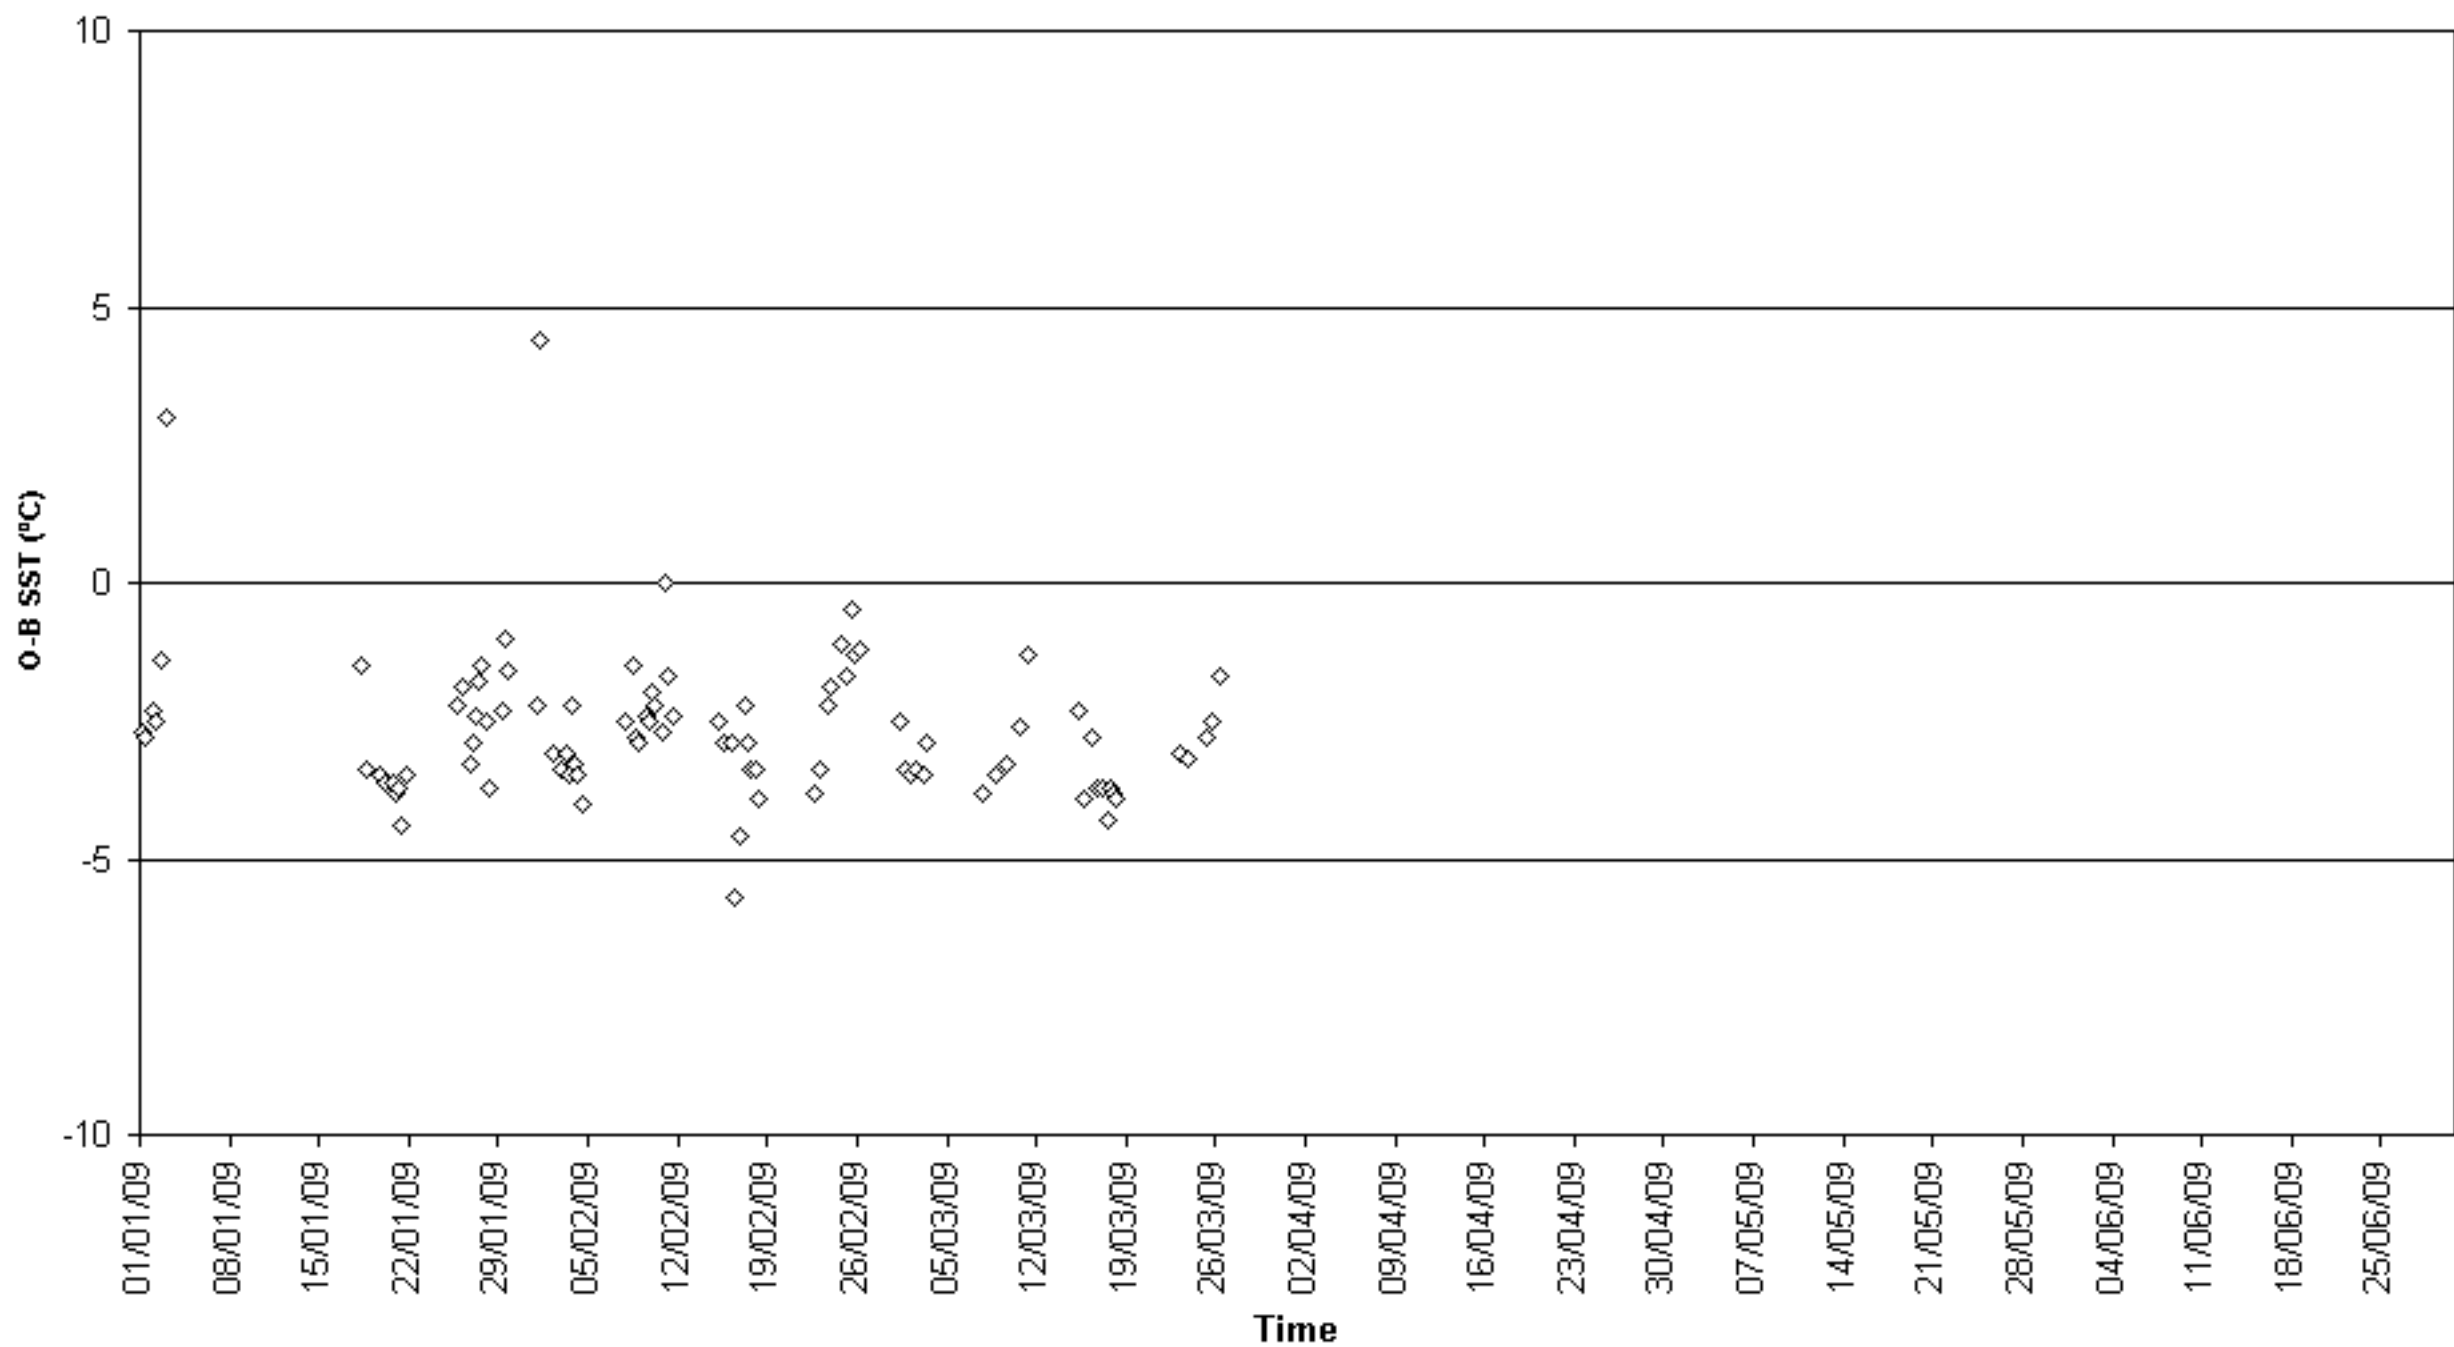


O-B SST (°C) for identifier KS034  
Number of obs. plotted = 154 Number of outliers = 0

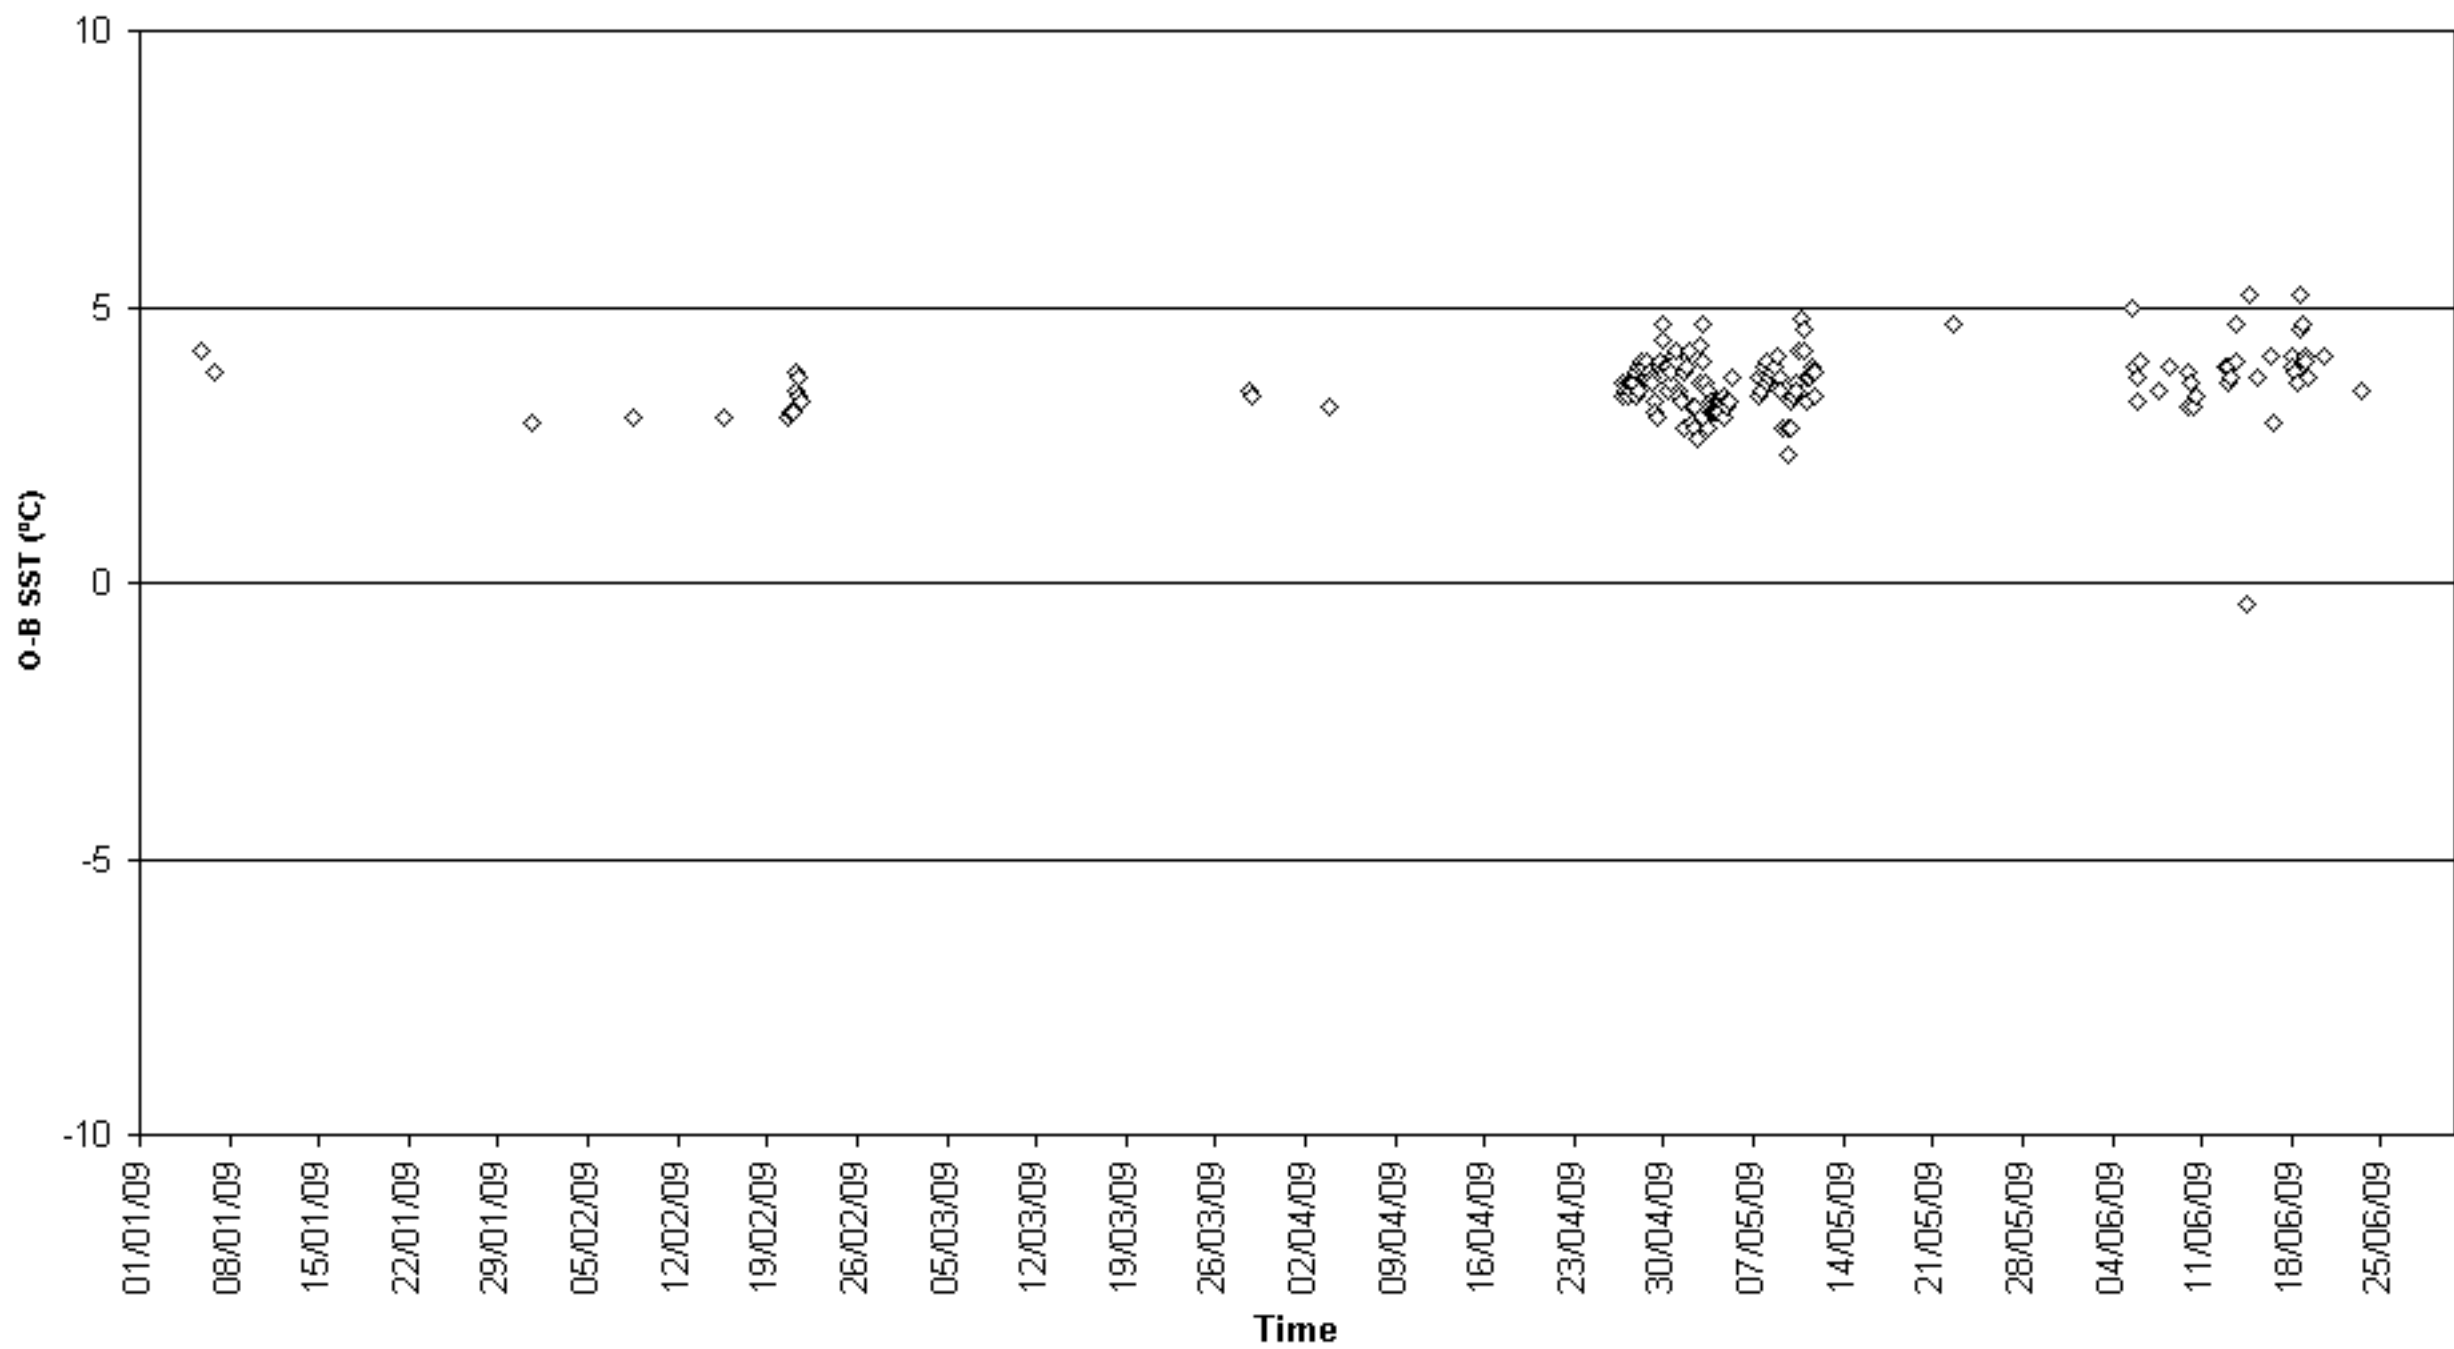

O-B SST (°C) for identifier KS063  
Number of obs. plotted = 0    Number of outliers = 115

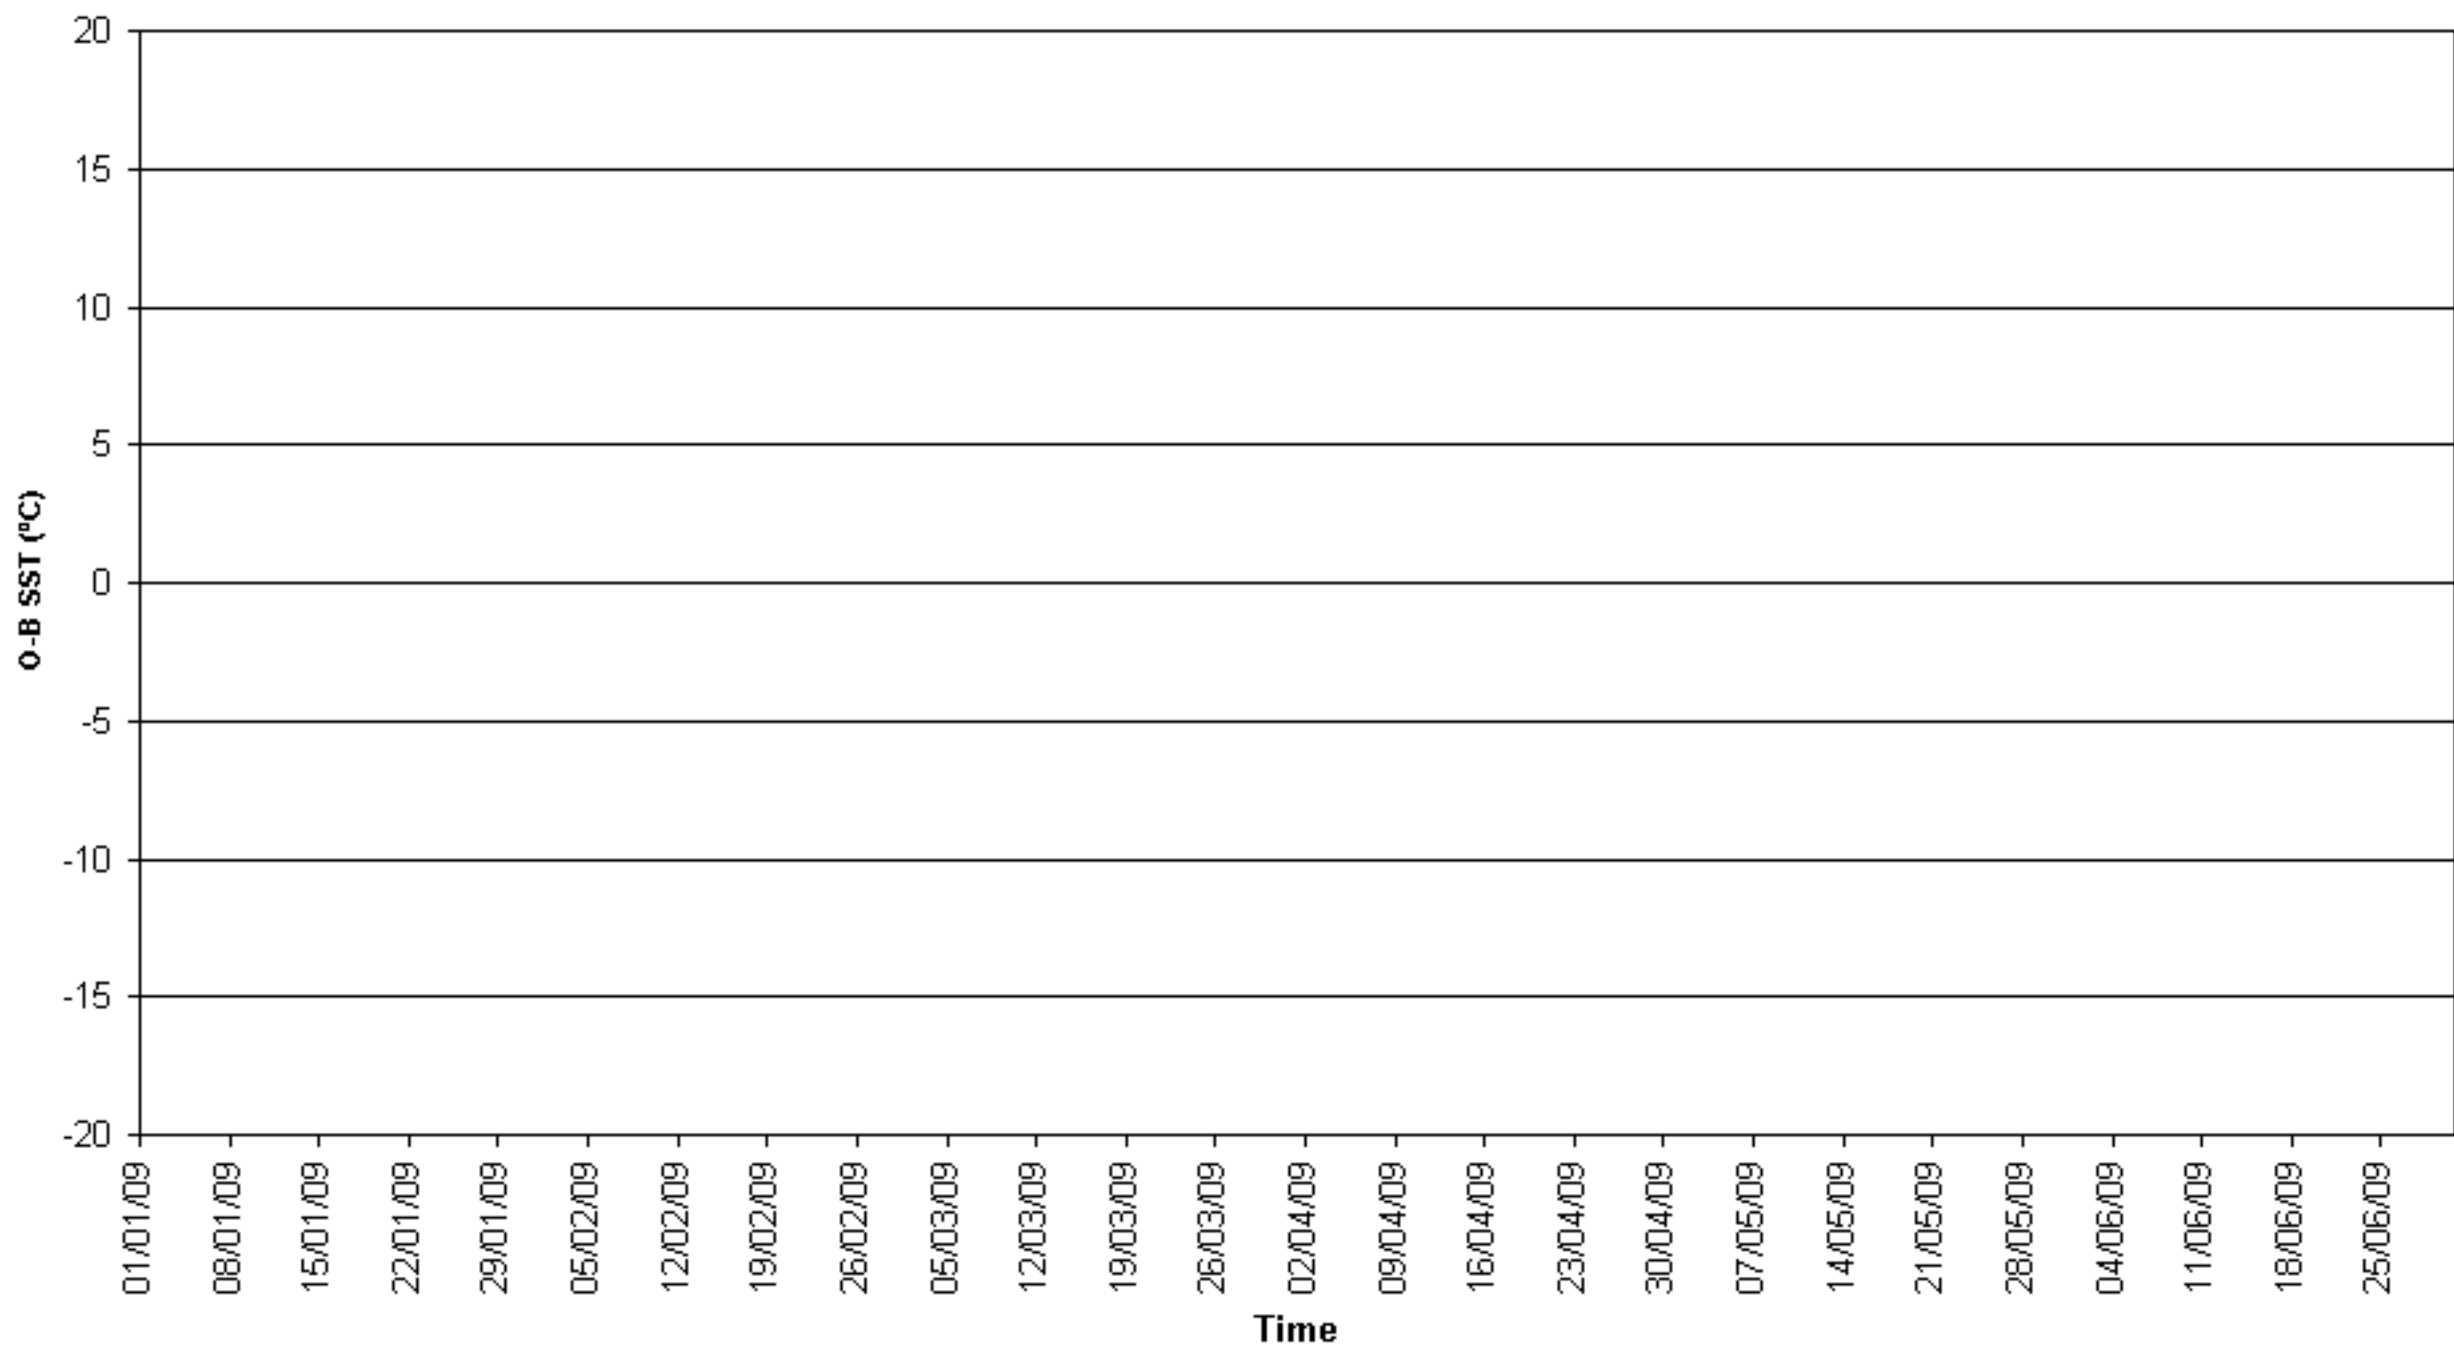


O-B SST (°C) for identifier KS066  
Number of obs. plotted = 43 Number of outliers = 2

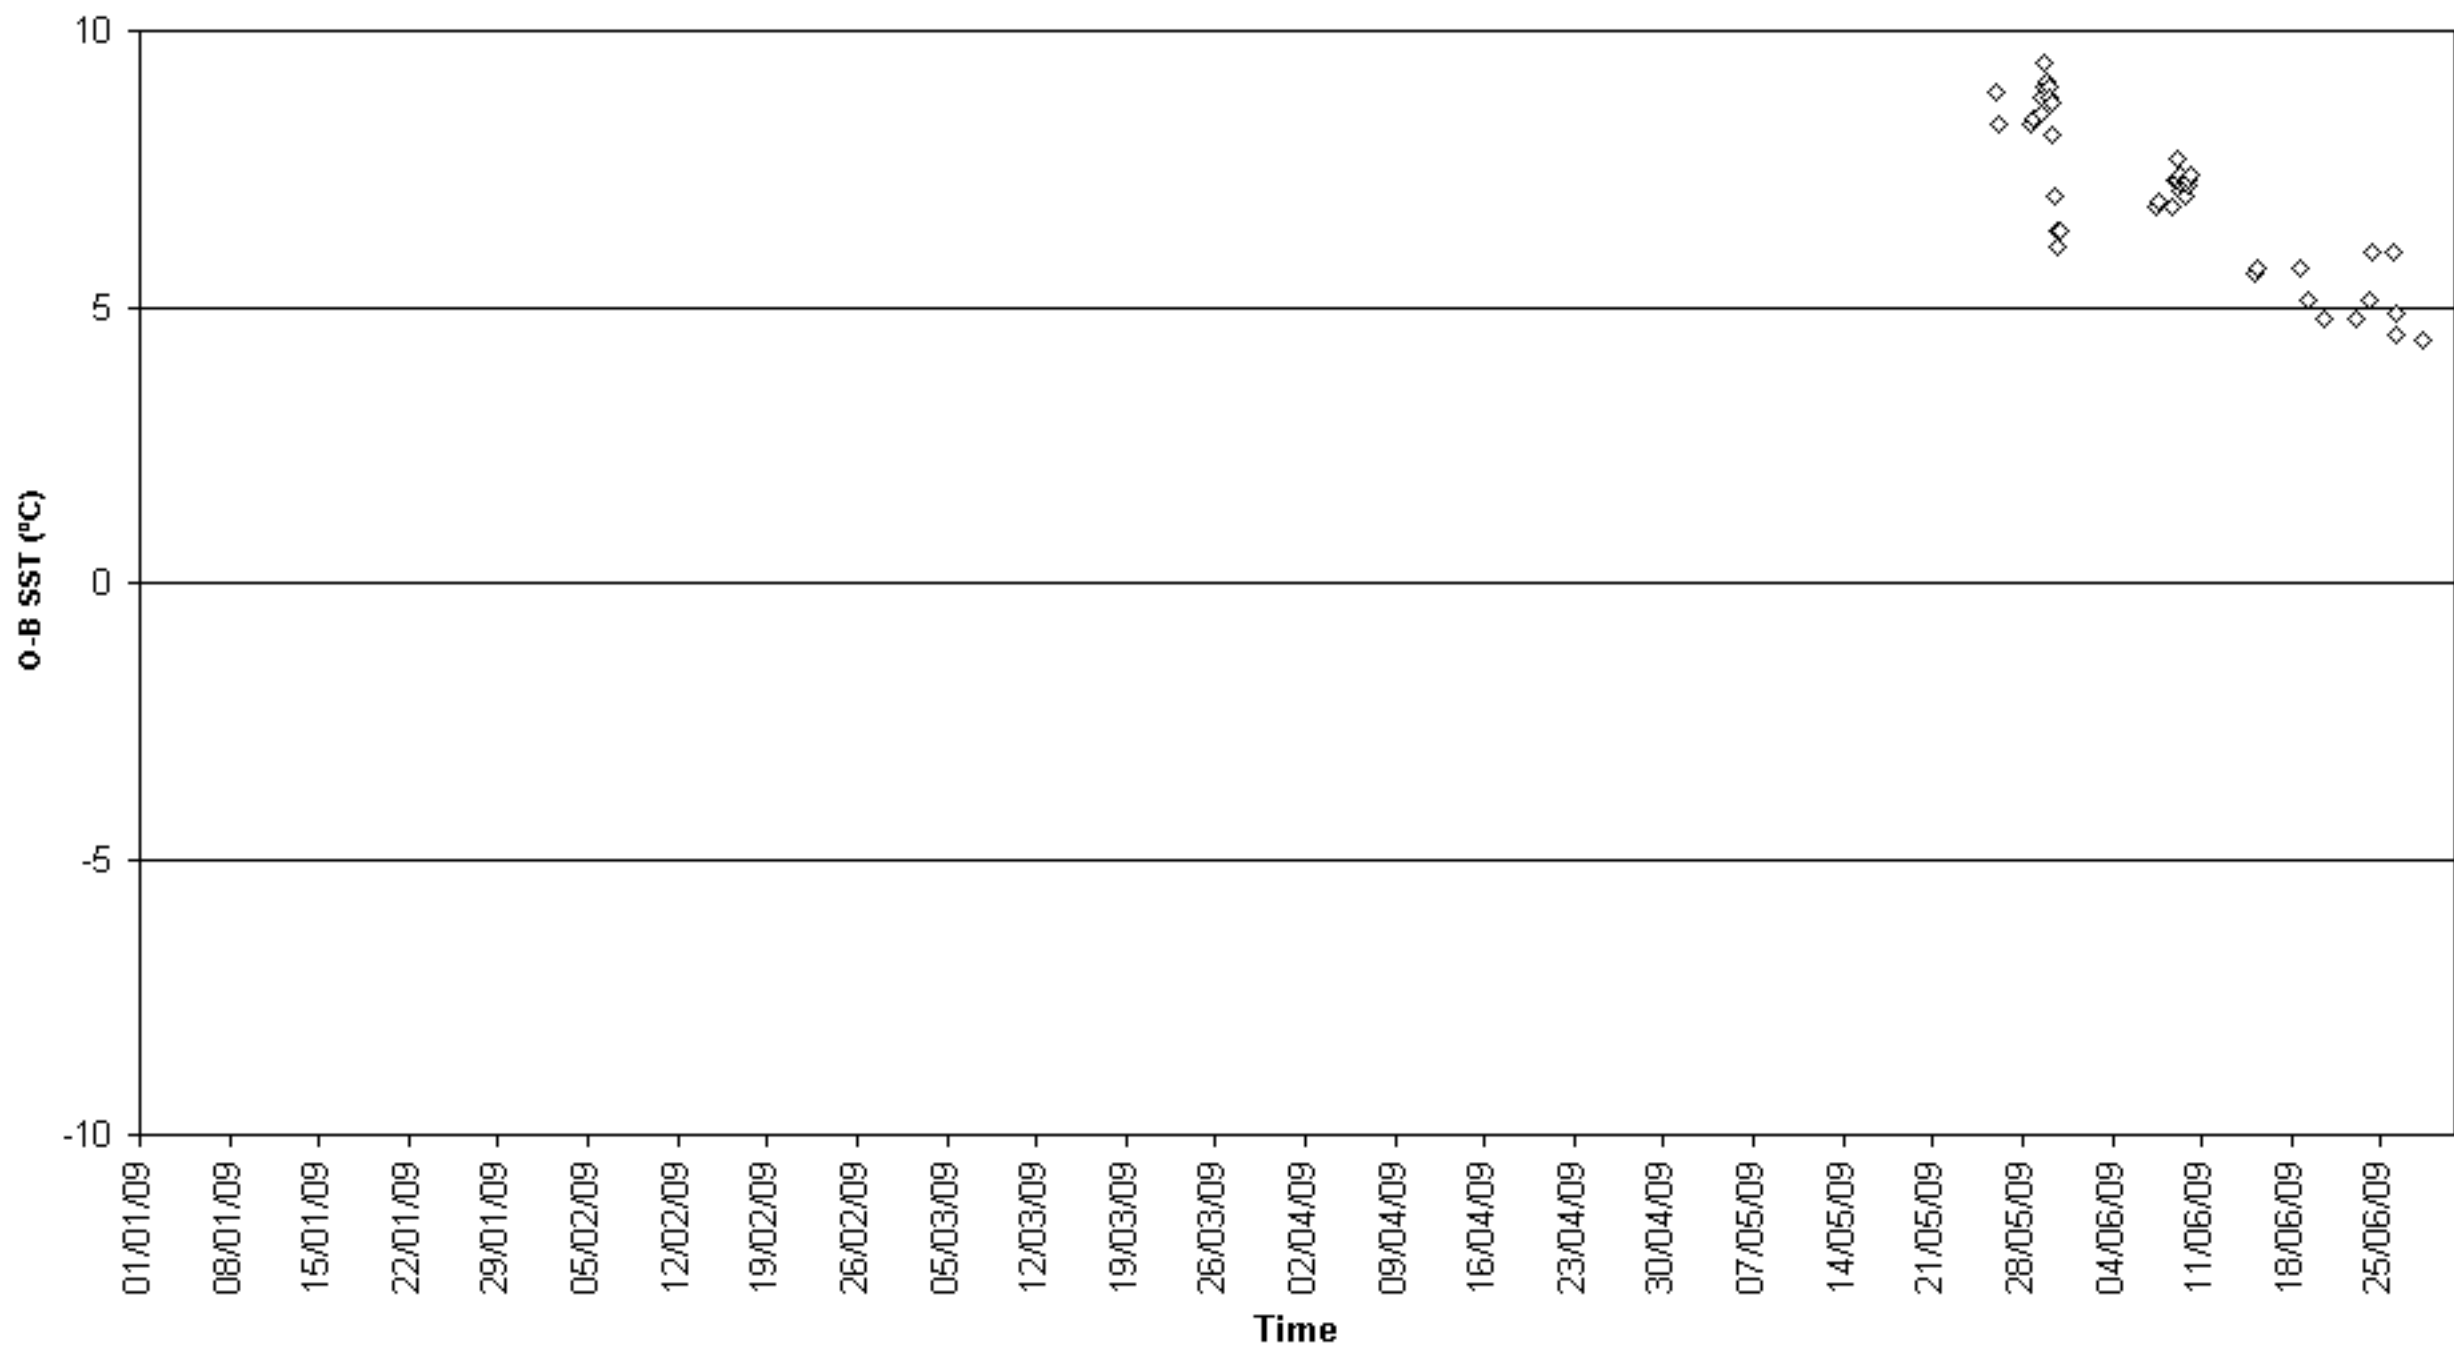





O-B SST (°C) for identifier KS067  
Number of obs. plotted = 440 Number of outliers = 4

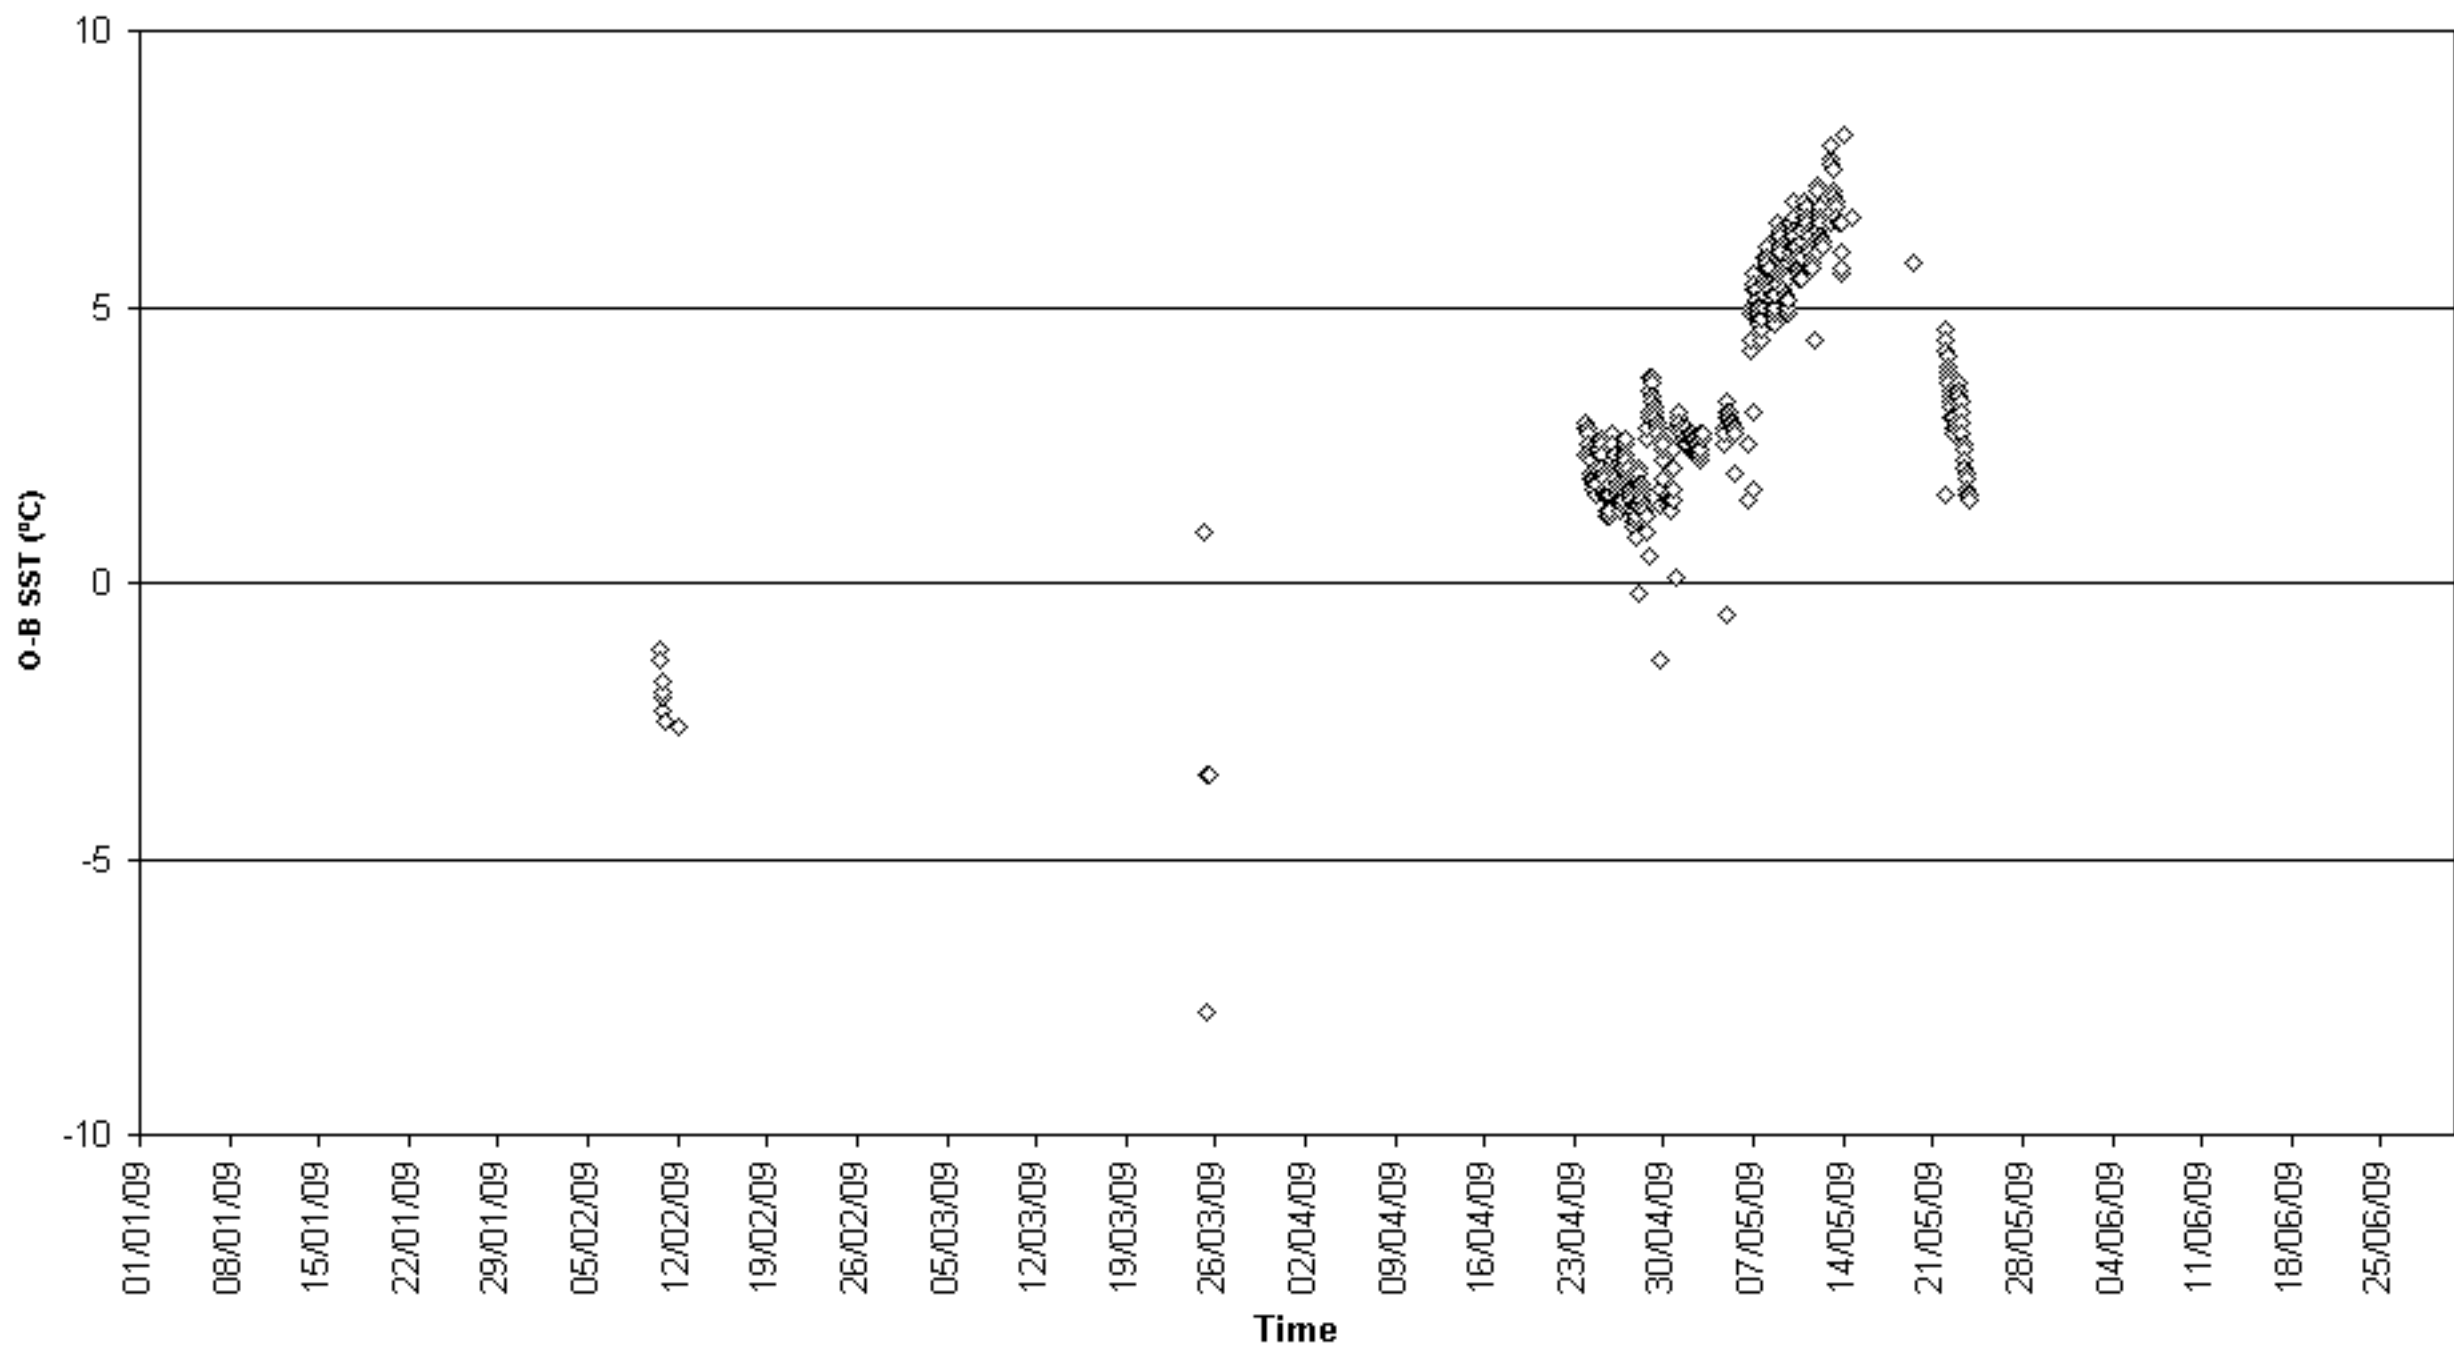


O-B SST (°C) for identifier KS078  
Number of obs. plotted = 496 Number of outliers = 0

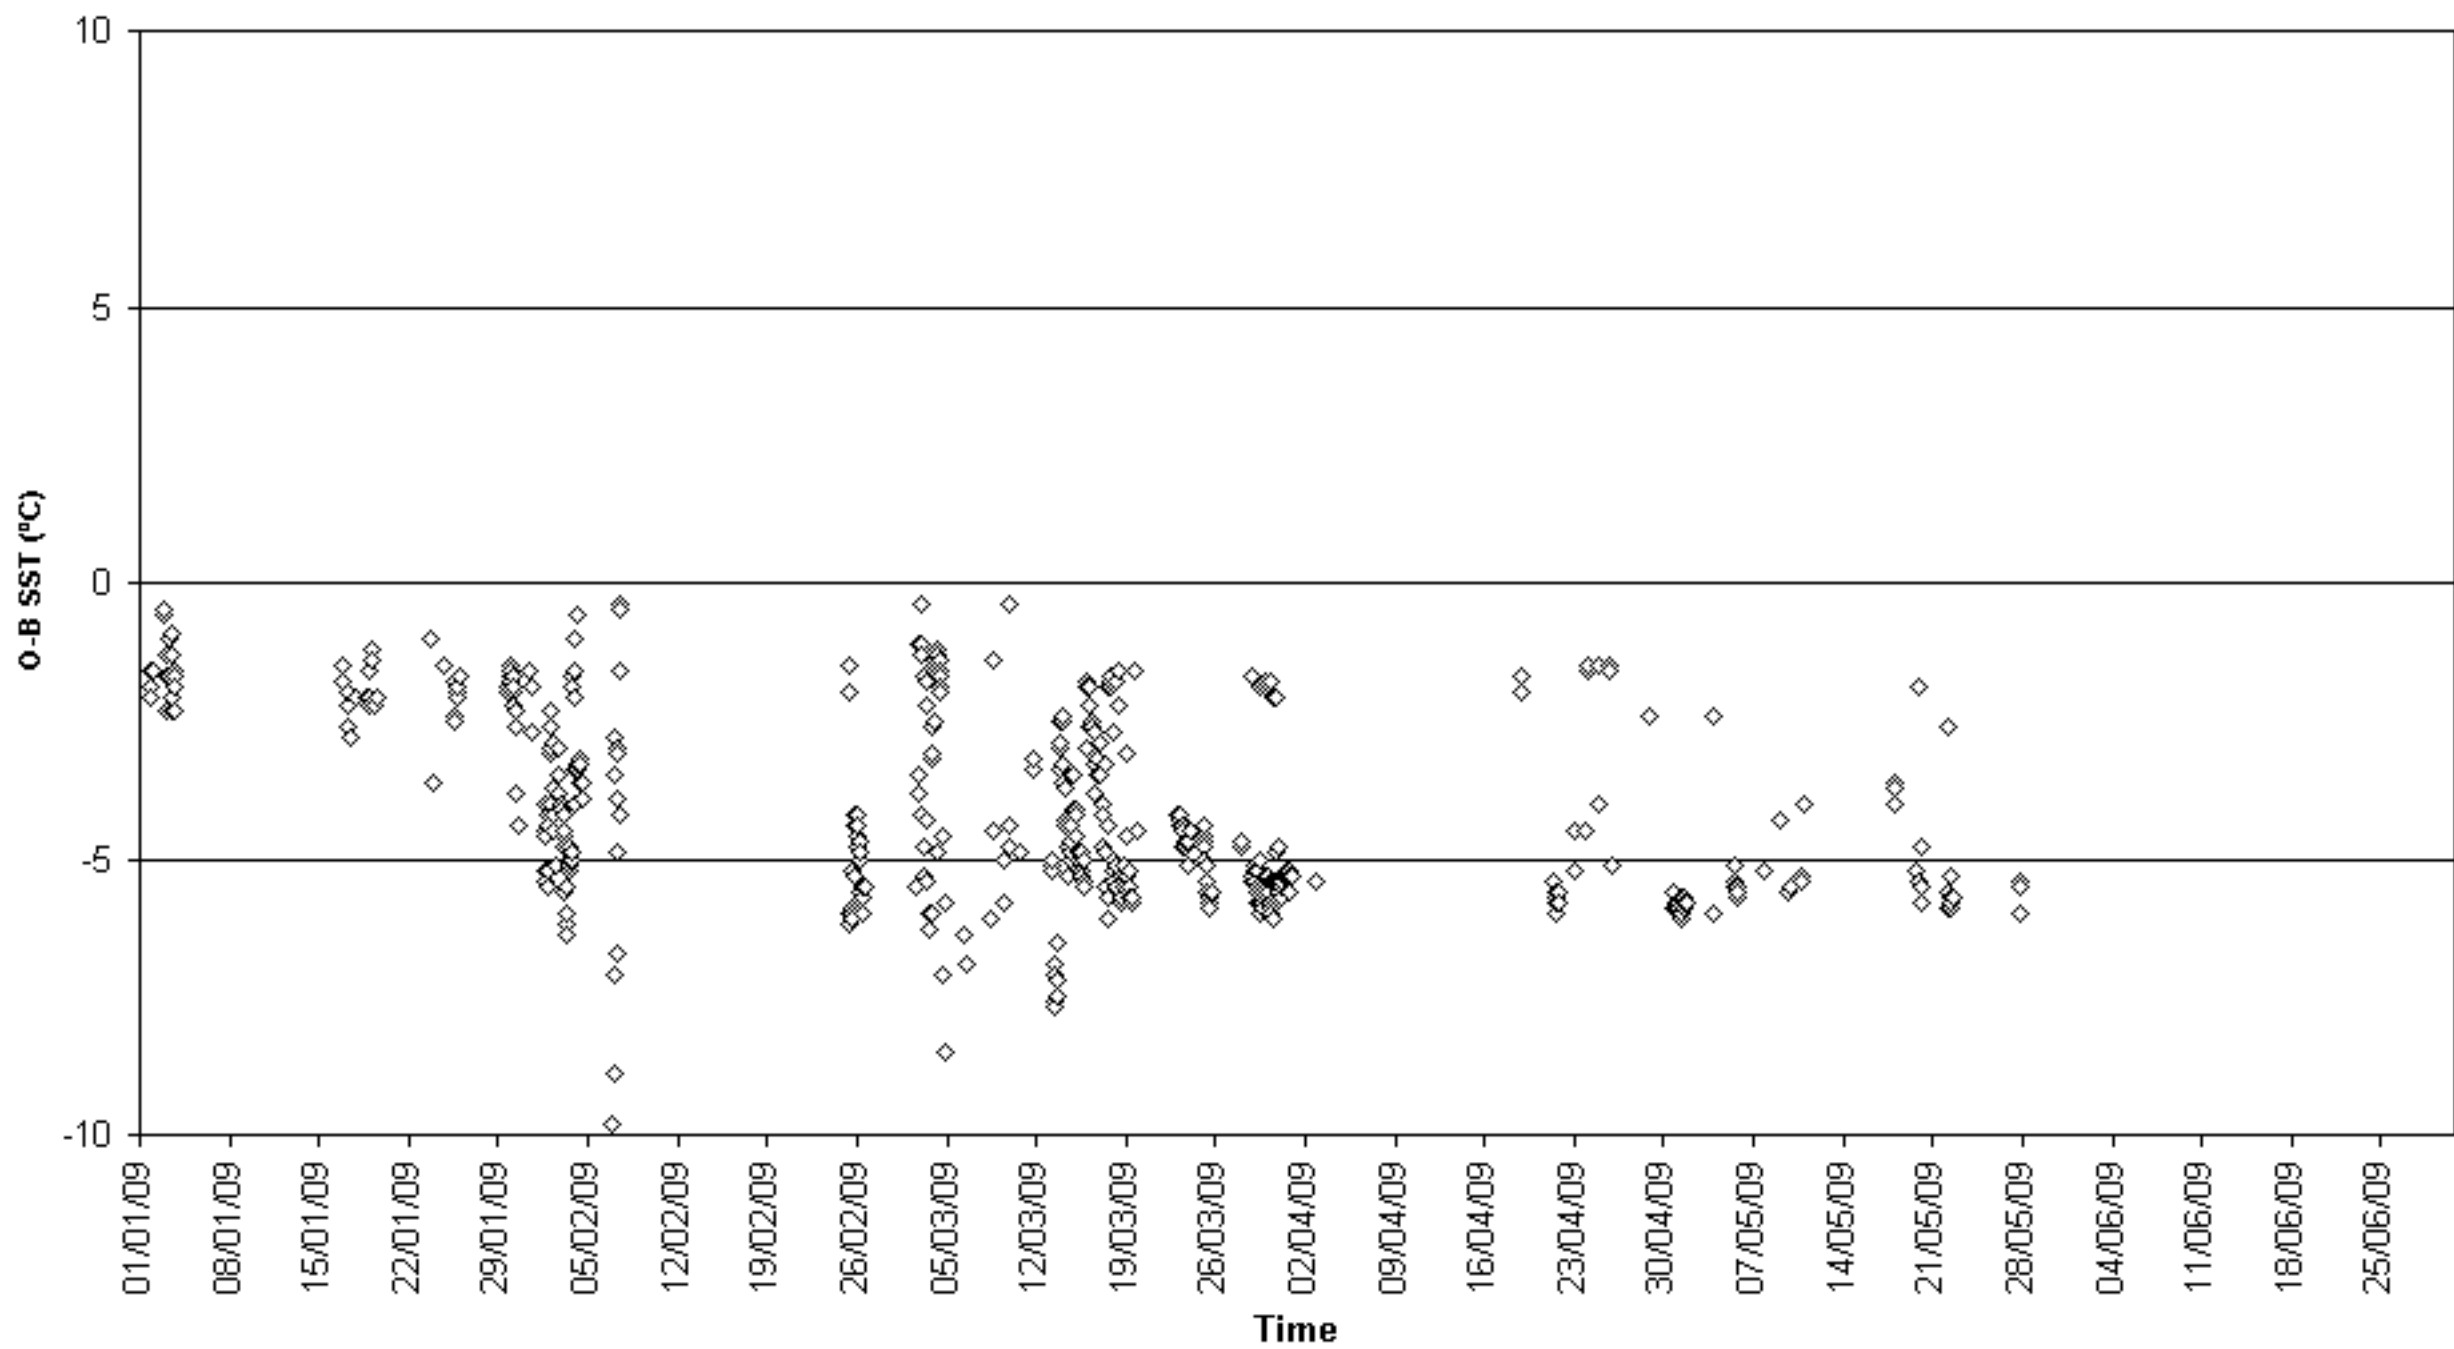


O-B SST (°C) for identifier KS080  
Number of obs. plotted = 43 Number of outliers = 29

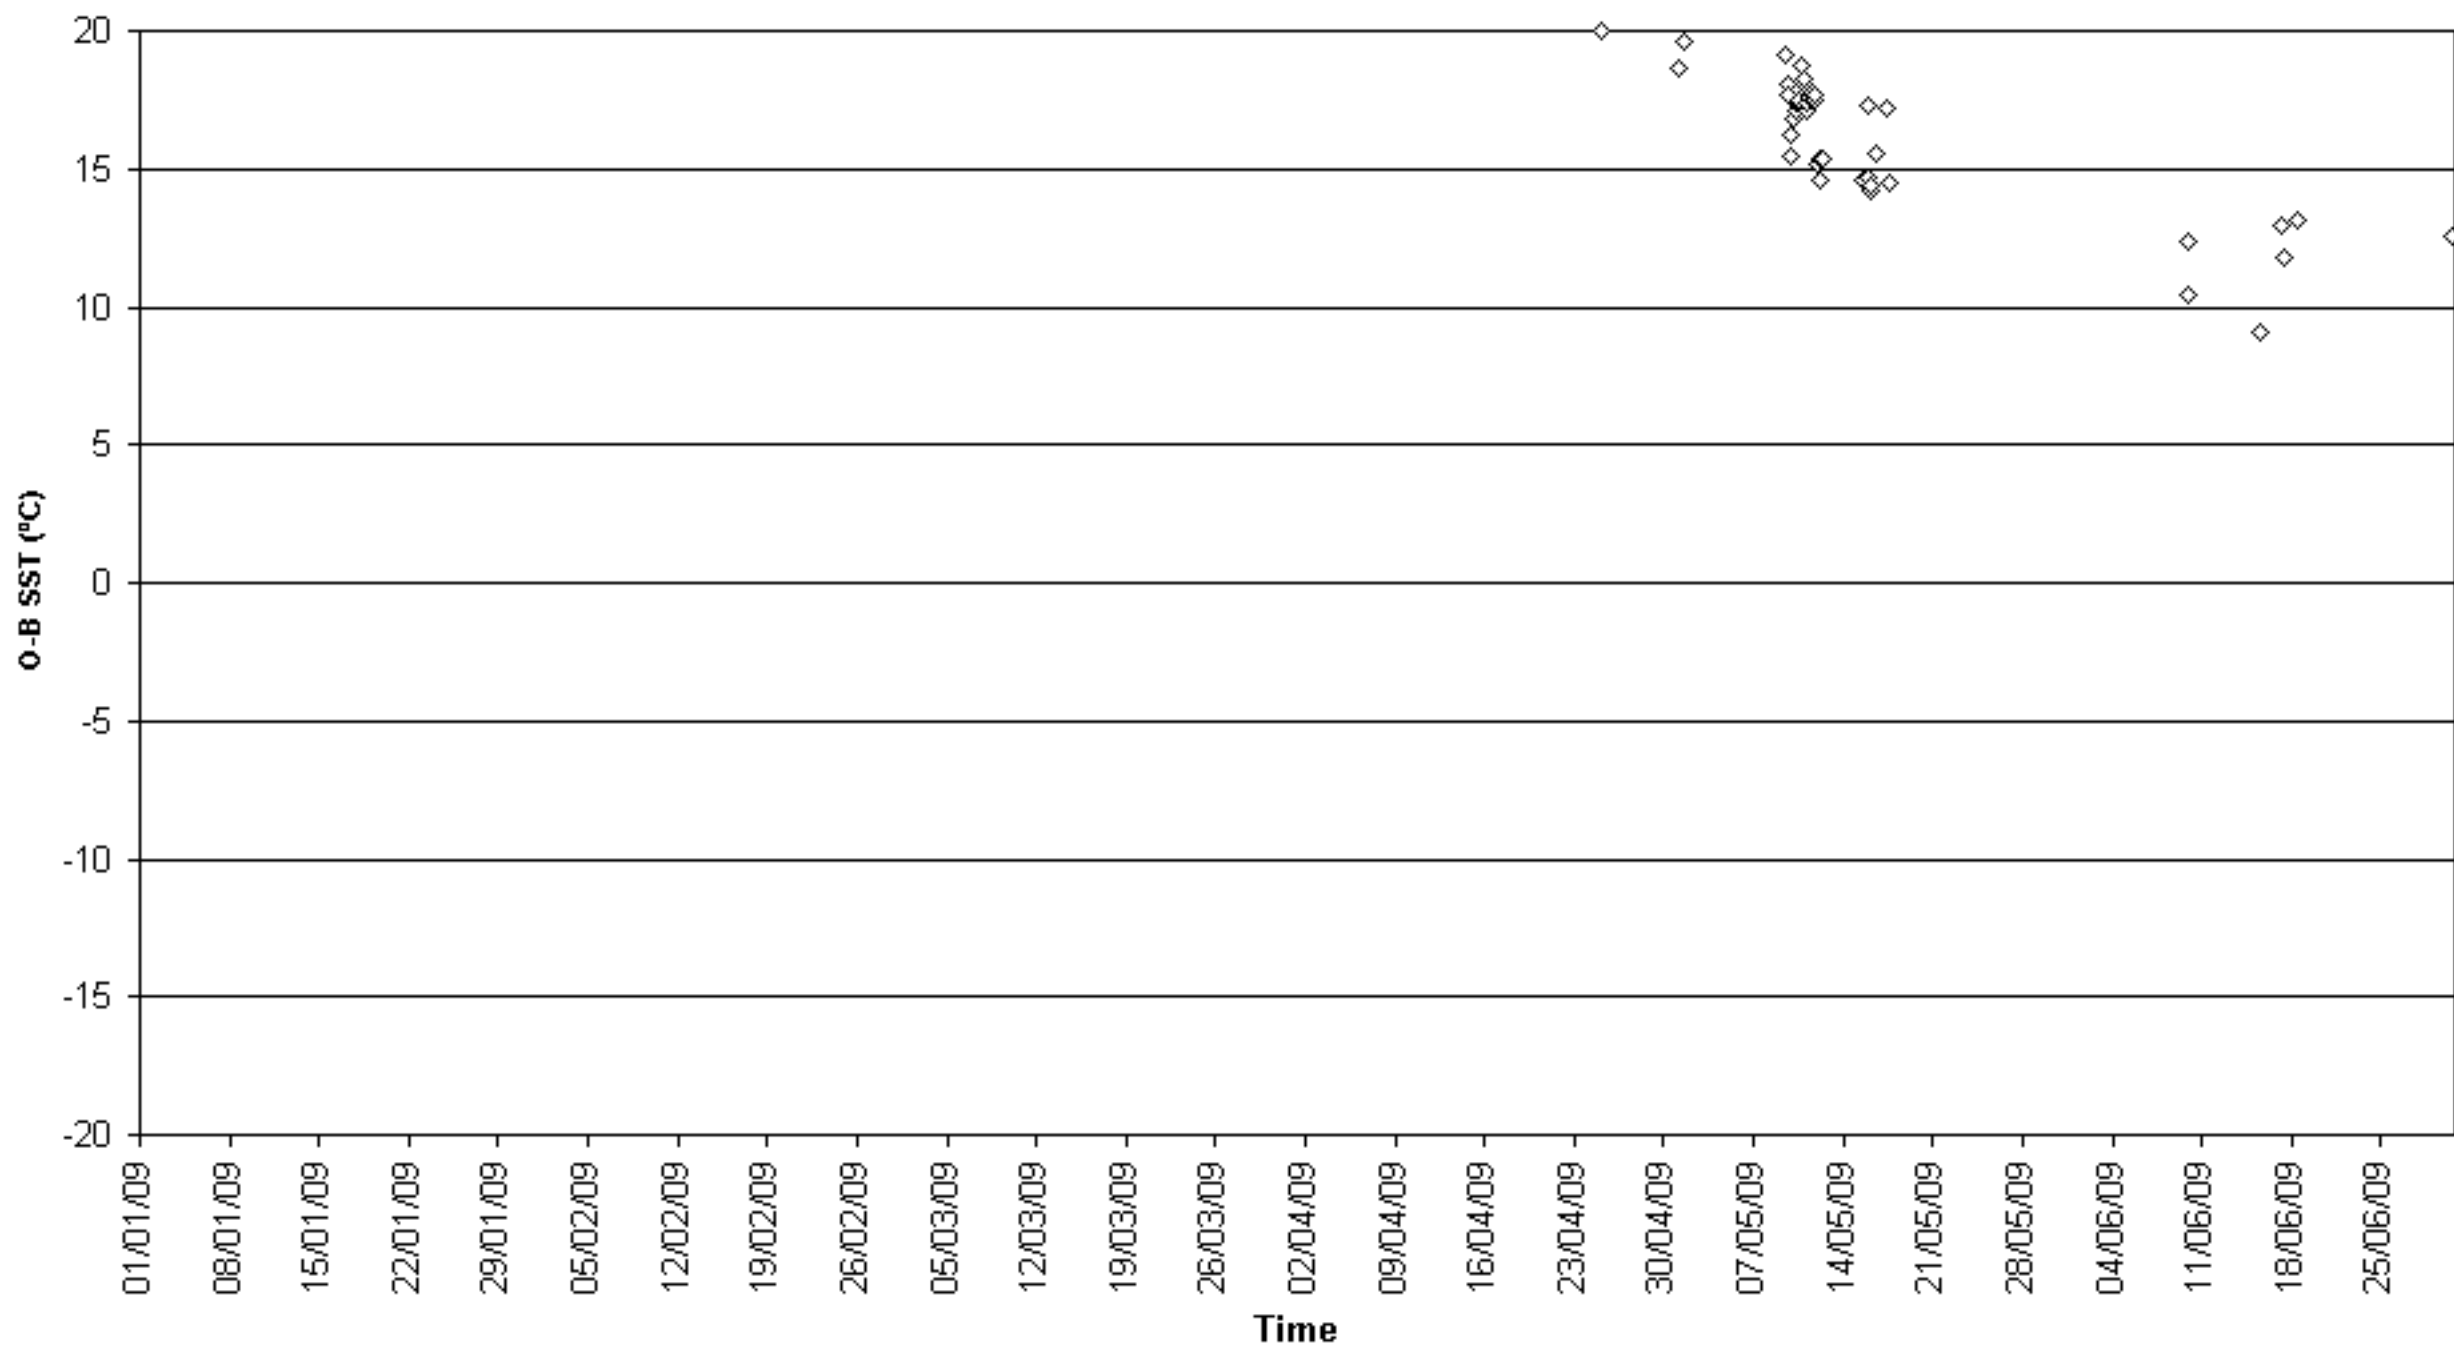


O-B SST (°C) for identifier KS087  
Number of obs. plotted = 2    Number of outliers = 118

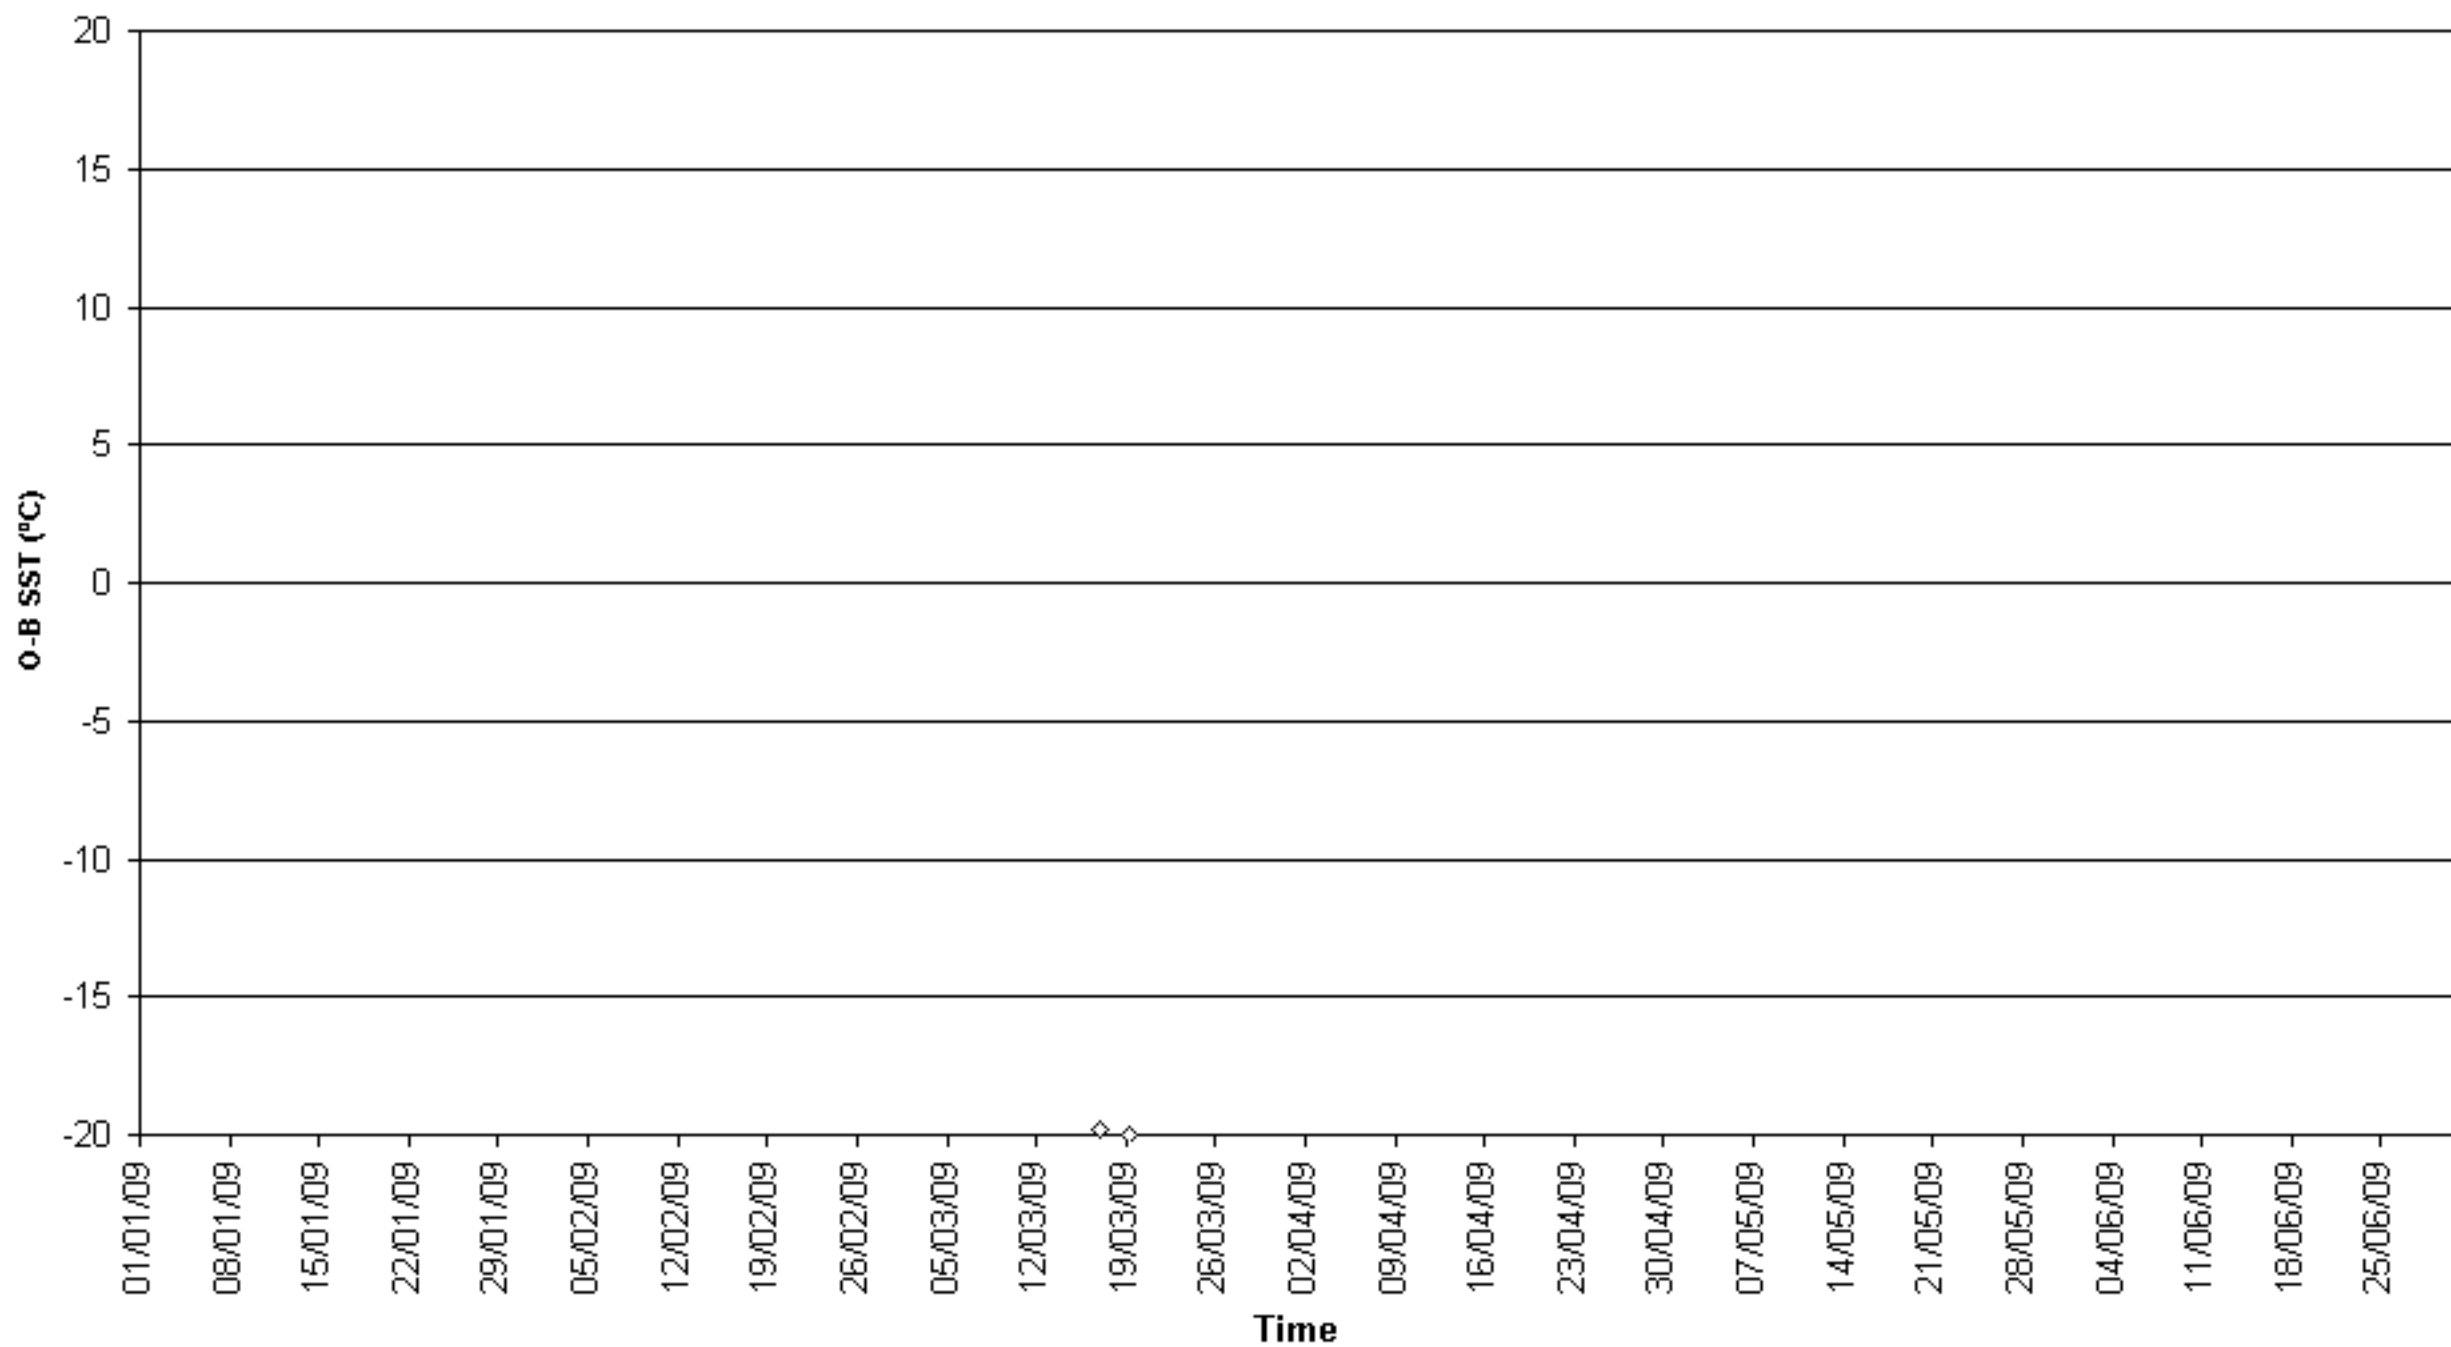


O-B SST (°C) for identifier KS088  
Number of obs. plotted = 88 Number of outliers = 0

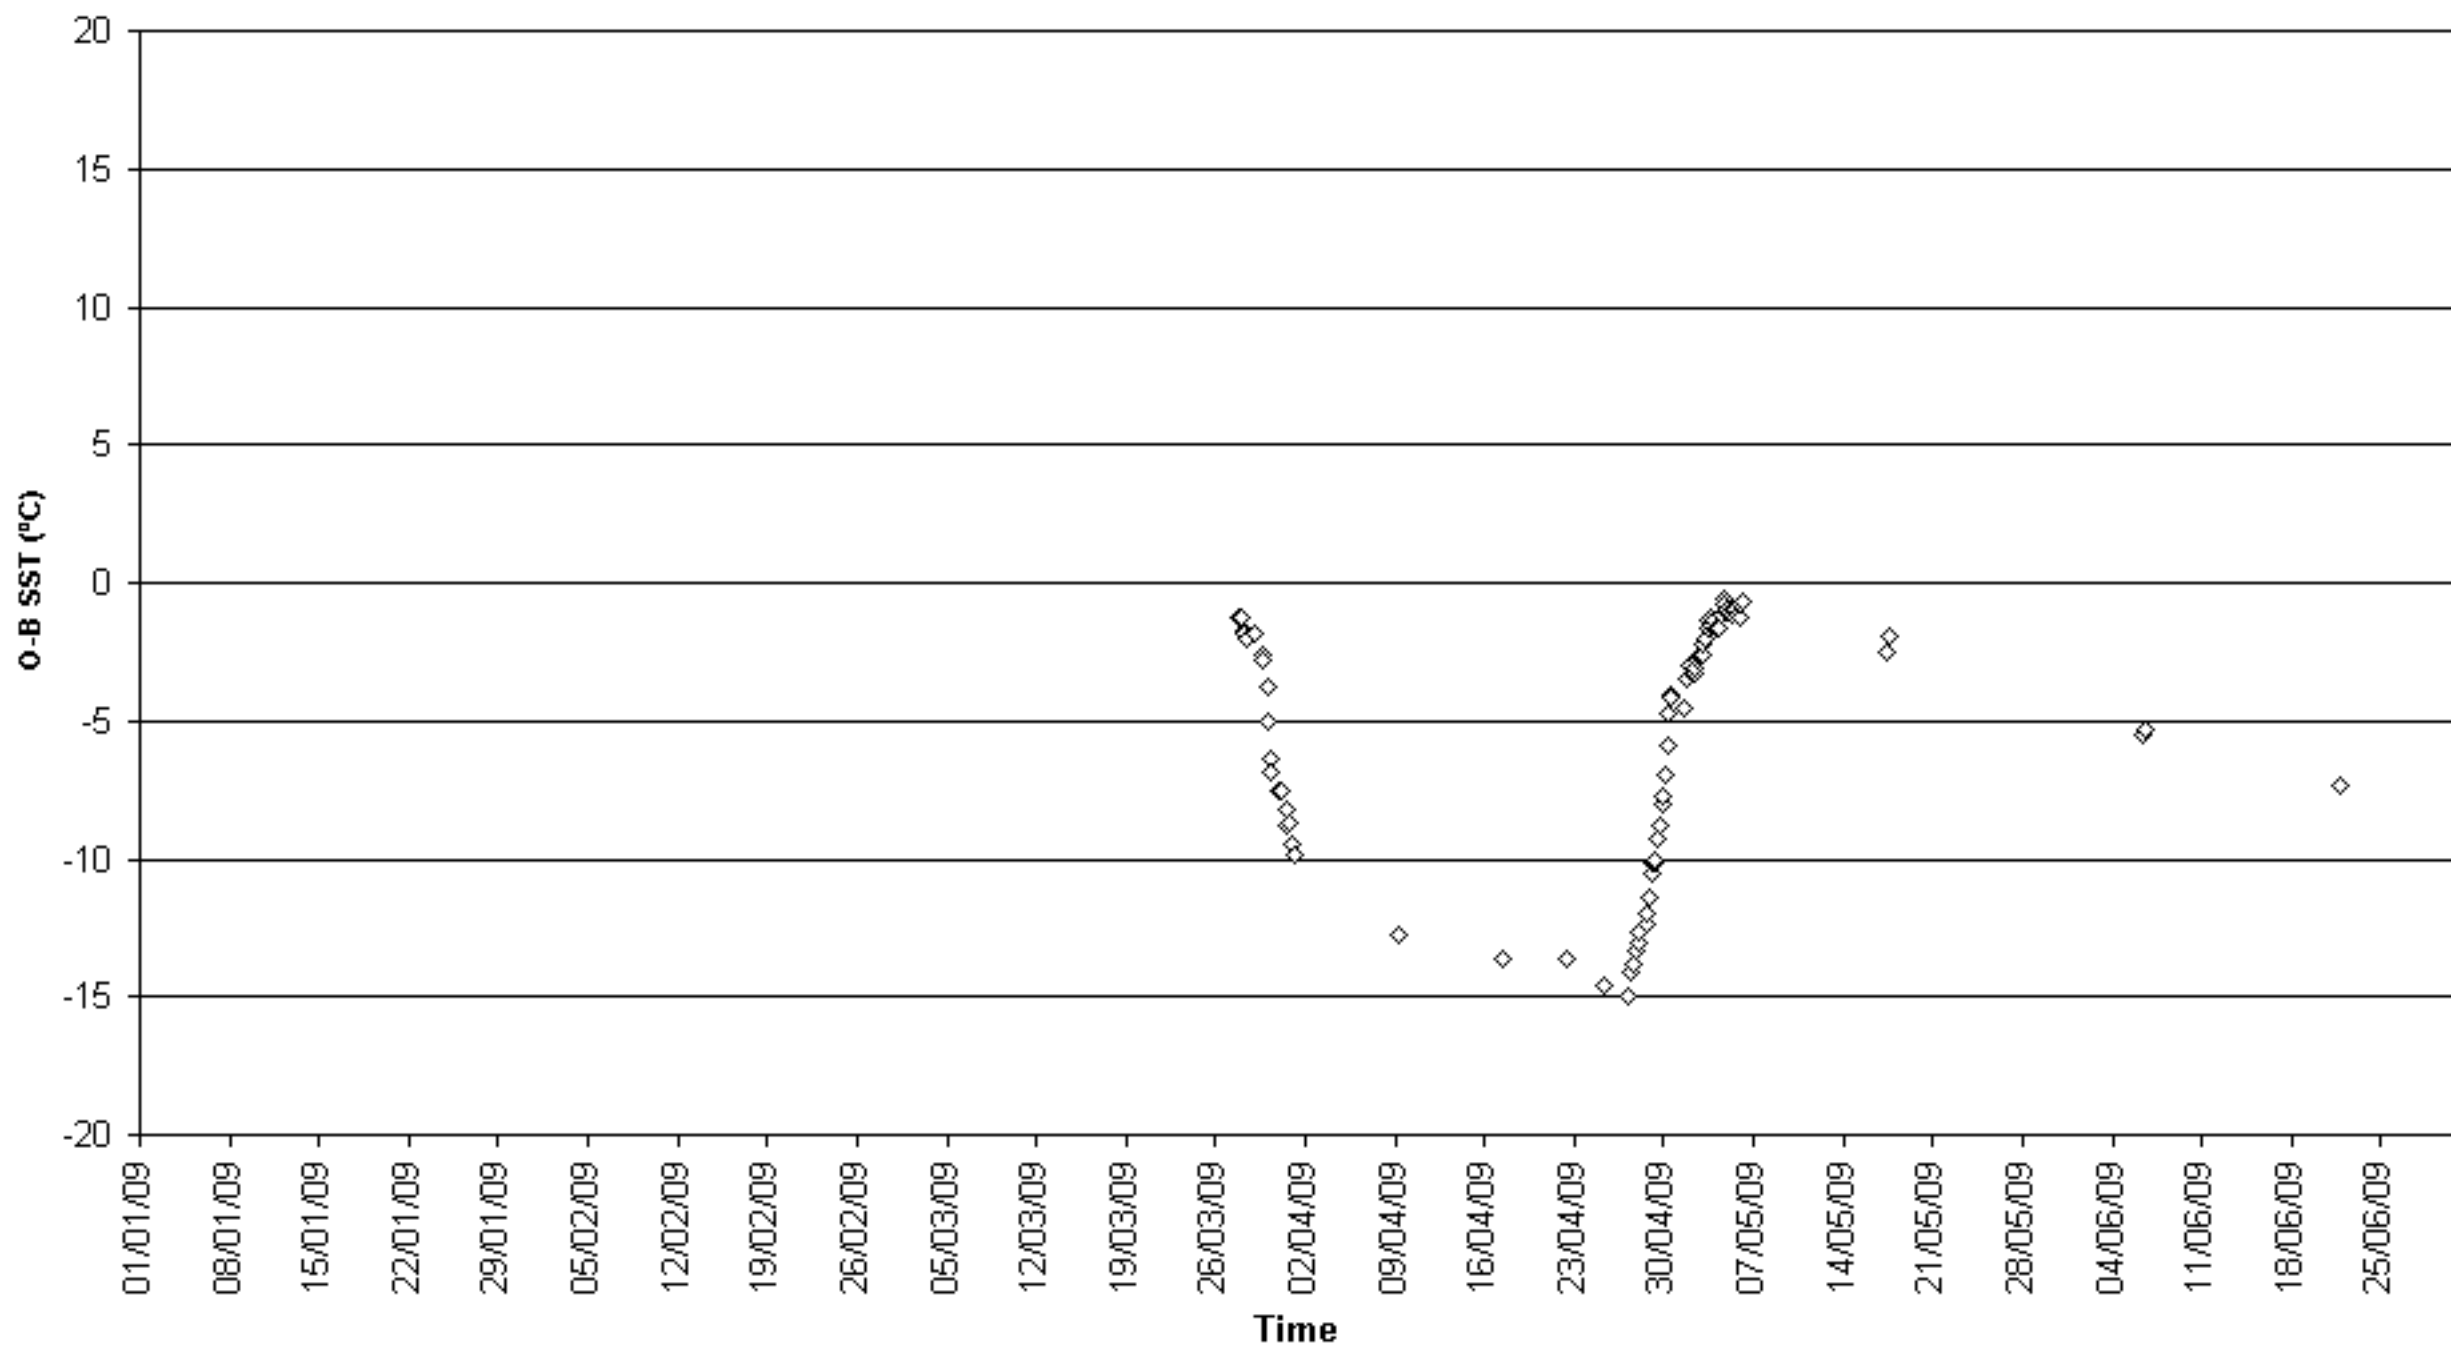


O-B SST (°C) for identifier KS089  
Number of obs. plotted = 46 Number of outliers = 47

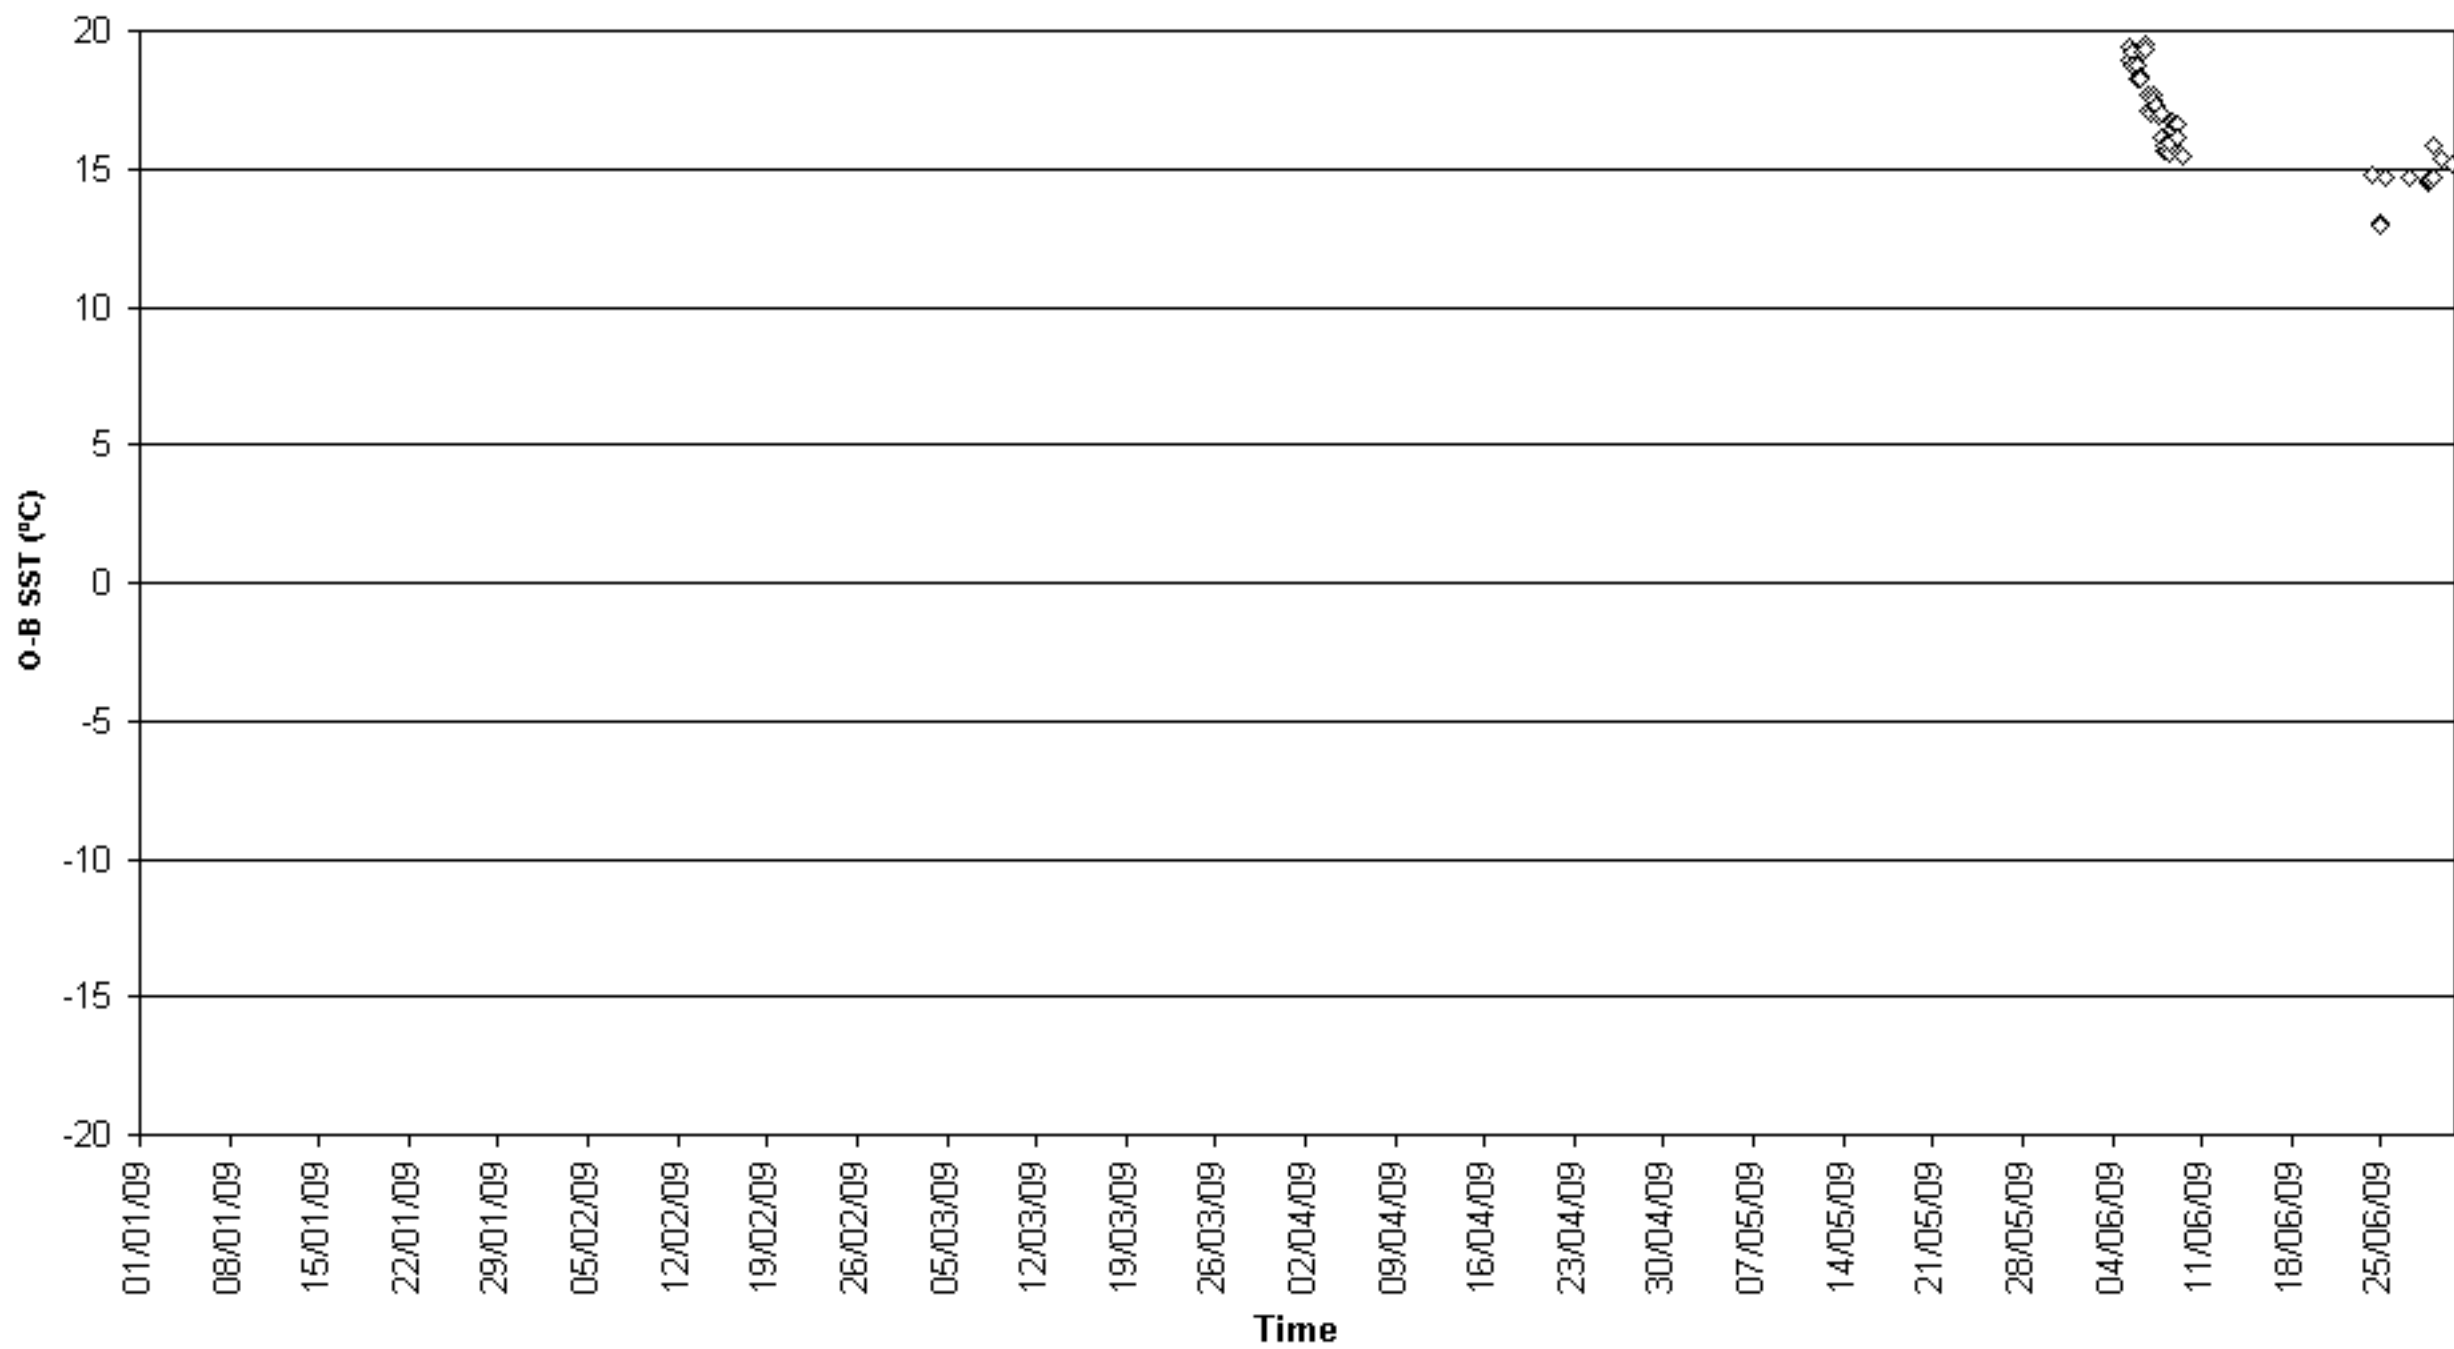

O-B SST (°C) for identifier MGSM3  
Number of obs. plotted = 54 Number of outliers = 31

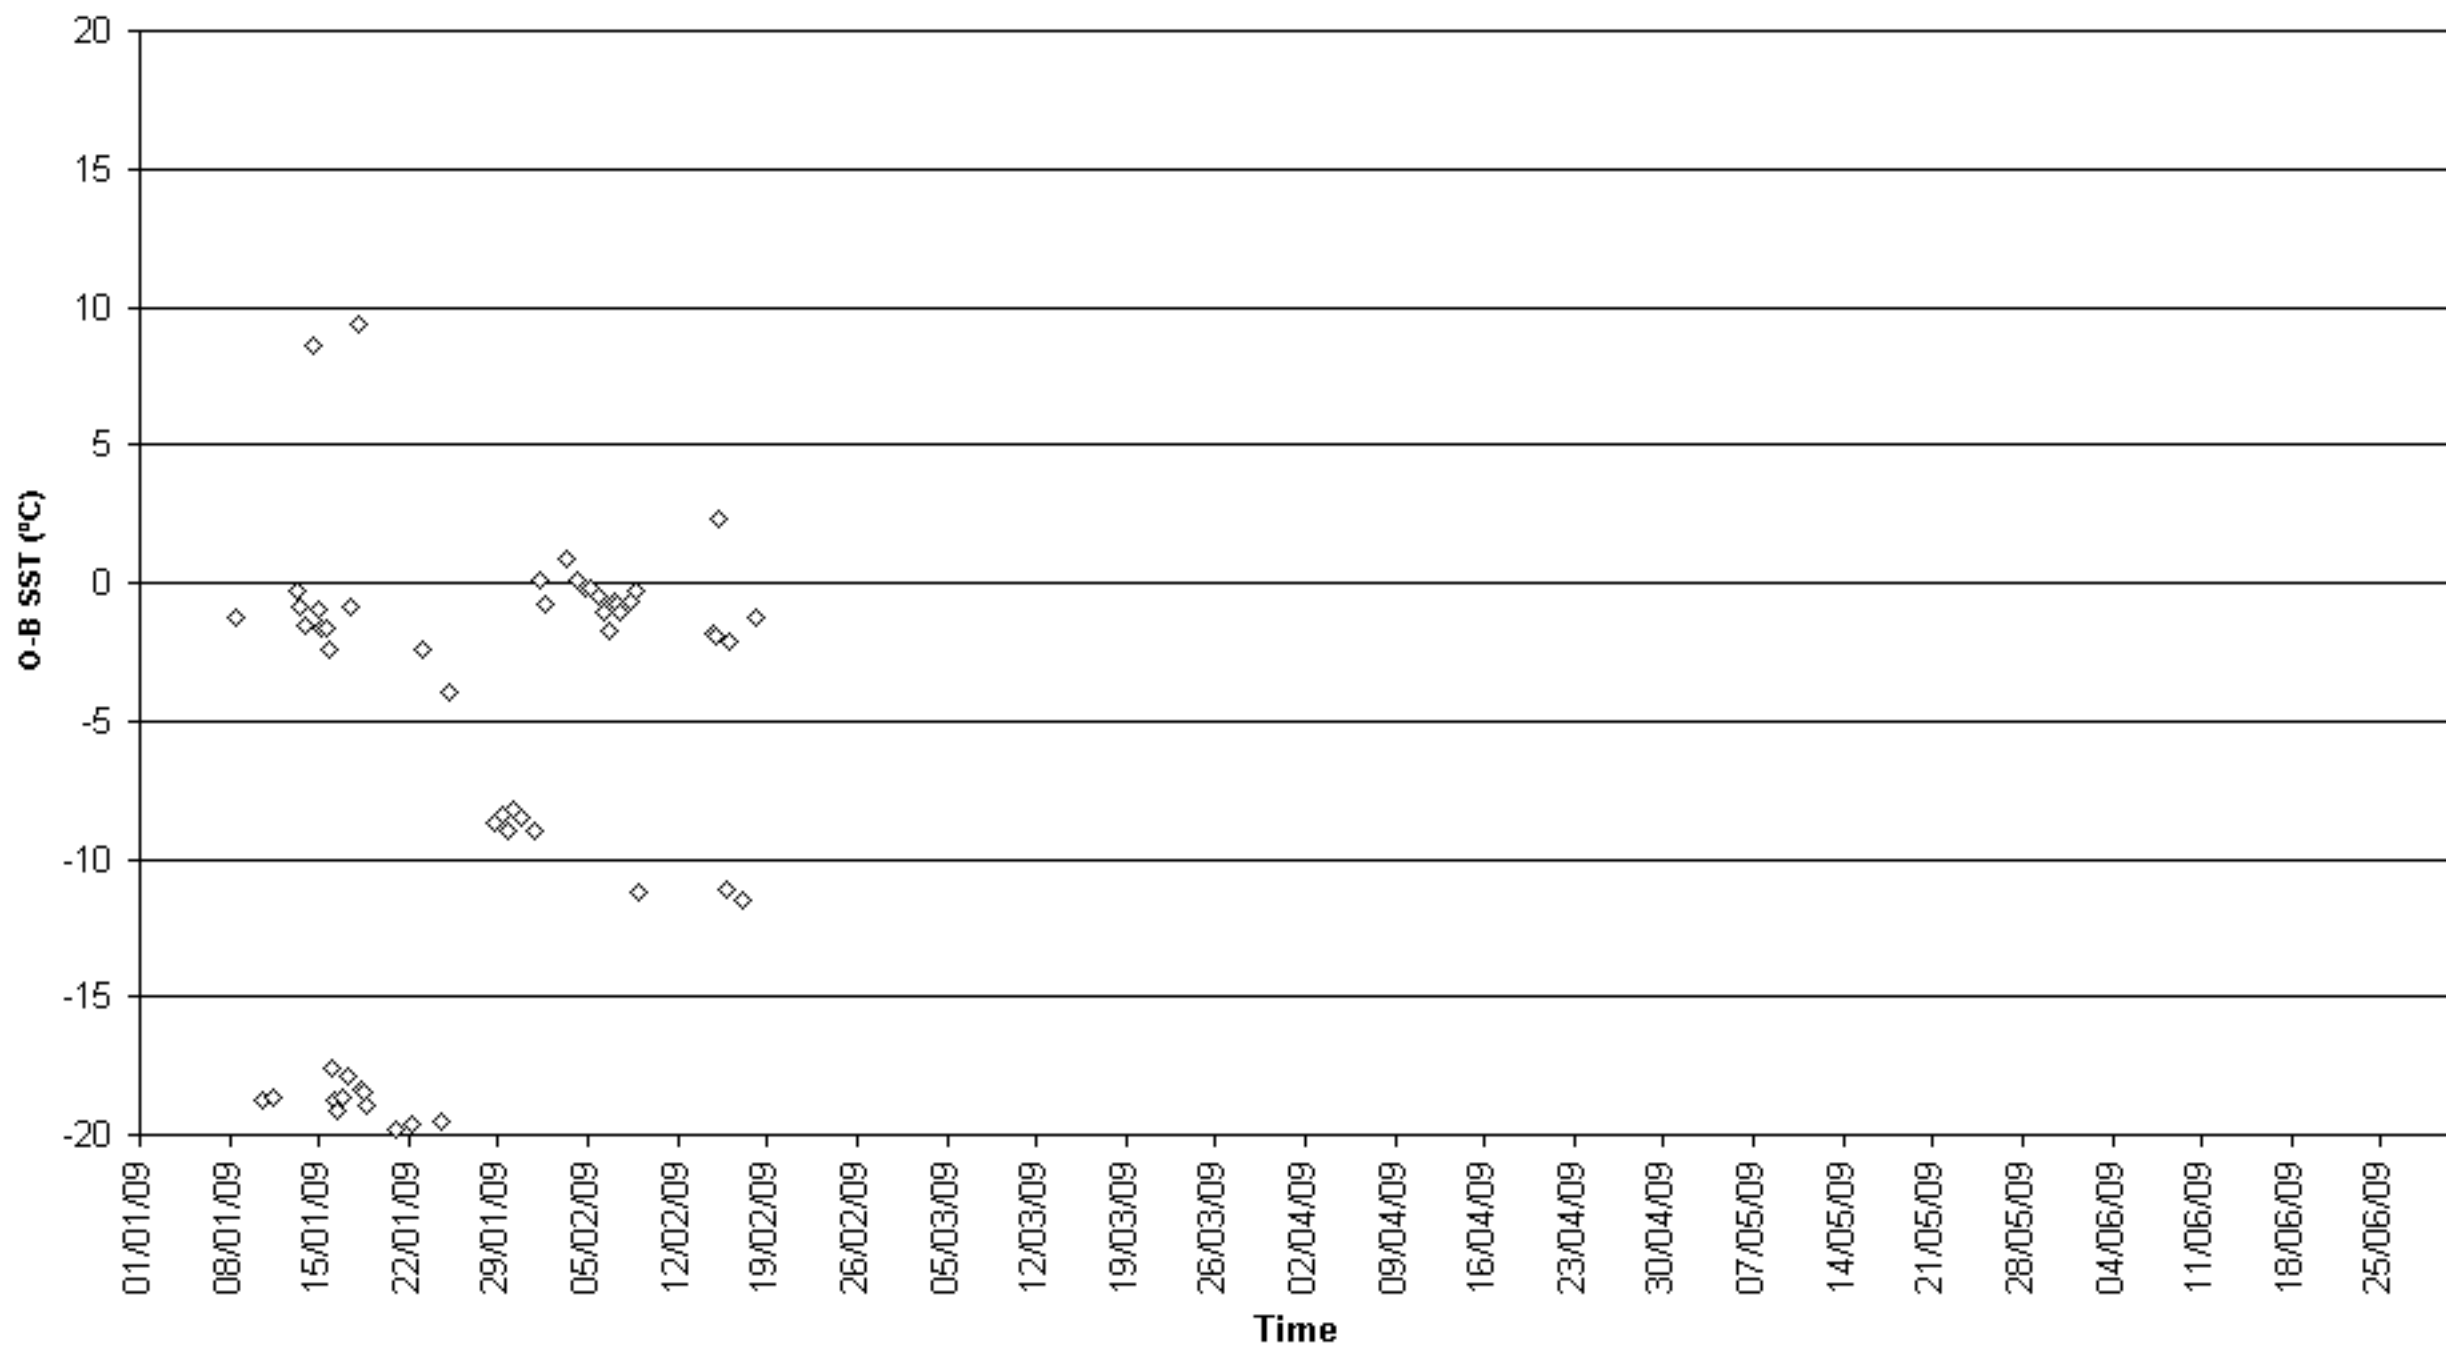


O-B SST (°C) for identifier ONAN  
Number of obs. plotted = 157 Number of outliers = 2

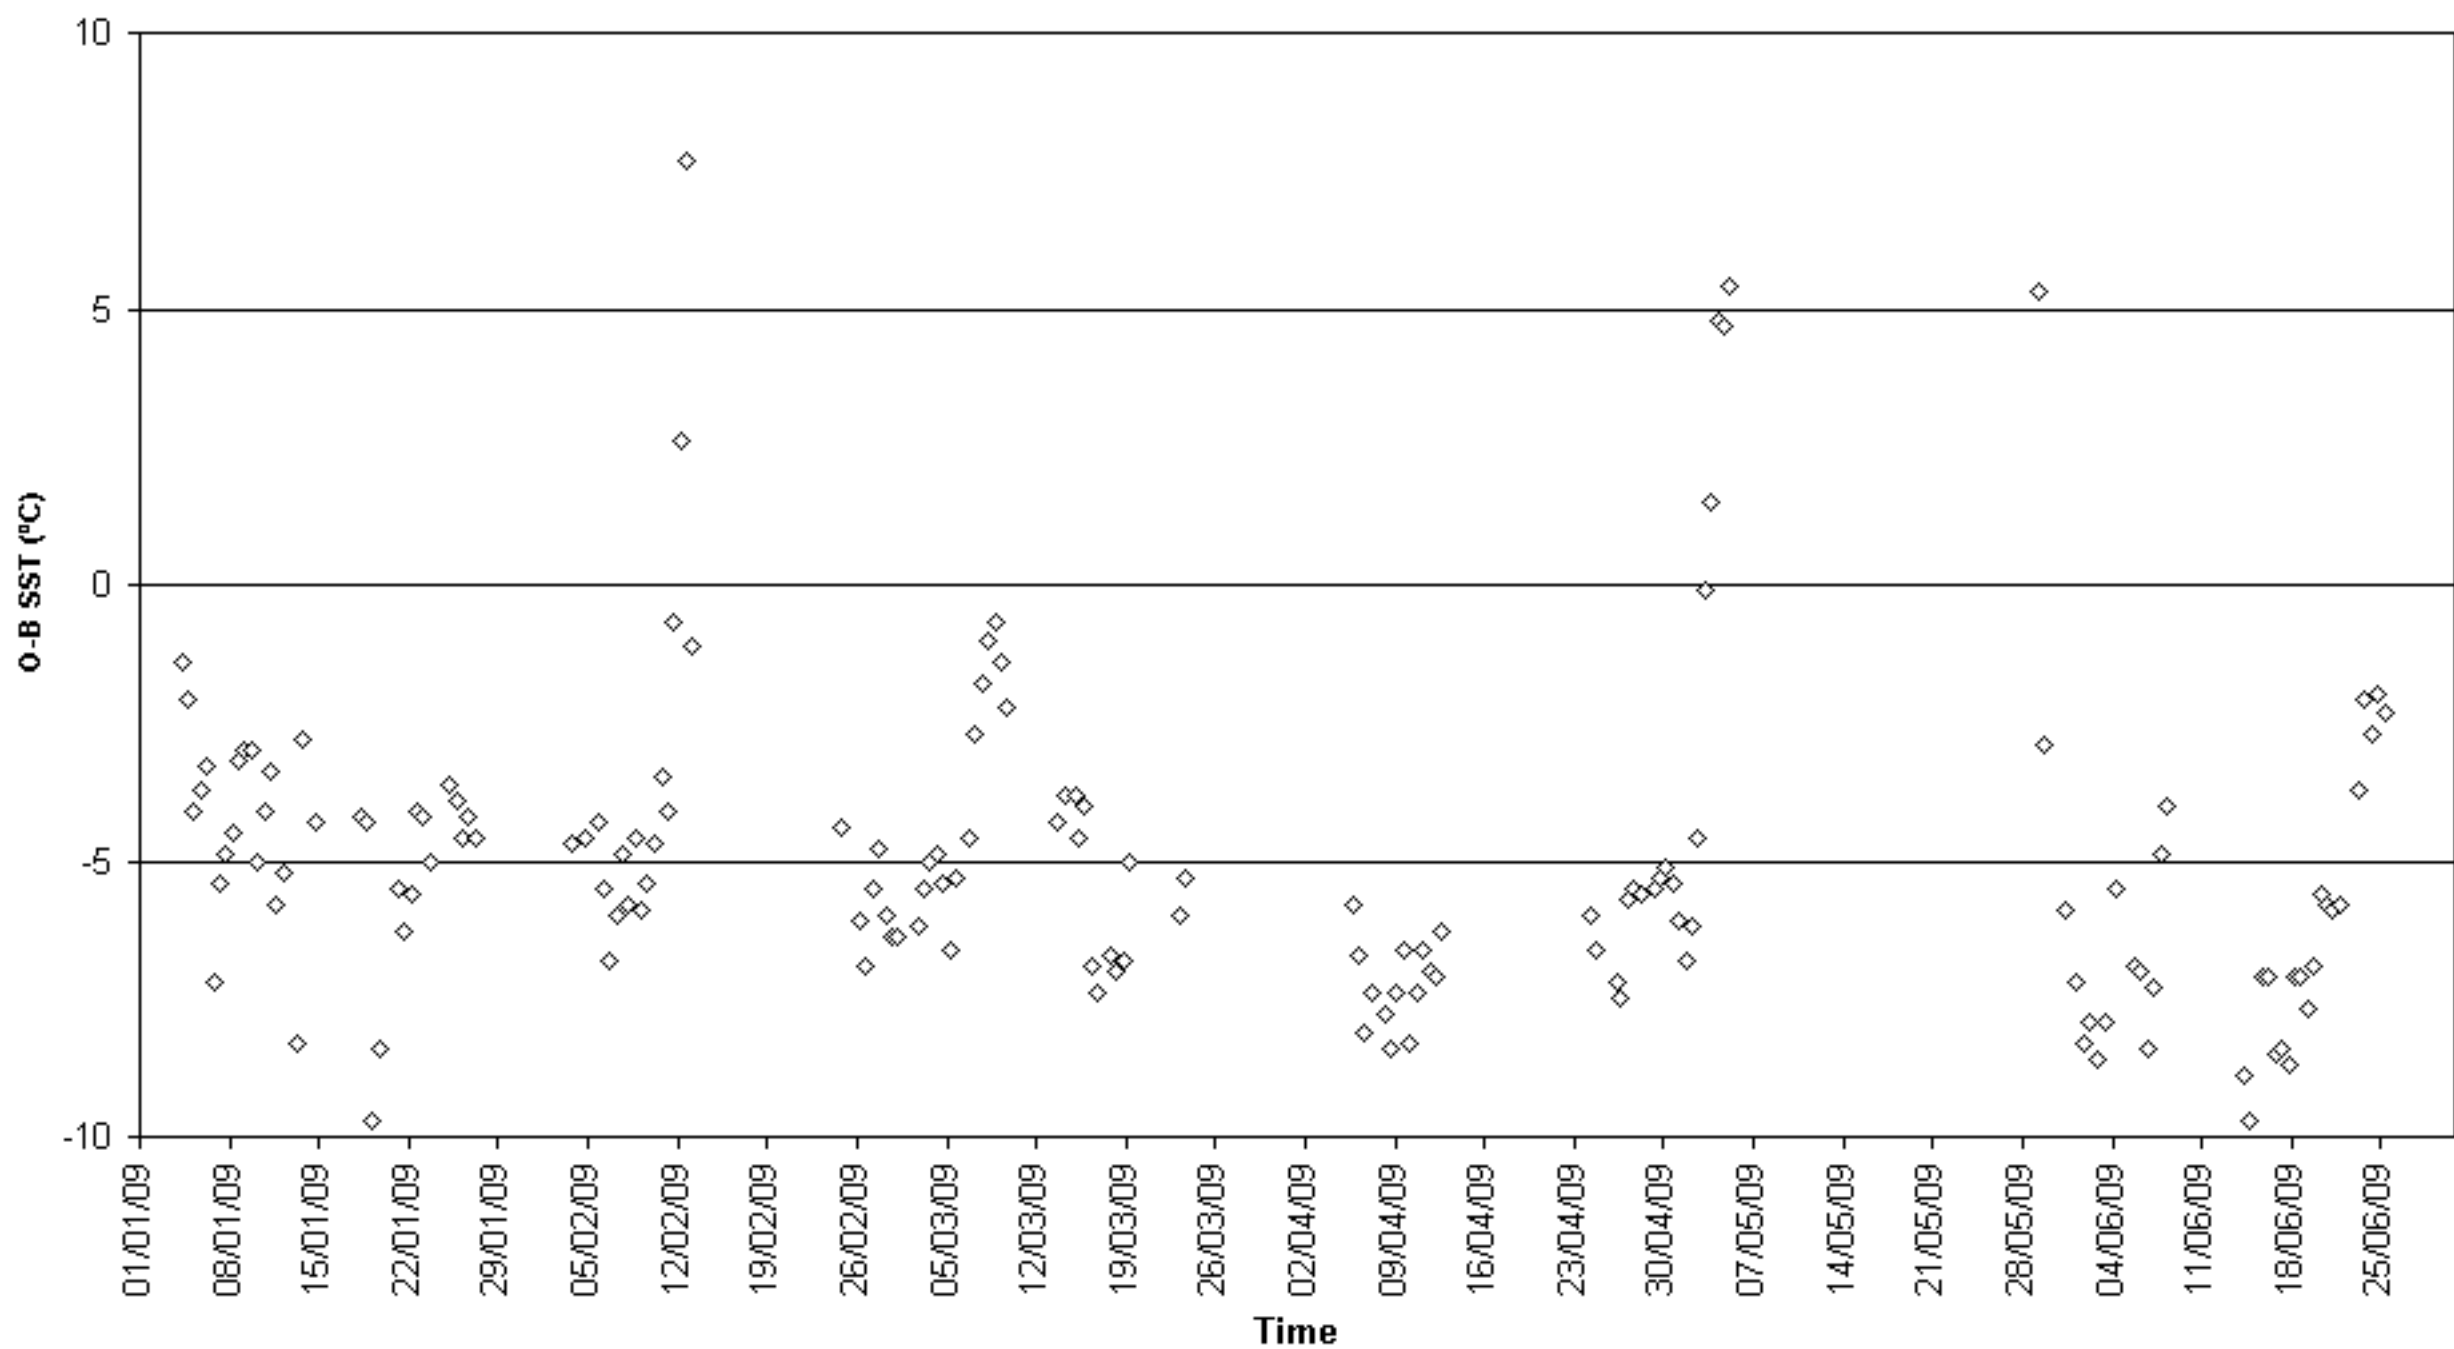





O-B SST (°C) for identifier PDUJ  
Number of obs. plotted = 53 Number of outliers = 0

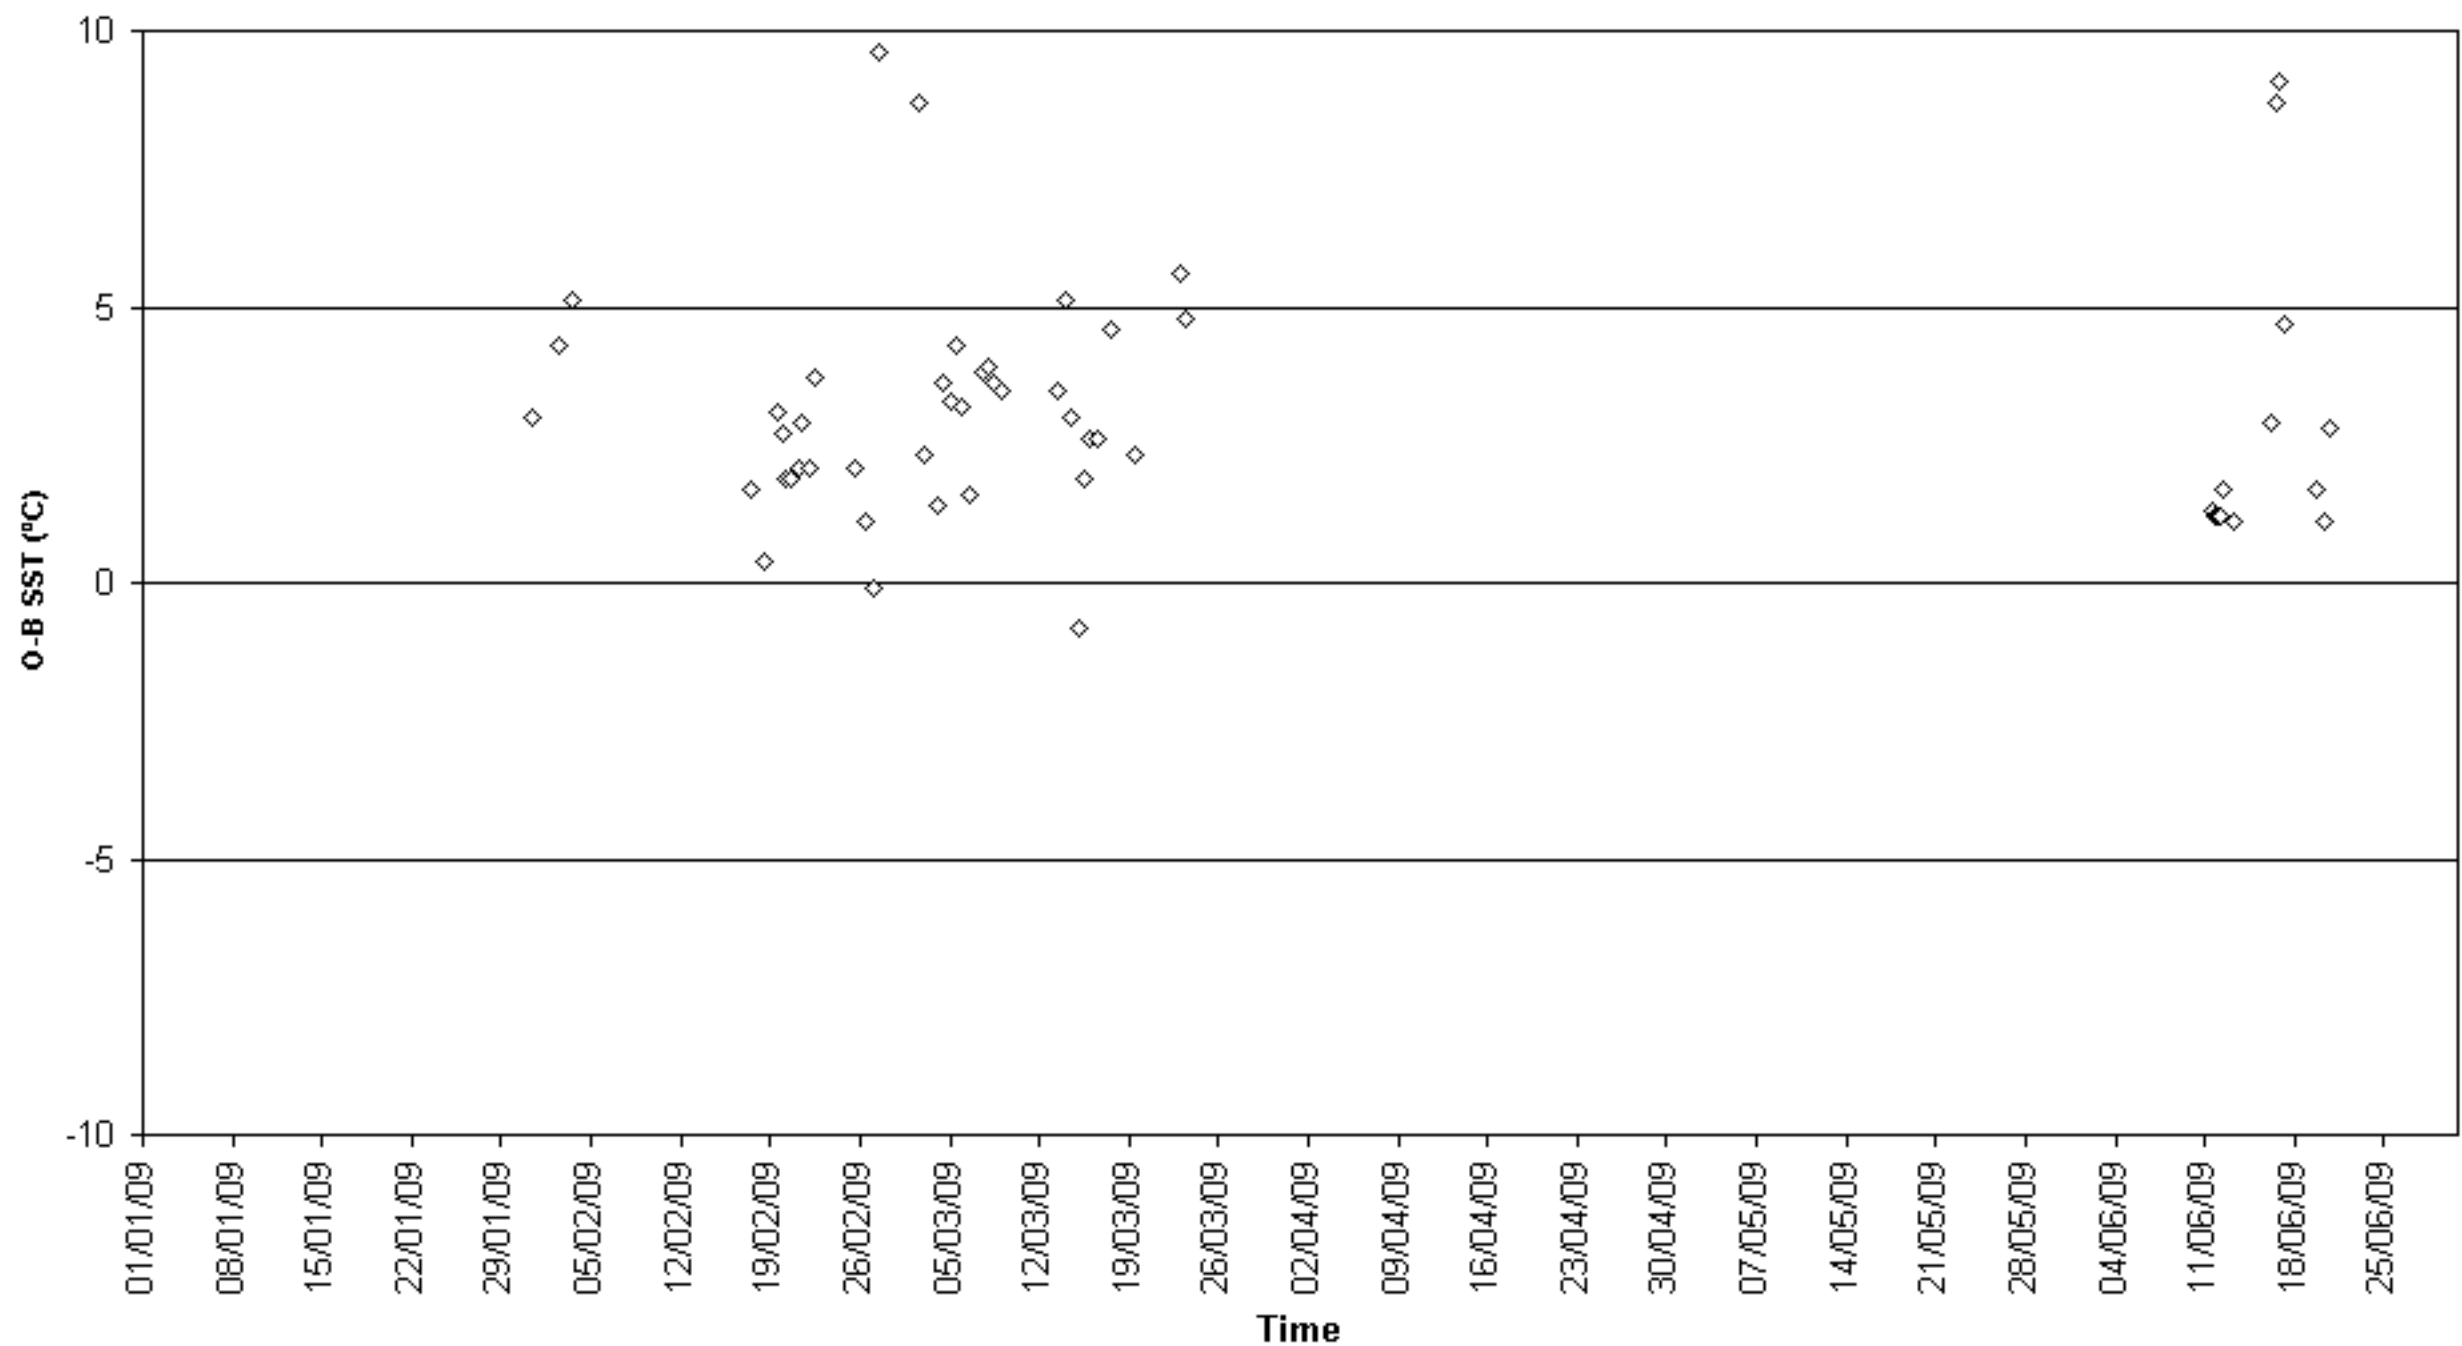


O-B SST (°C) for identifier SFRZ  
Number of obs. plotted = 157 Number of outliers = 0

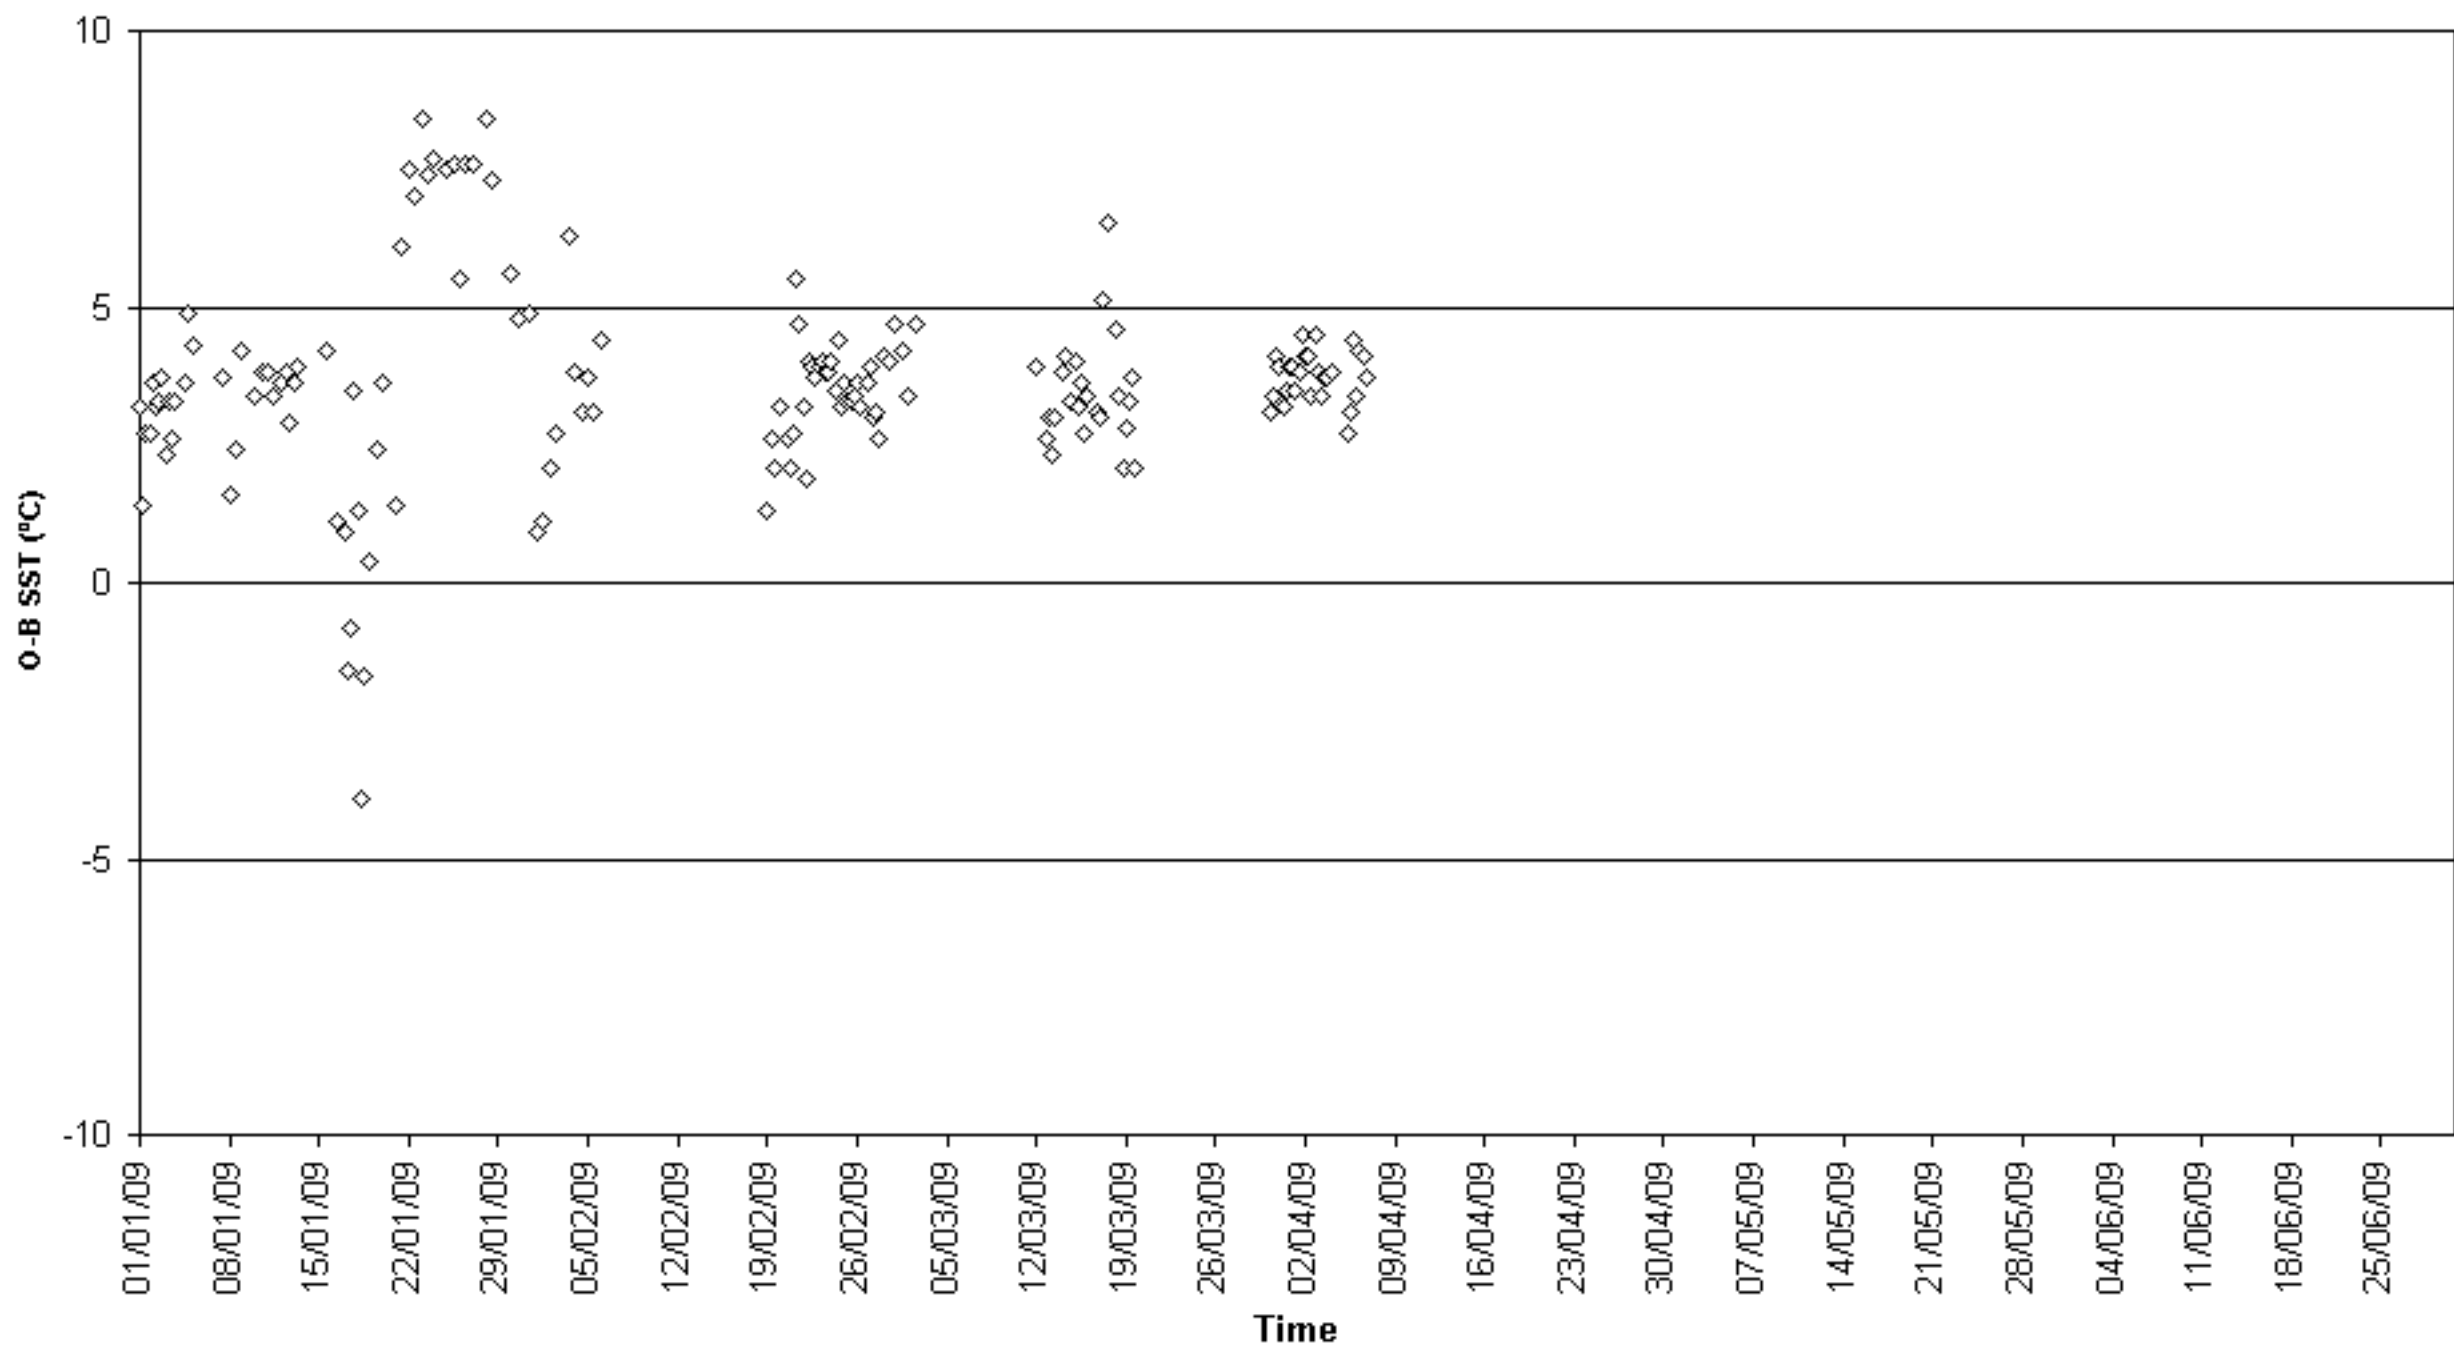


O-B SST (°C) for identifier SGBA  
Number of obs. plotted = 51 Number of outliers = 0

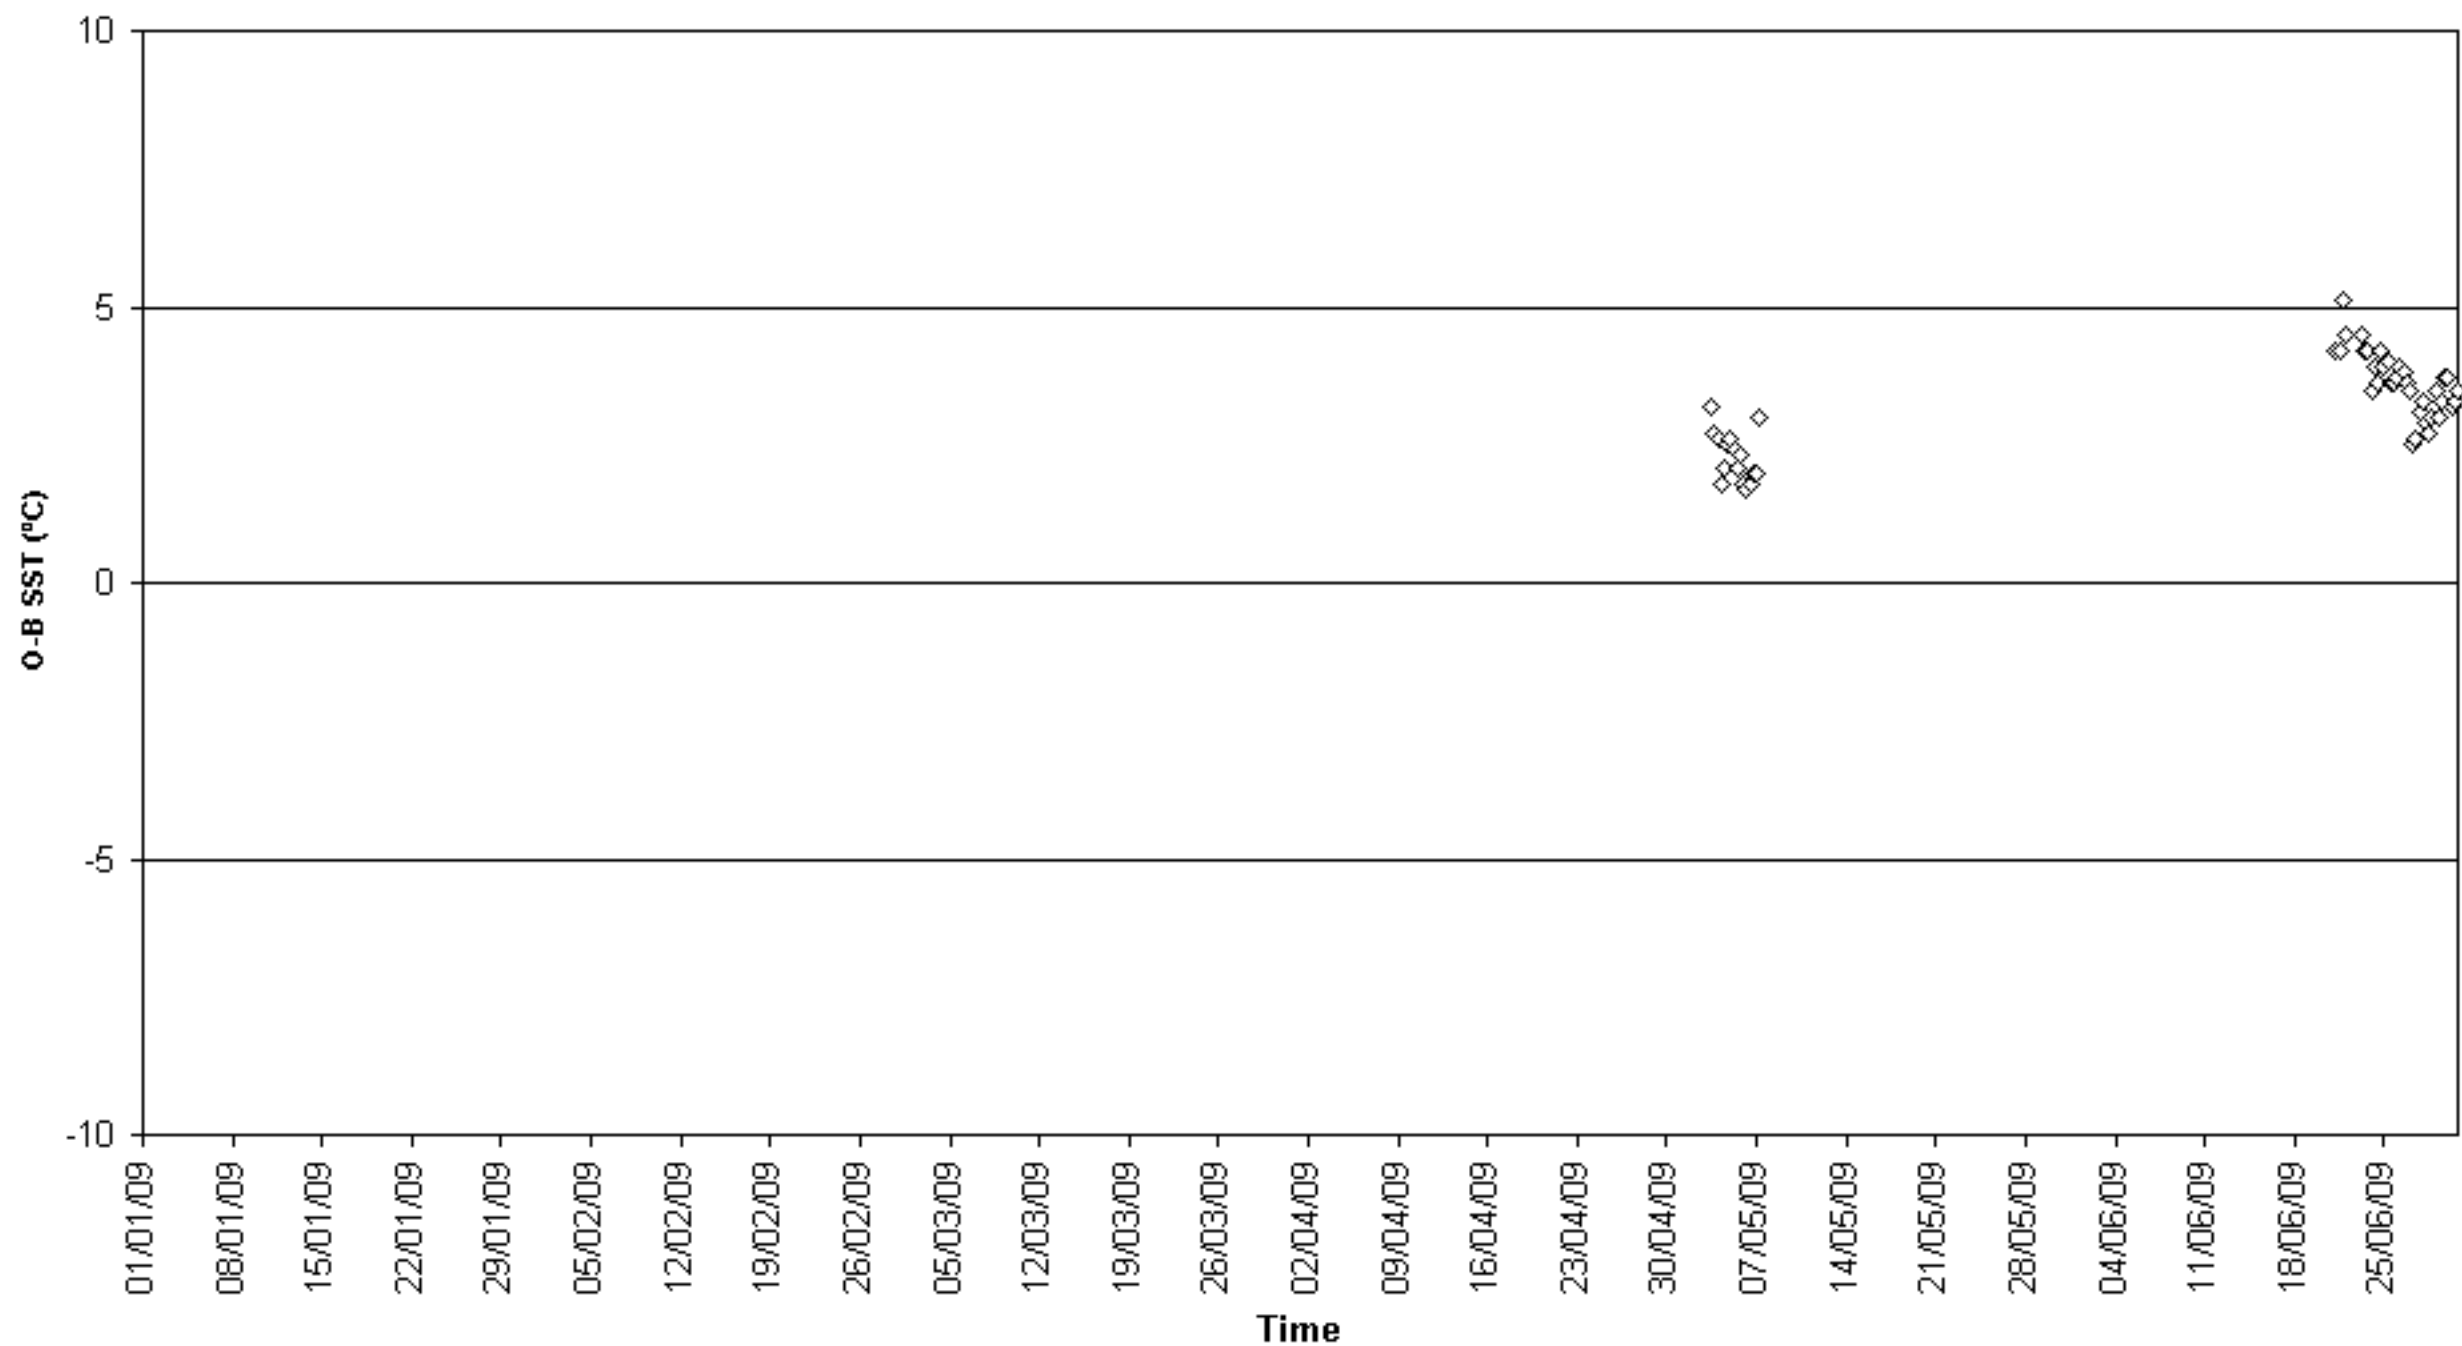


O-B SST (°C) for identifier UCJL  
Number of obs. plotted = 105 Number of outliers = 0

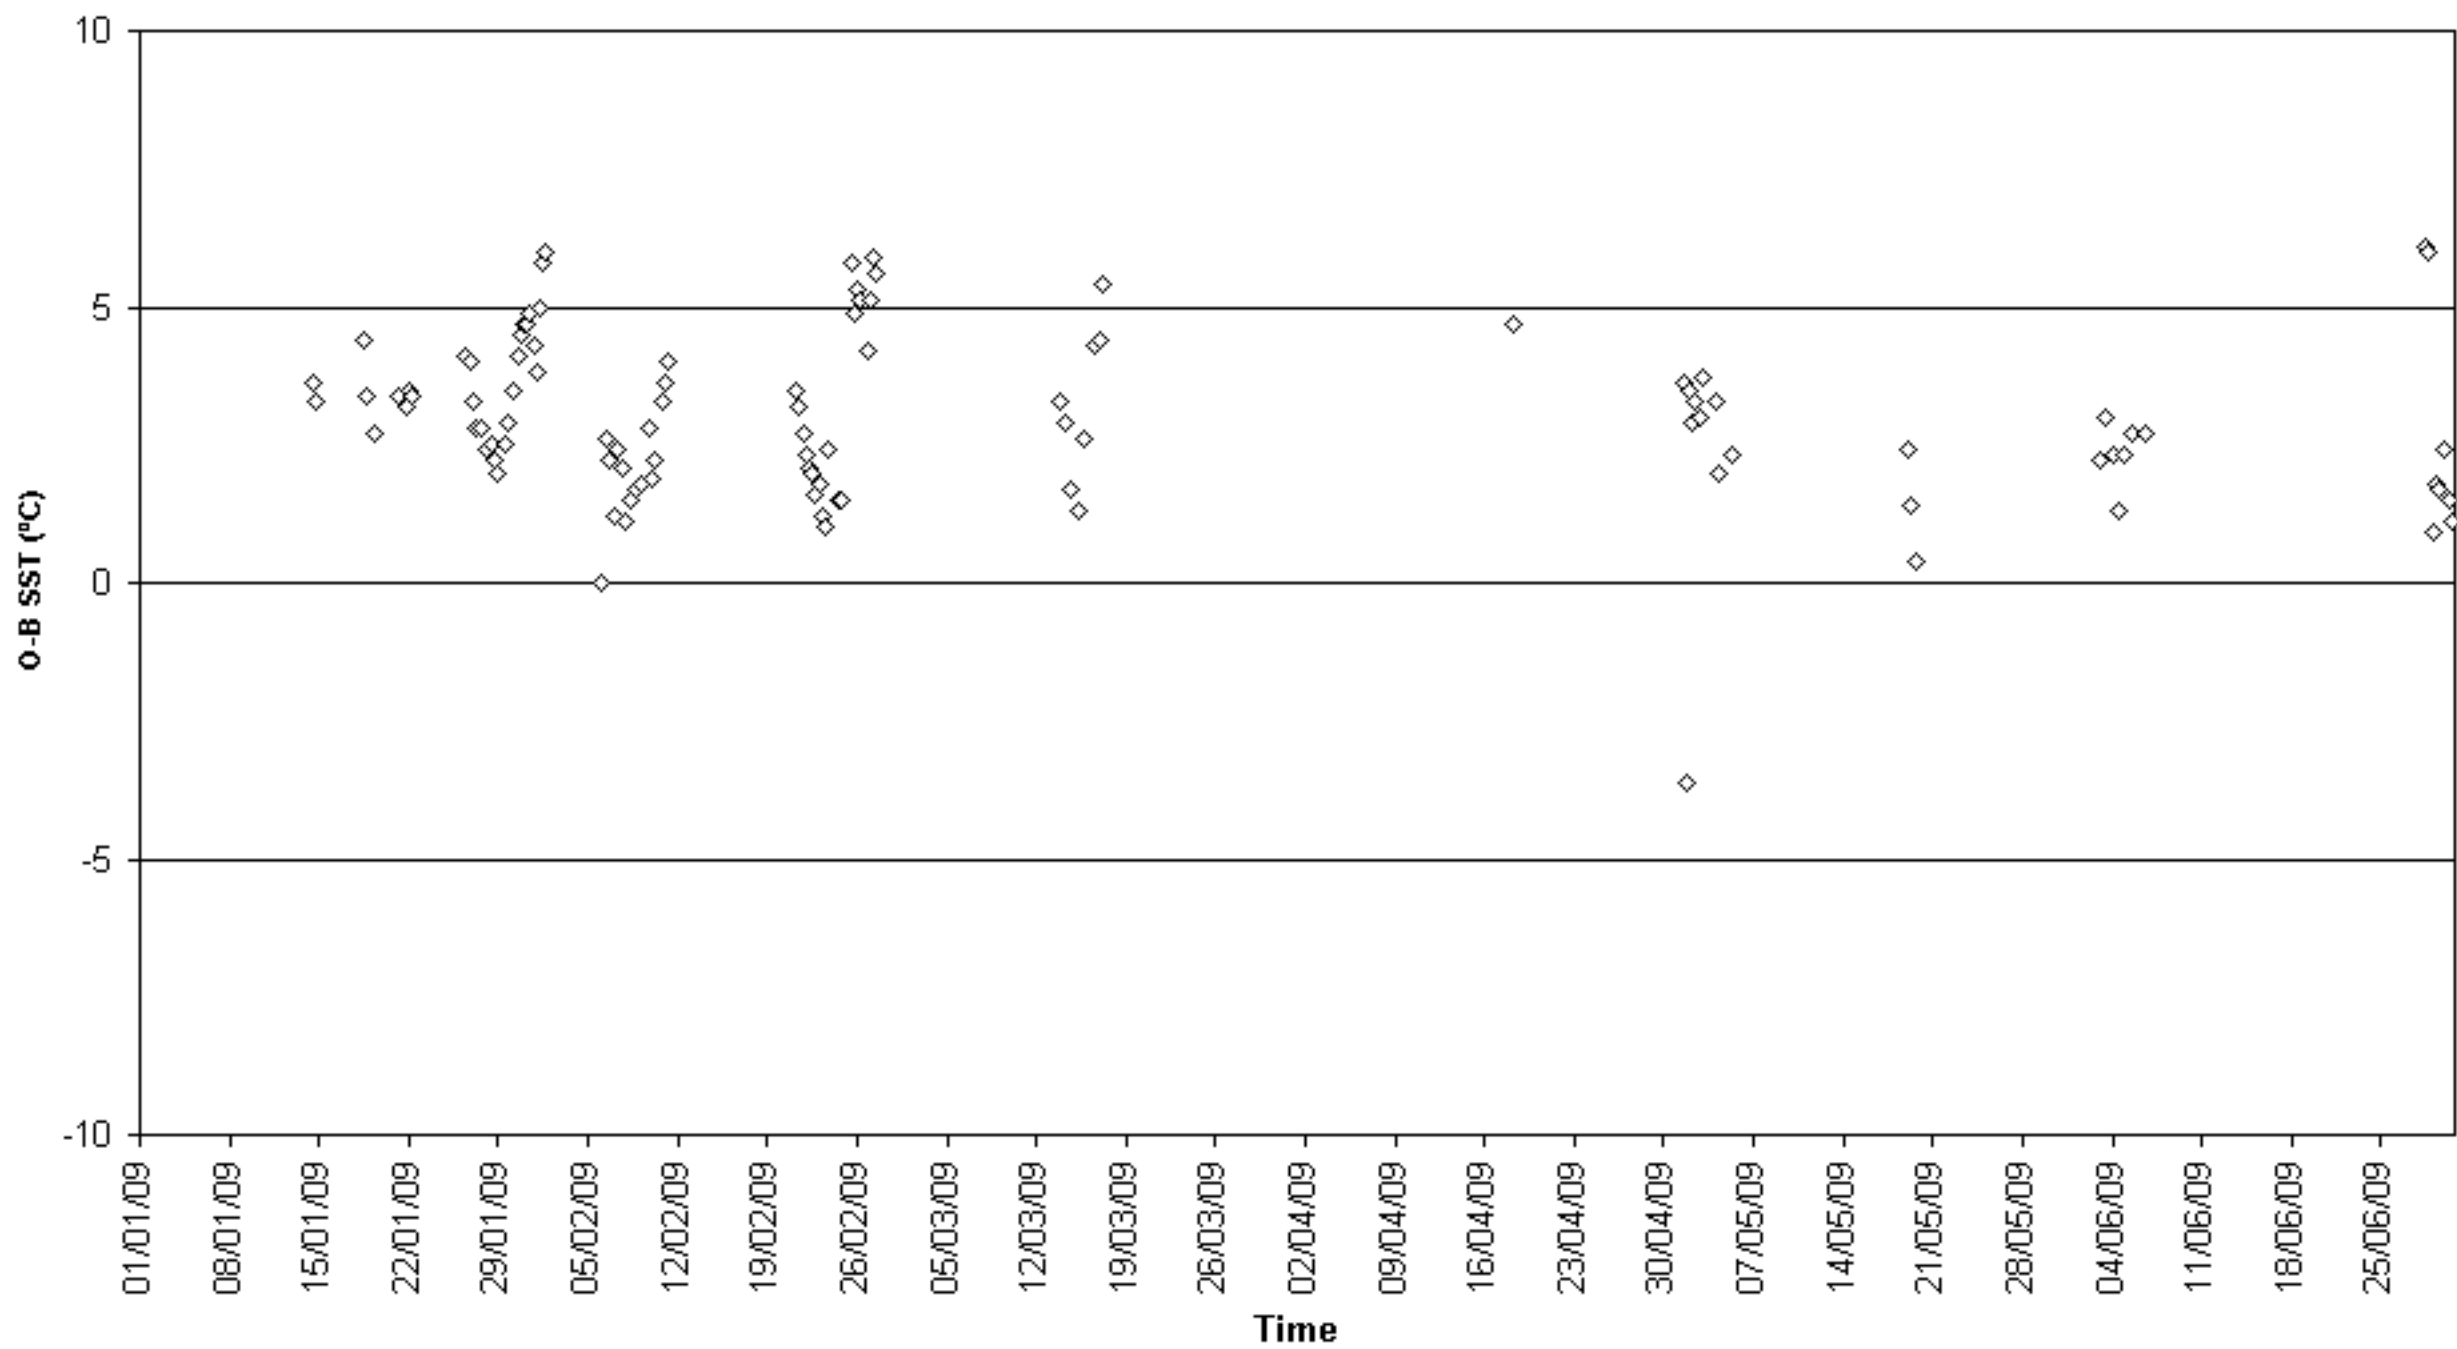


O-B SST (°C) for identifier UHWZ  
Number of obs. plotted = 67 Number of outliers = 1

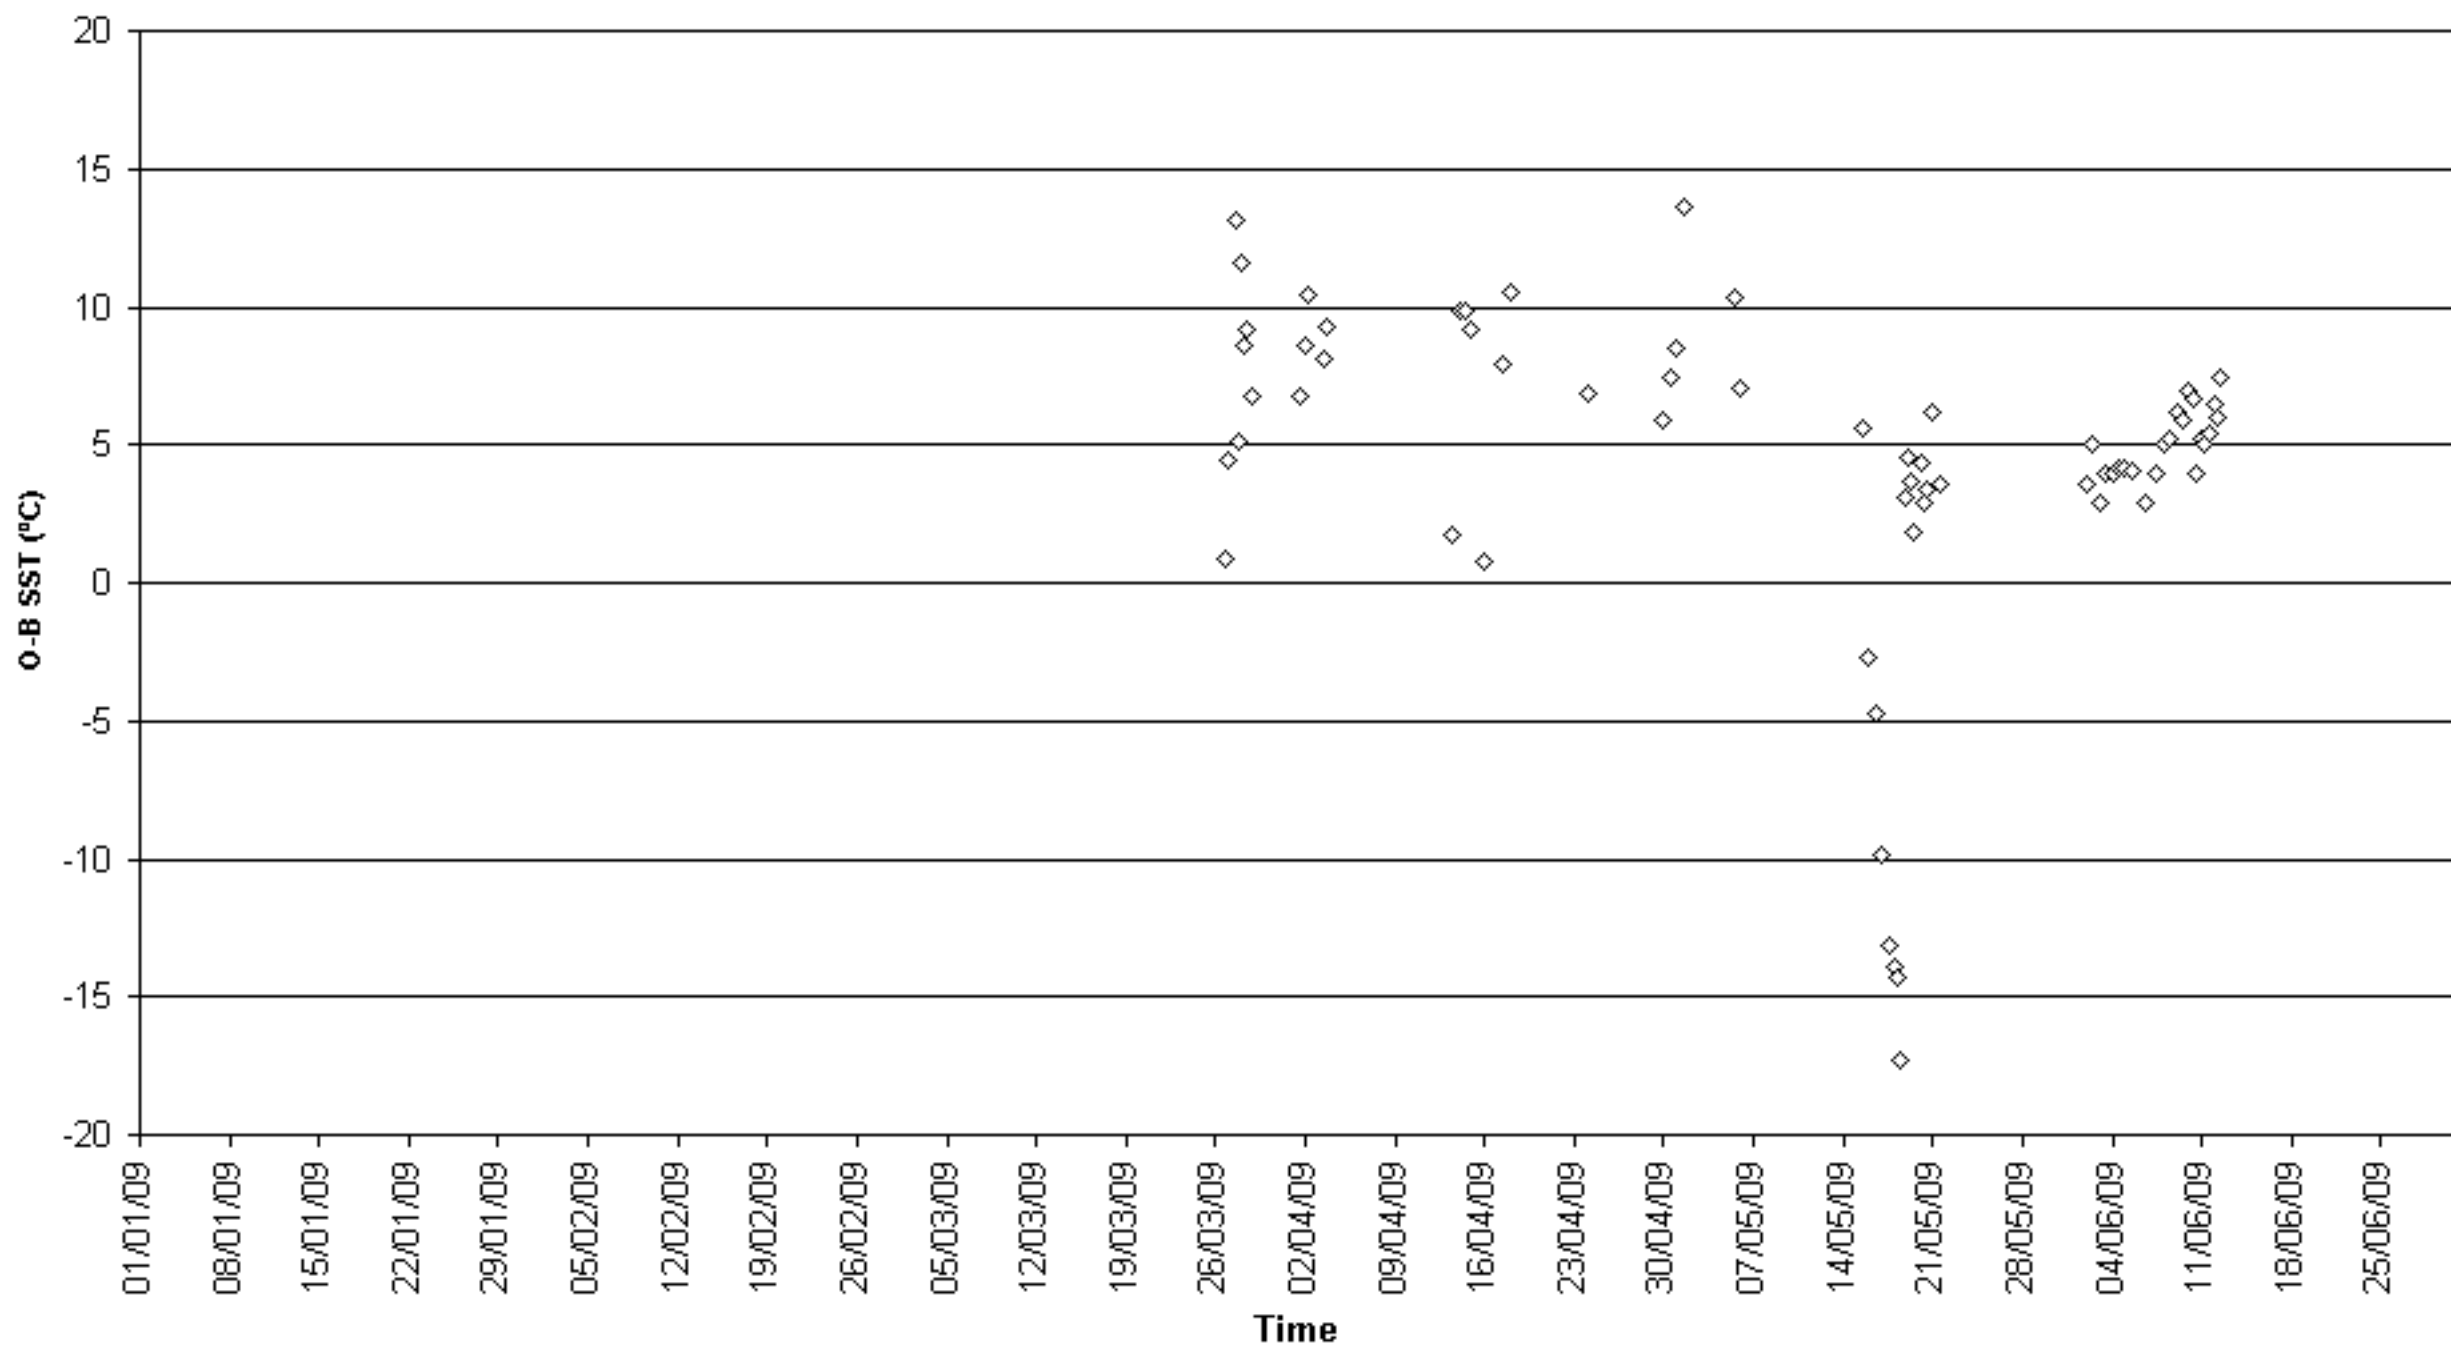


O-B SST (°C) for identifier V2LA8  
Number of obs. plotted = 42 Number of outliers = 0

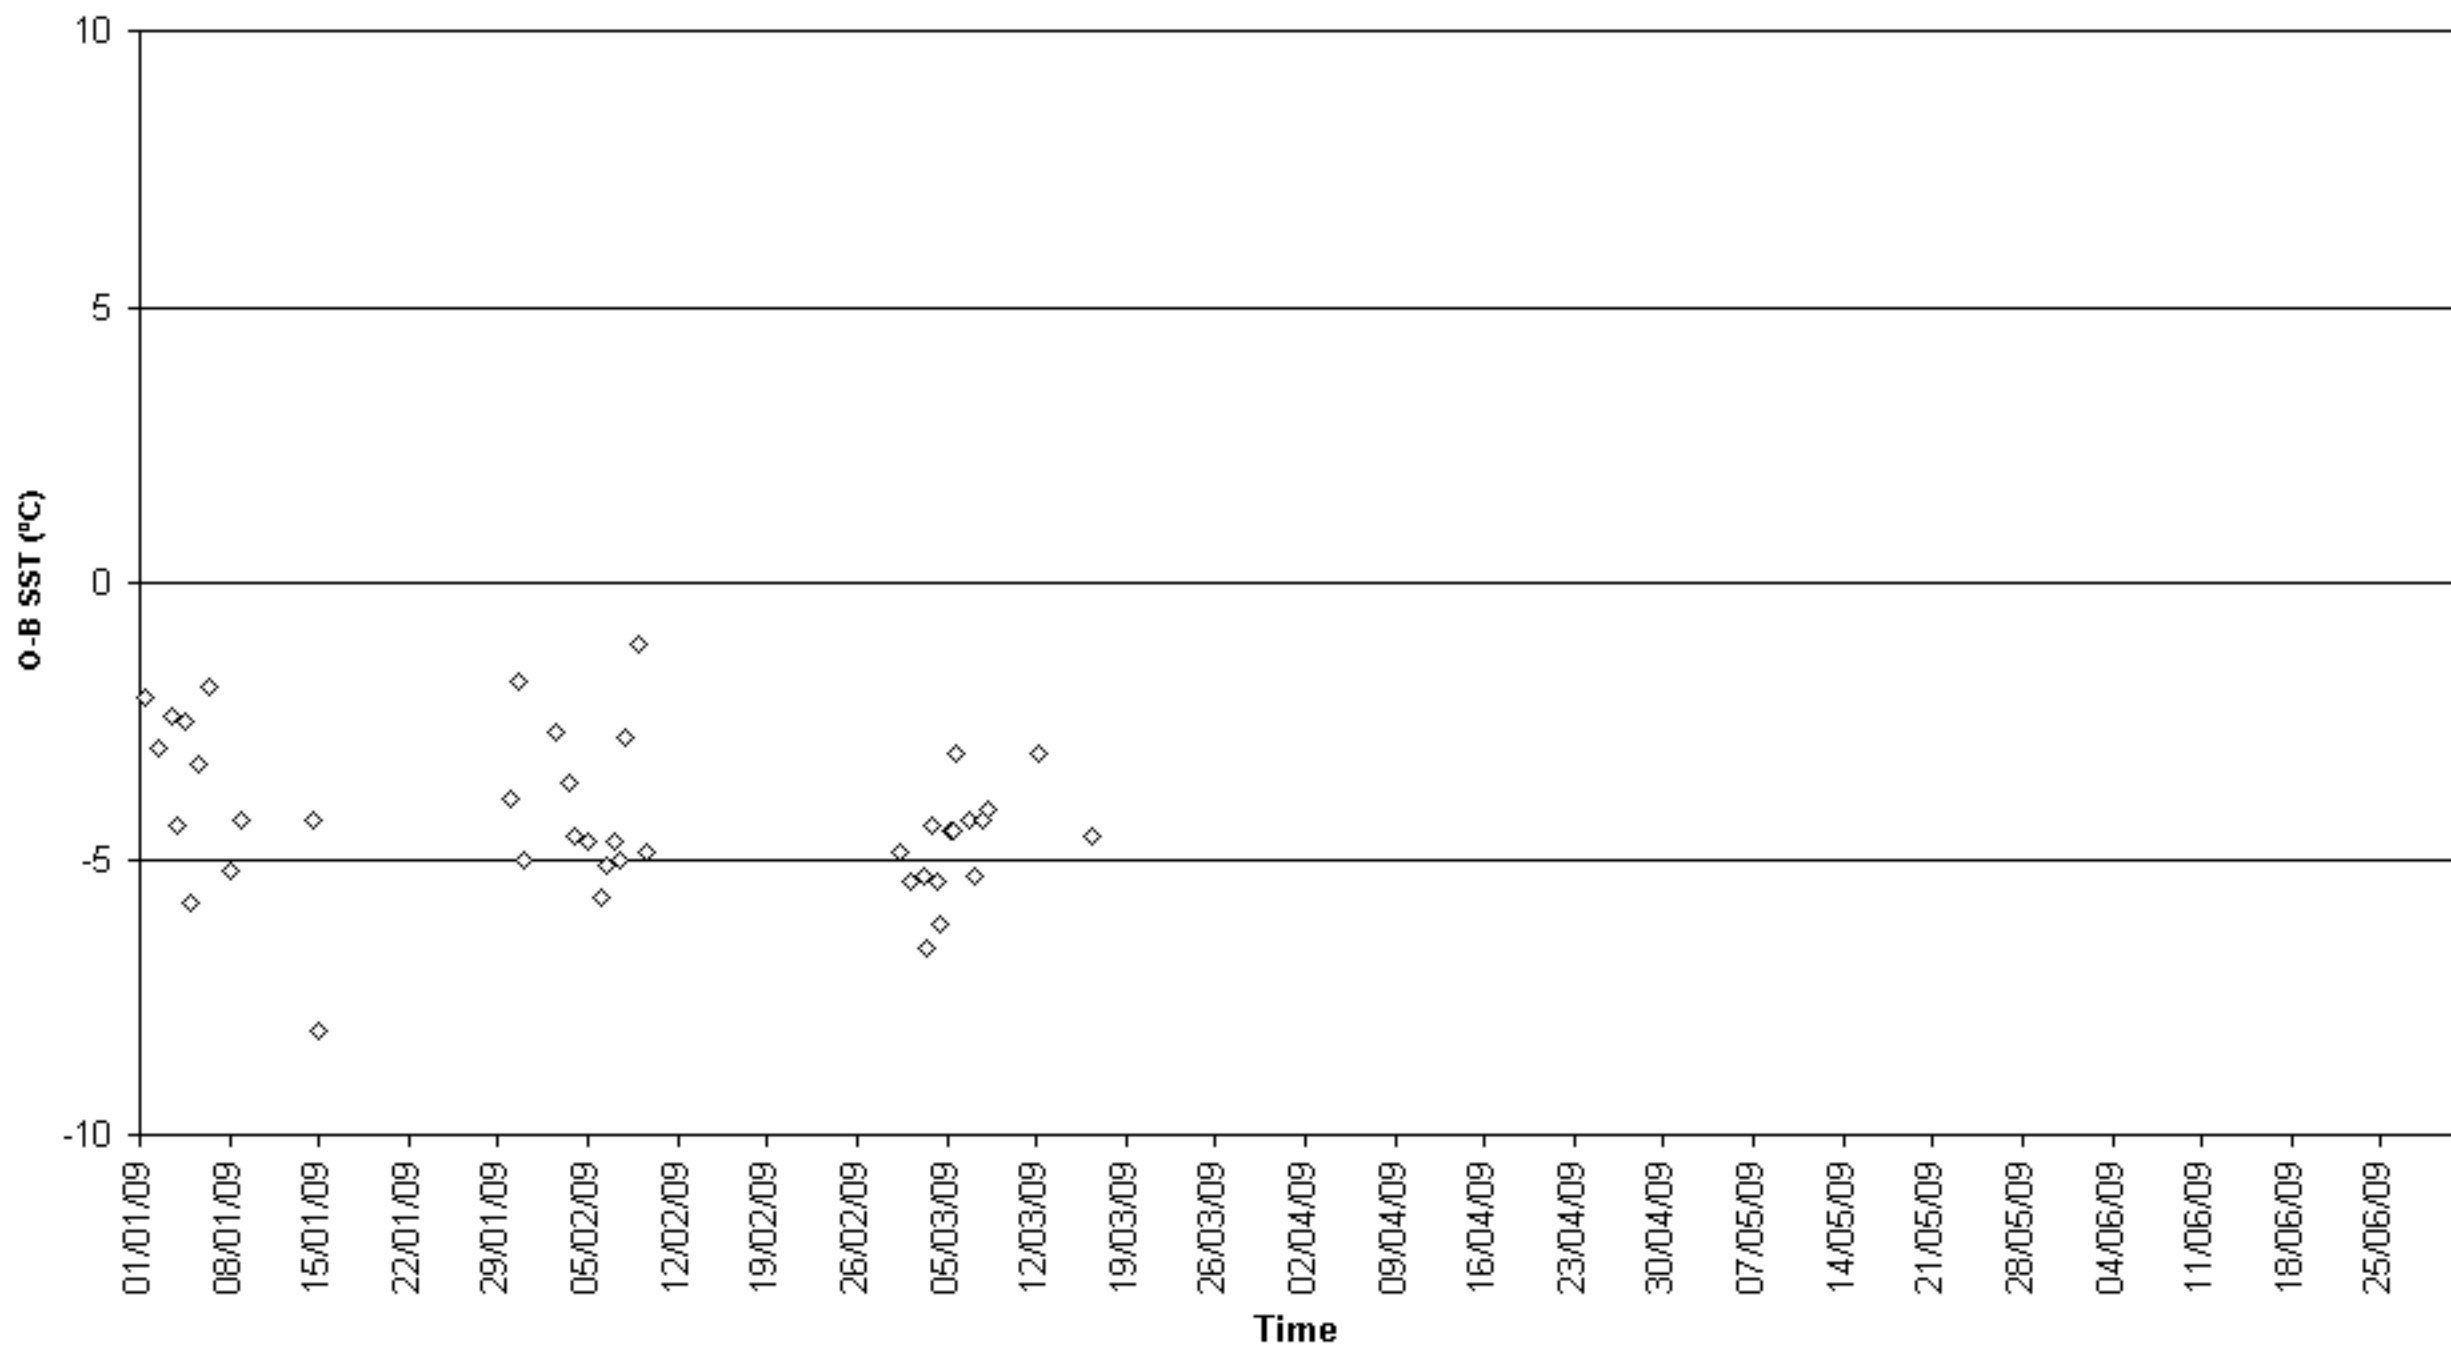

O-B SST ( $^{\circ}$ C) for identifier V7DI7  
Number of obs. plotted = 191 Number of outliers = 0

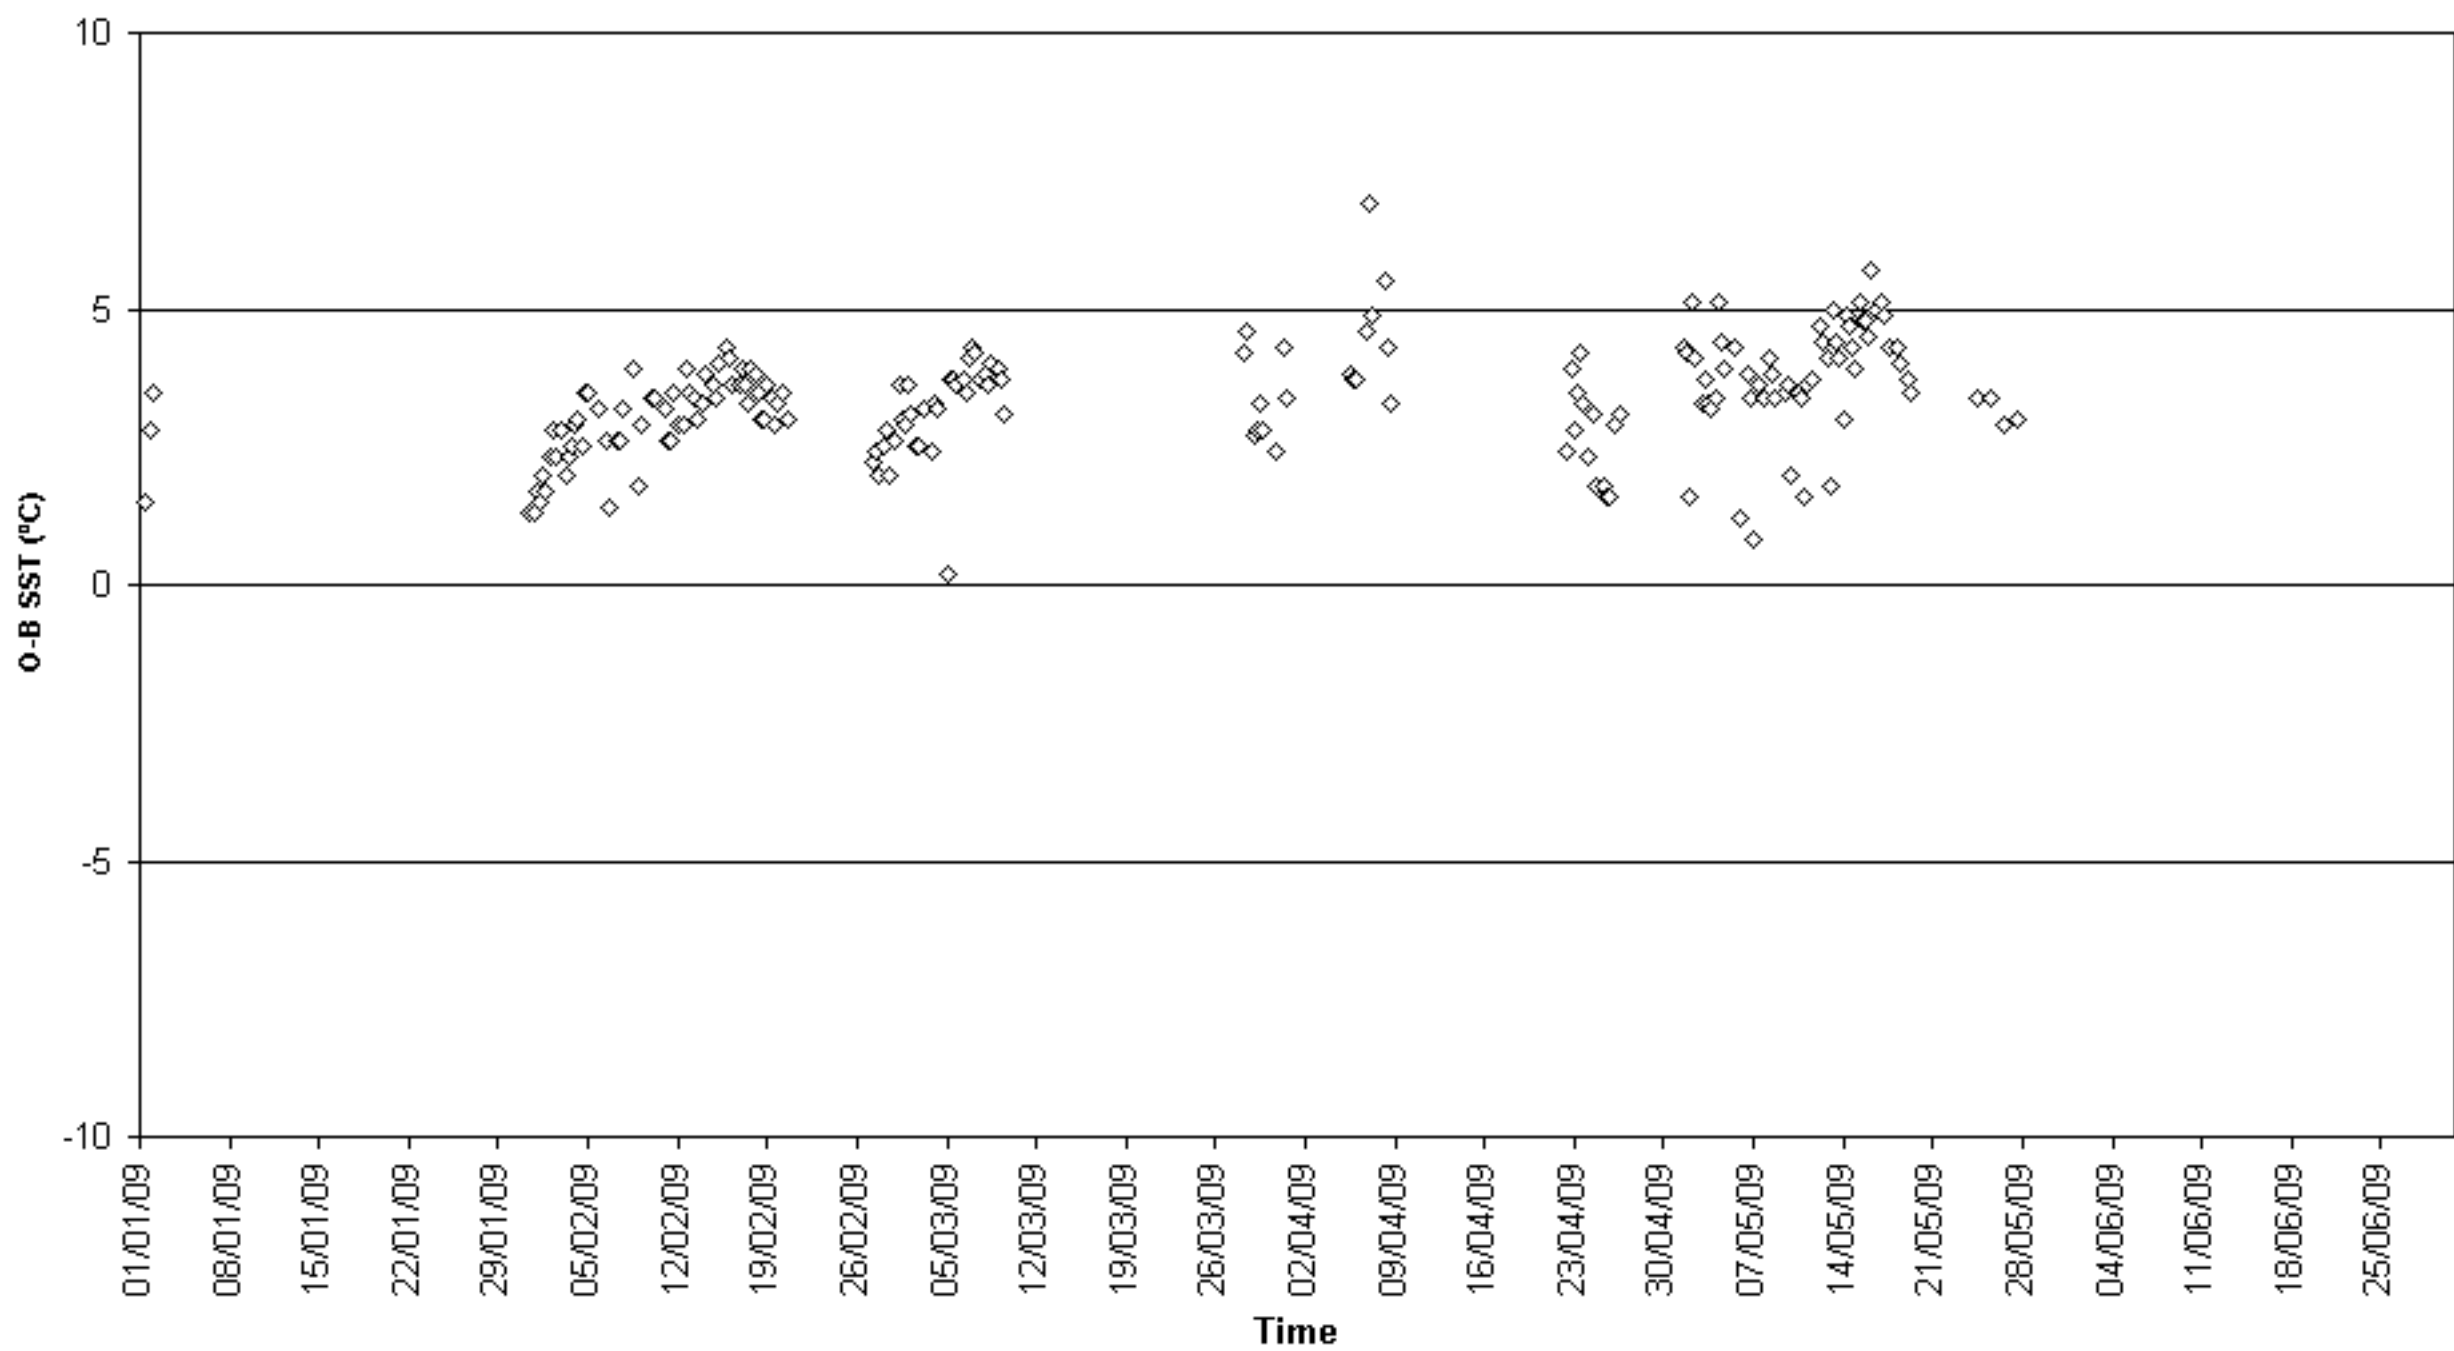


O-B SST (°C) for identifier VRWE7  
Number of obs. plotted = 62 Number of outliers = 12

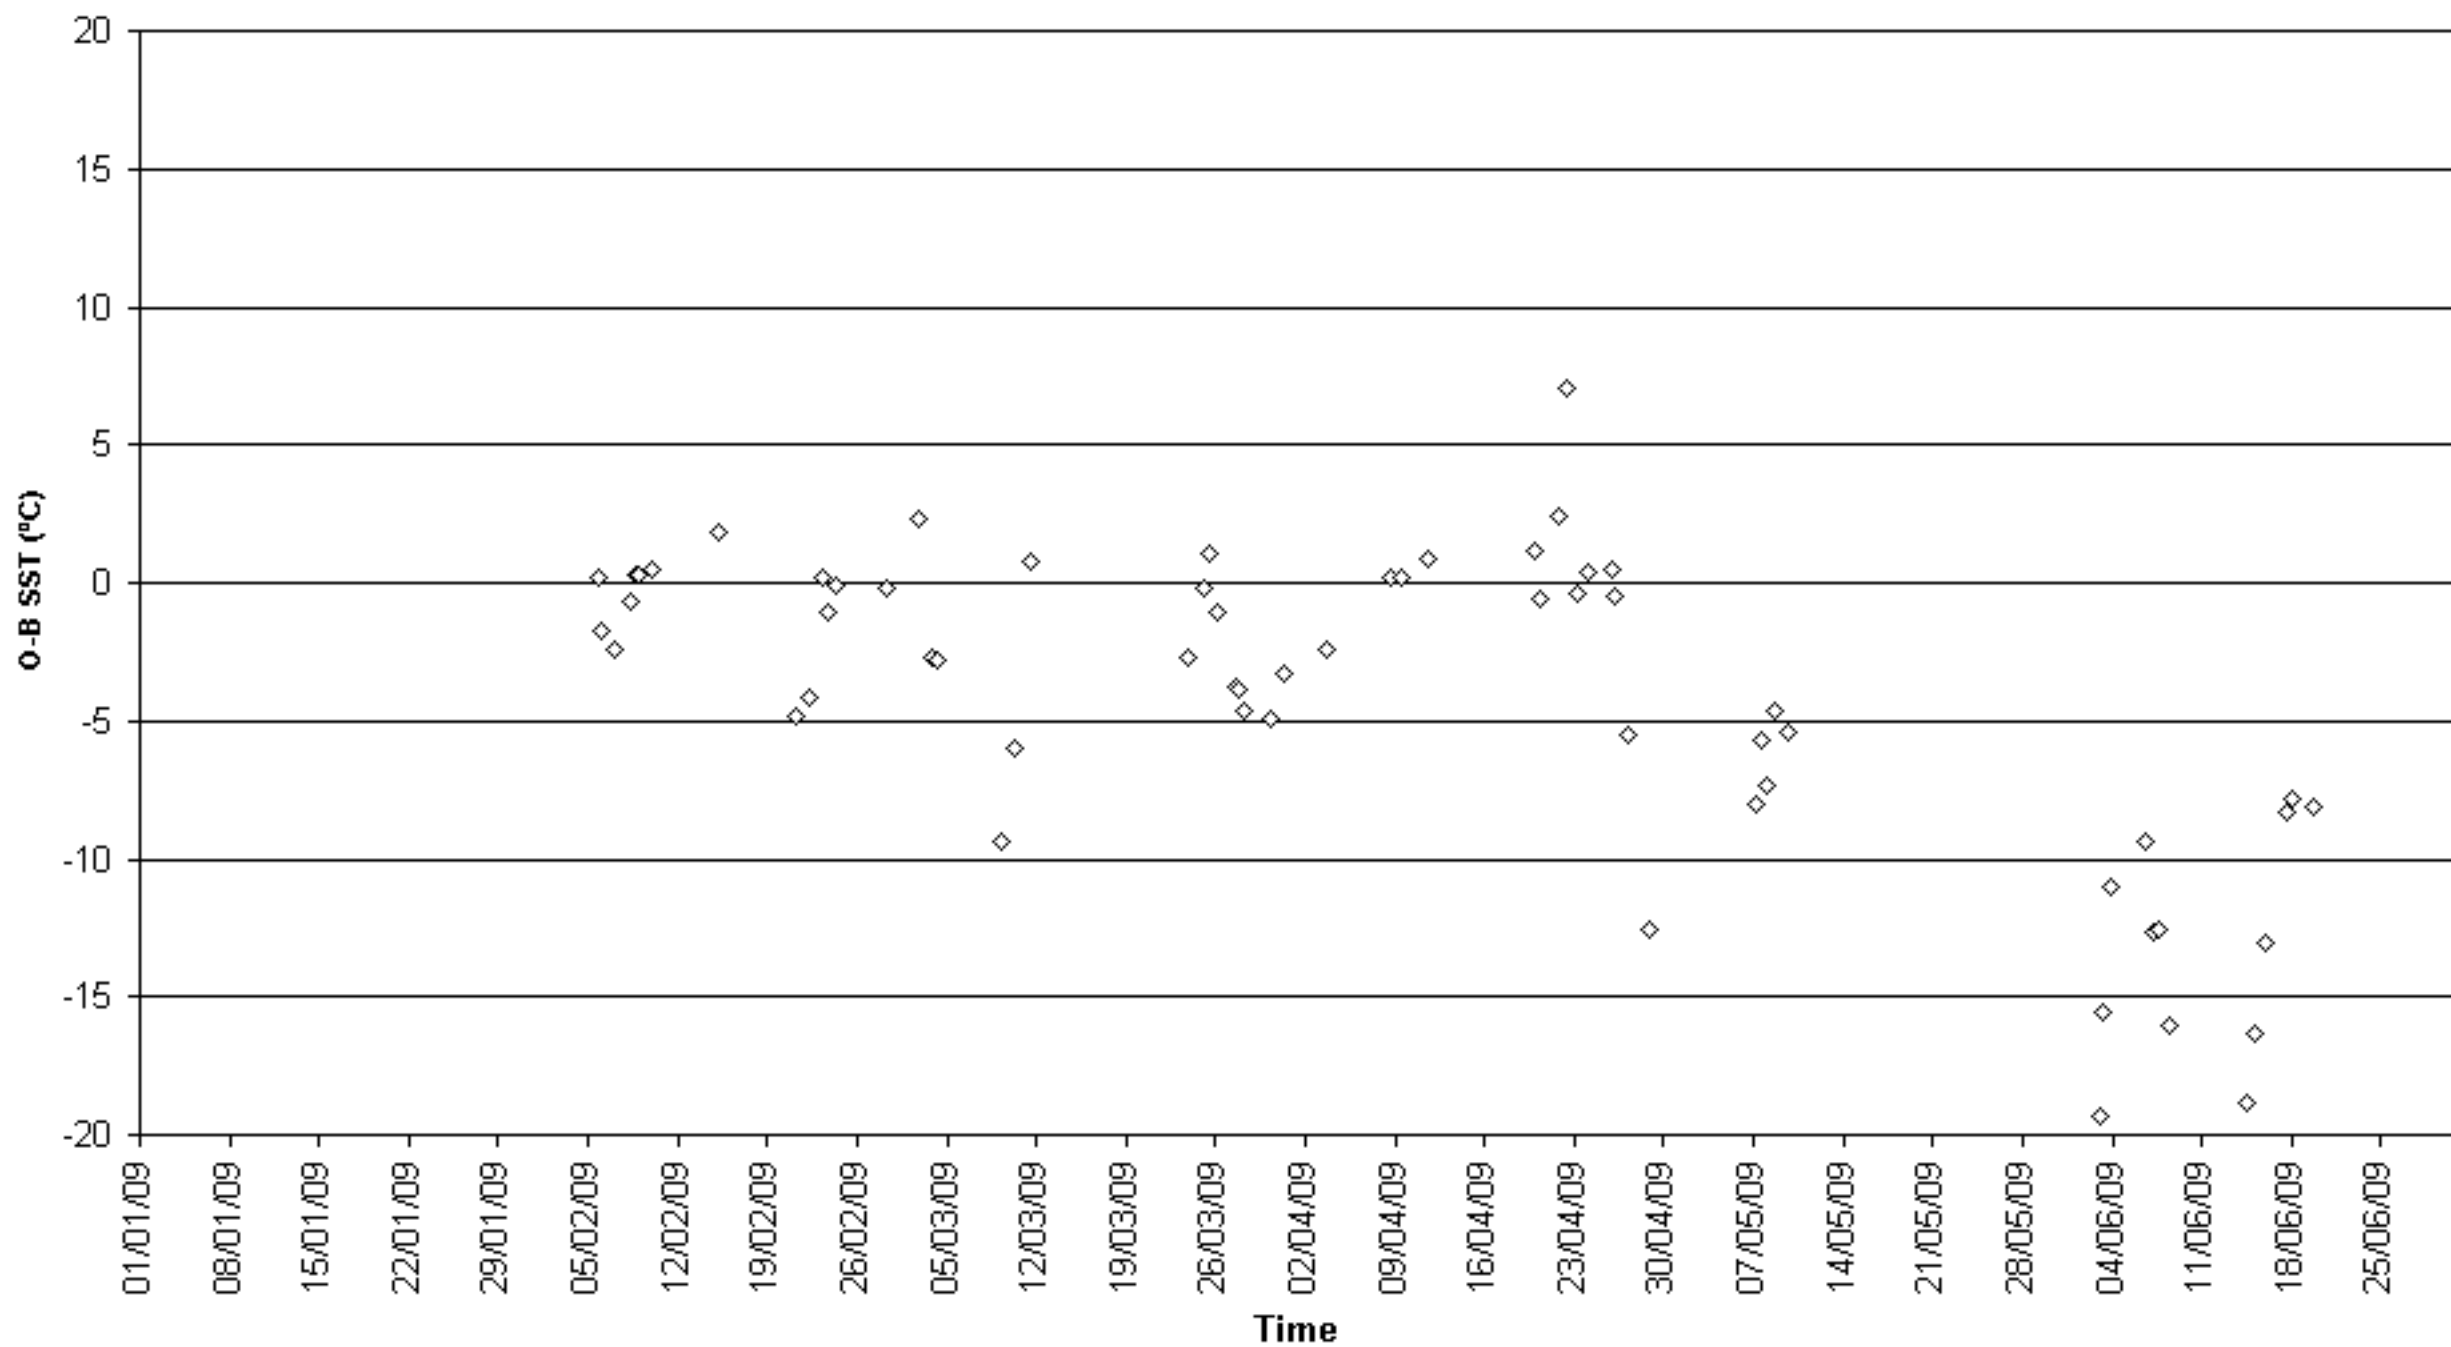





O-B SST (°C) for identifier VRXK9  
Number of obs. plotted = 8    Number of outliers = 63

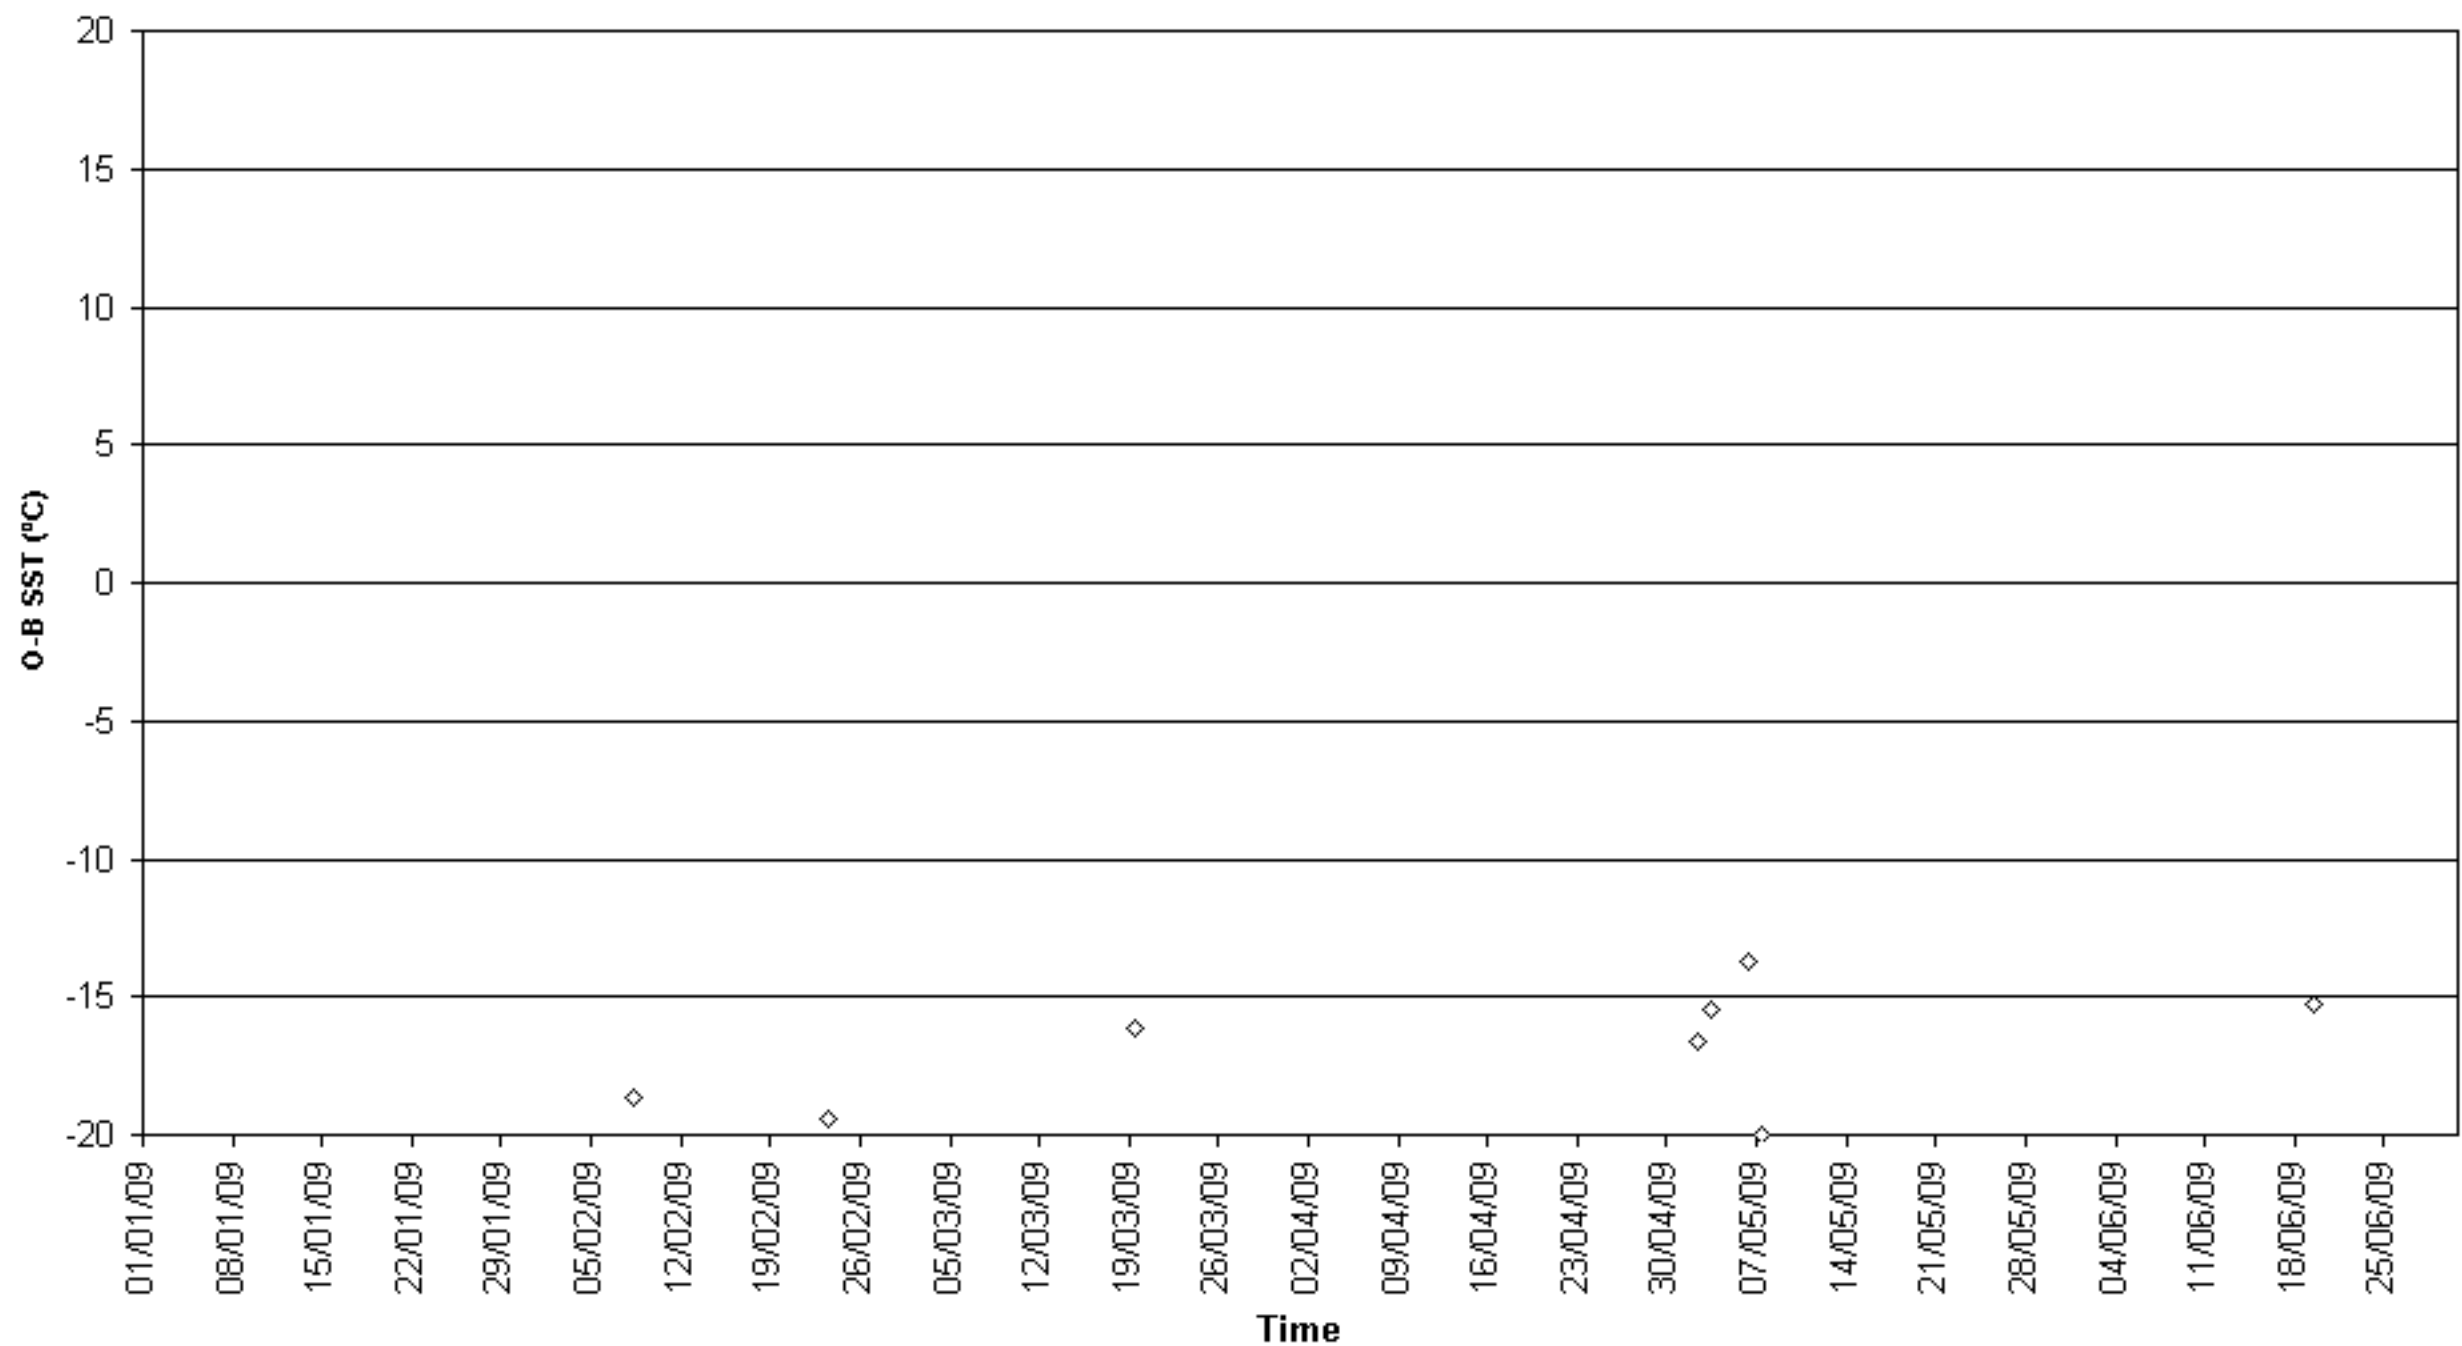

O-B SST (°C) for identifier WAAH  
Number of obs. plotted = 88 Number of outliers = 0

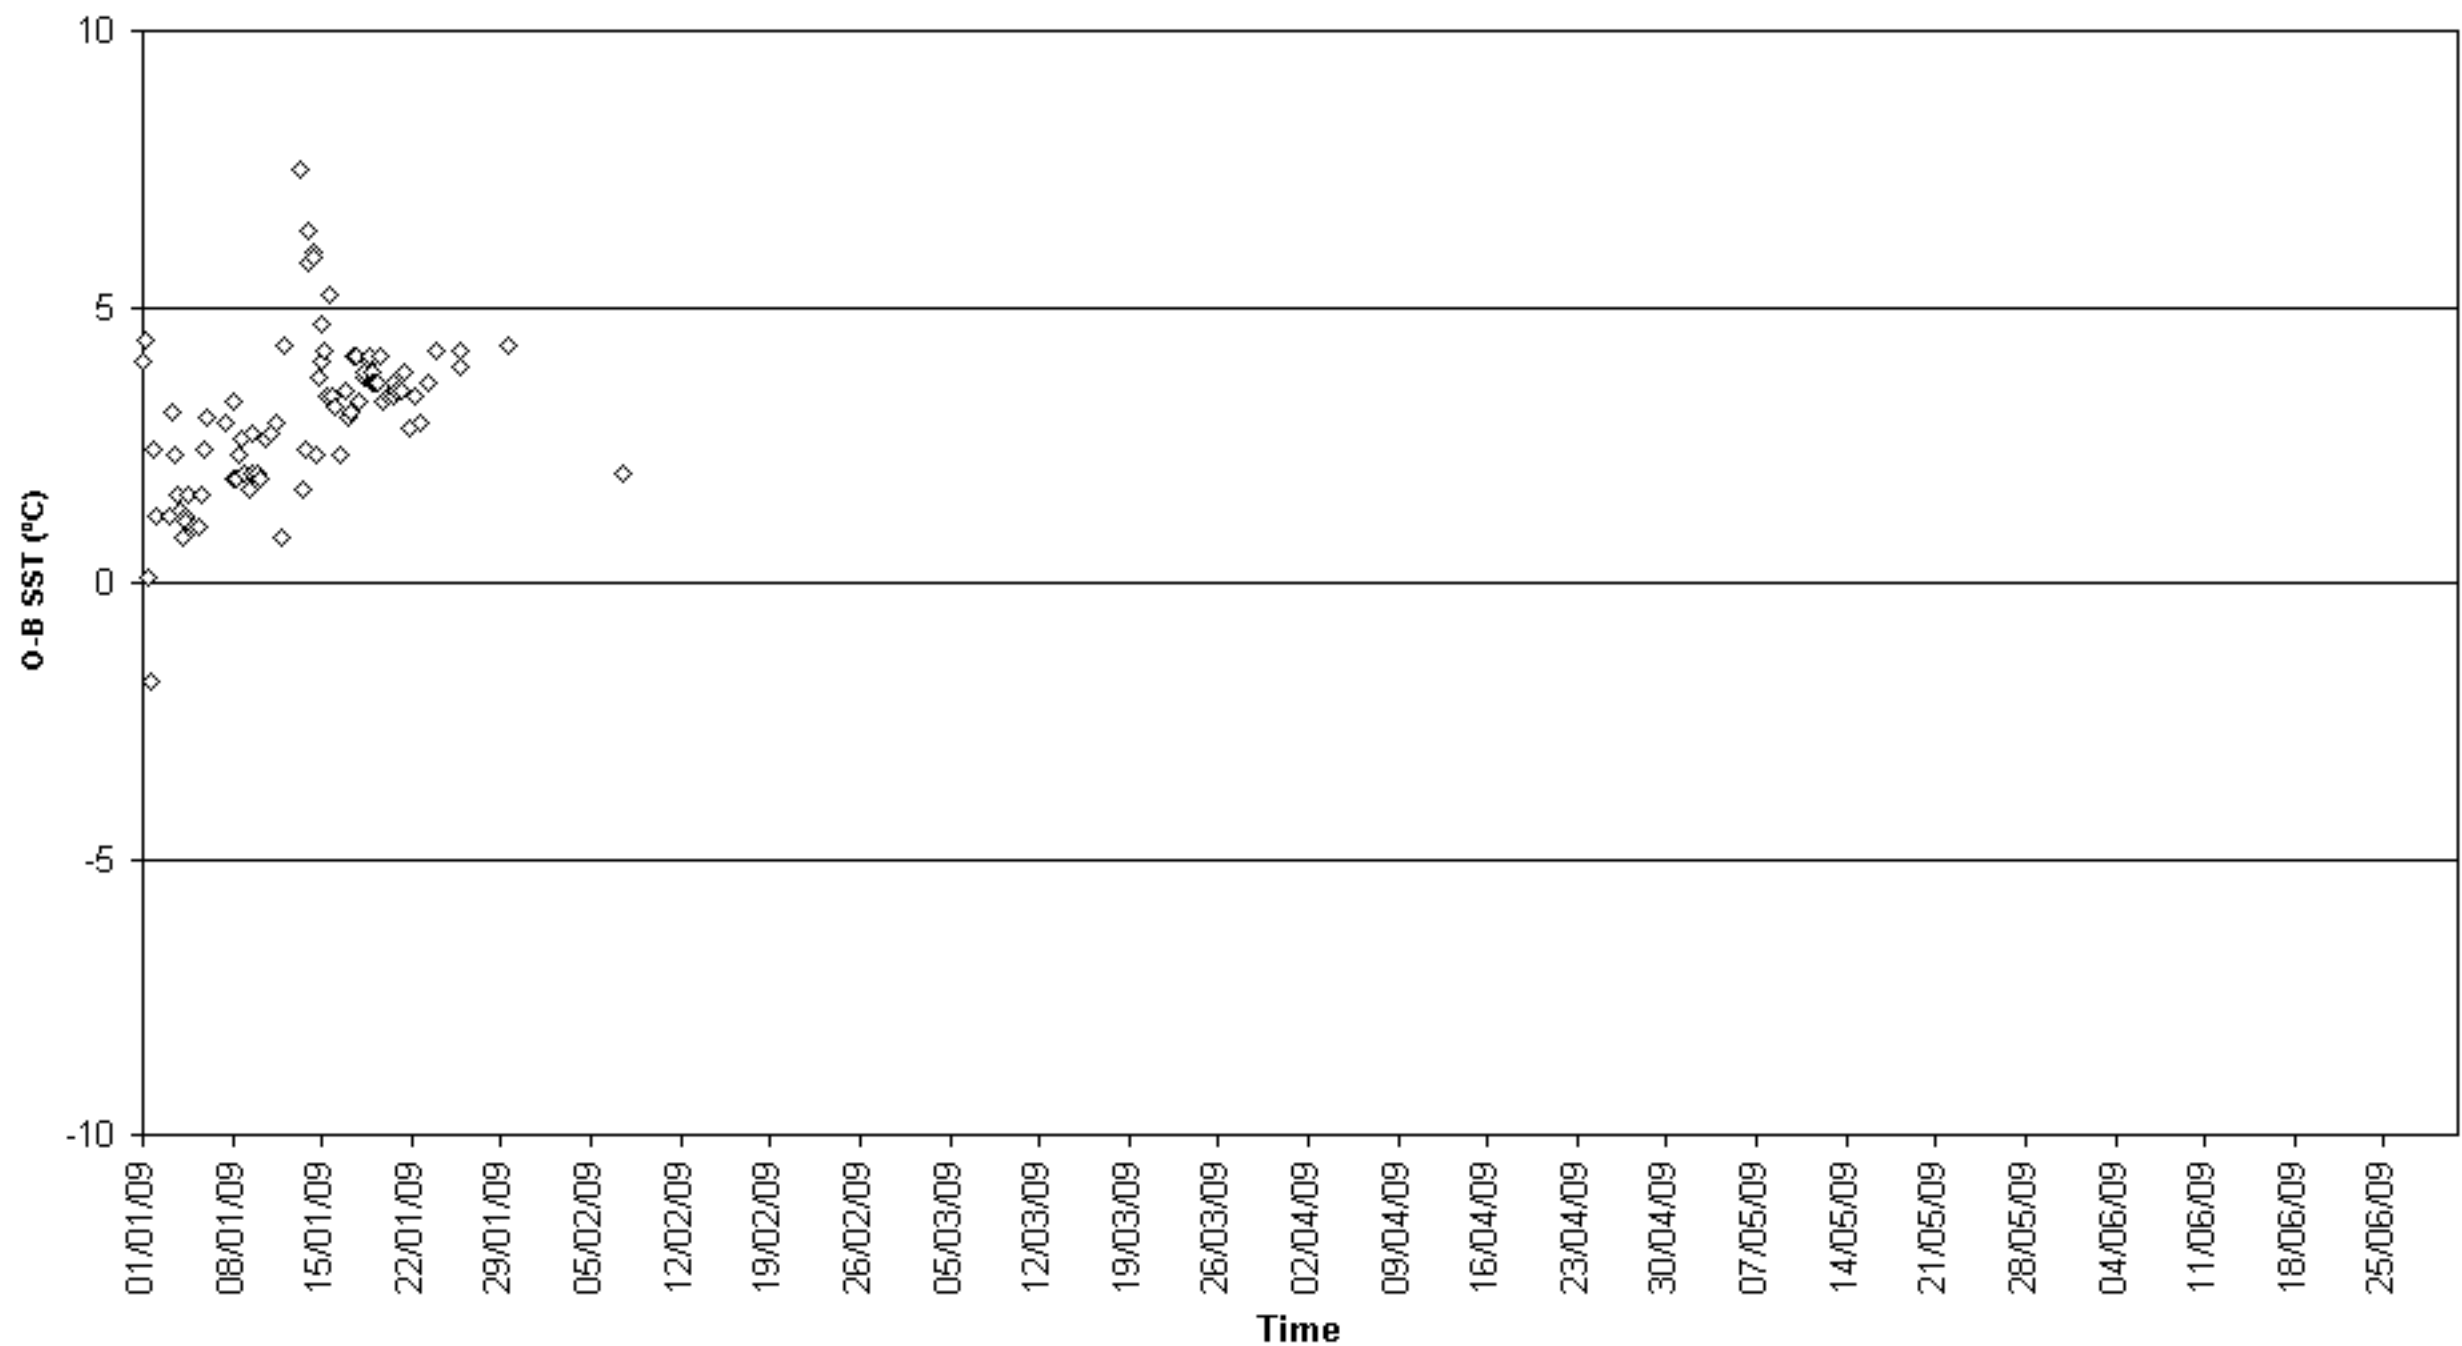

O-B SST (°C) for identifier WZZF  
Number of obs. plotted = 268 Number of outliers = 1

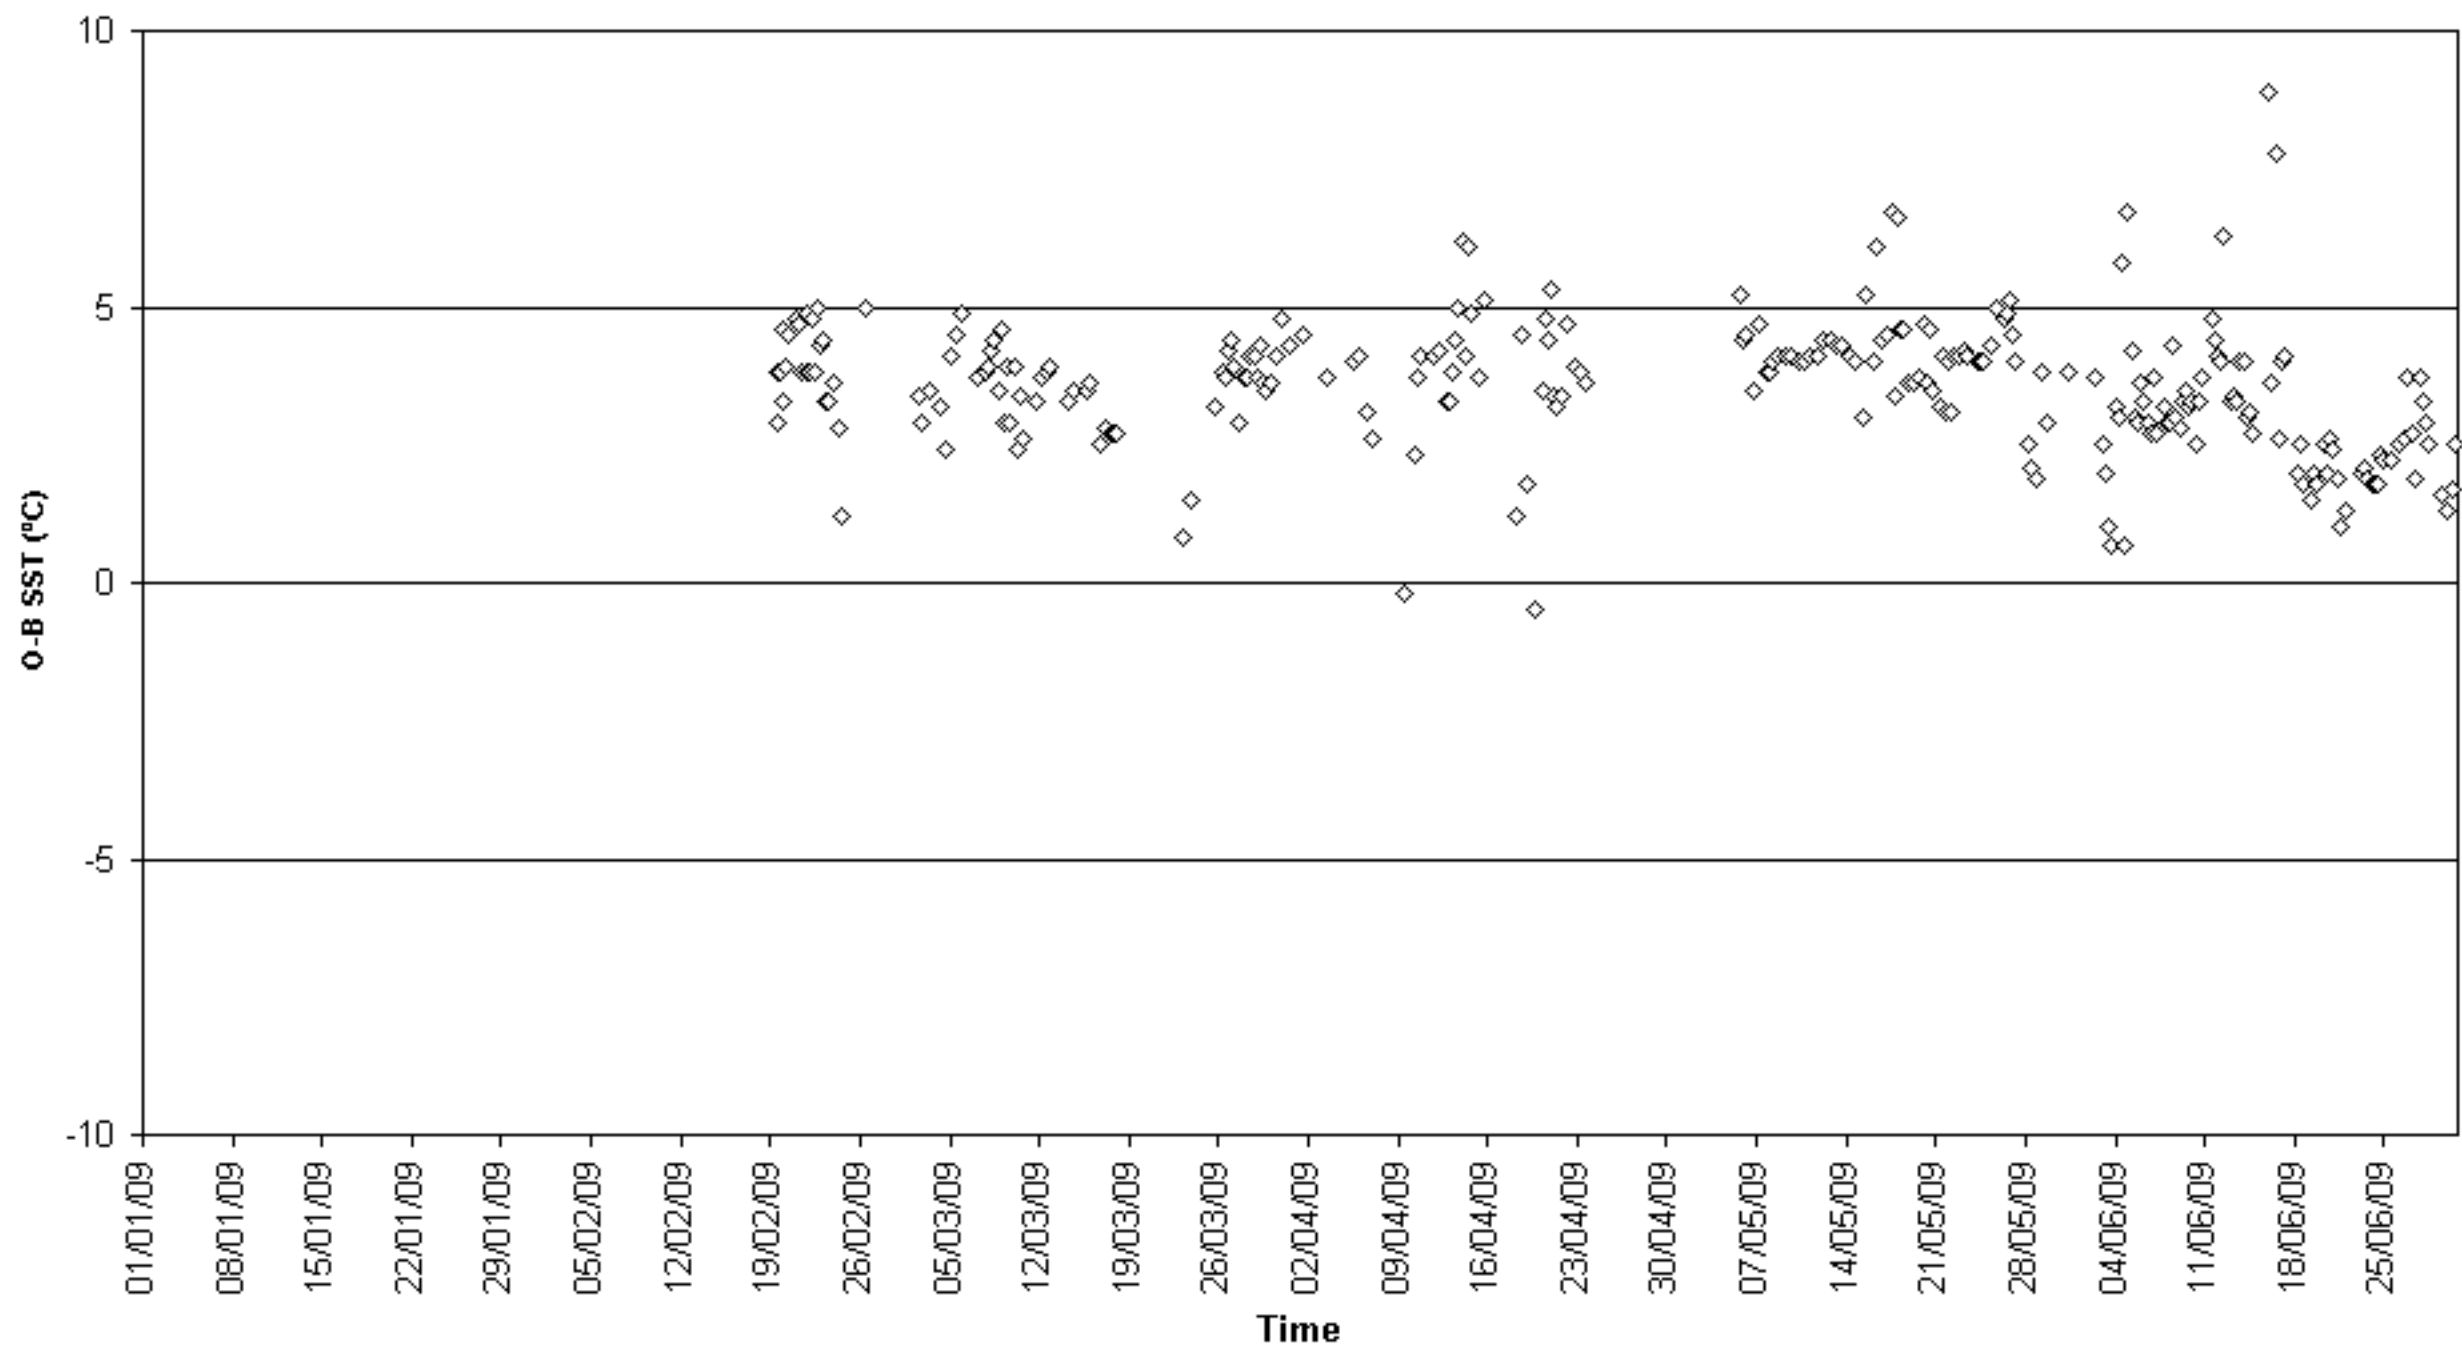

O-B SST (°C) for identifier ZDGR8  
Number of obs. plotted = 64 Number of outliers = 10

