




O-B SST (°C) for identifier 13558
Number of obs. plotted = 355 Number of outliers = 3

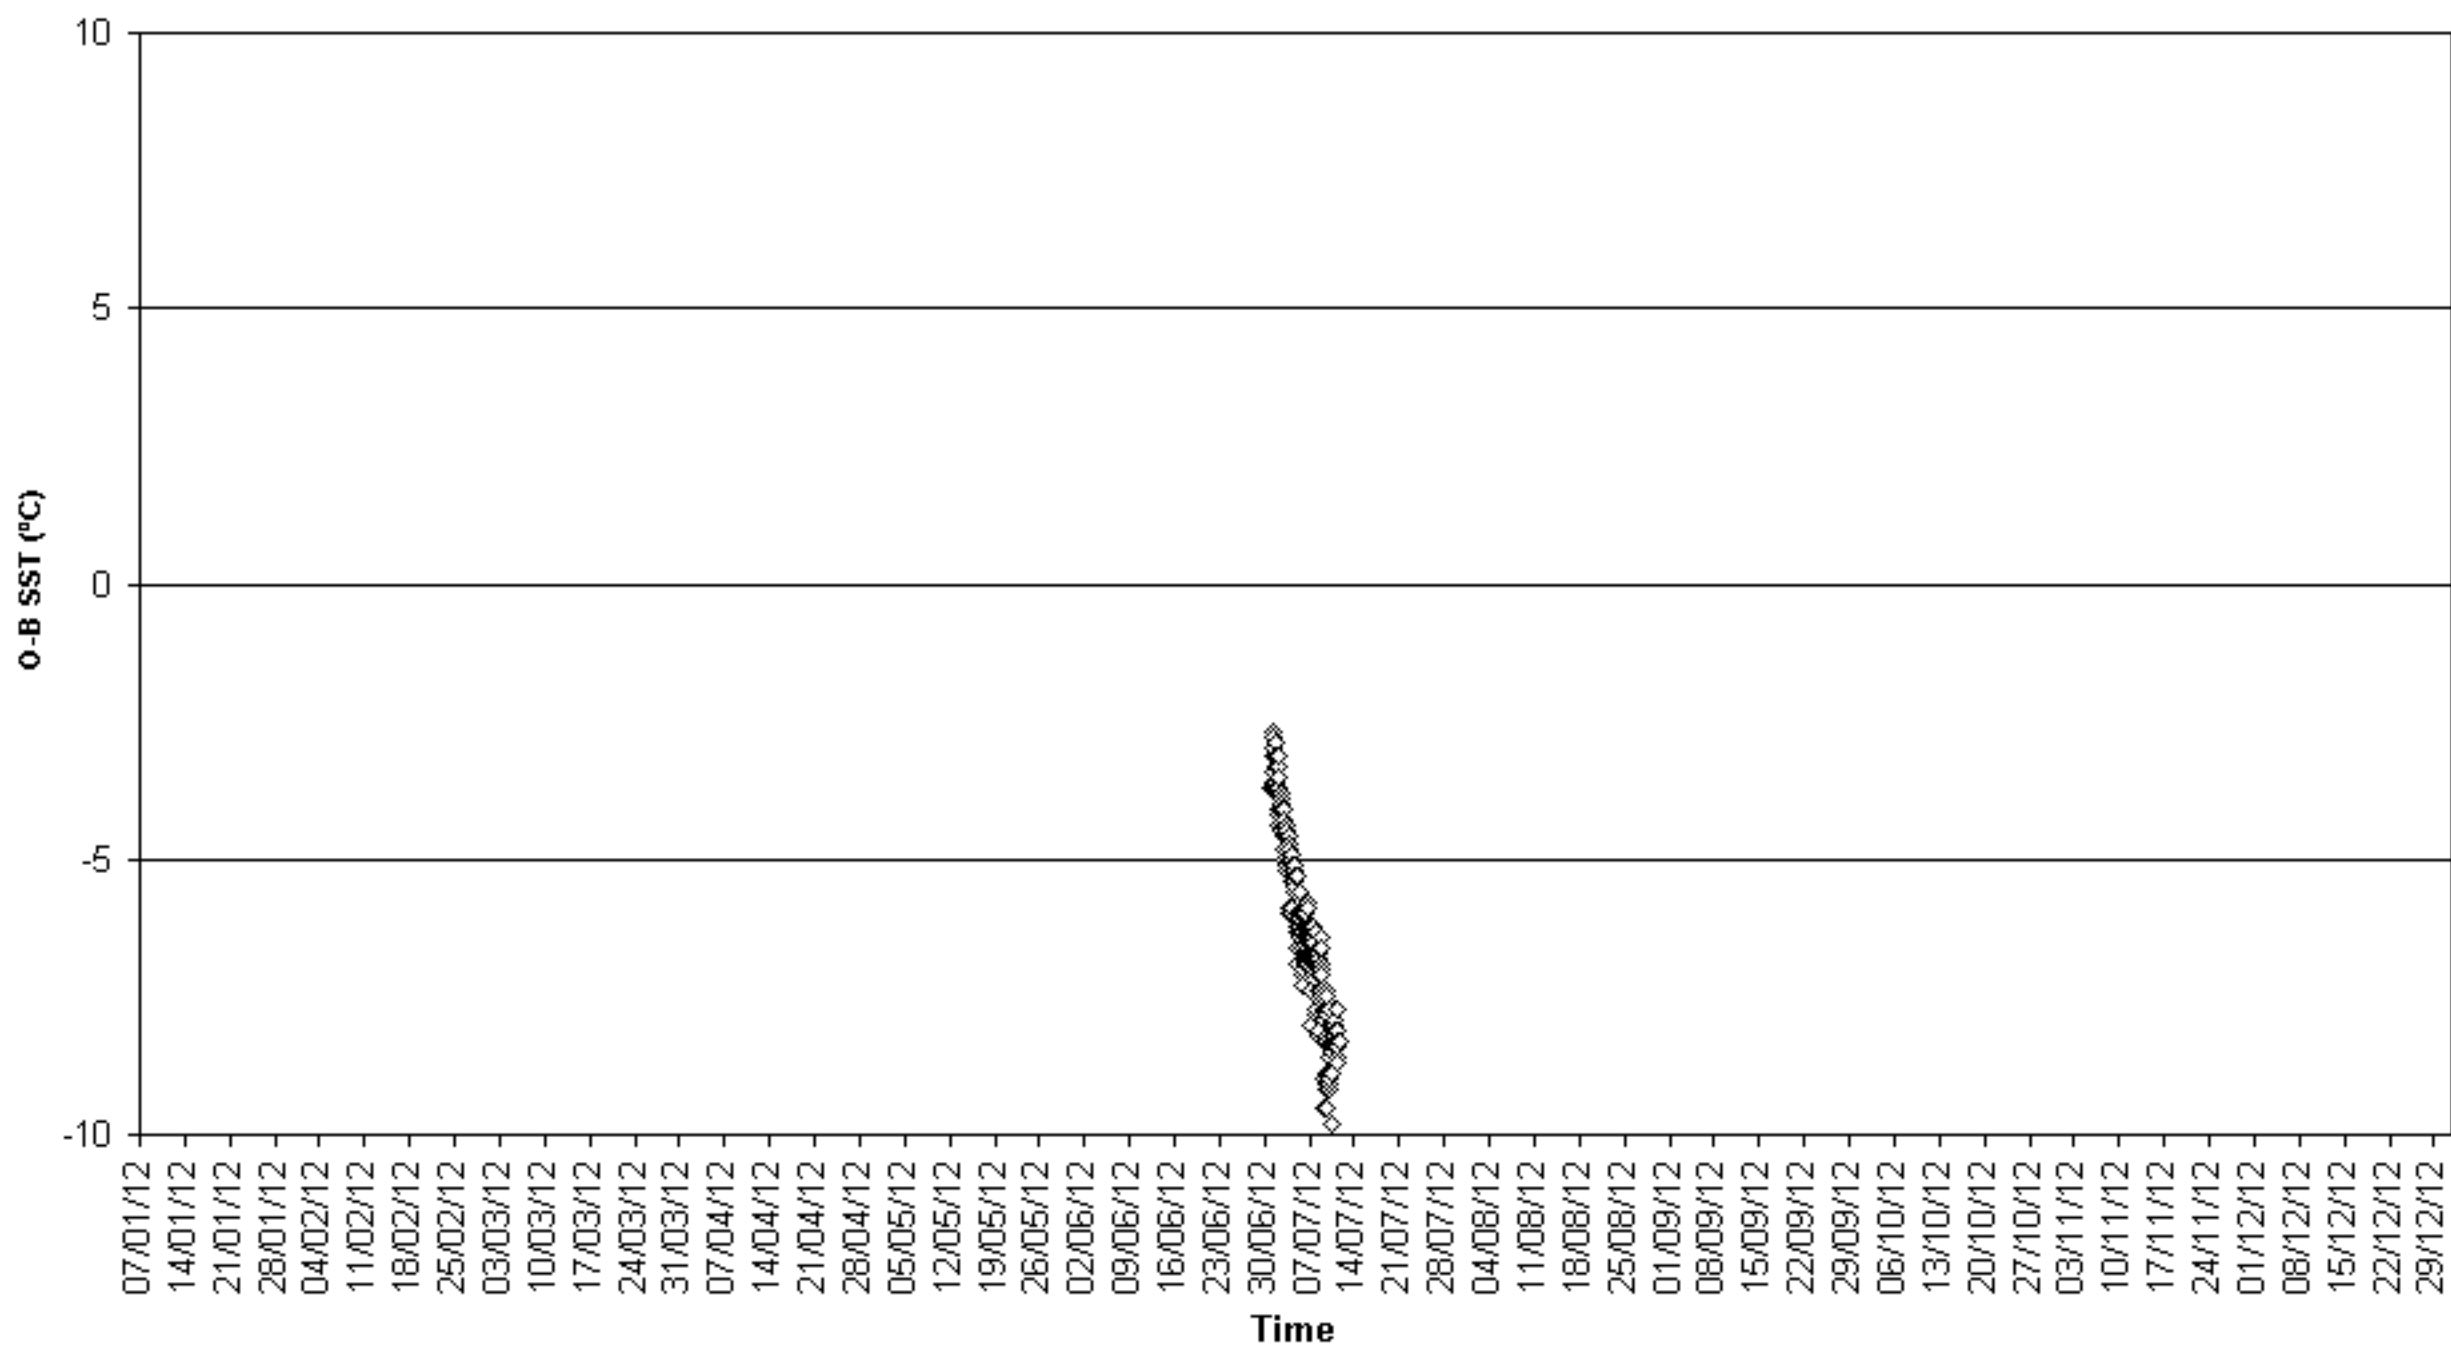


O-B SST (°C) for identifier 16551
Number of obs. plotted = 3269 Number of outliers = 1071

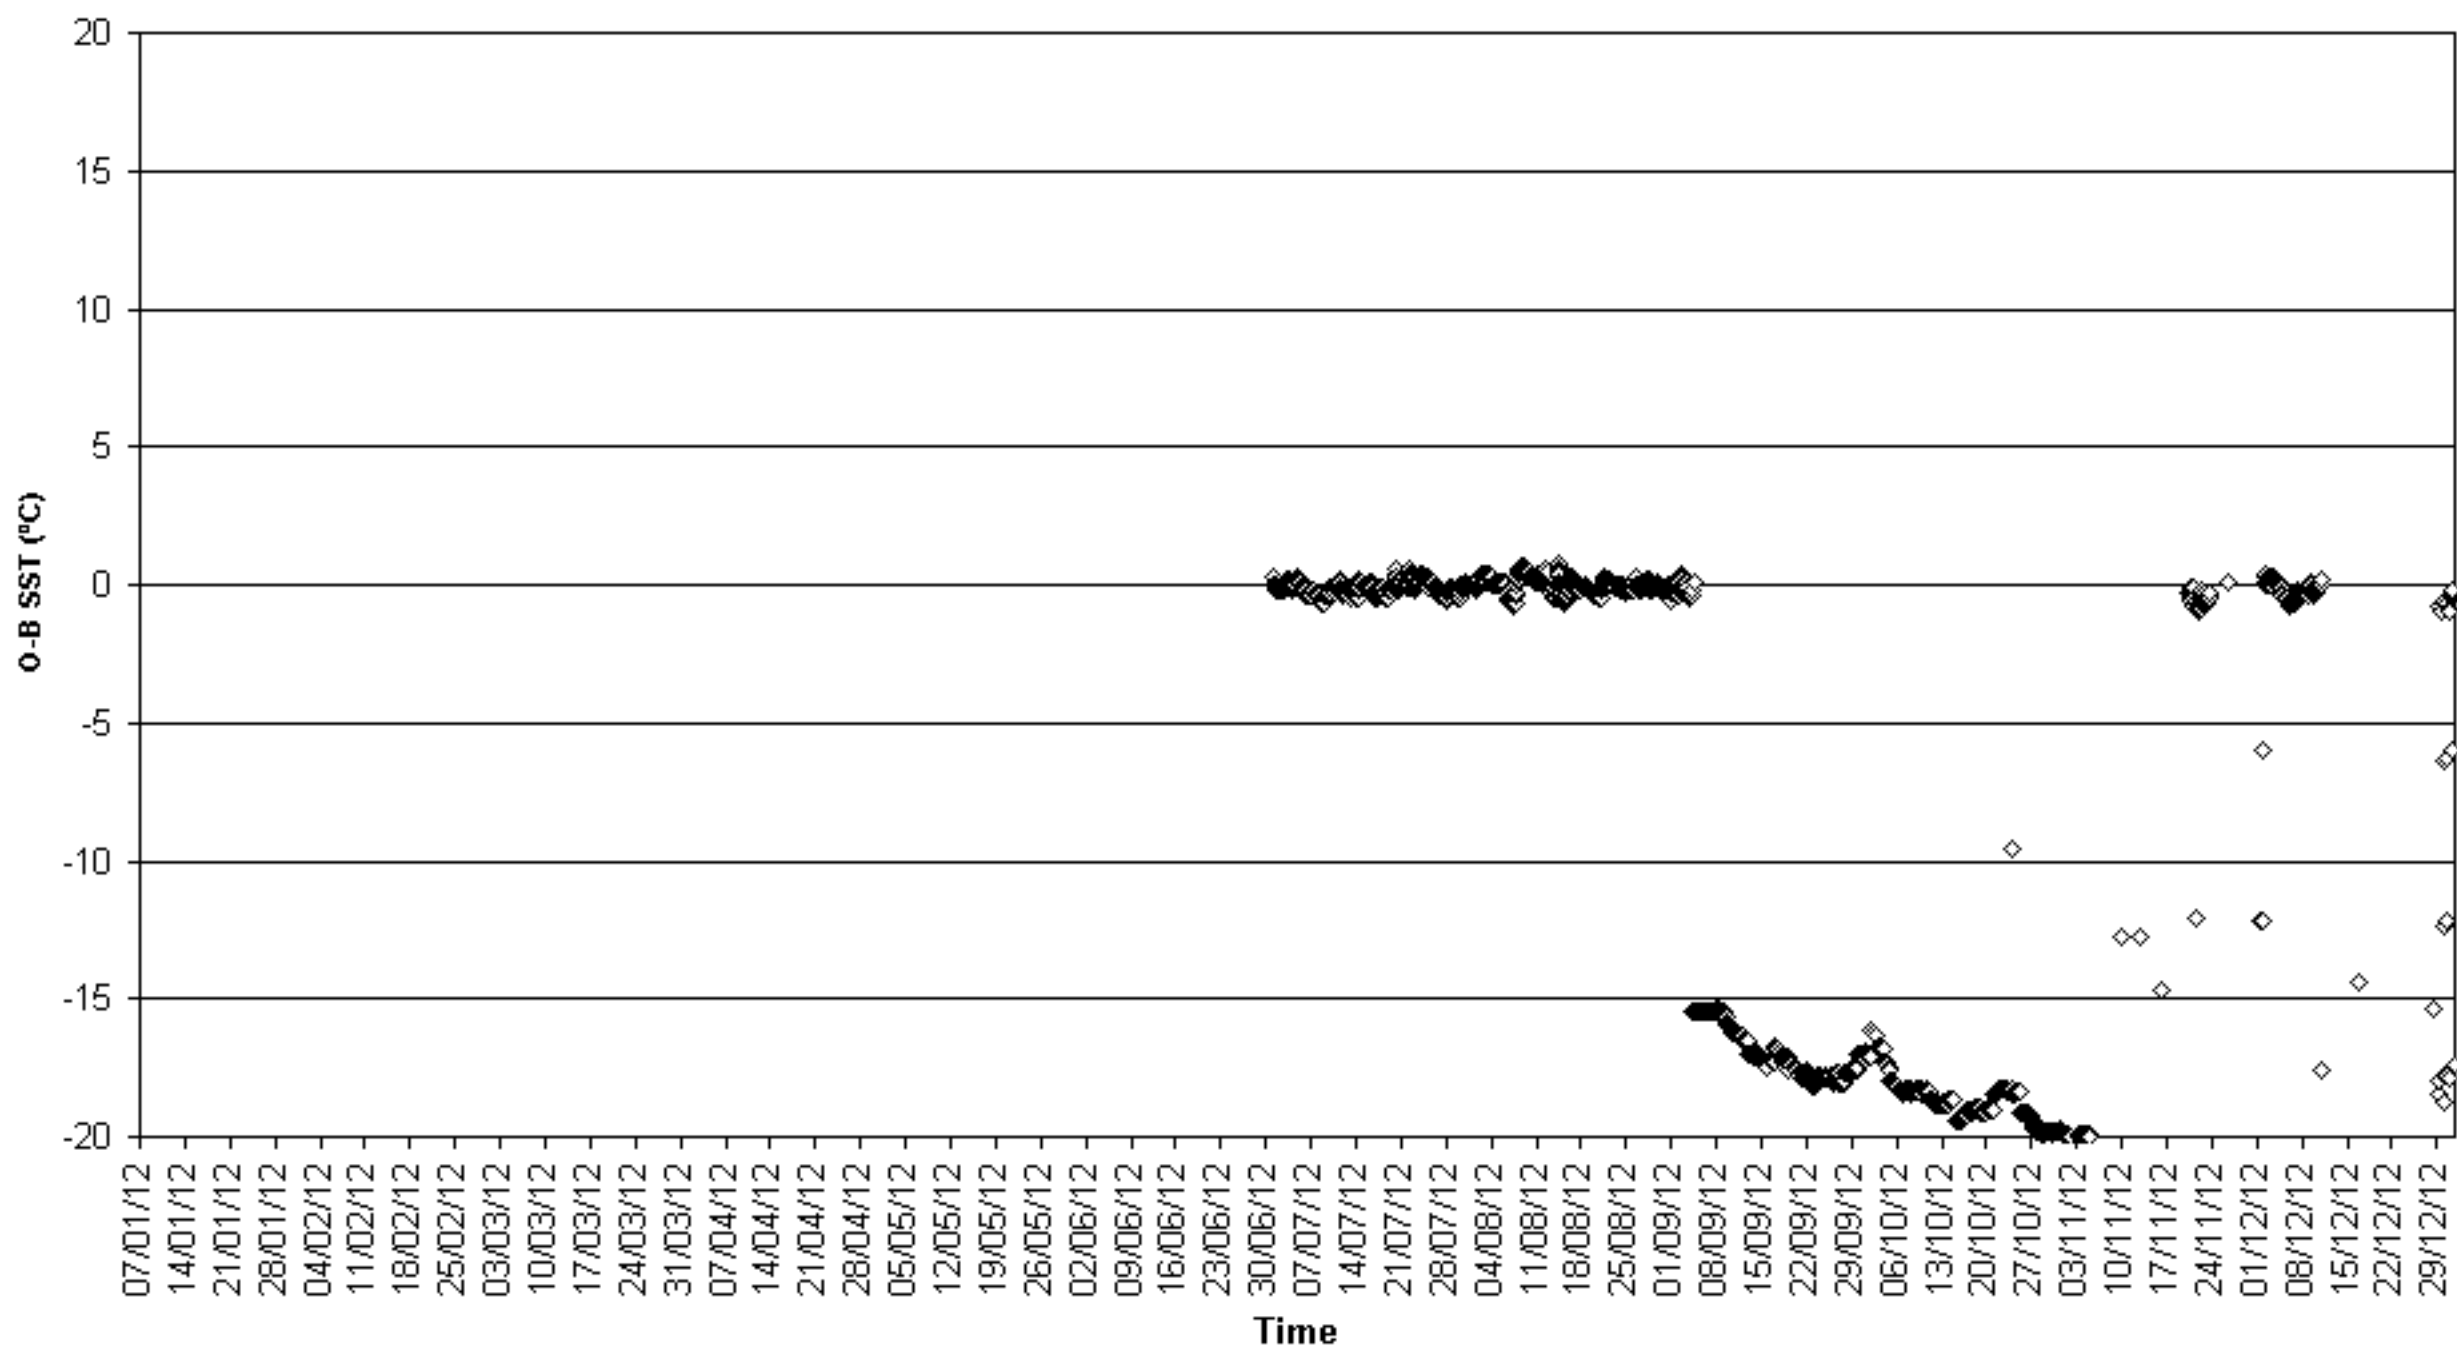


O-B SST (°C) for identifier 21936
Number of obs. plotted = 200 Number of outliers = 50

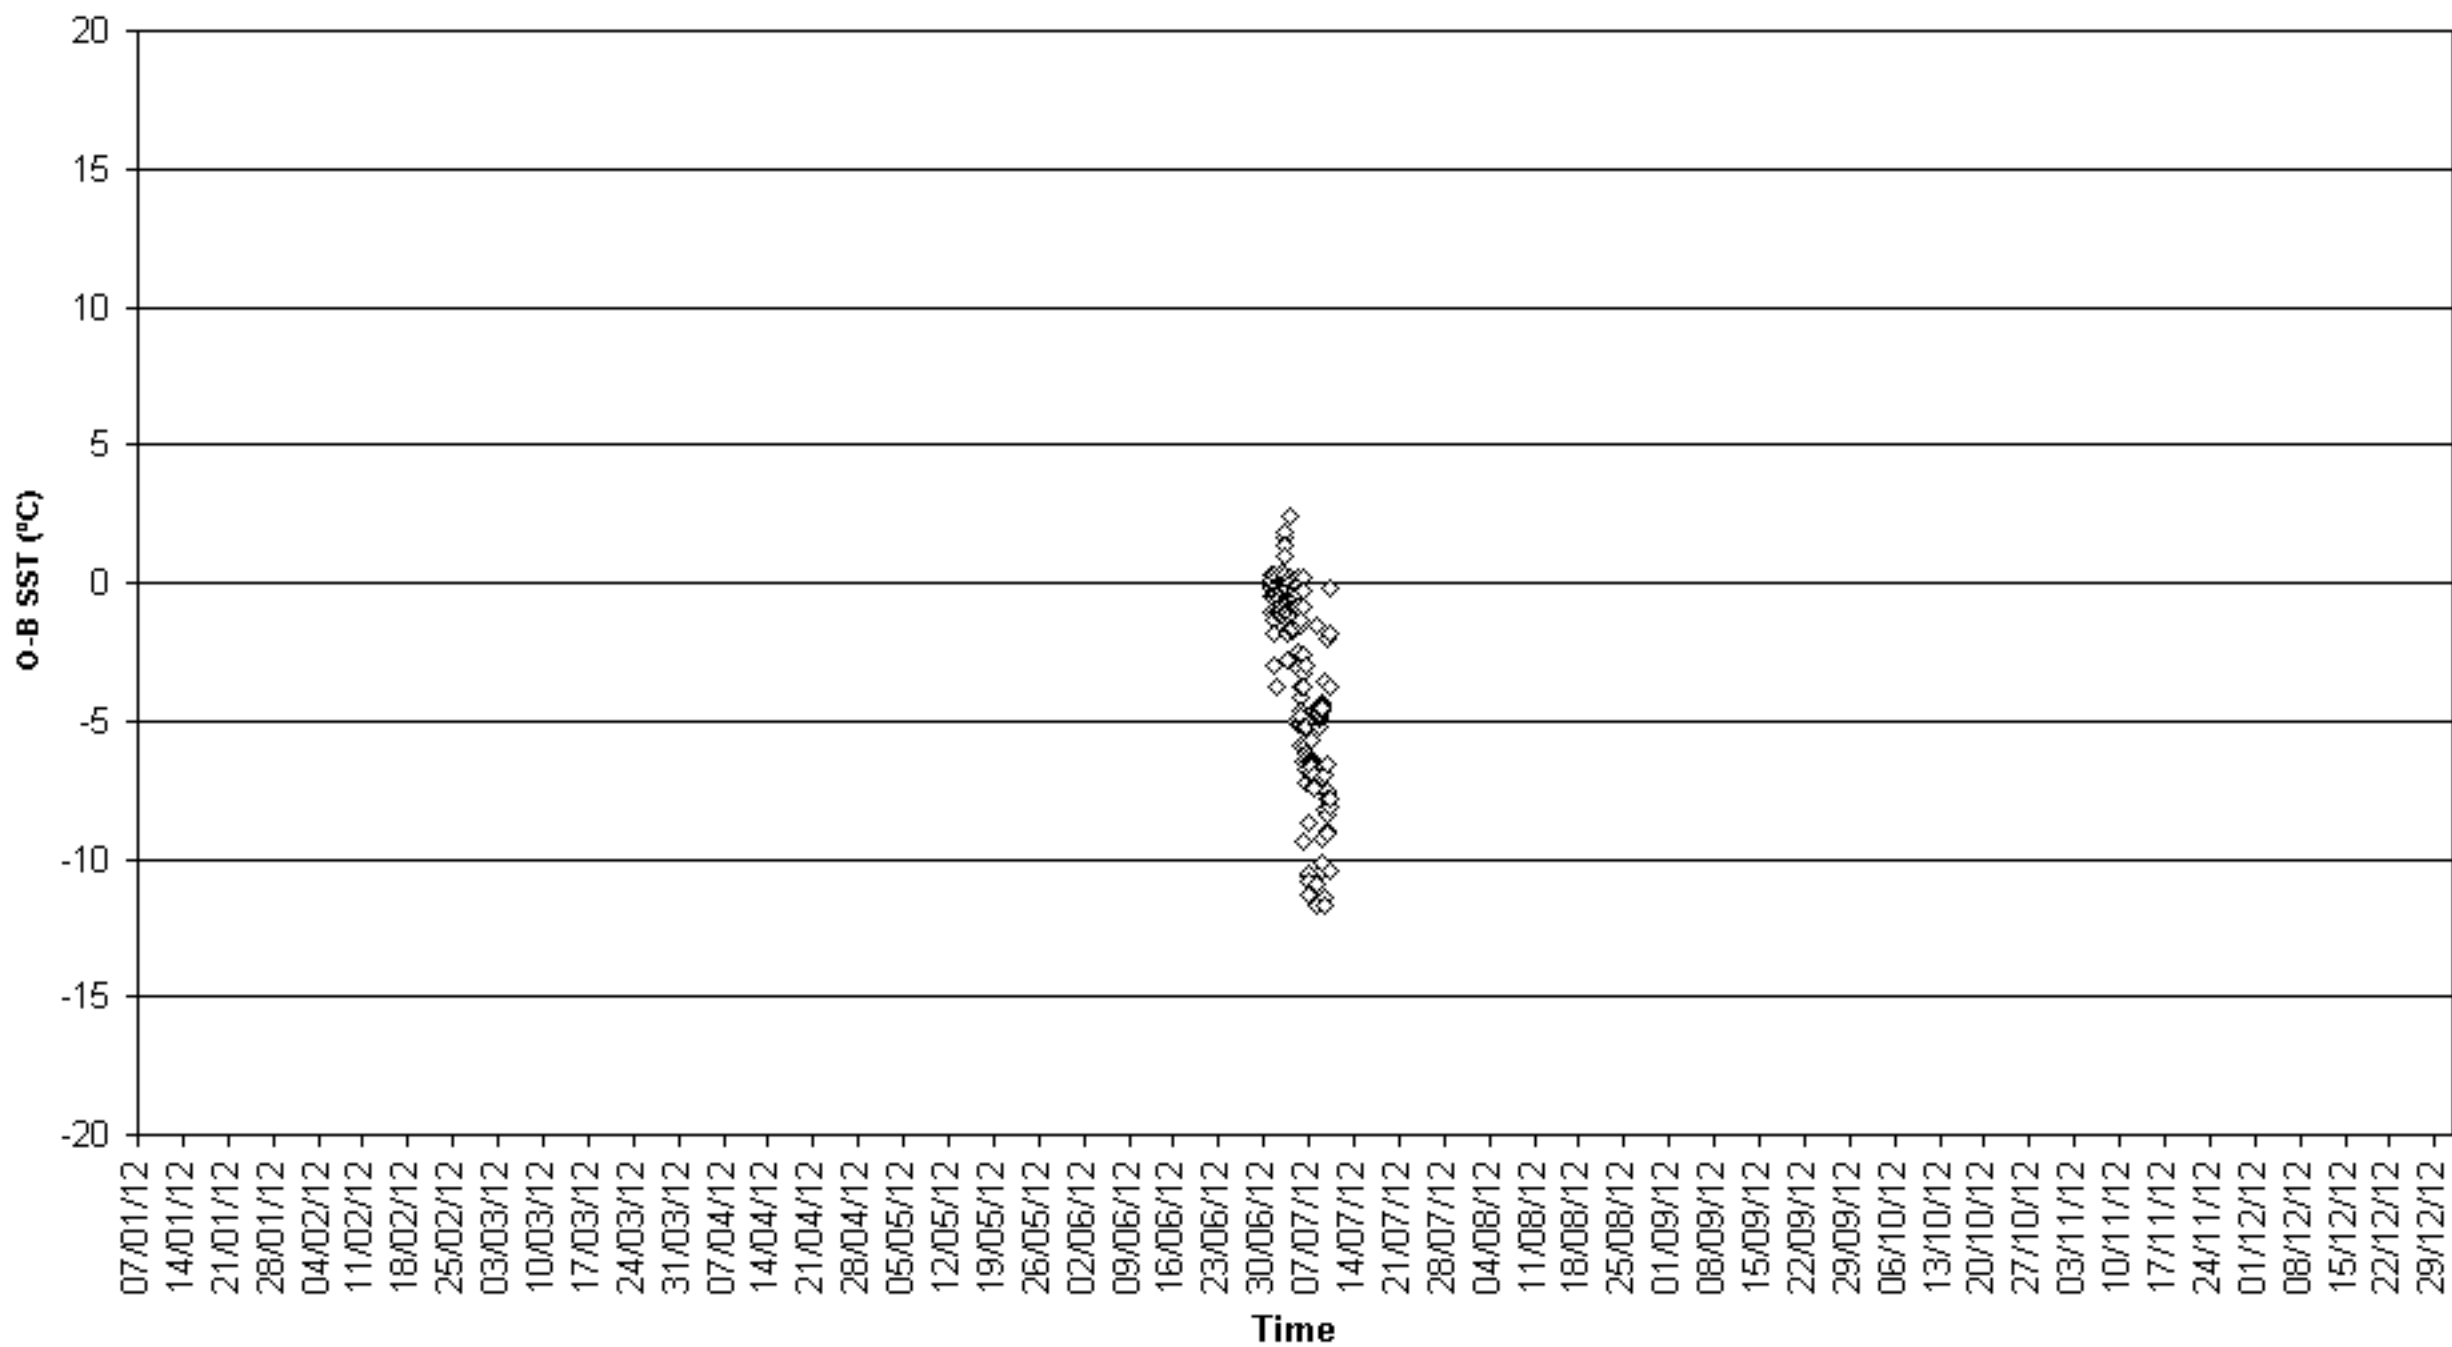


O-B SST (°C) for identifier 22535
Number of obs. plotted = 2 Number of outliers = 44

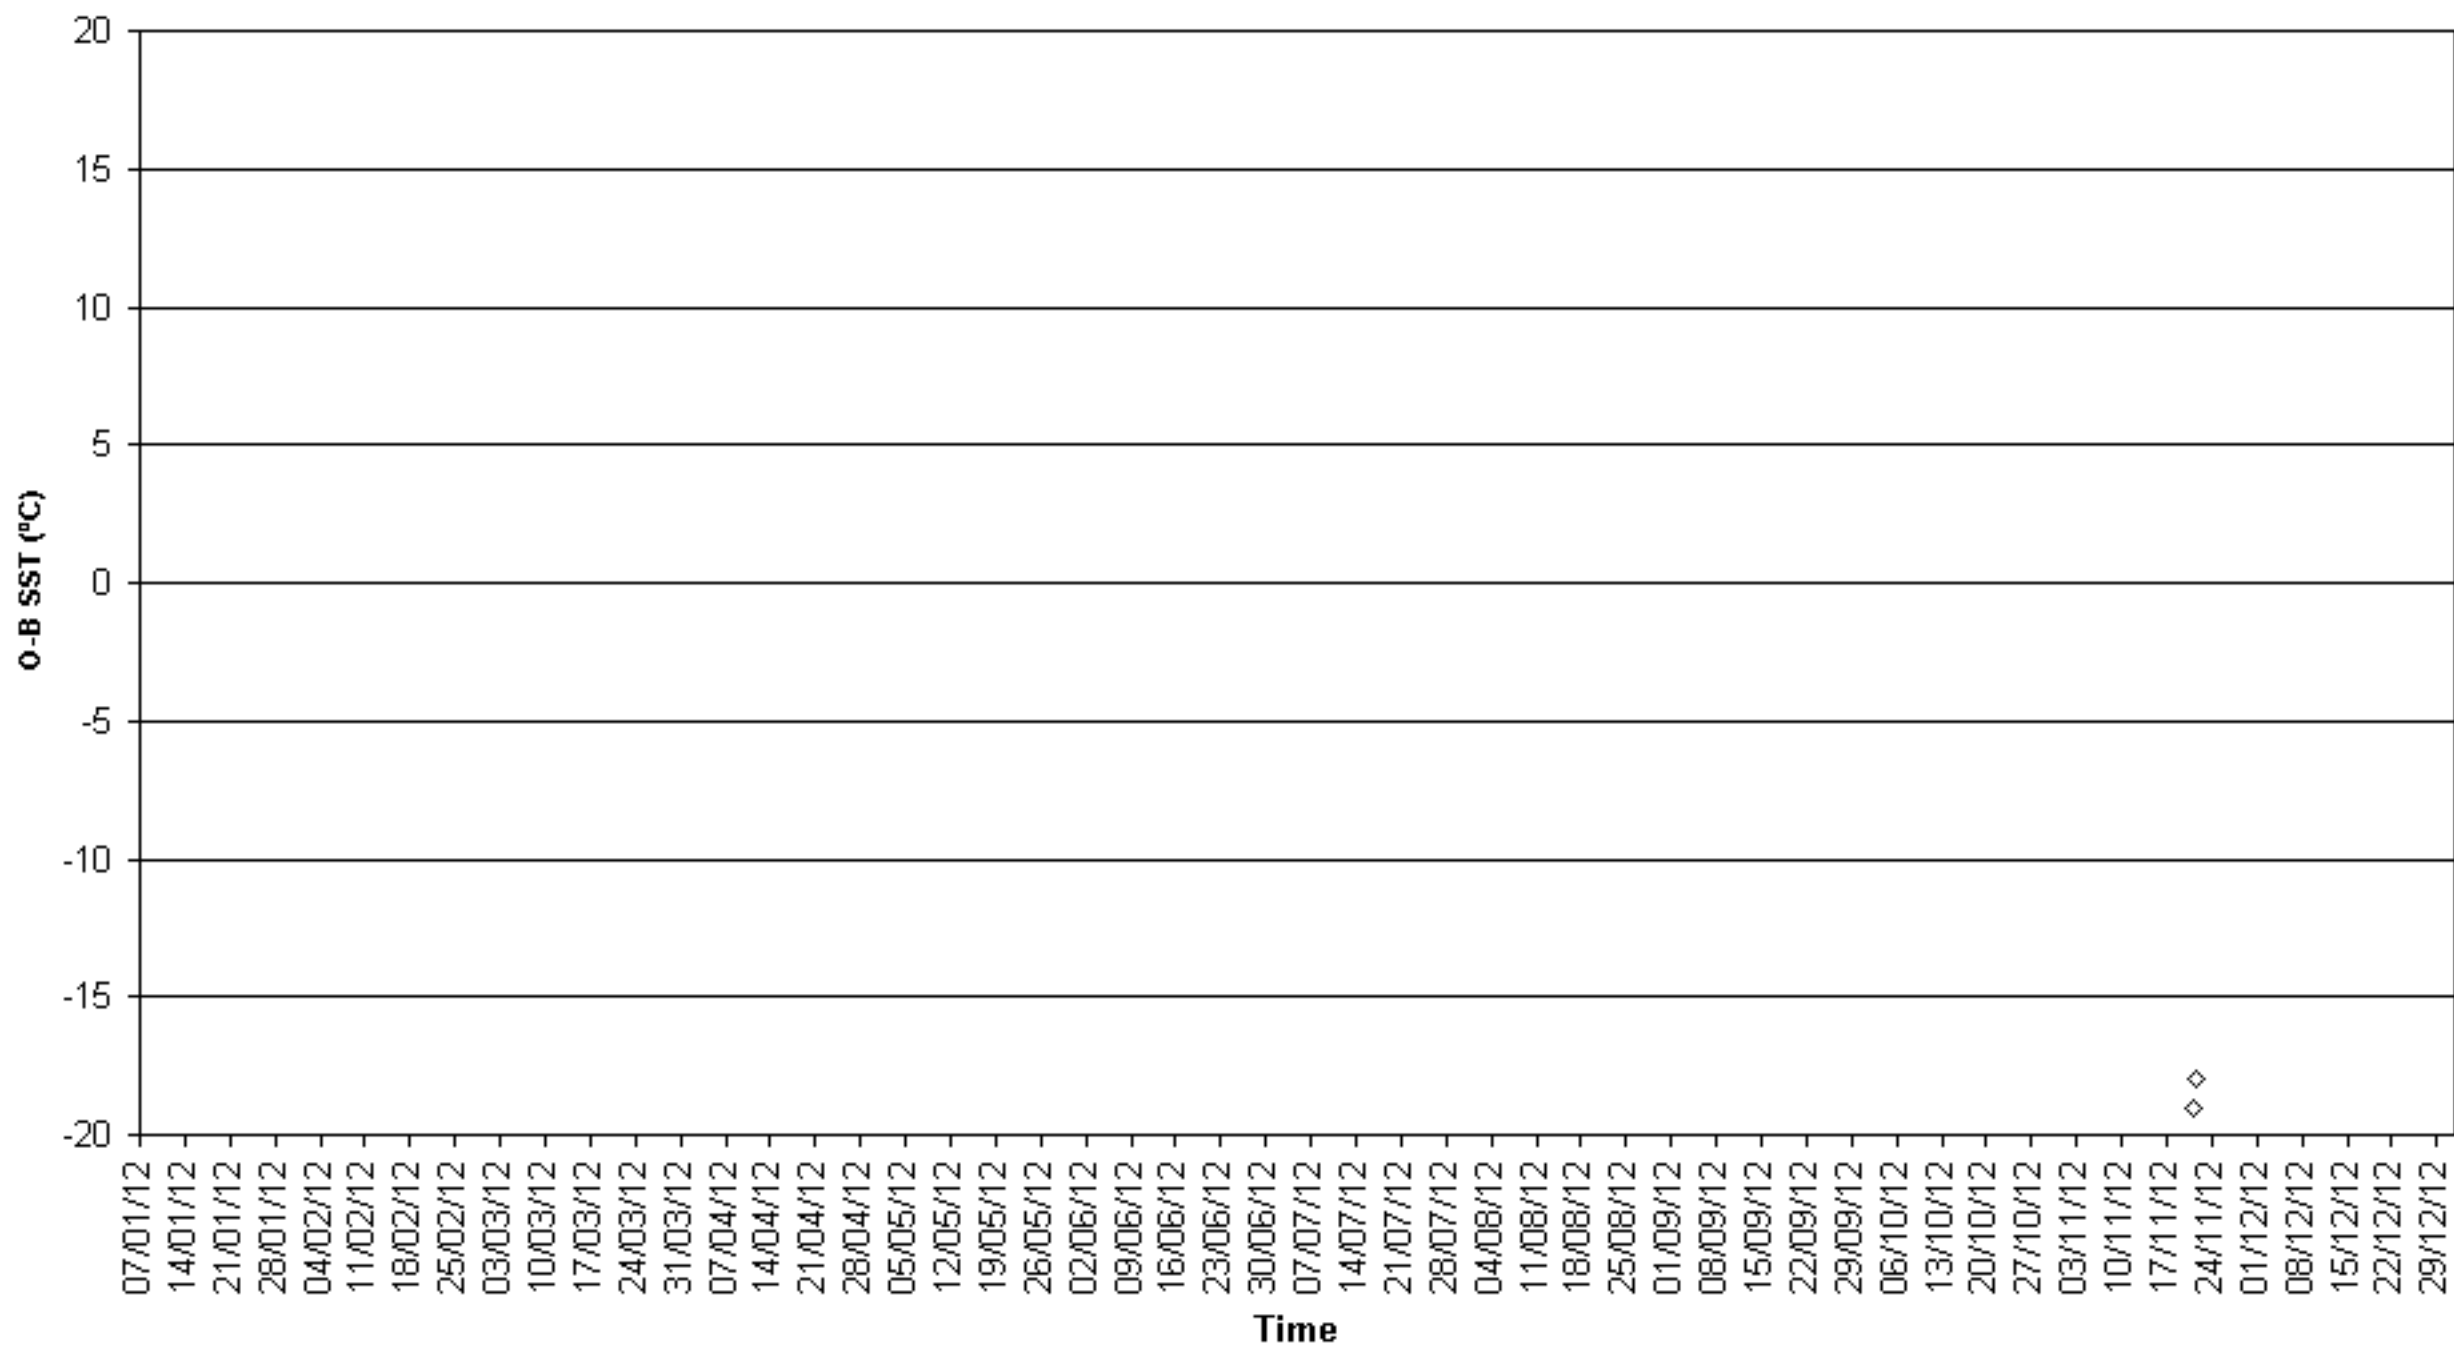


O-B SST (°C) for identifier 23708
Number of obs. plotted = 0 Number of outliers = 390

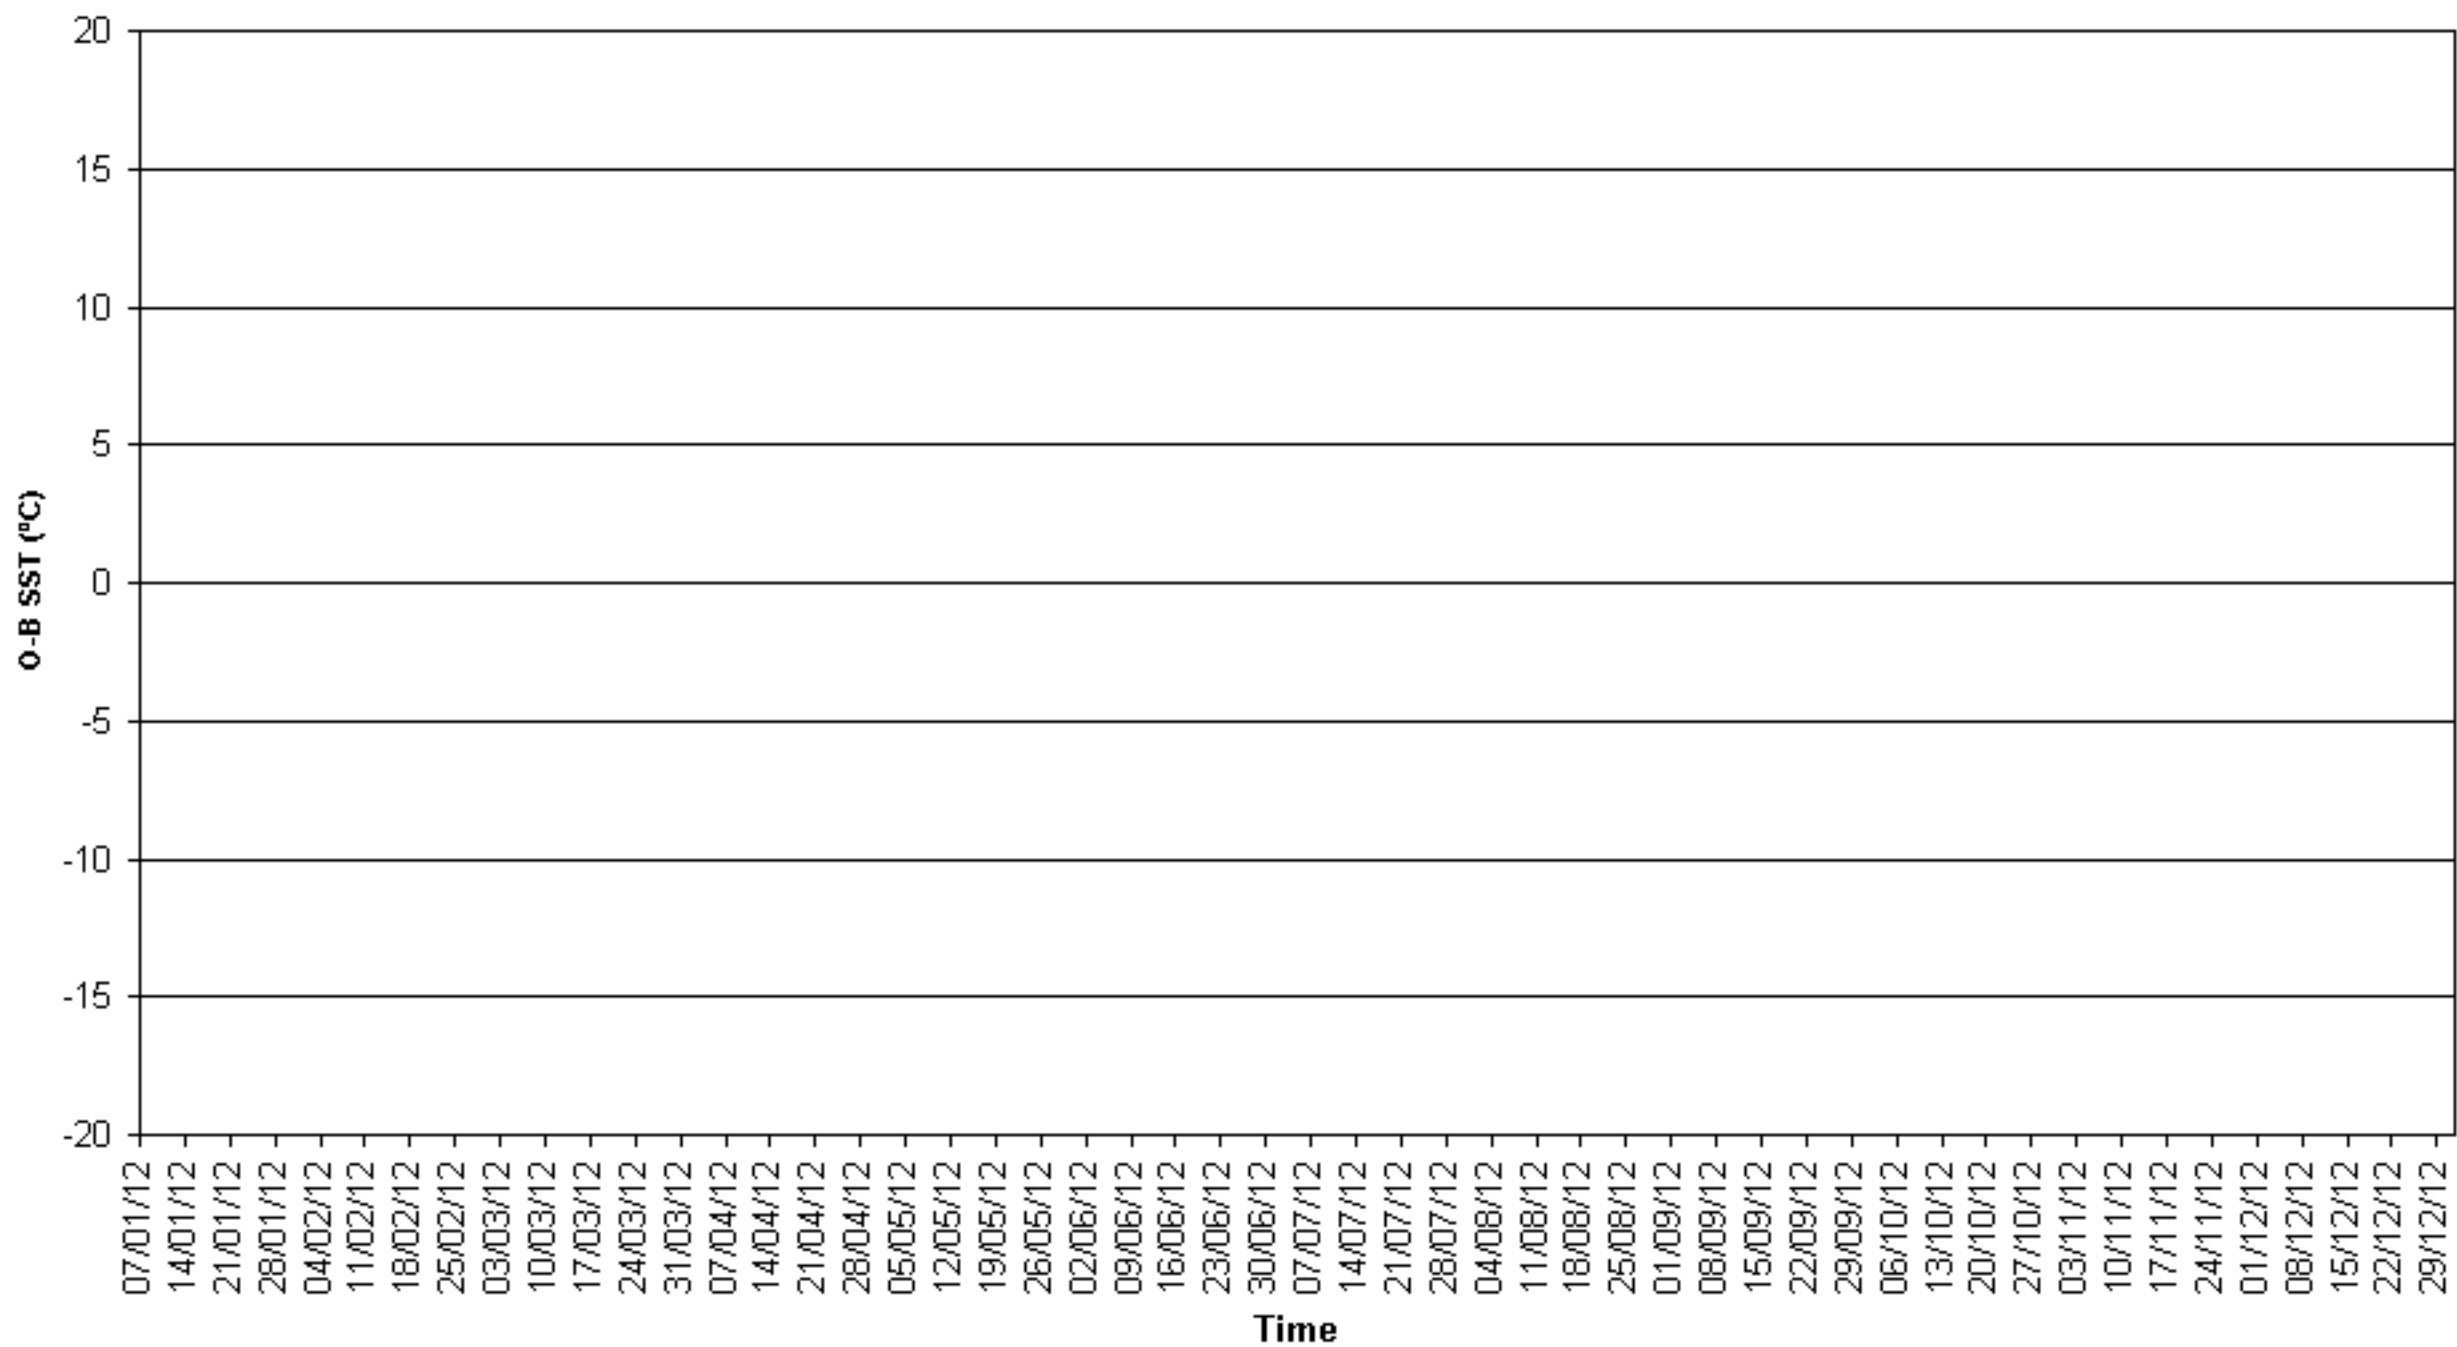


O-B SST (°C) for identifier 23751
Number of obs. plotted = 840 Number of outliers = 495

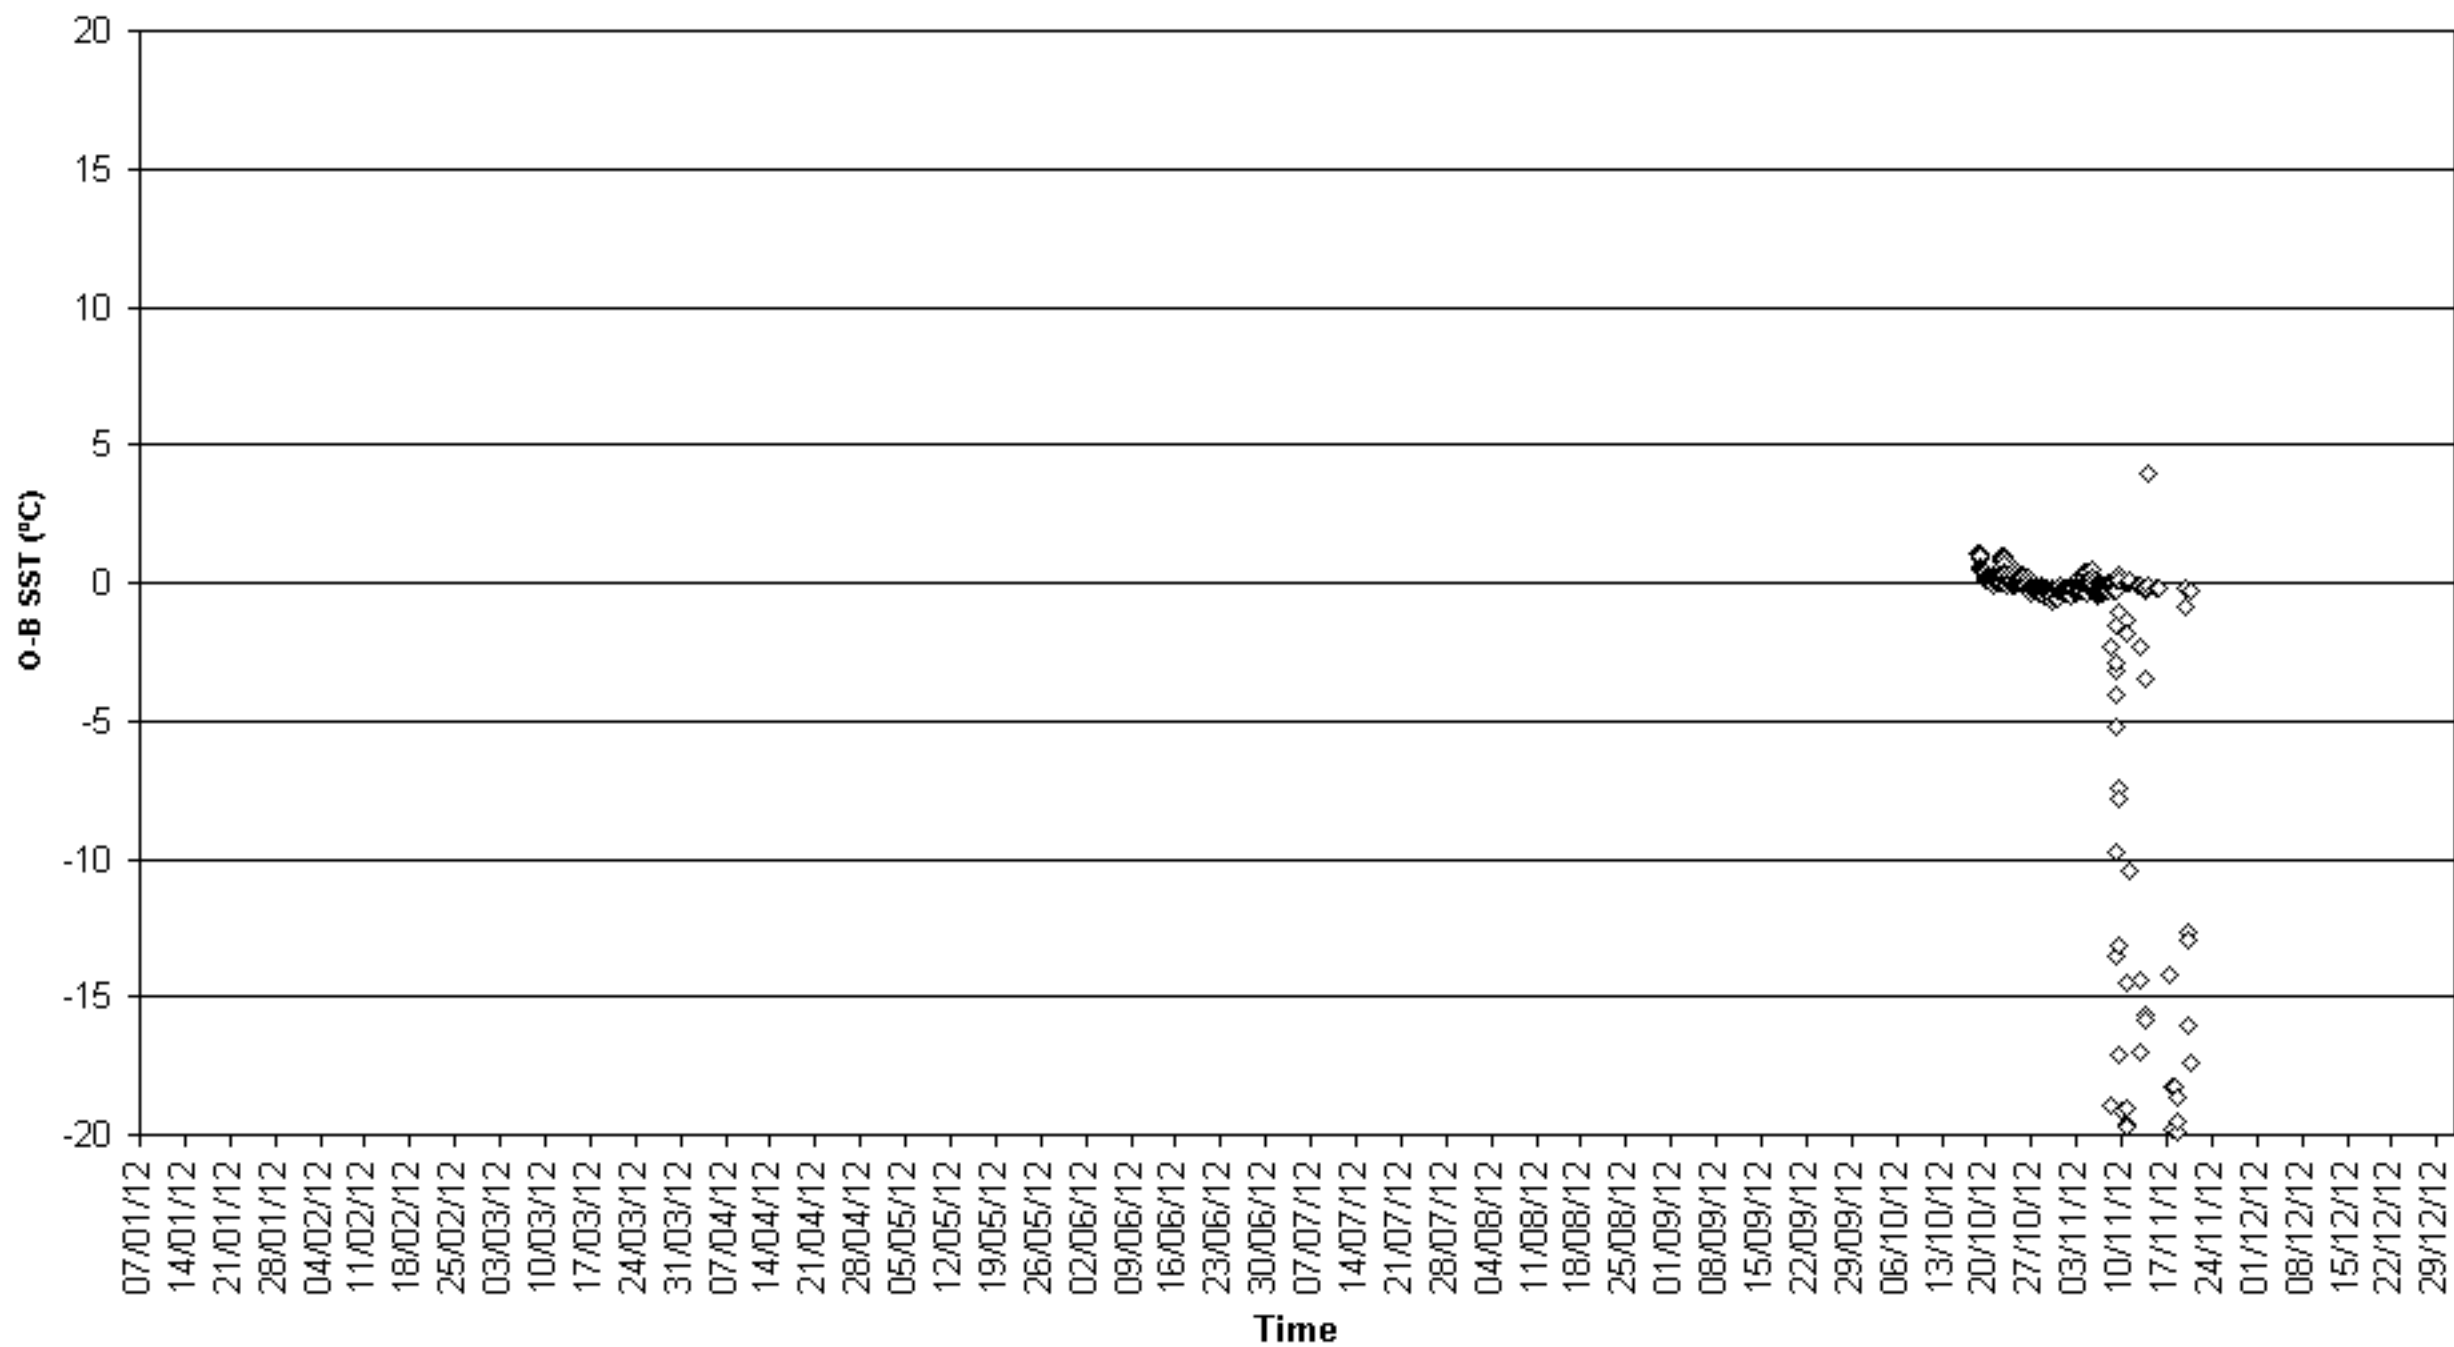


O-B SST (°C) for identifier 25634
Number of obs. plotted = 3662 Number of outliers = 60

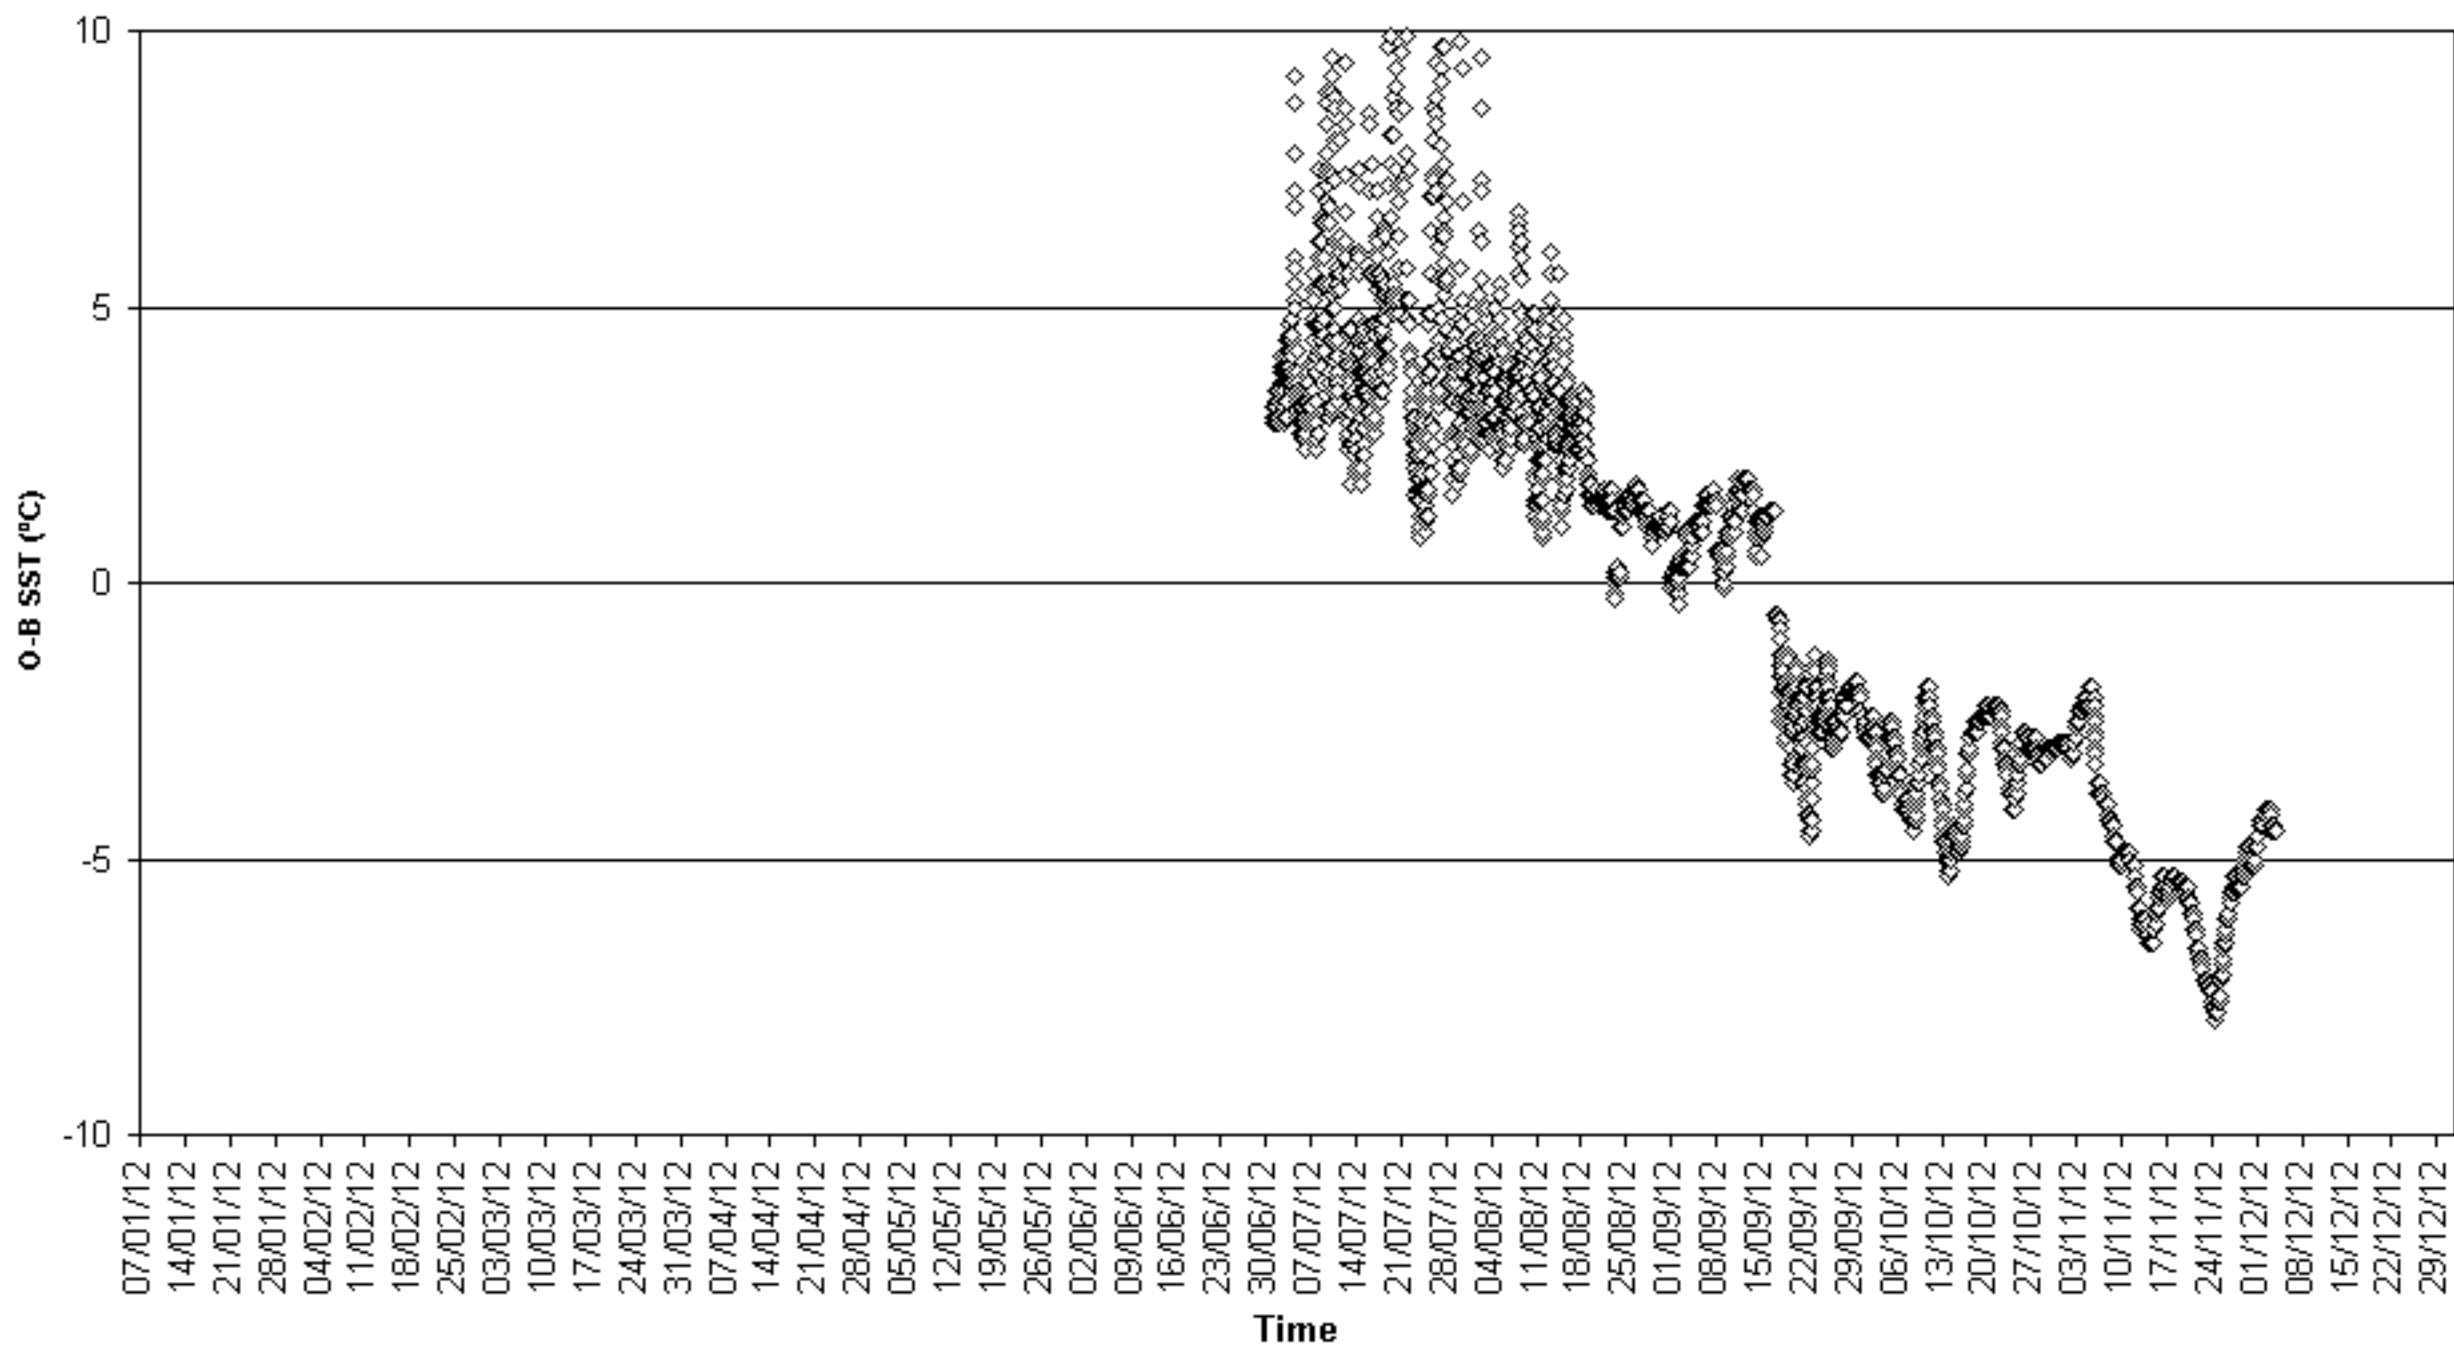


O-B SST (°C) for identifier 31516
Number of obs. plotted = 377 Number of outliers = 0

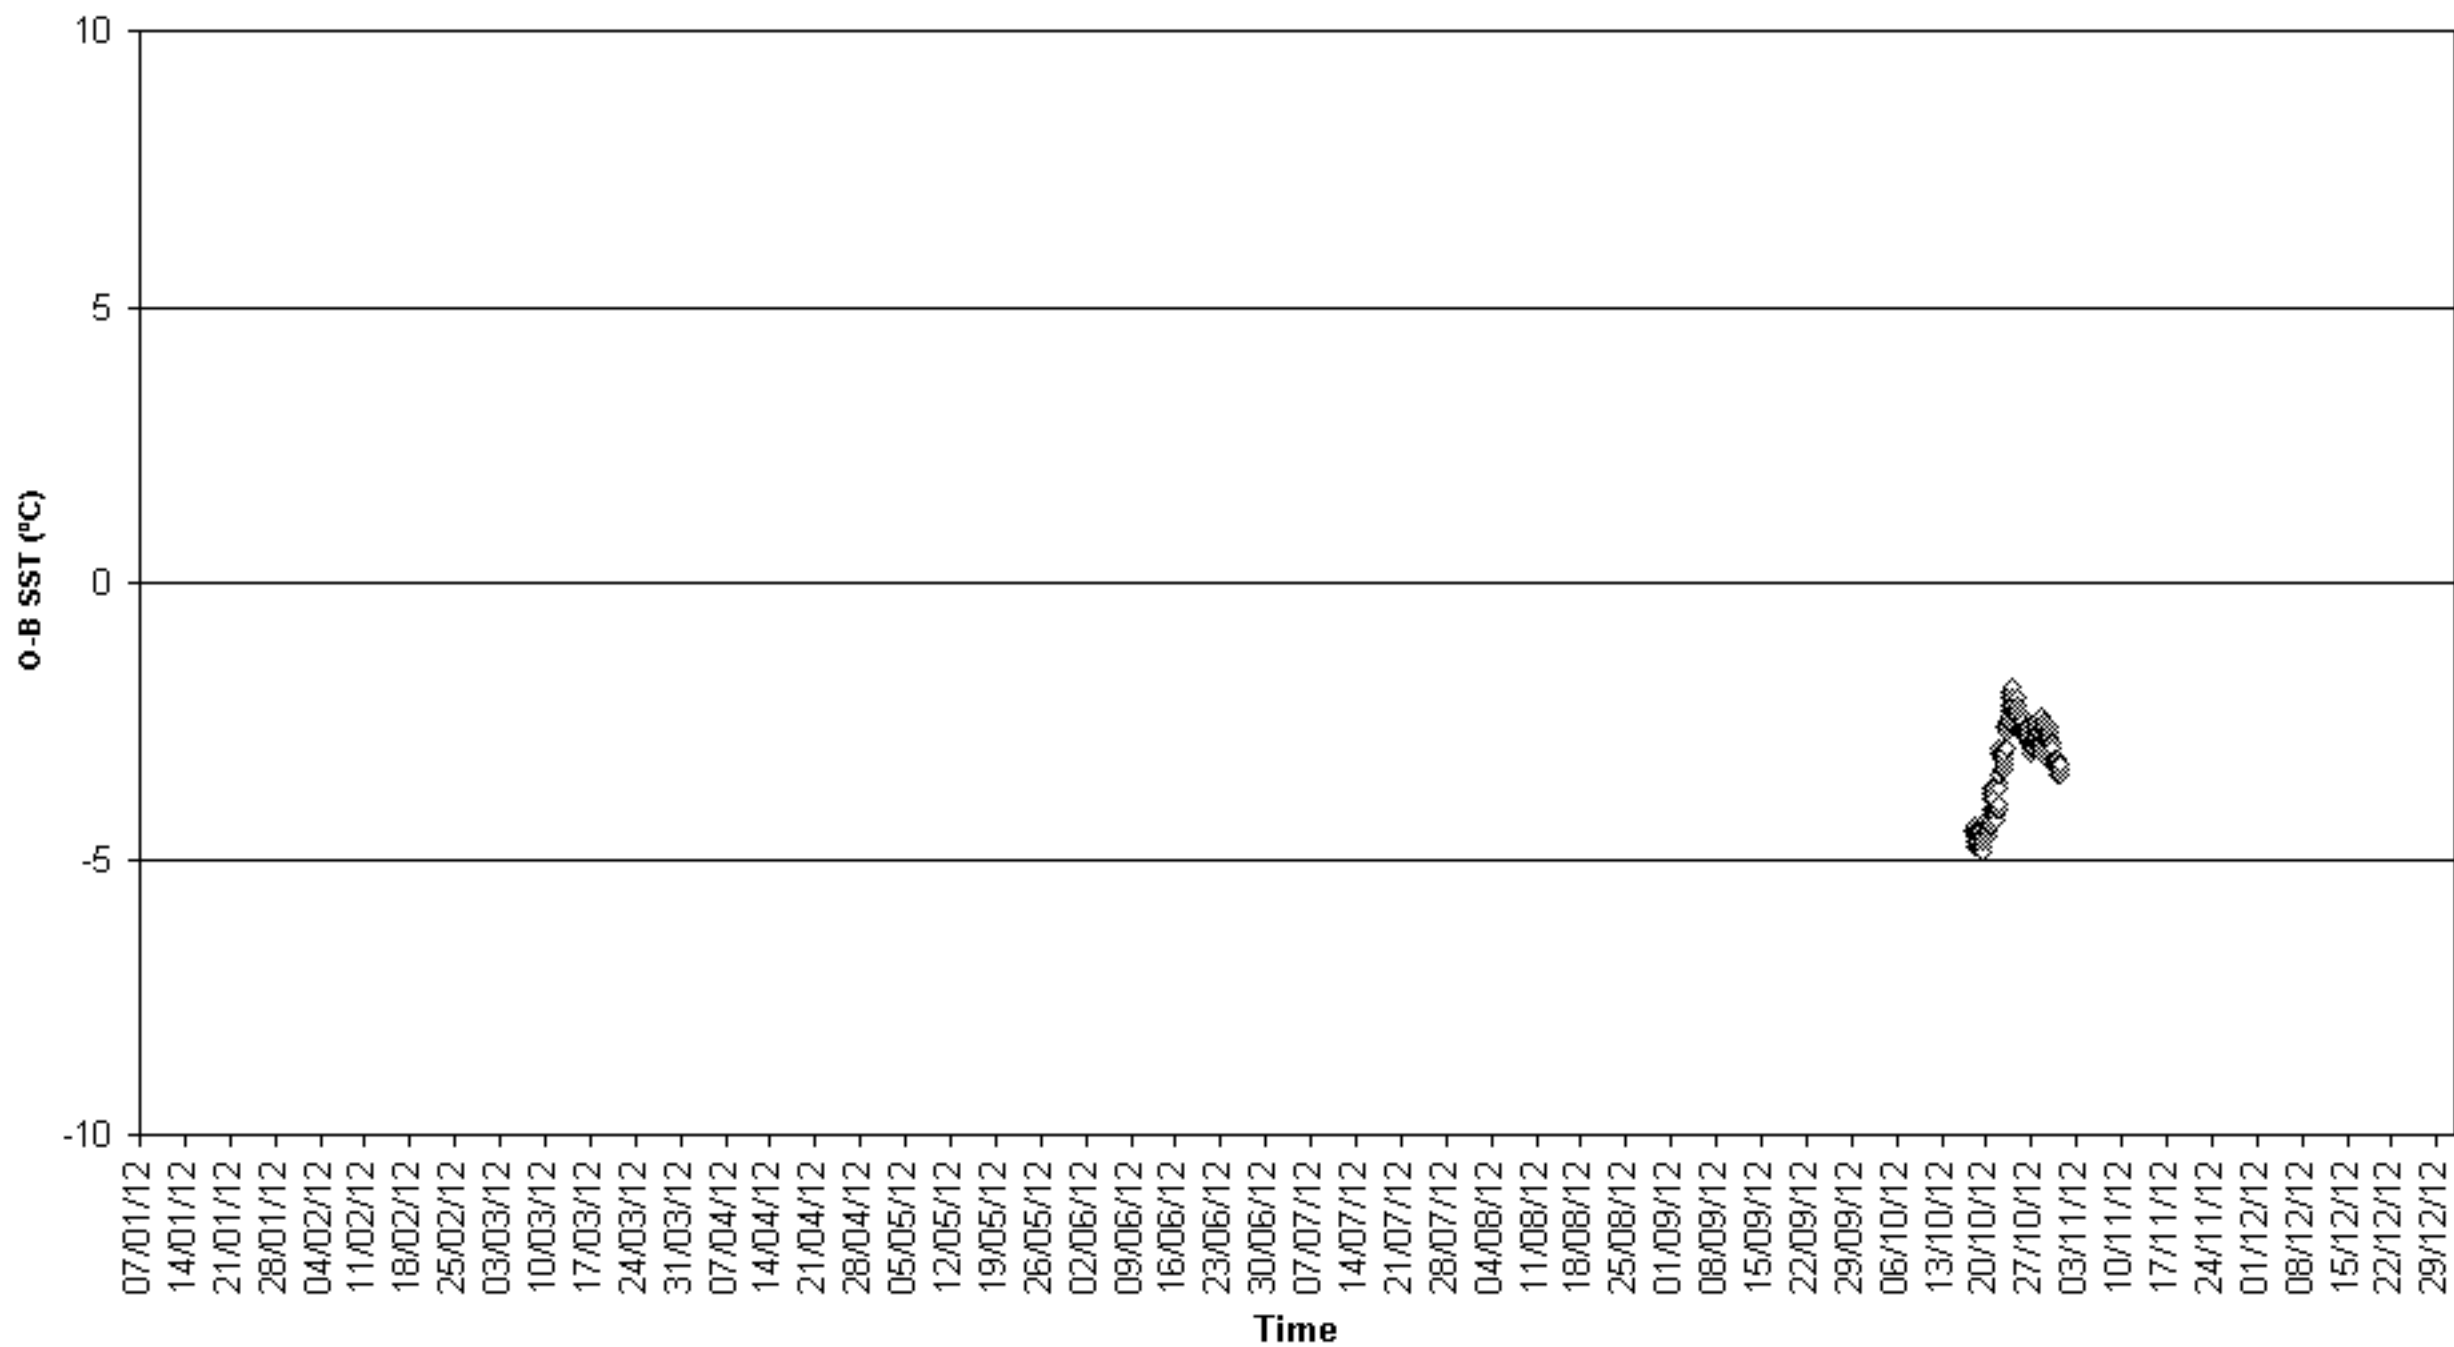


O-B SST (°C) for identifier 31915
Number of obs. plotted = 61 Number of outliers = 0

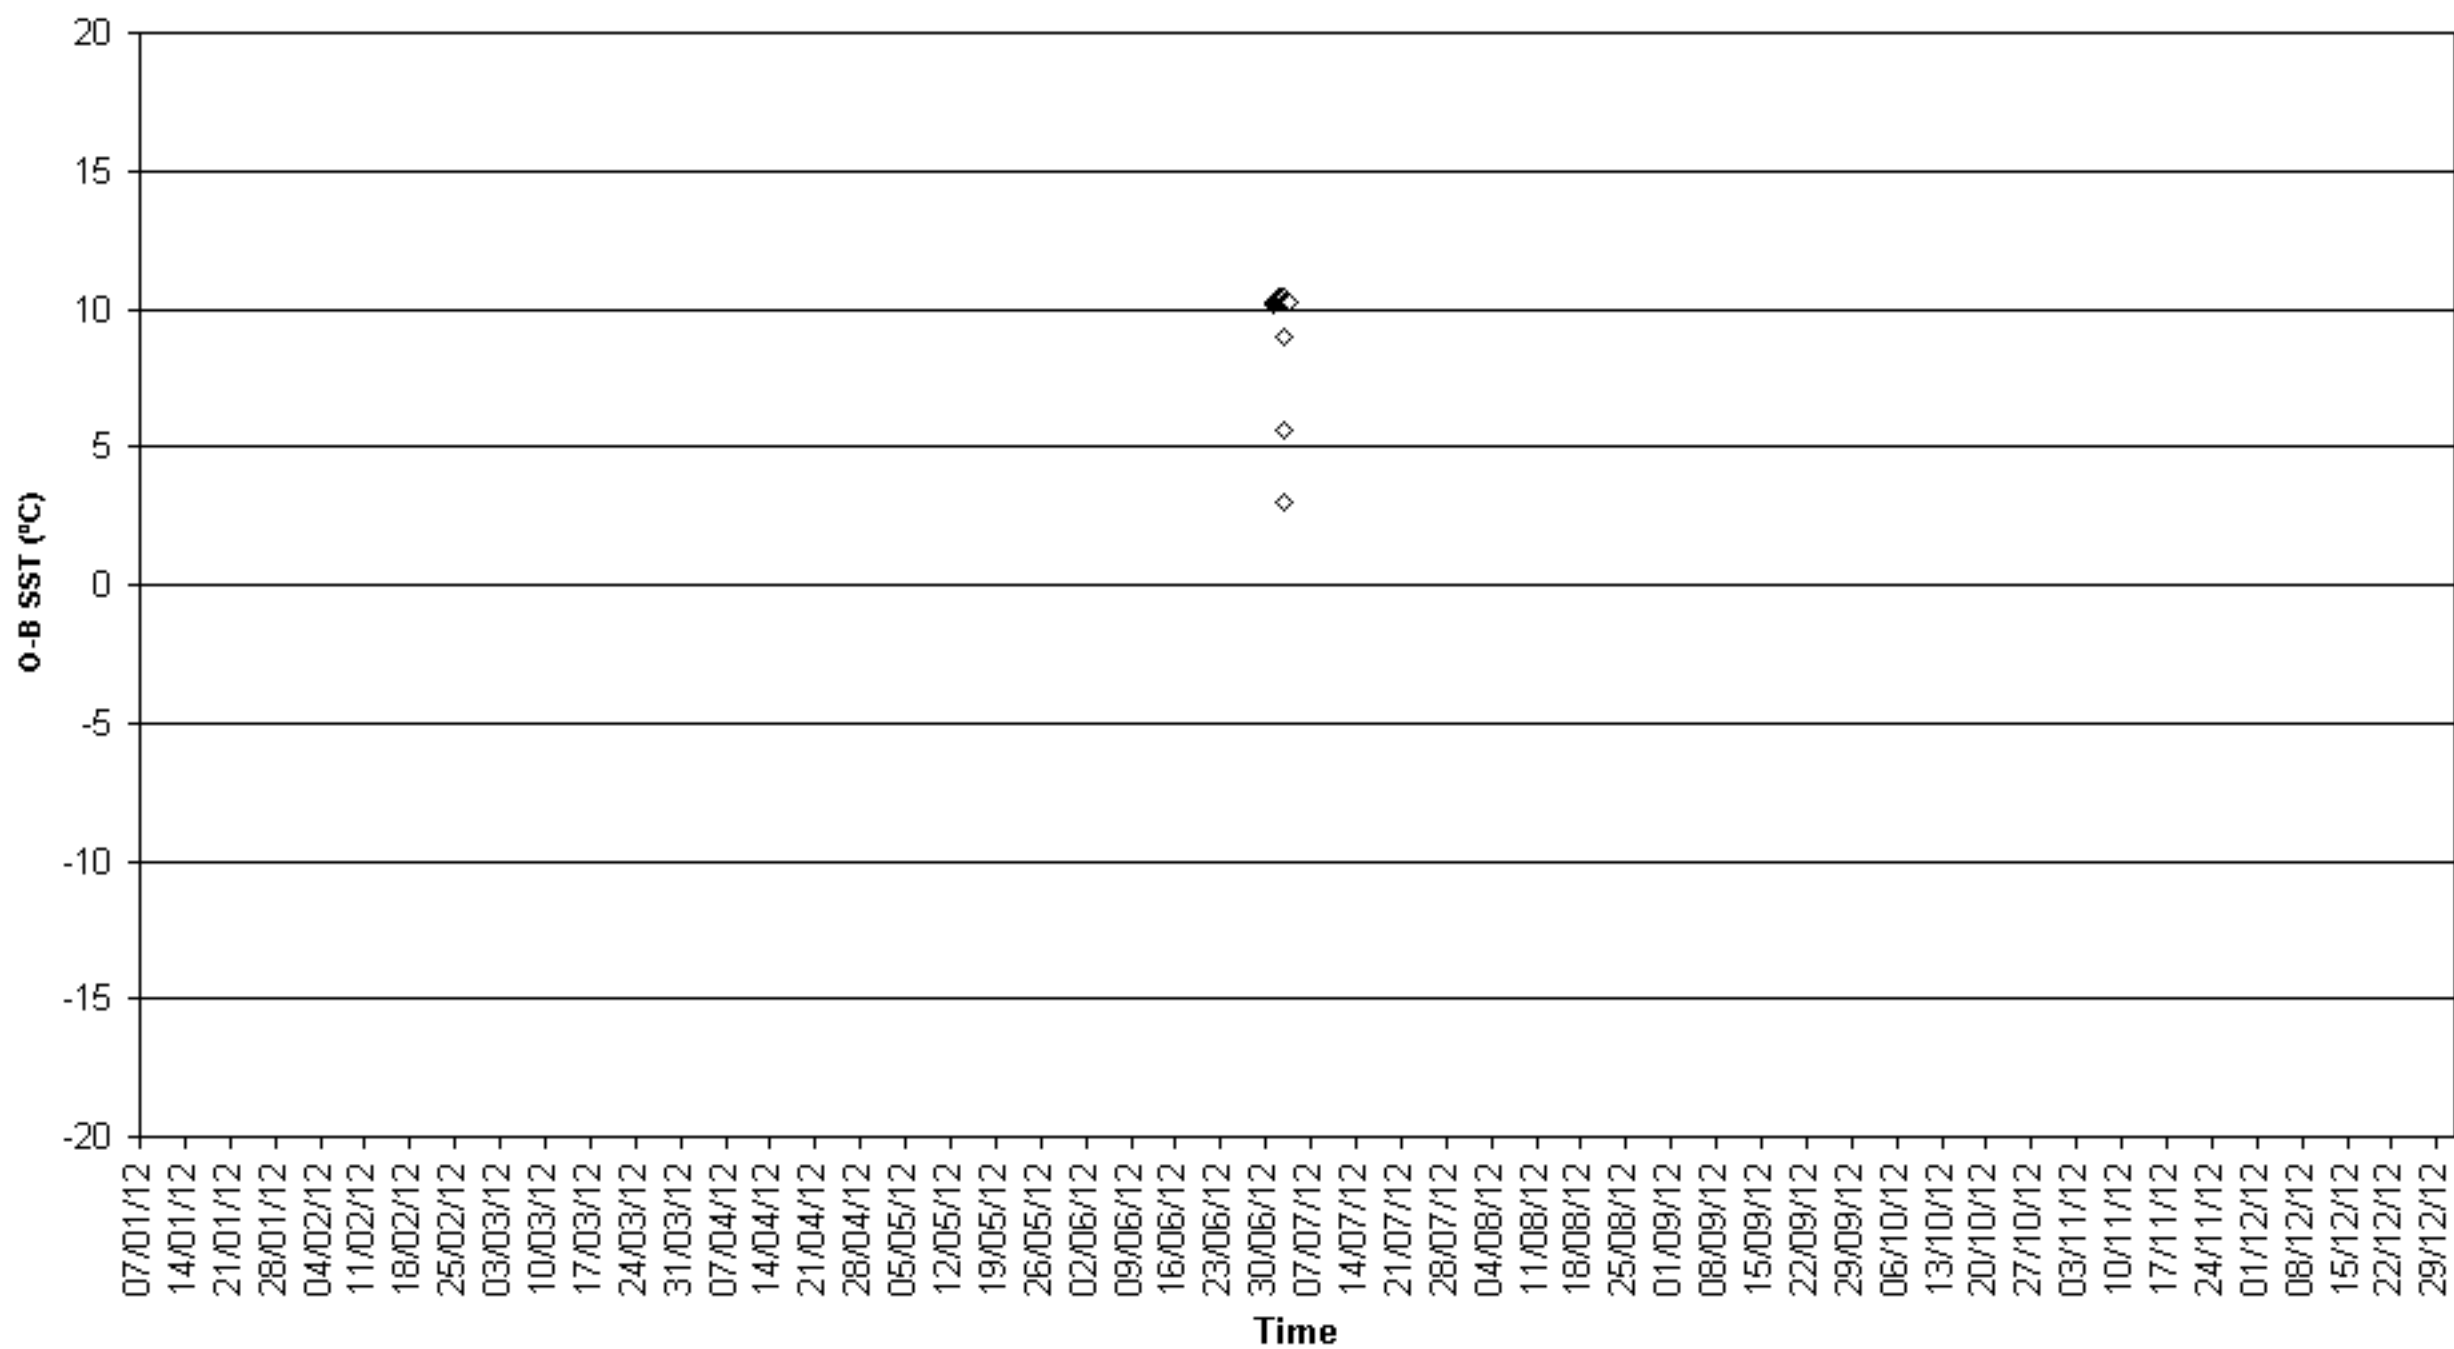


O-B SST (°C) for identifier 33535
Number of obs. plotted = 73 Number of outliers = 245

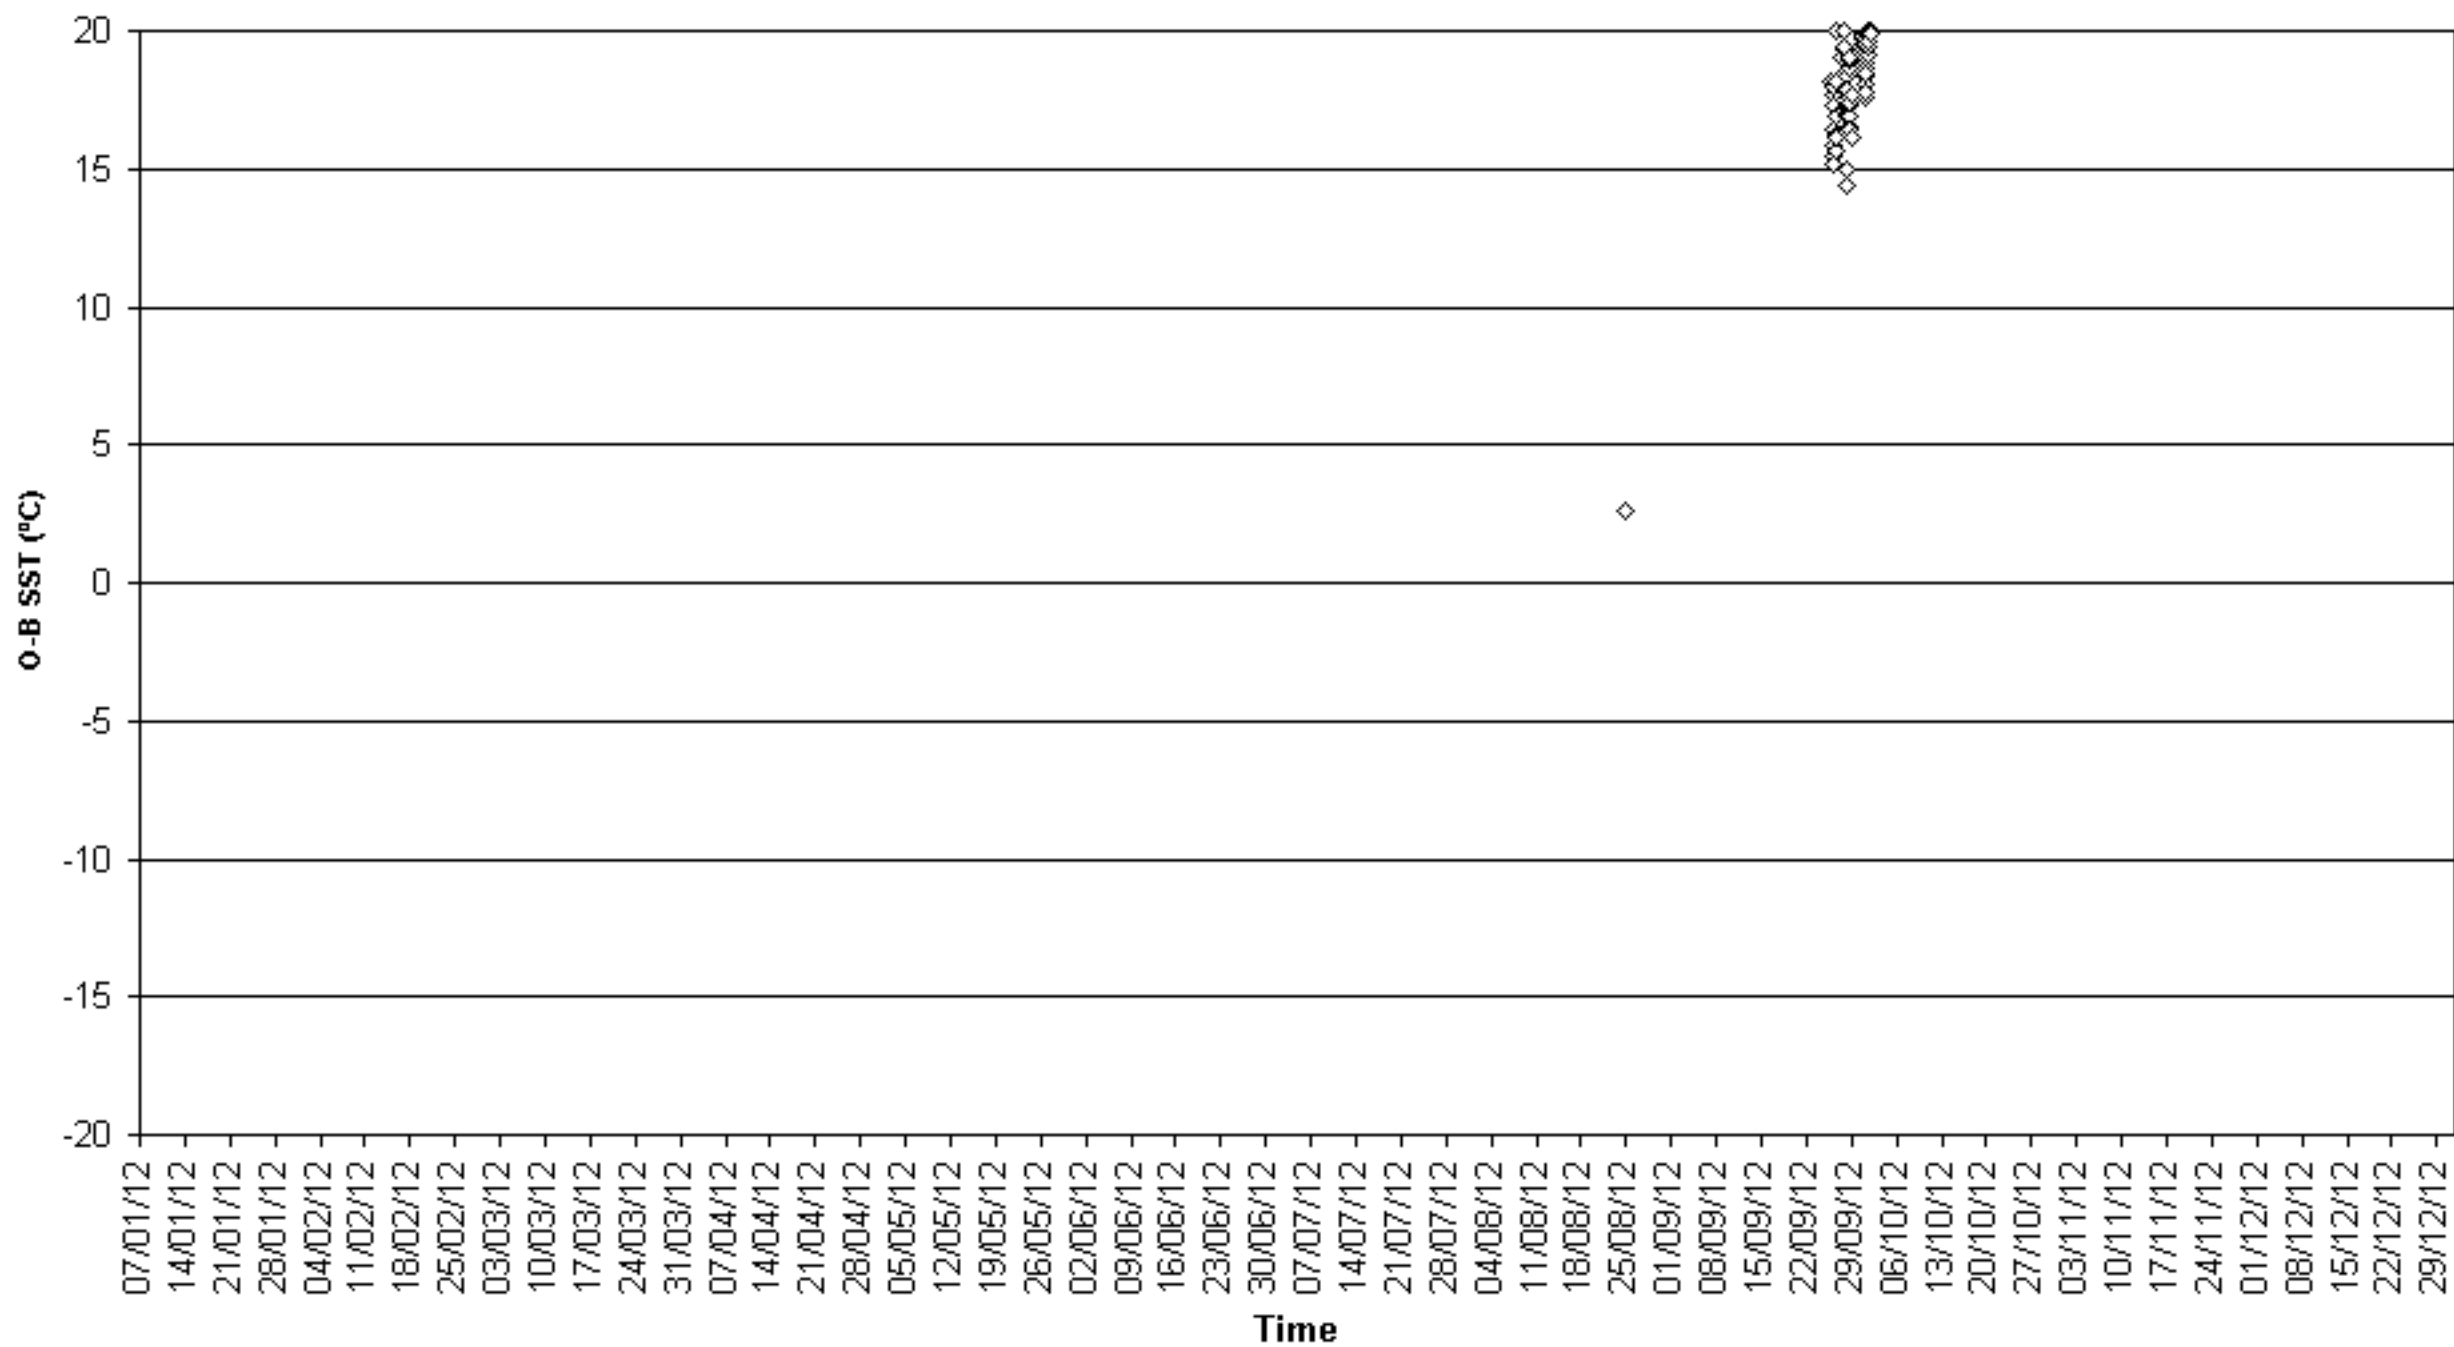


O-B SST (°C) for identifier 33593
Number of obs. plotted = 86 Number of outliers = 0

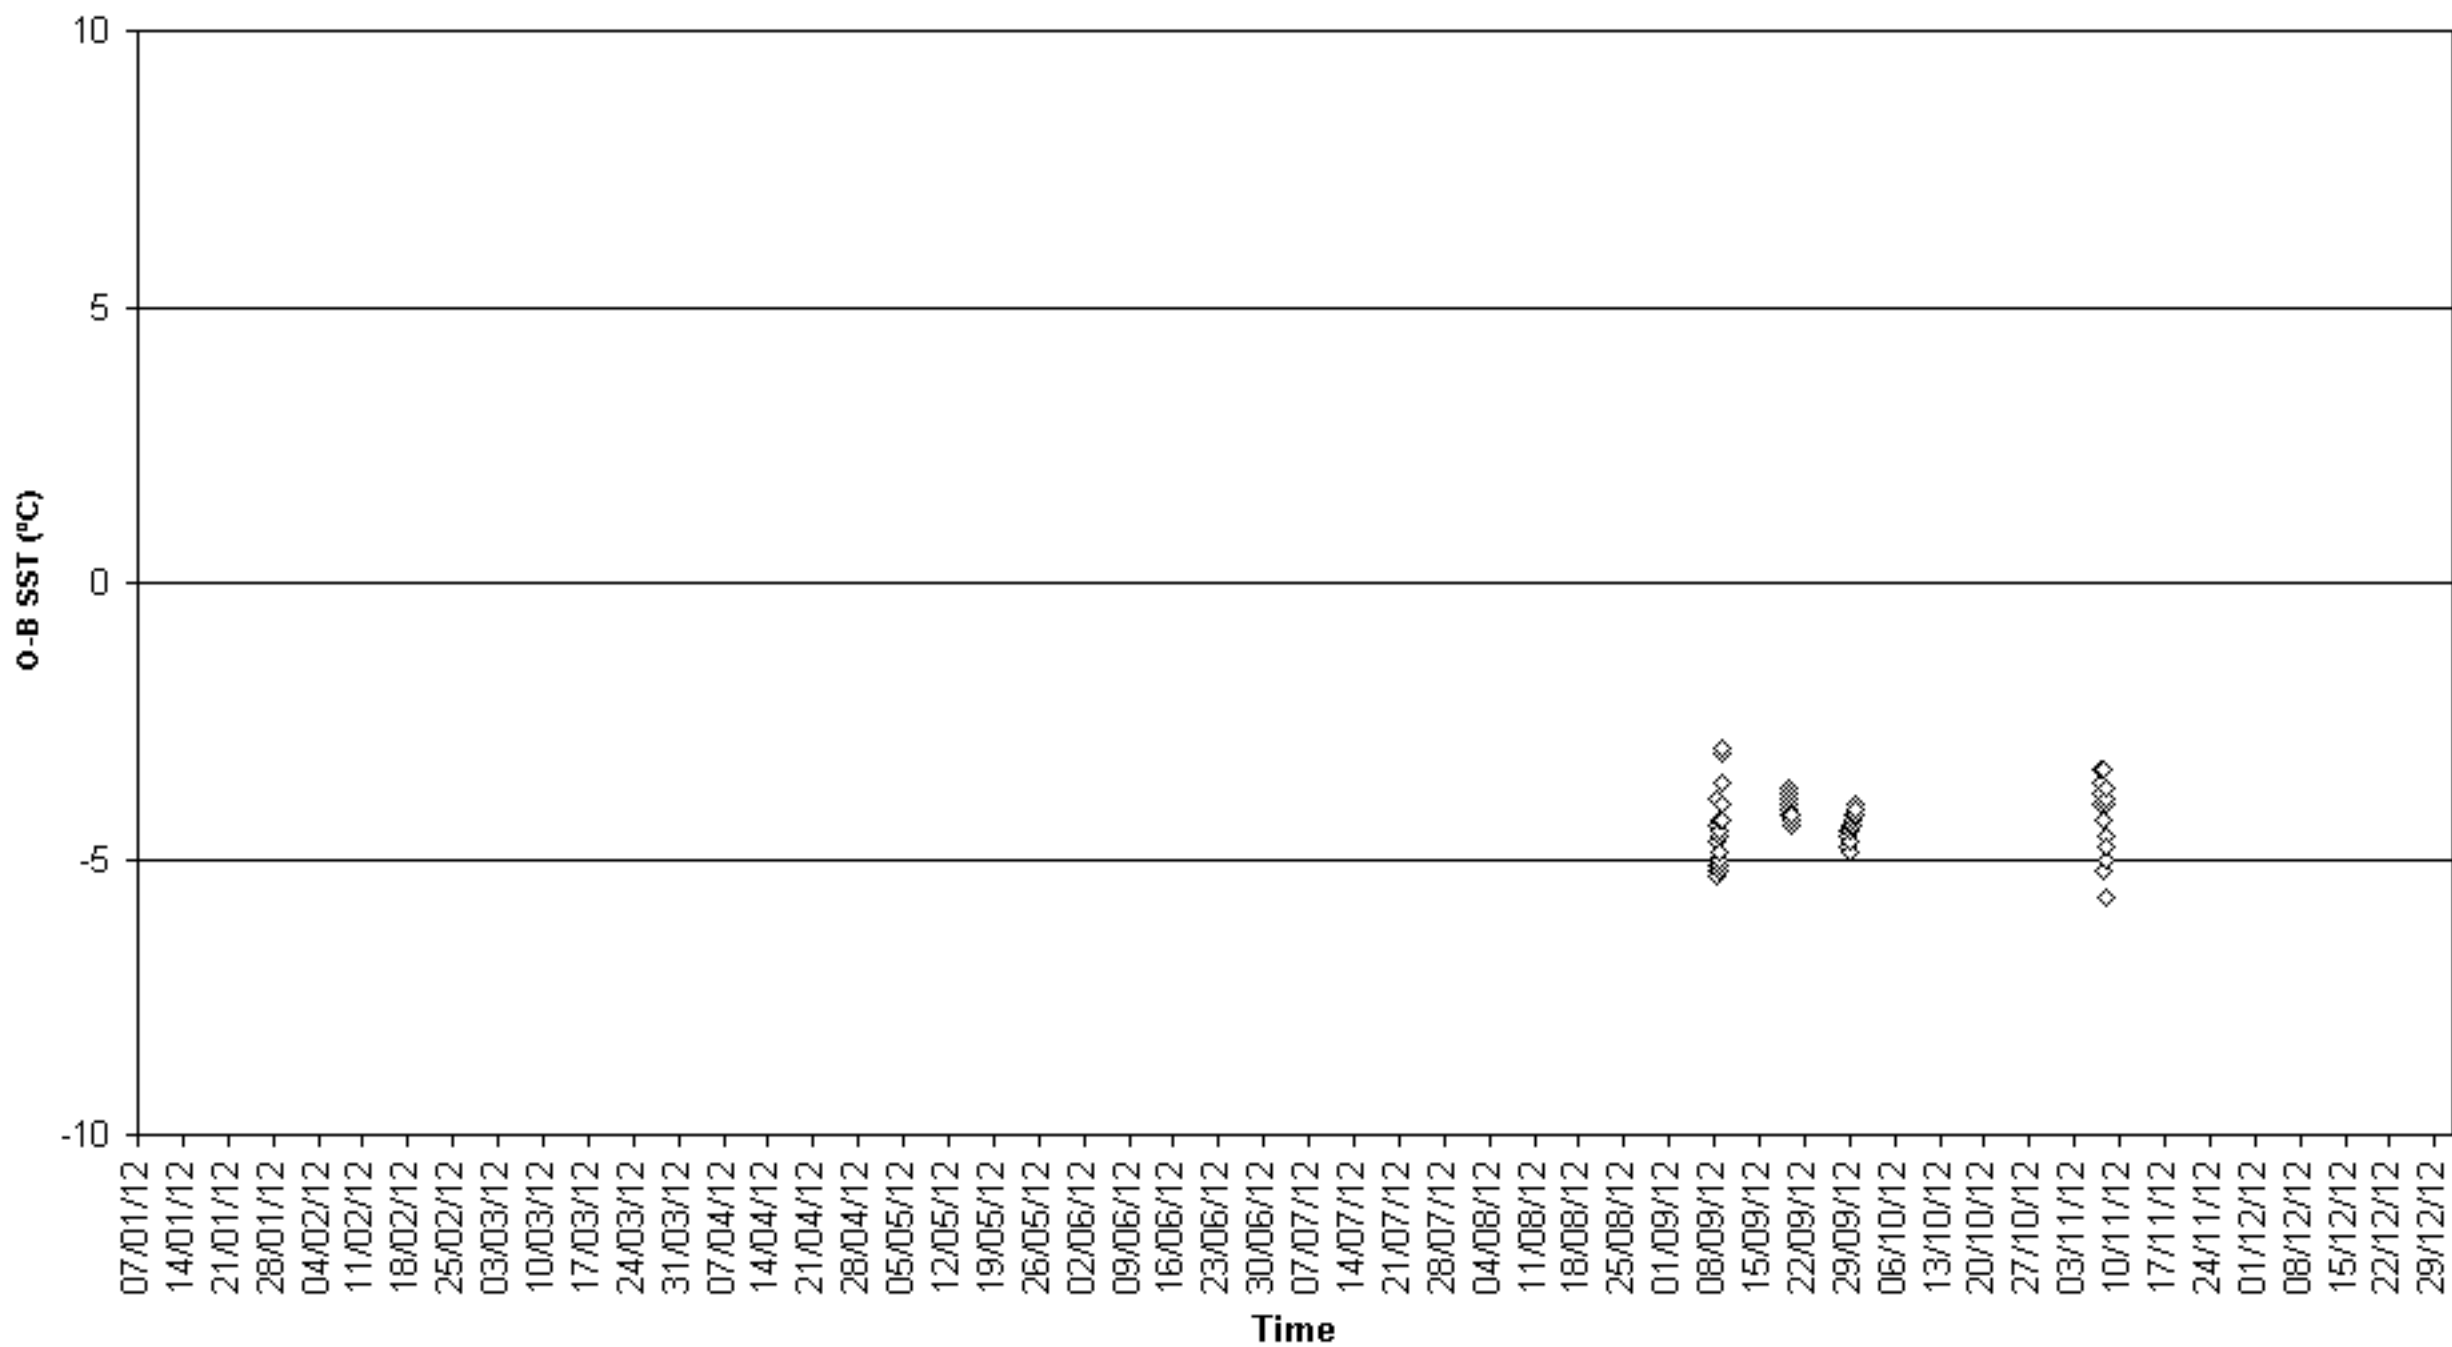


O-B SST (°C) for identifier 3FAV5
Number of obs. plotted = 153 Number of outliers = 0

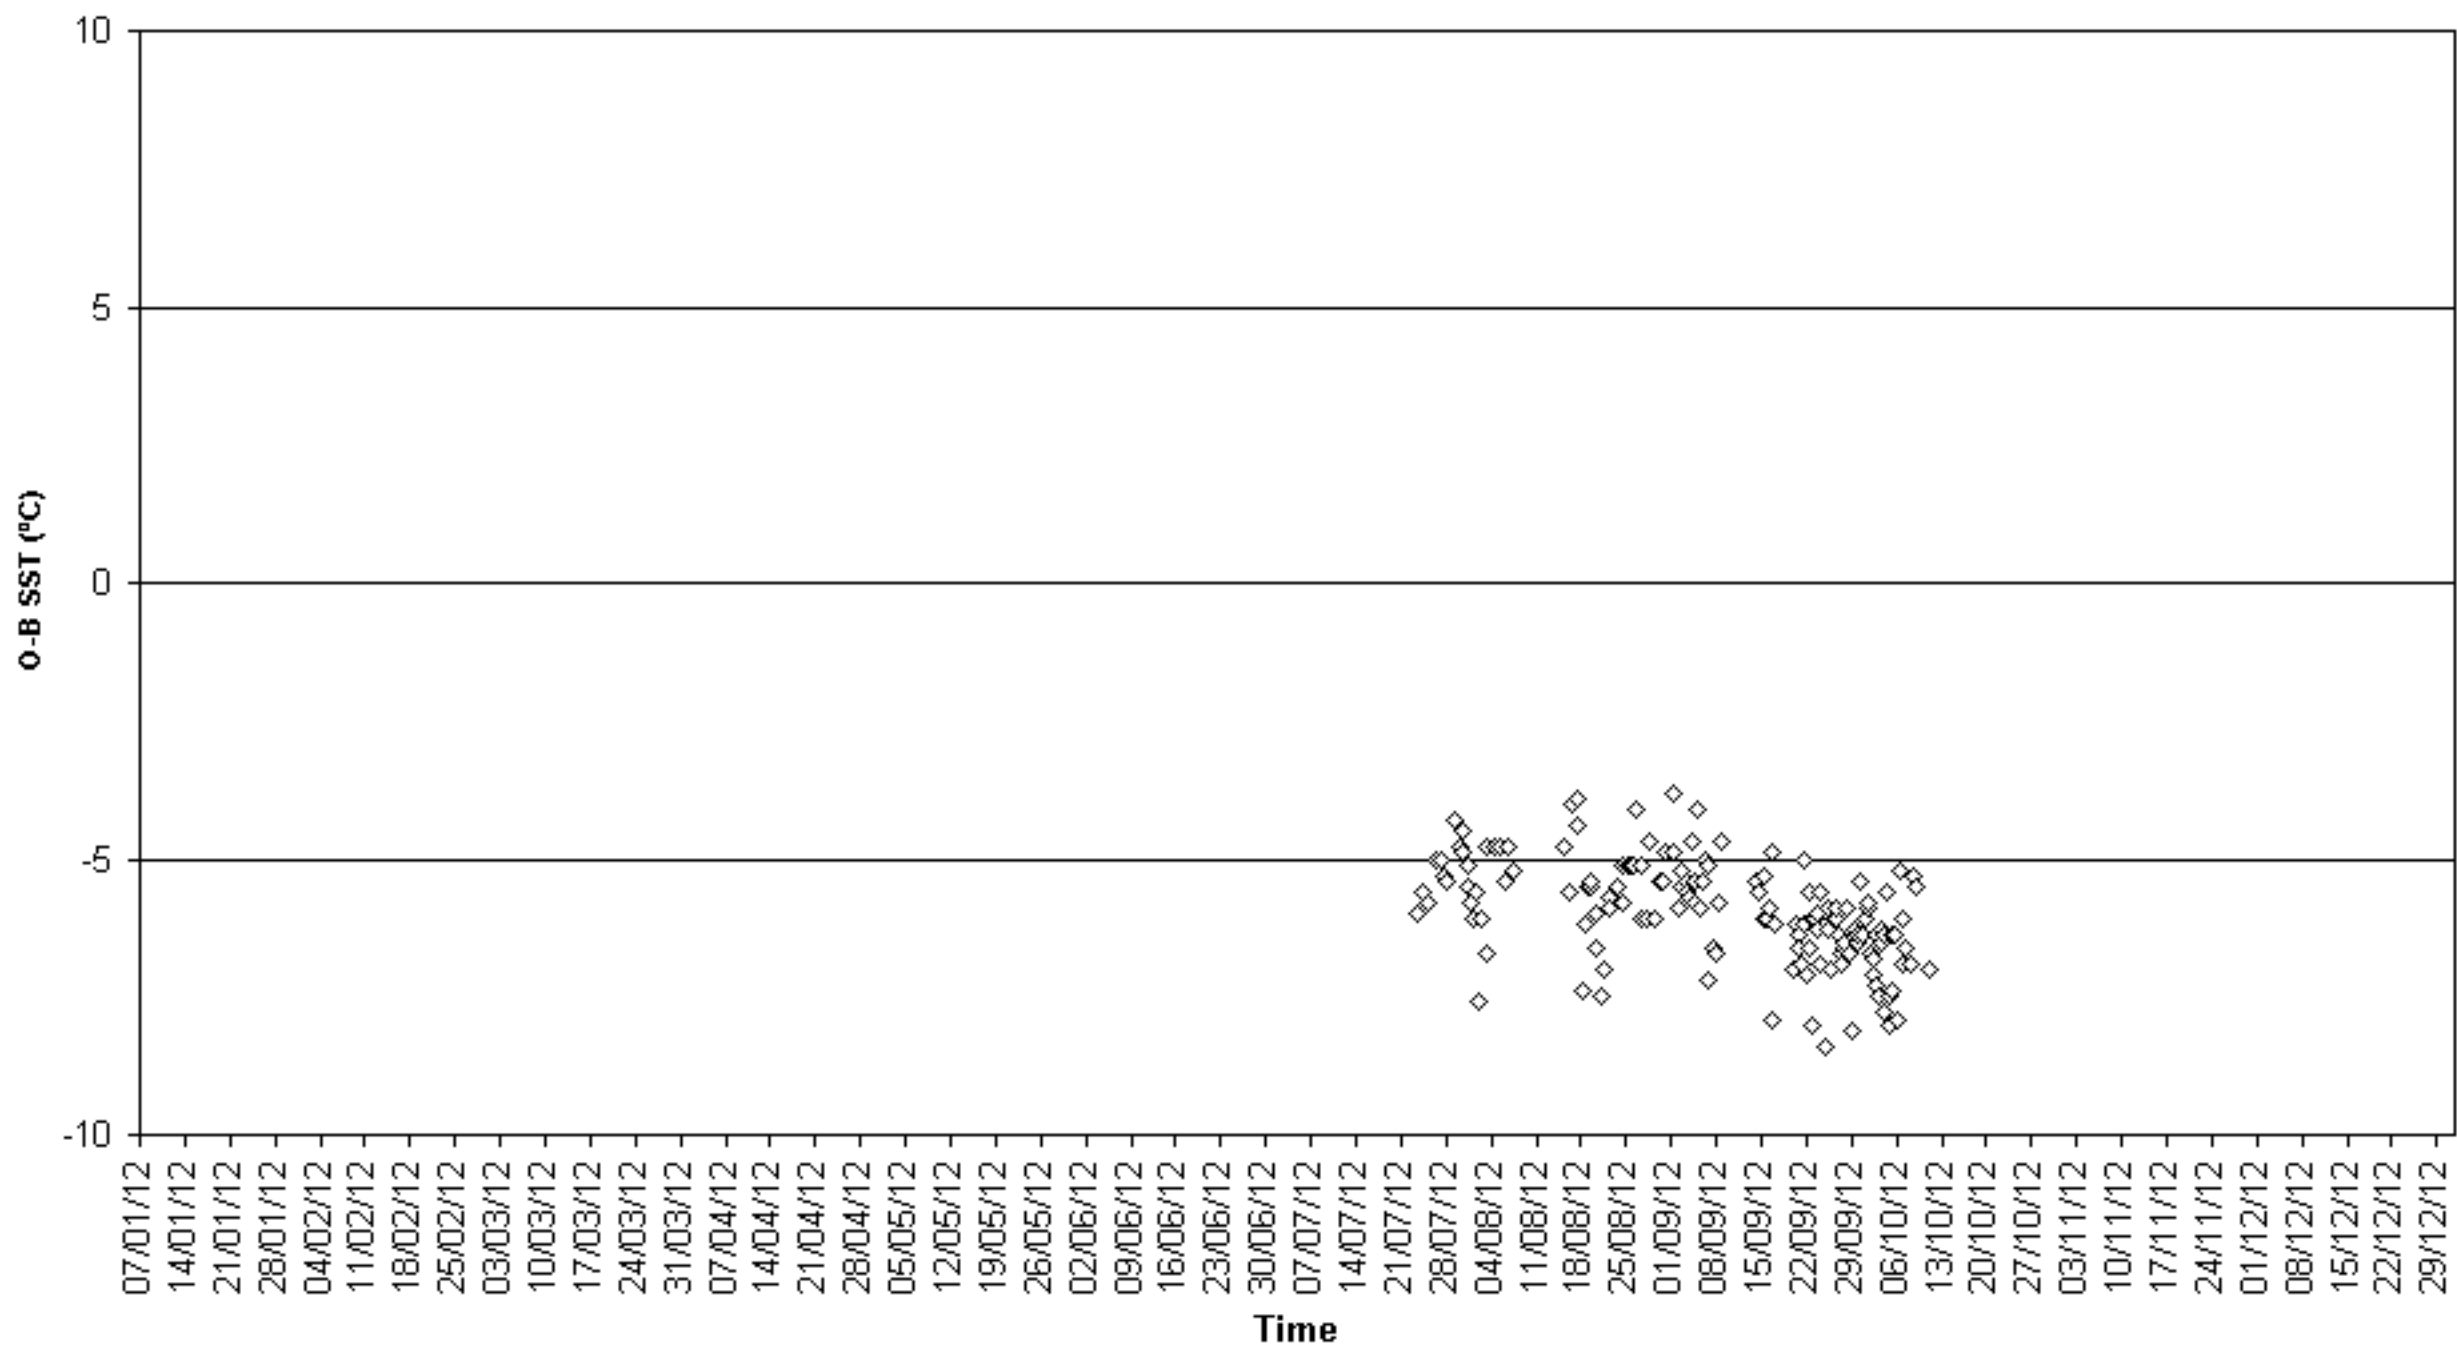


O-B SST (°C) for identifier 41591
Number of obs. plotted = 3 Number of outliers = 139

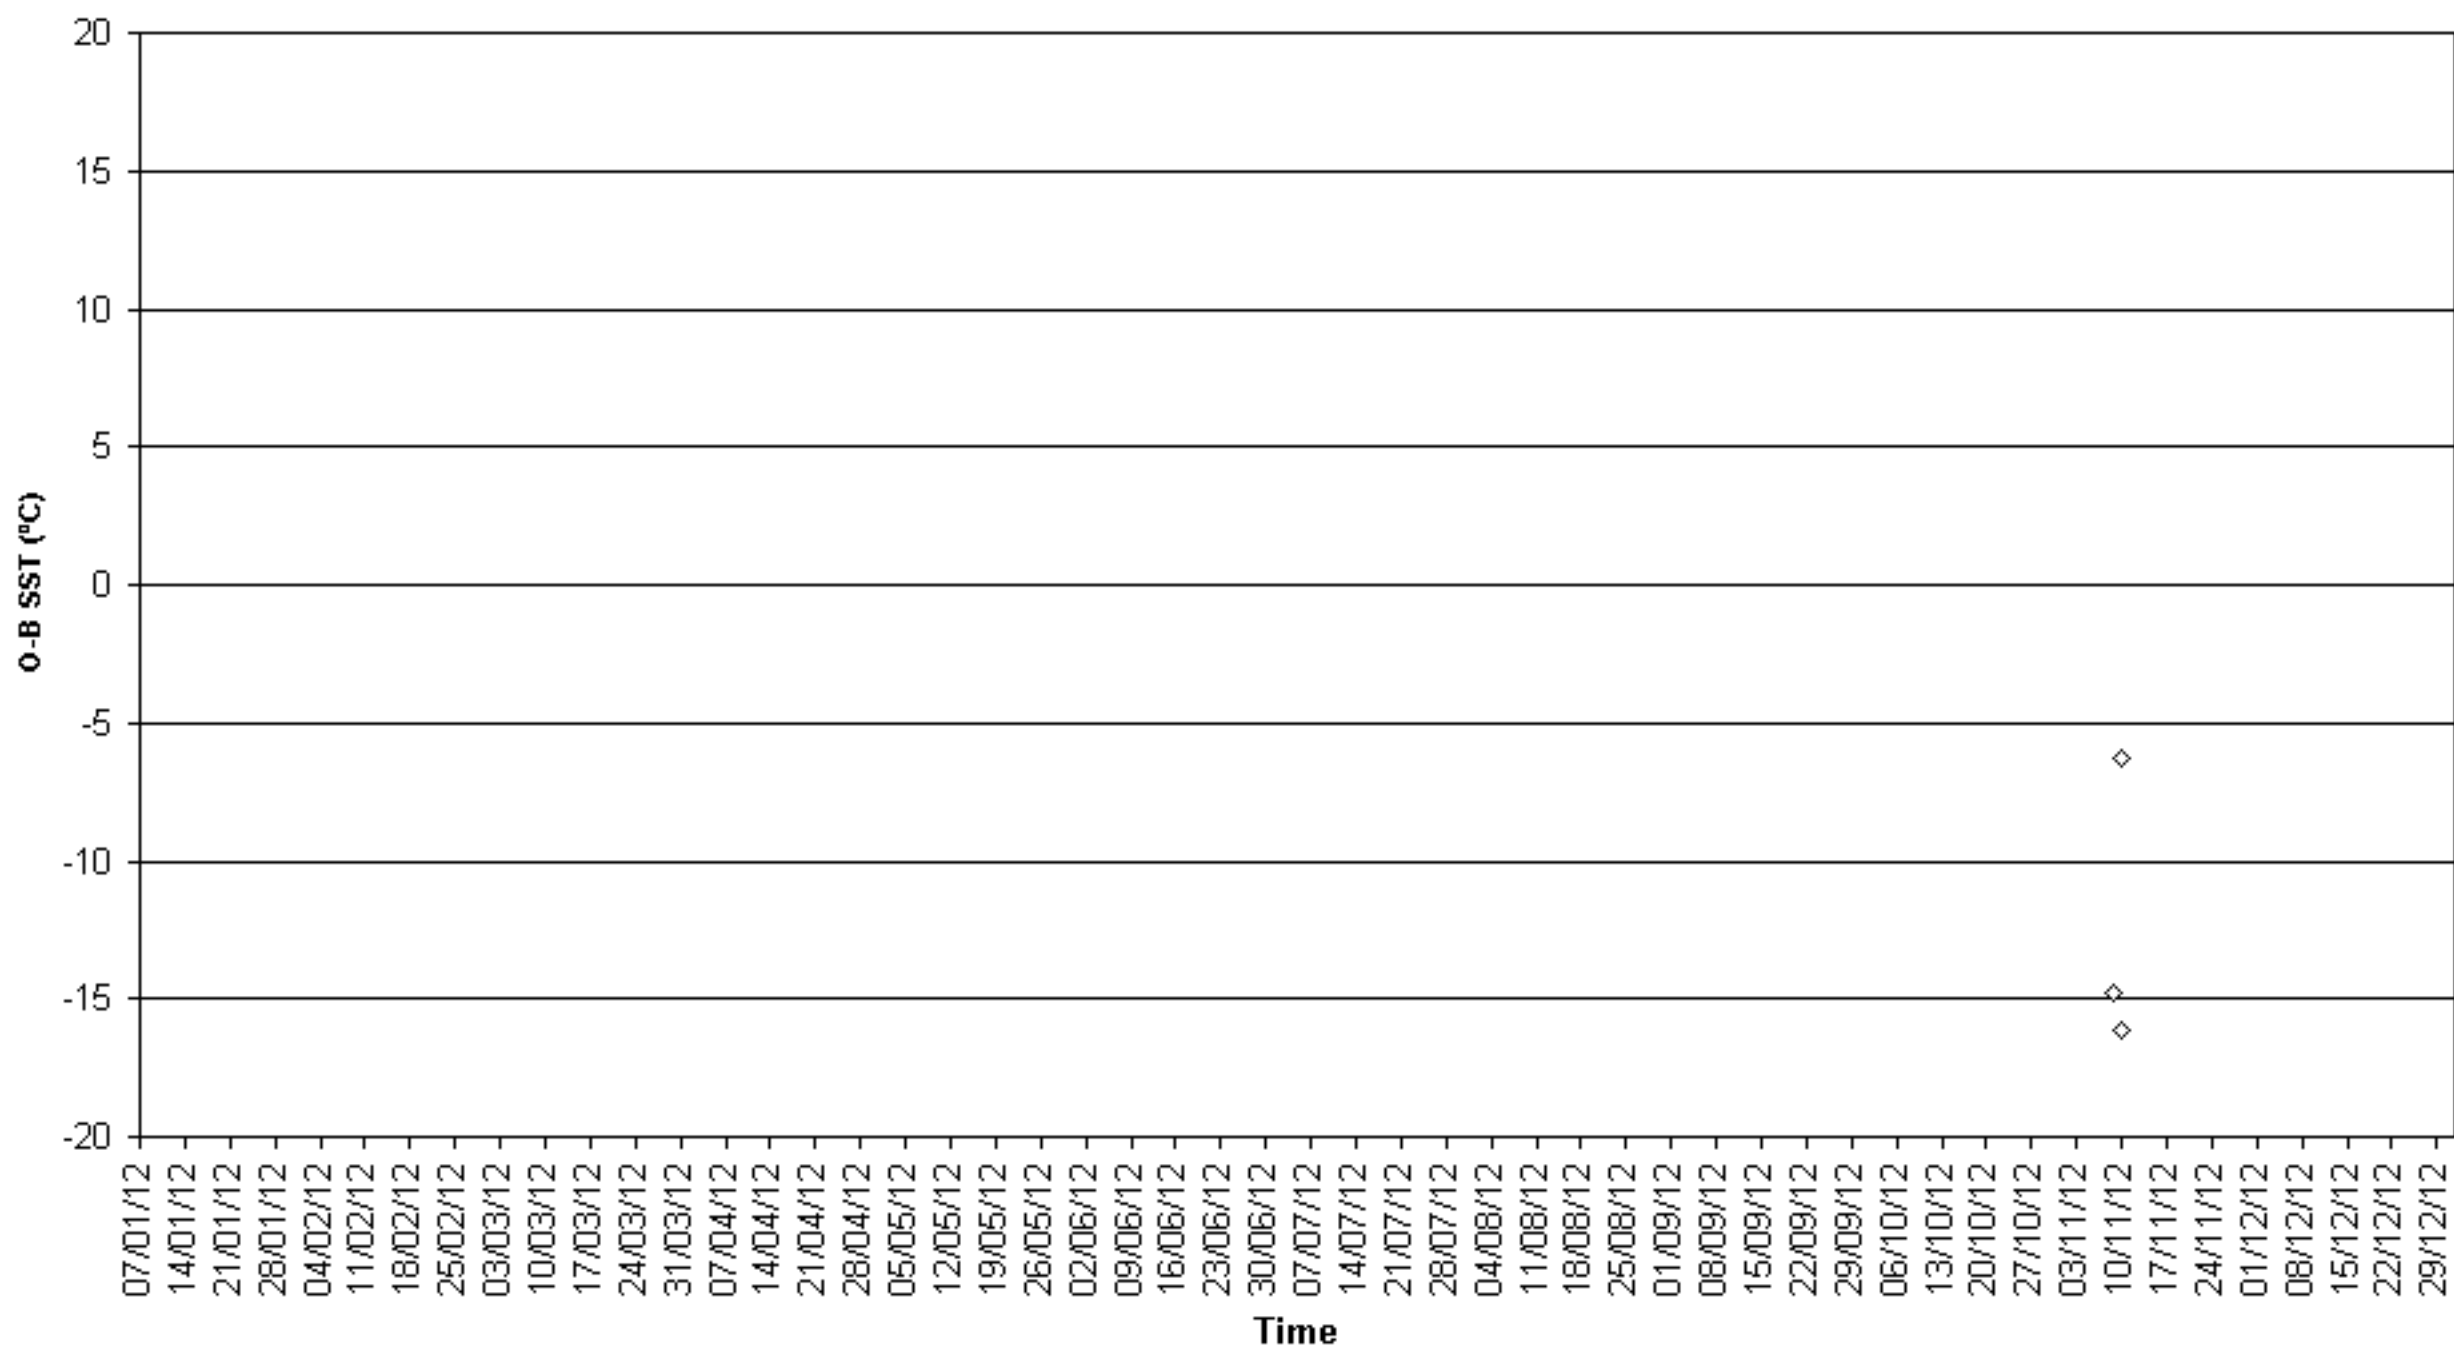

O-B SST (°C) for identifier 41594
Number of obs. plotted = 2 Number of outliers = 131

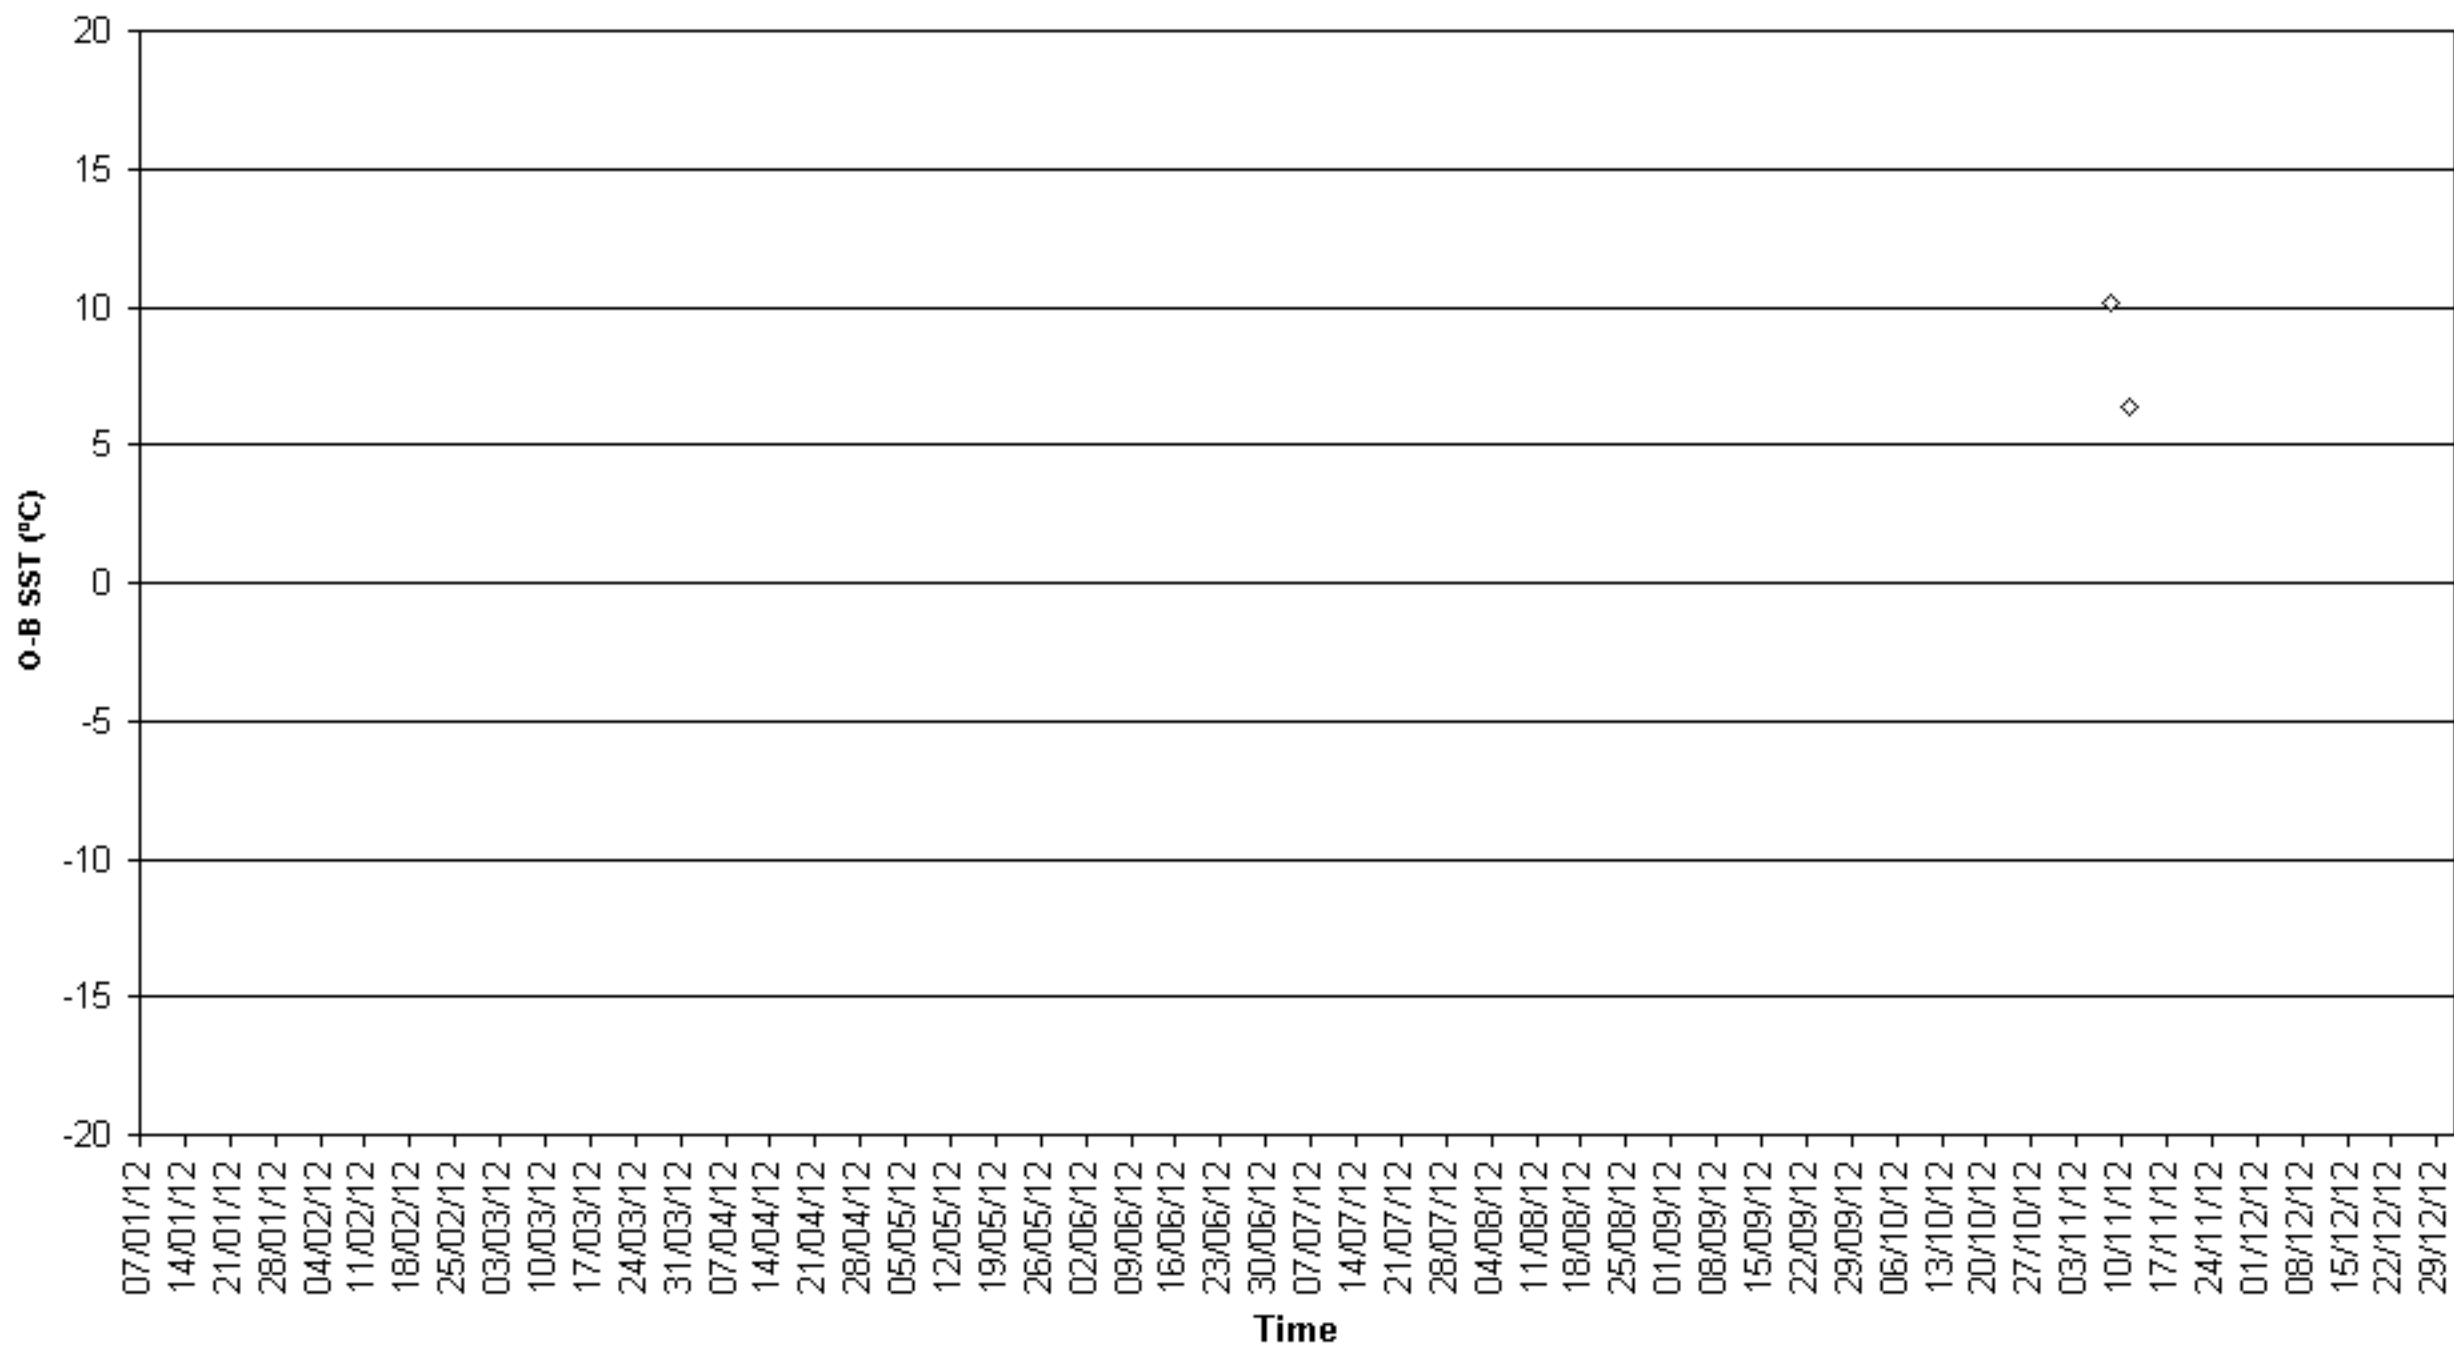


O-B SST (°C) for identifier 41975
Number of obs. plotted = 467 Number of outliers = 0

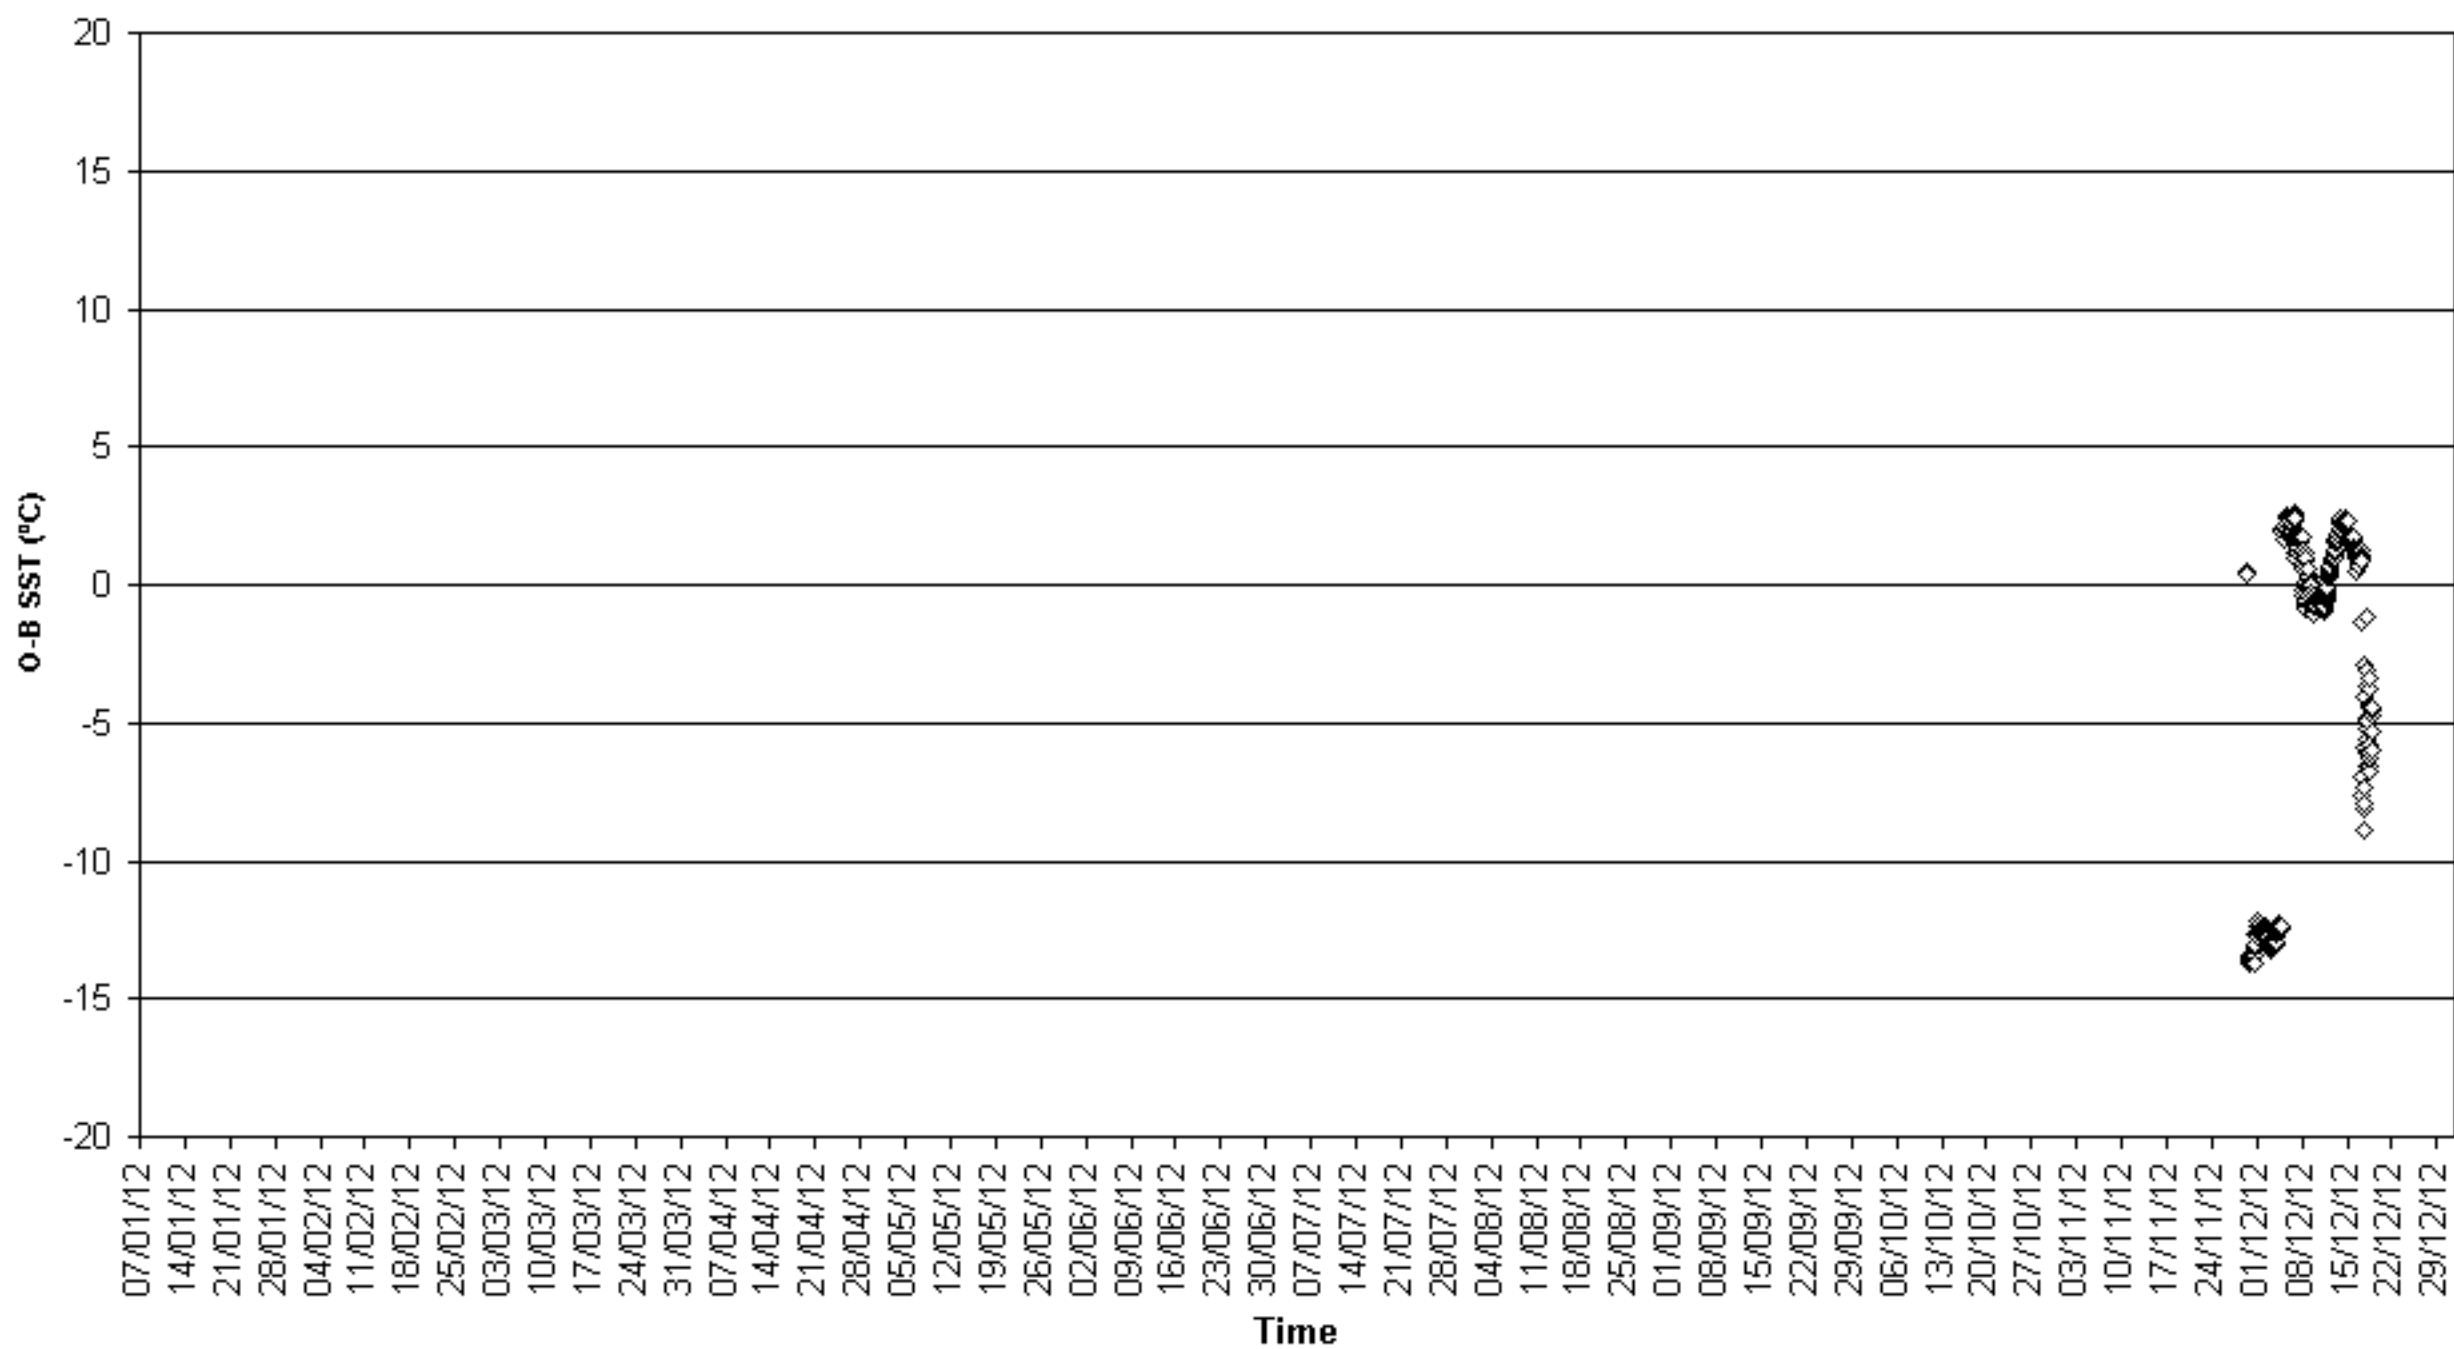


O-B SST (°C) for identifier 42554


Number of obs. plotted = 24388 Number of outliers = 247

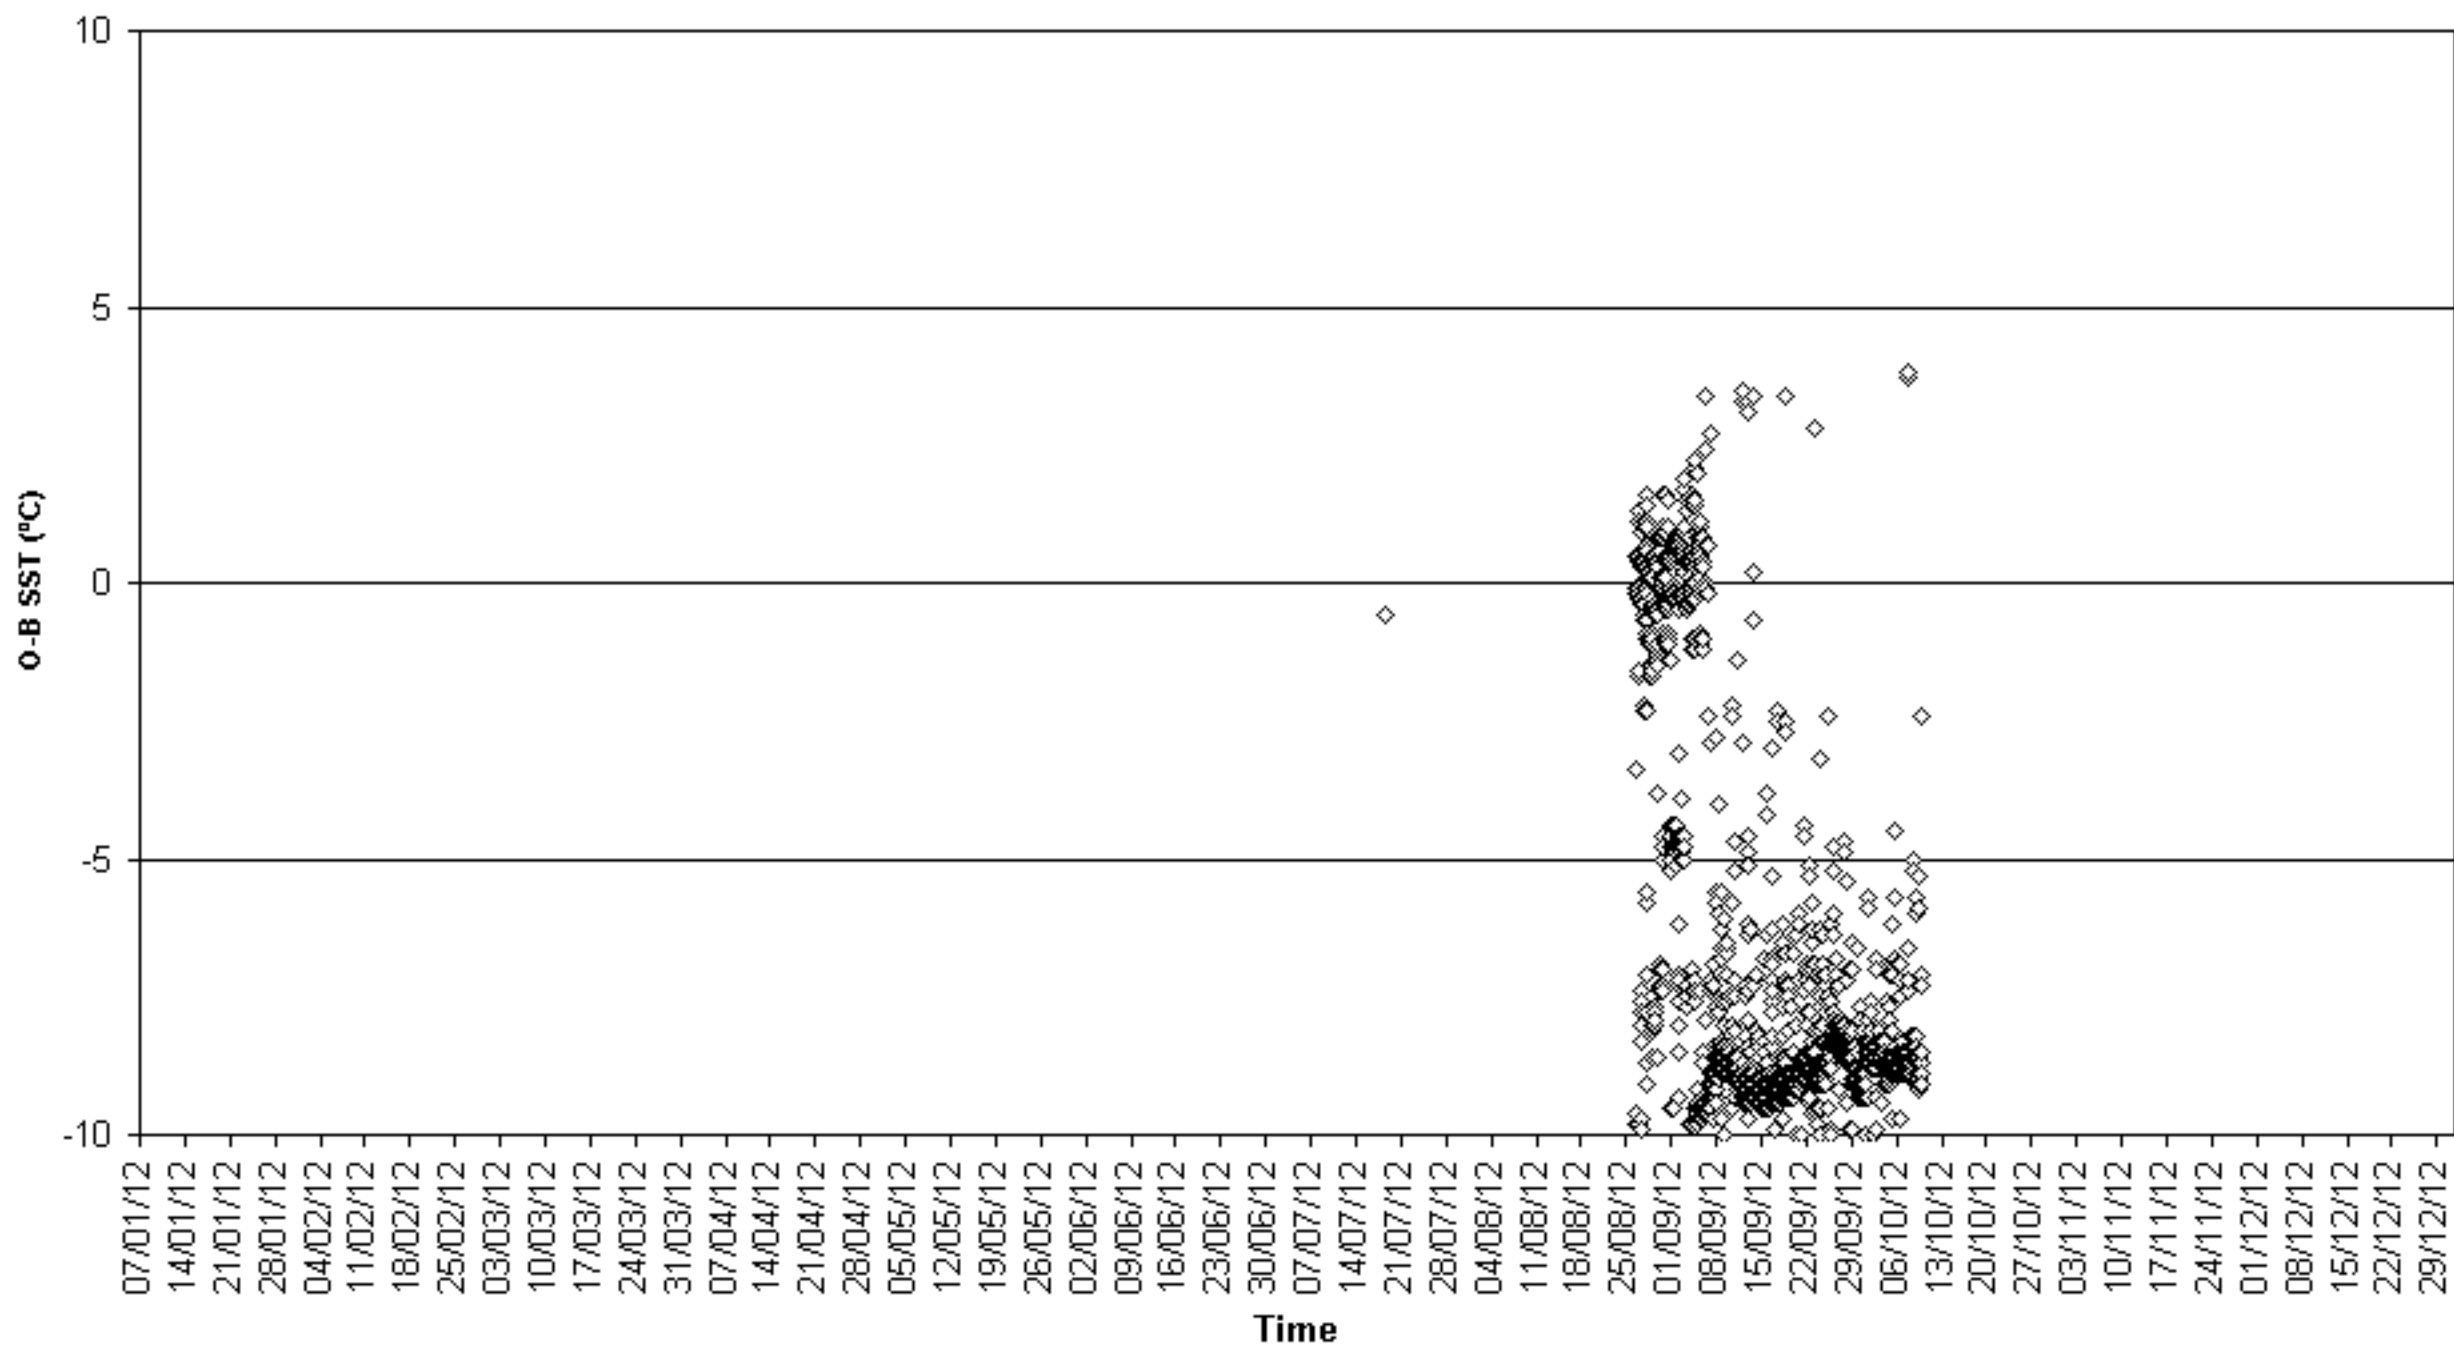


O-B SST (°C) for identifier 43922
Number of obs. plotted = 177 Number of outliers = 0

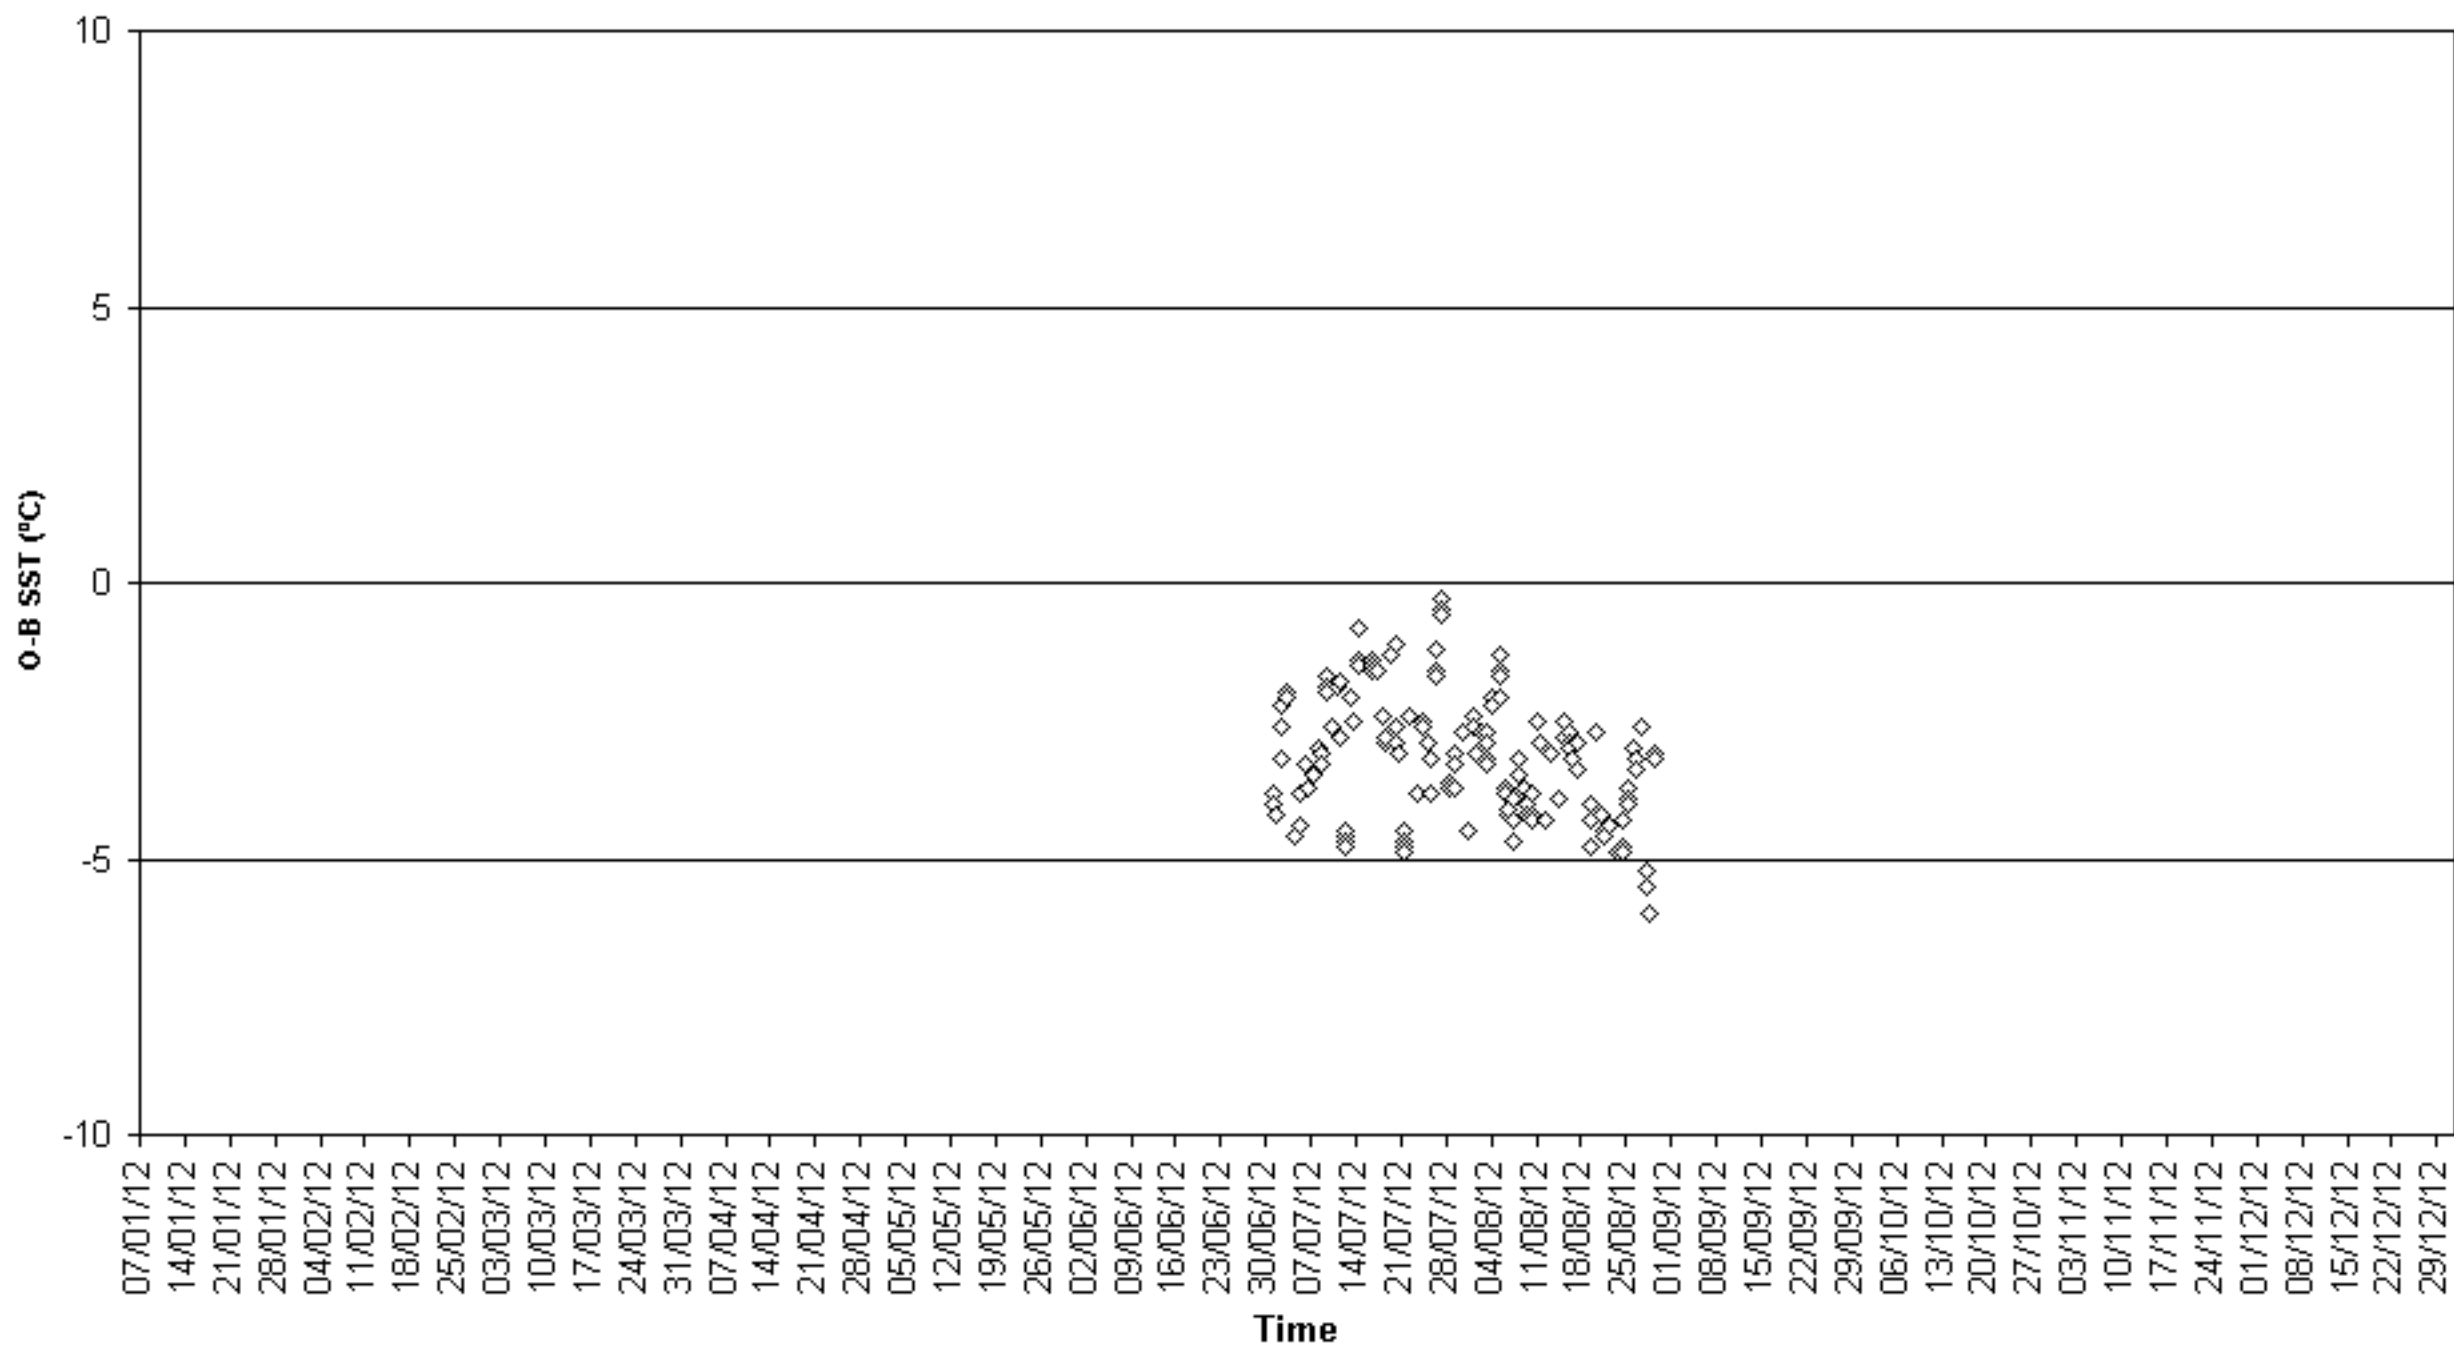


O-B SST (°C) for identifier 44137
Number of obs. plotted = 3552 Number of outliers = 116

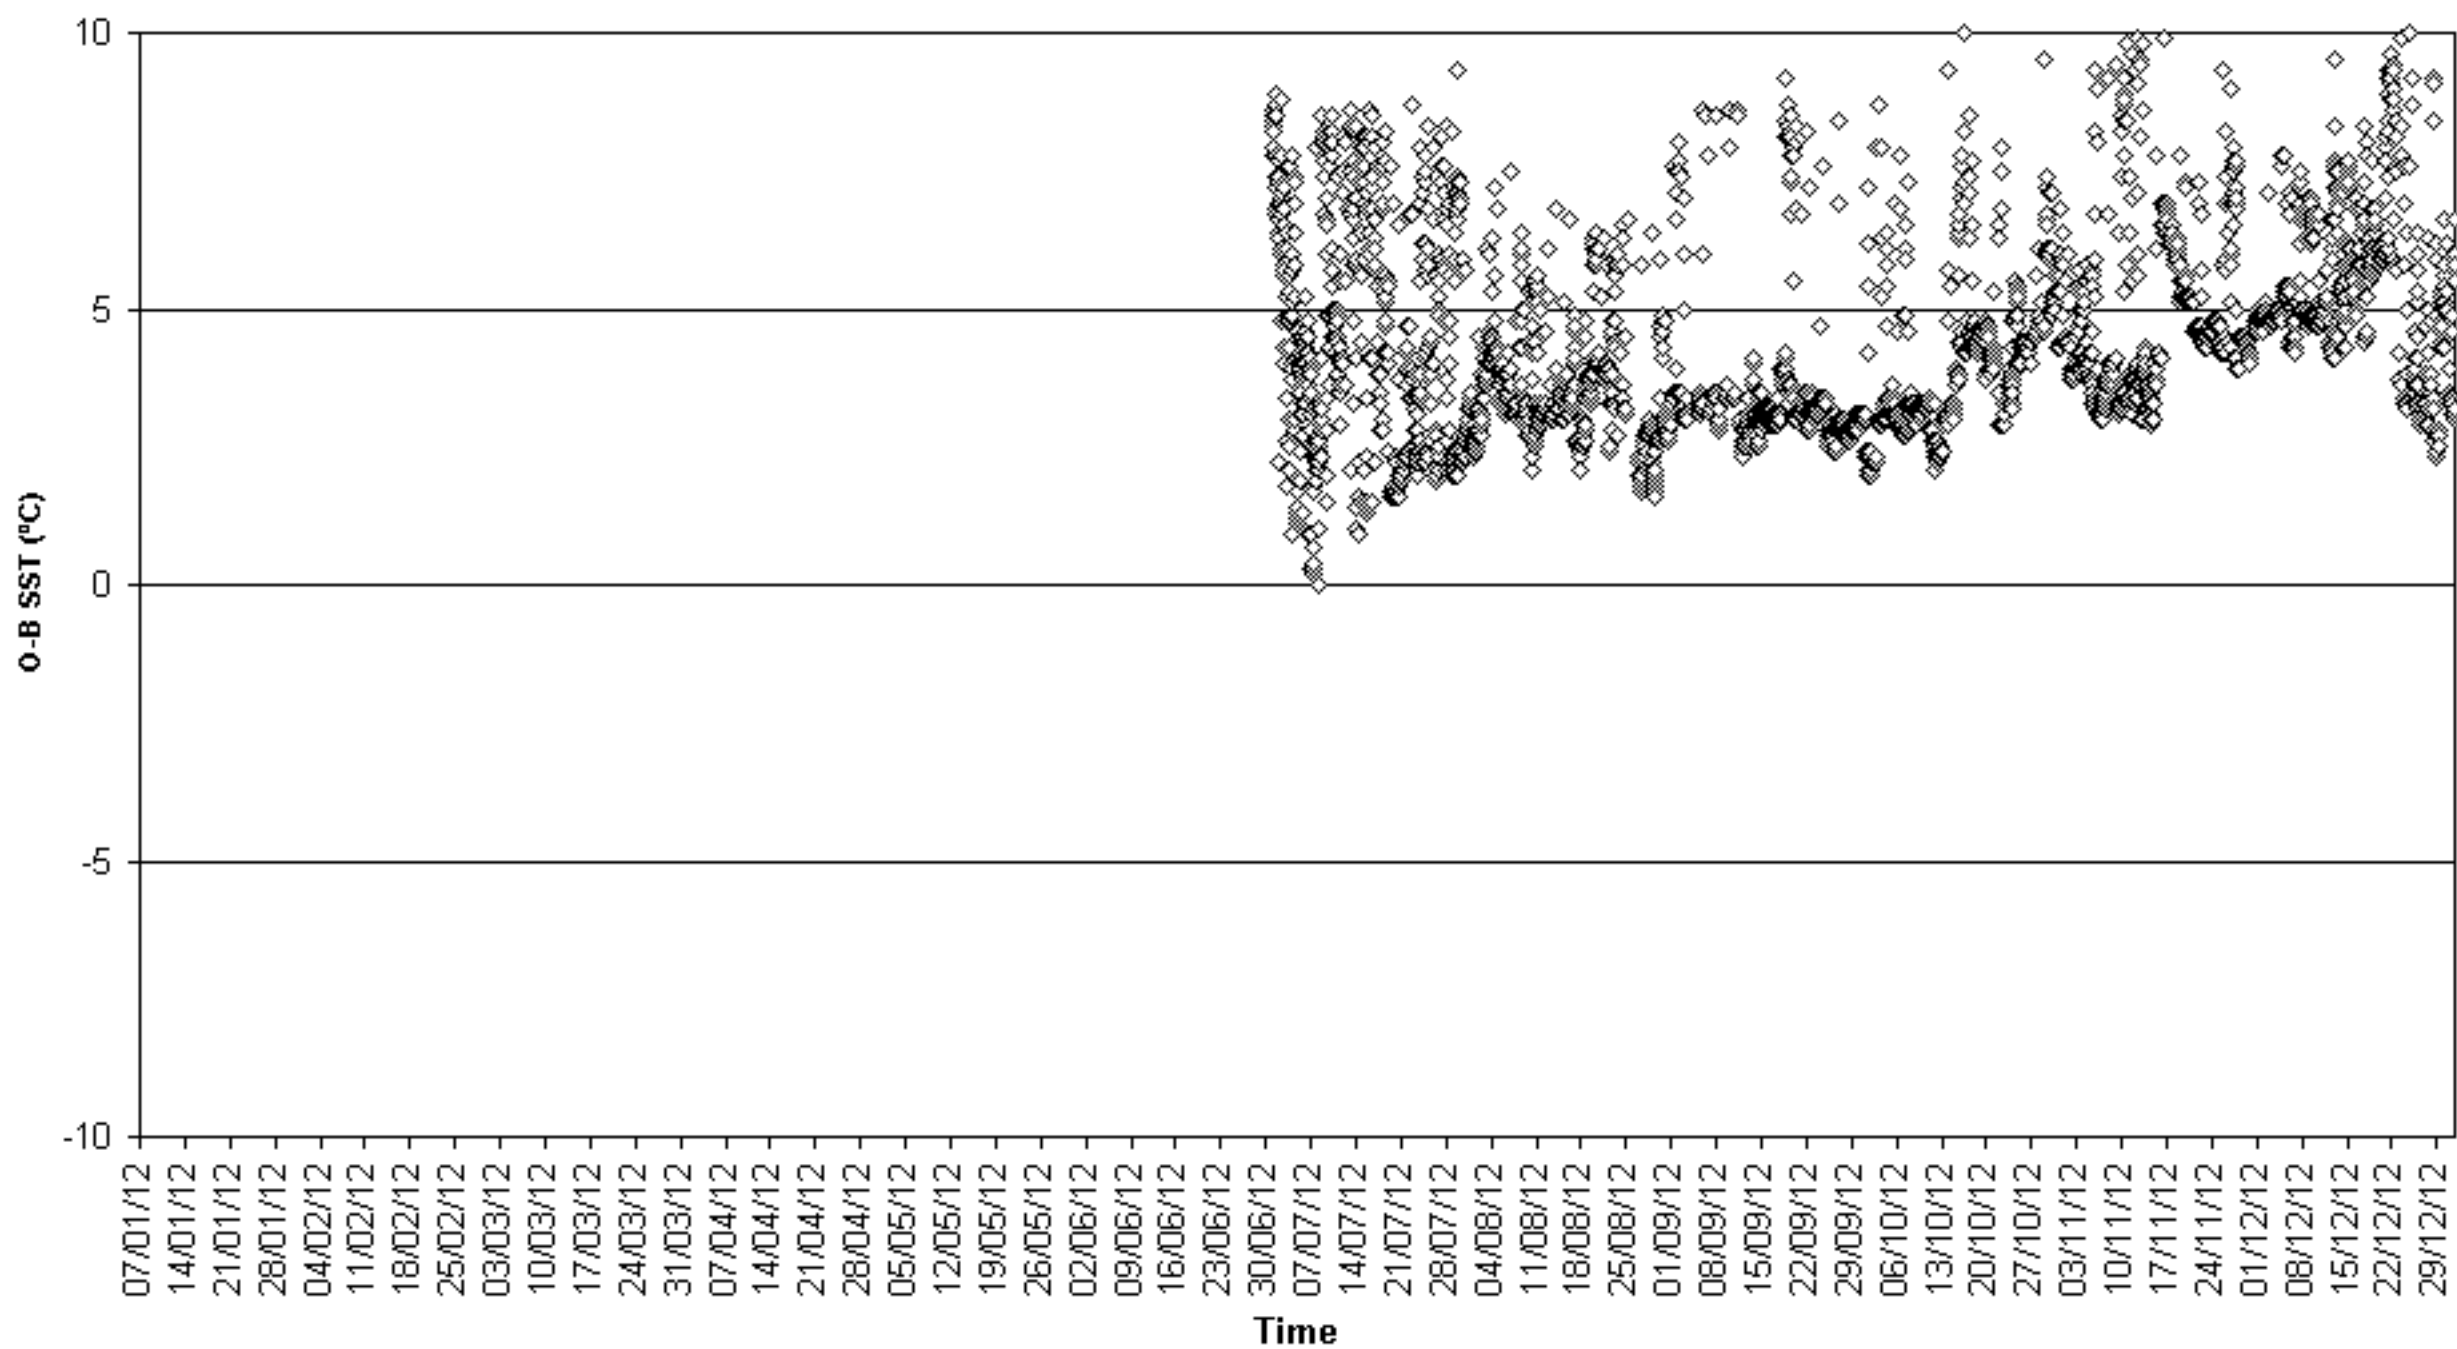


O-B SST (°C) for identifier 46567
Number of obs. plotted = 59 Number of outliers = 56

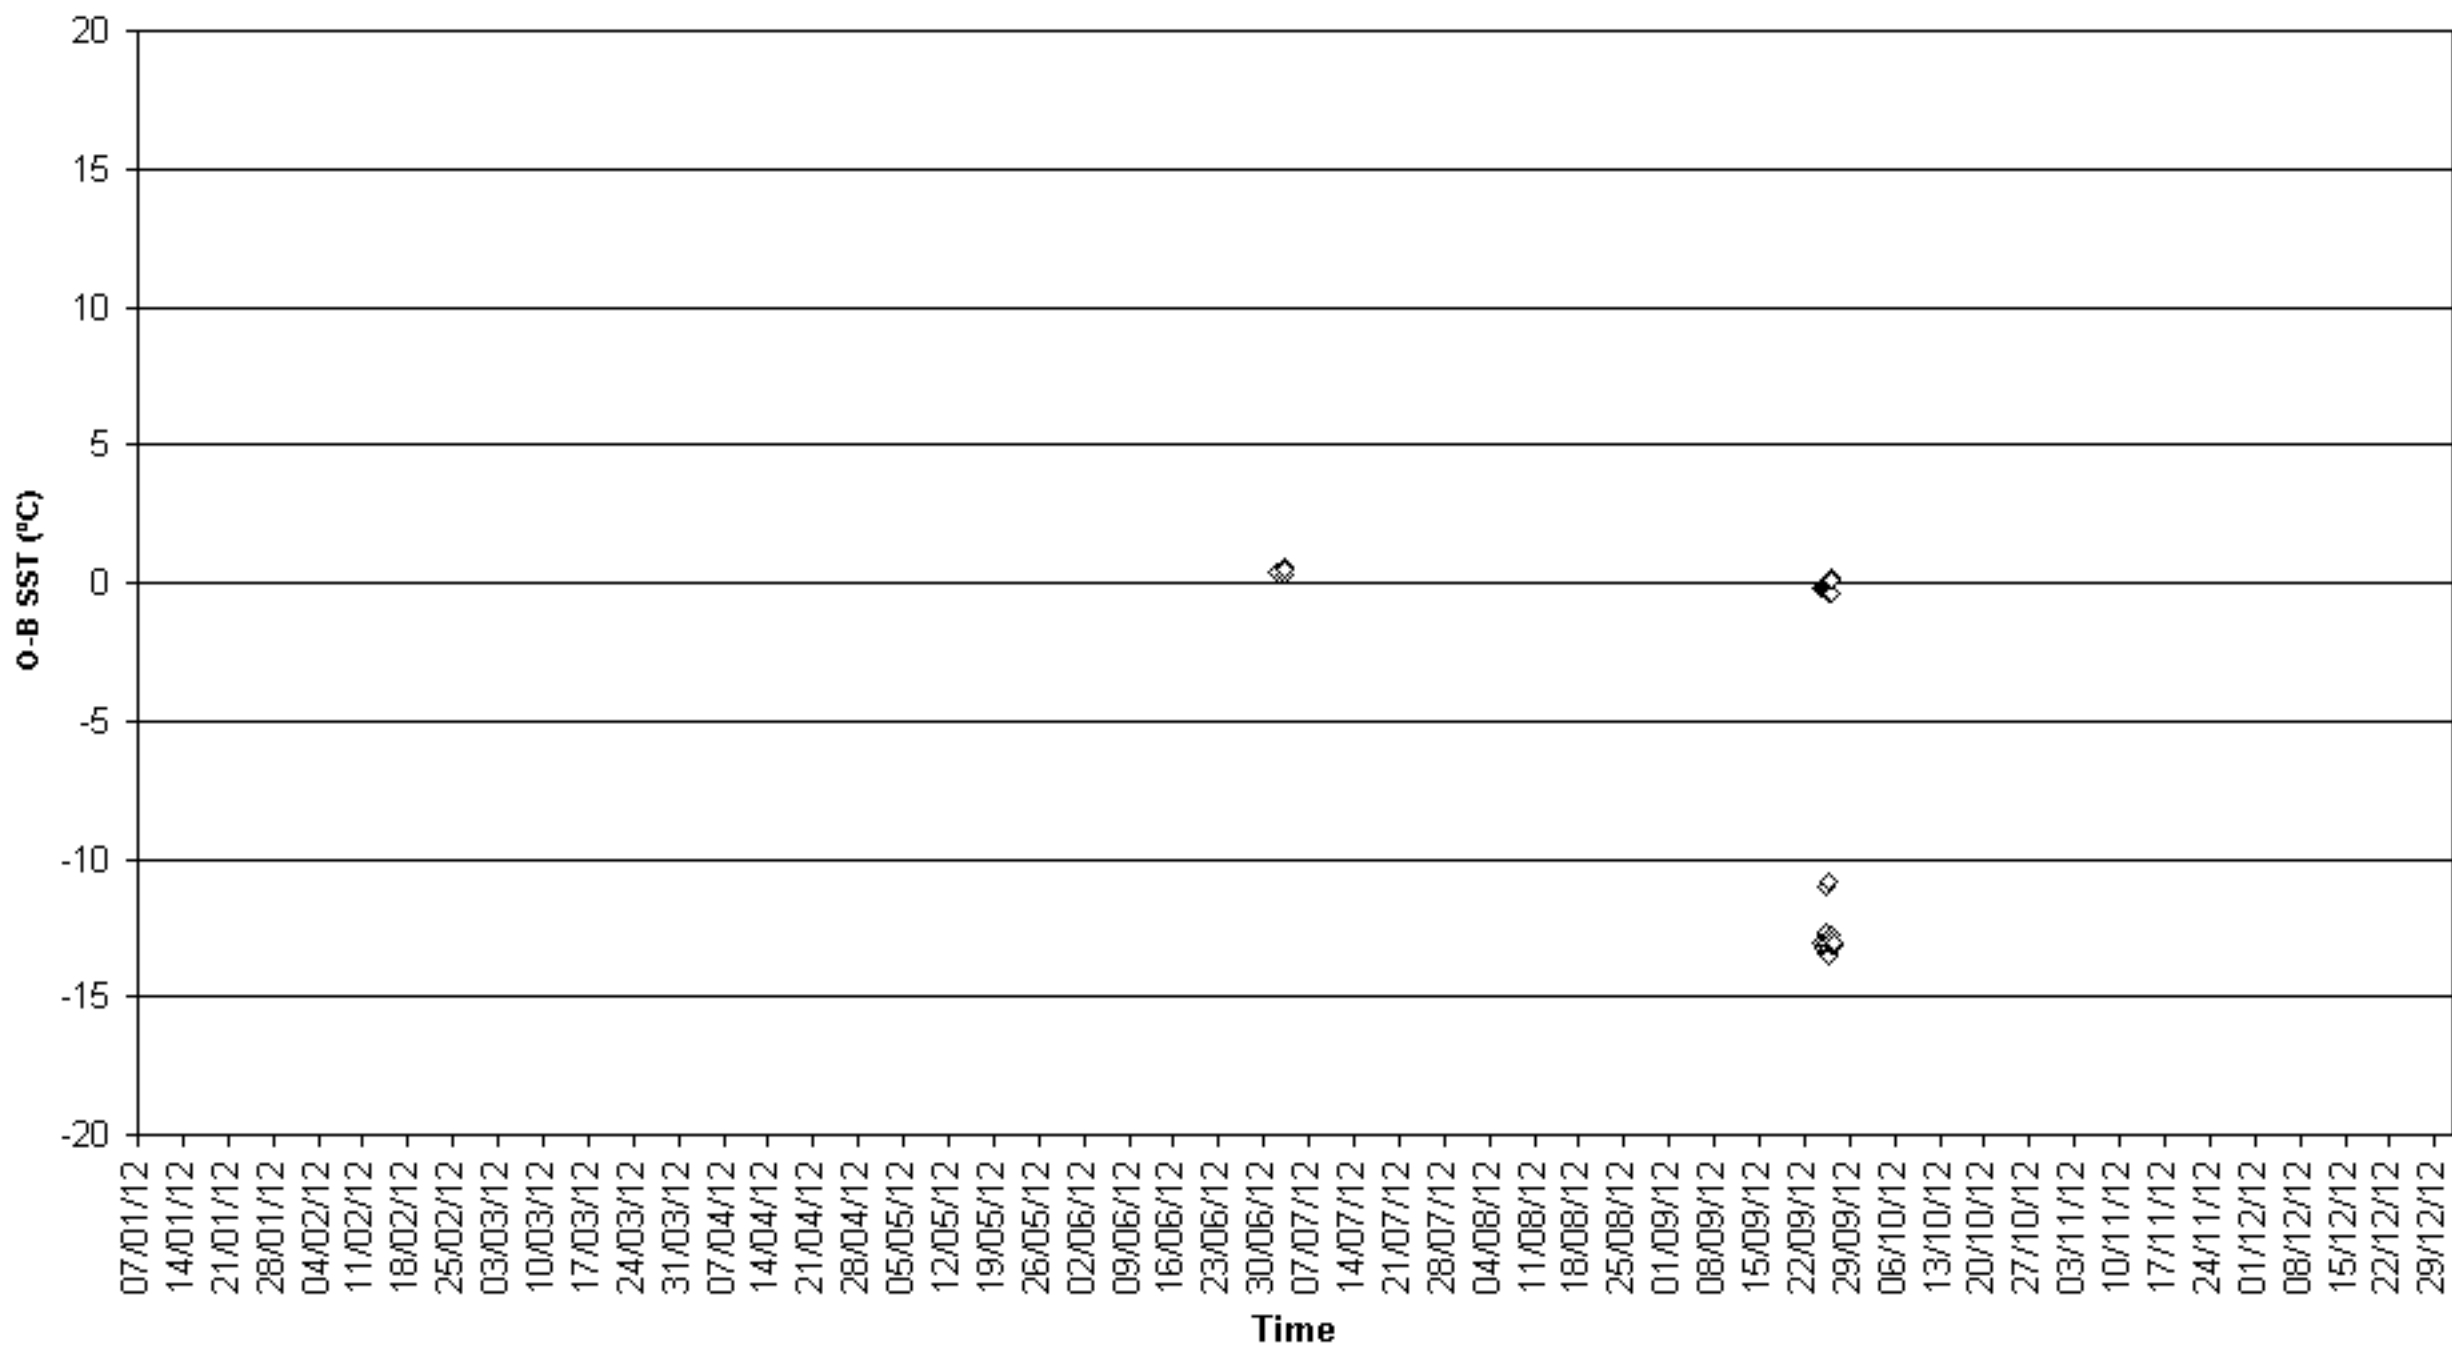

O-B SST (°C) for identifier 48659
Number of obs. plotted = 253 Number of outliers = 110

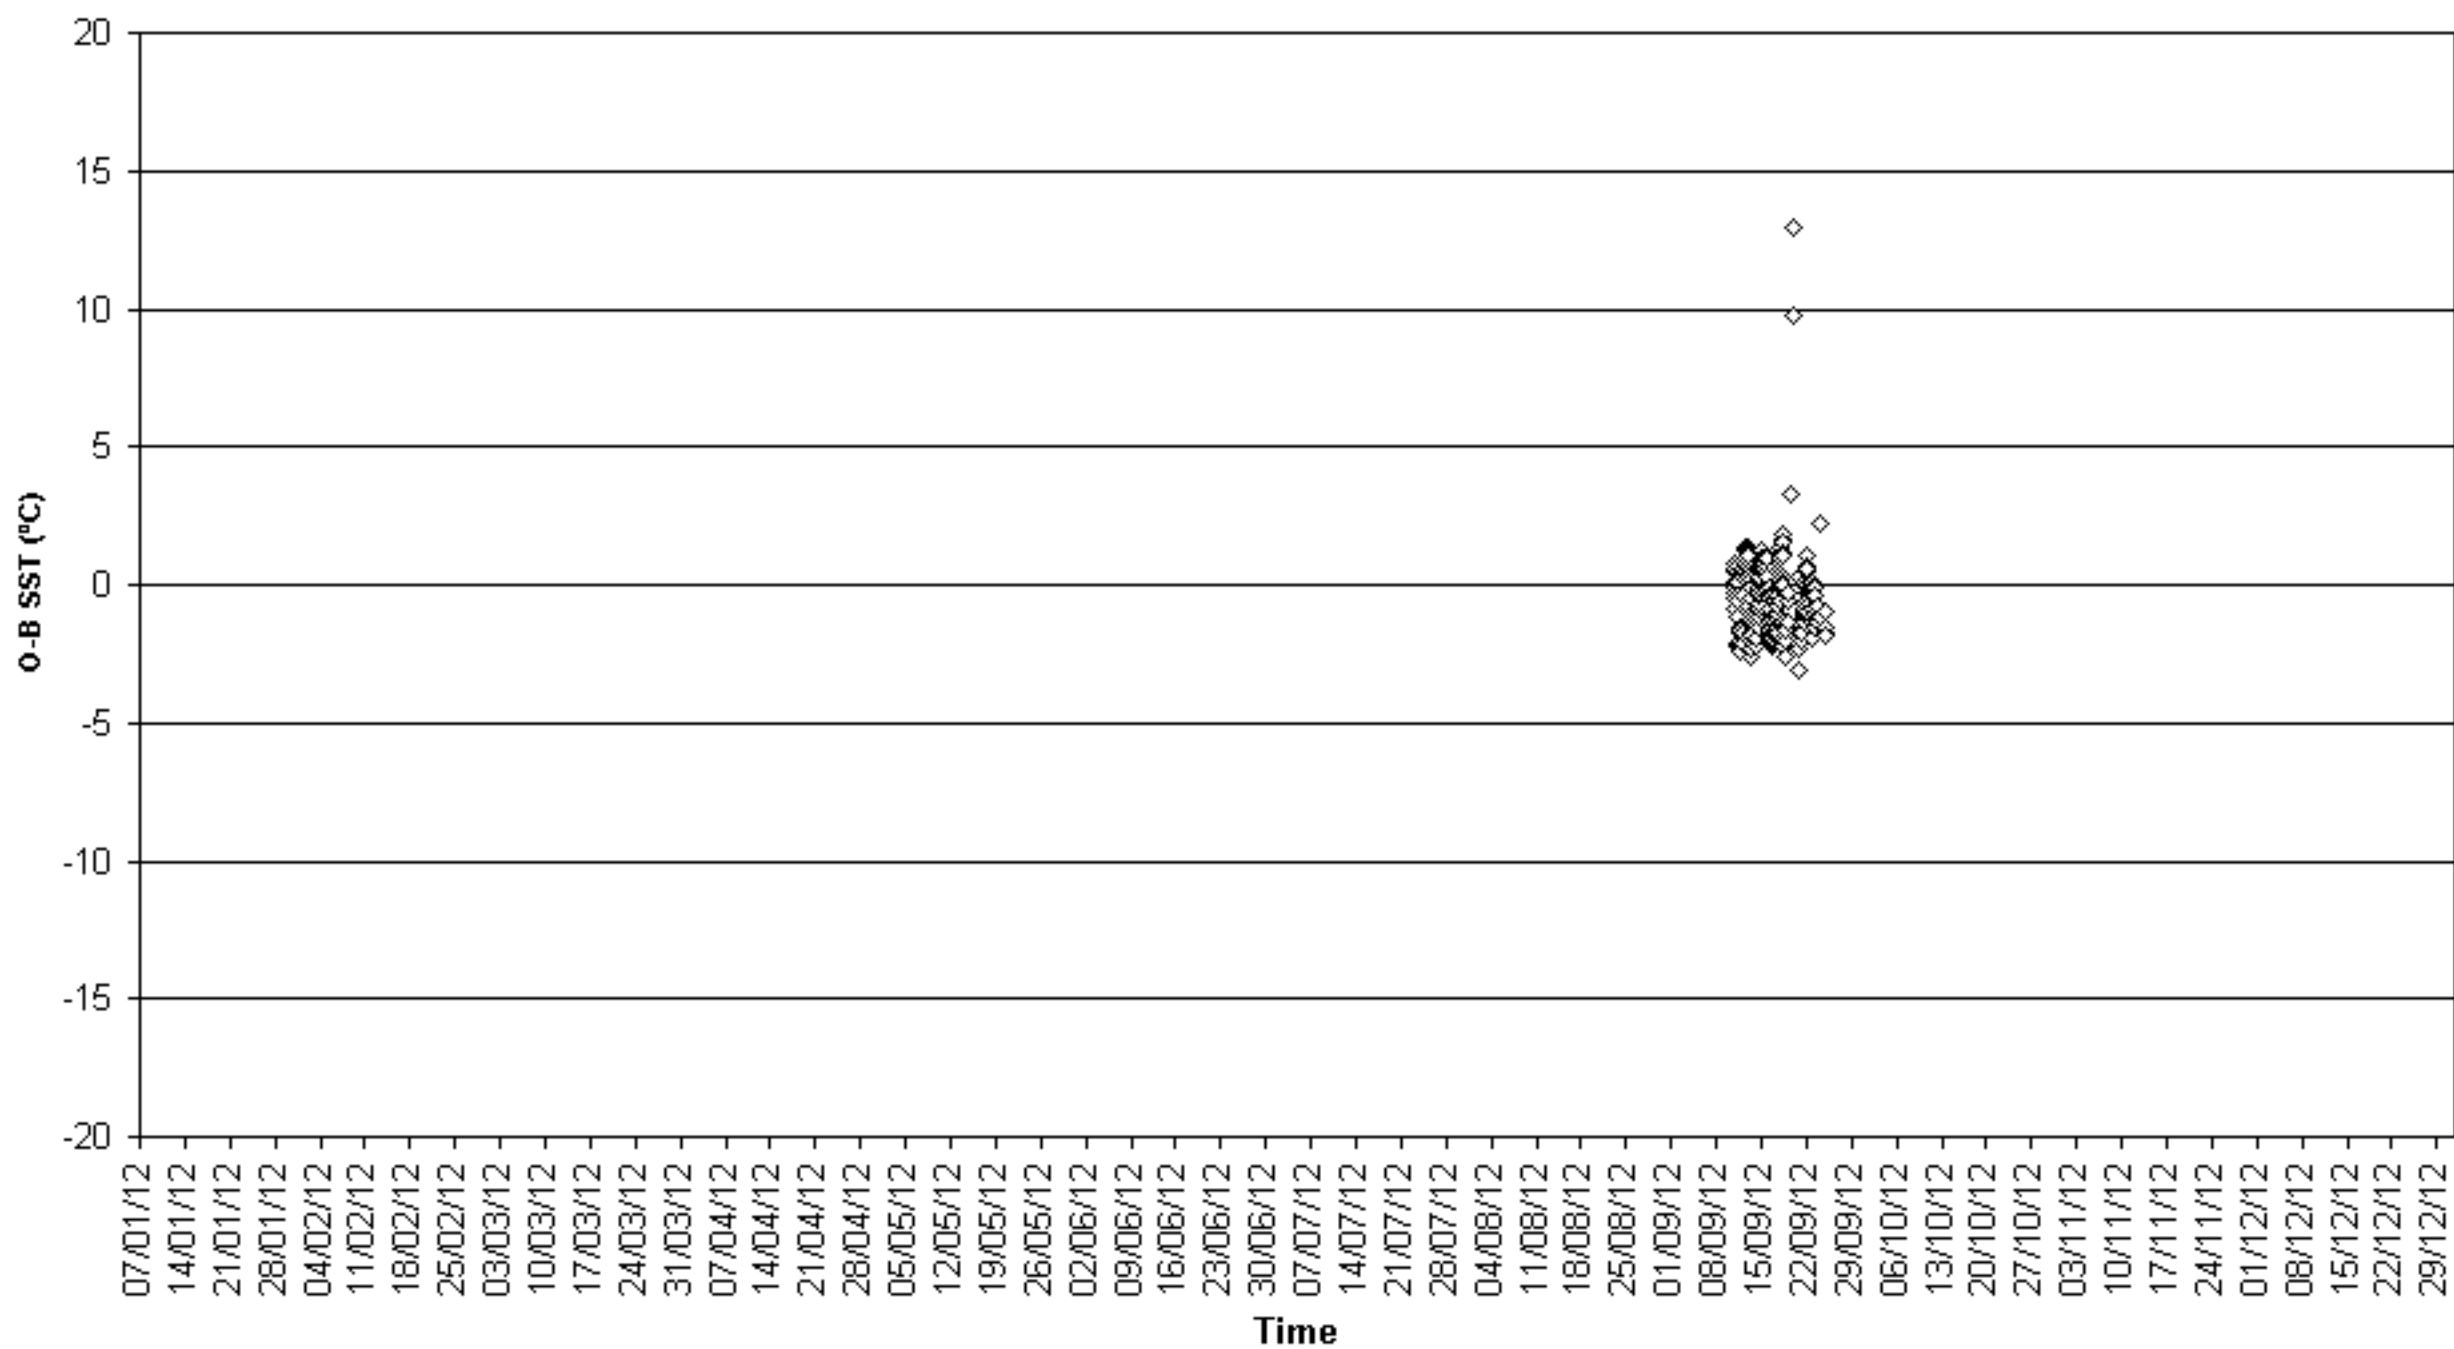


O-B SST (°C) for identifier 48726
Number of obs. plotted = 0 Number of outliers = 299

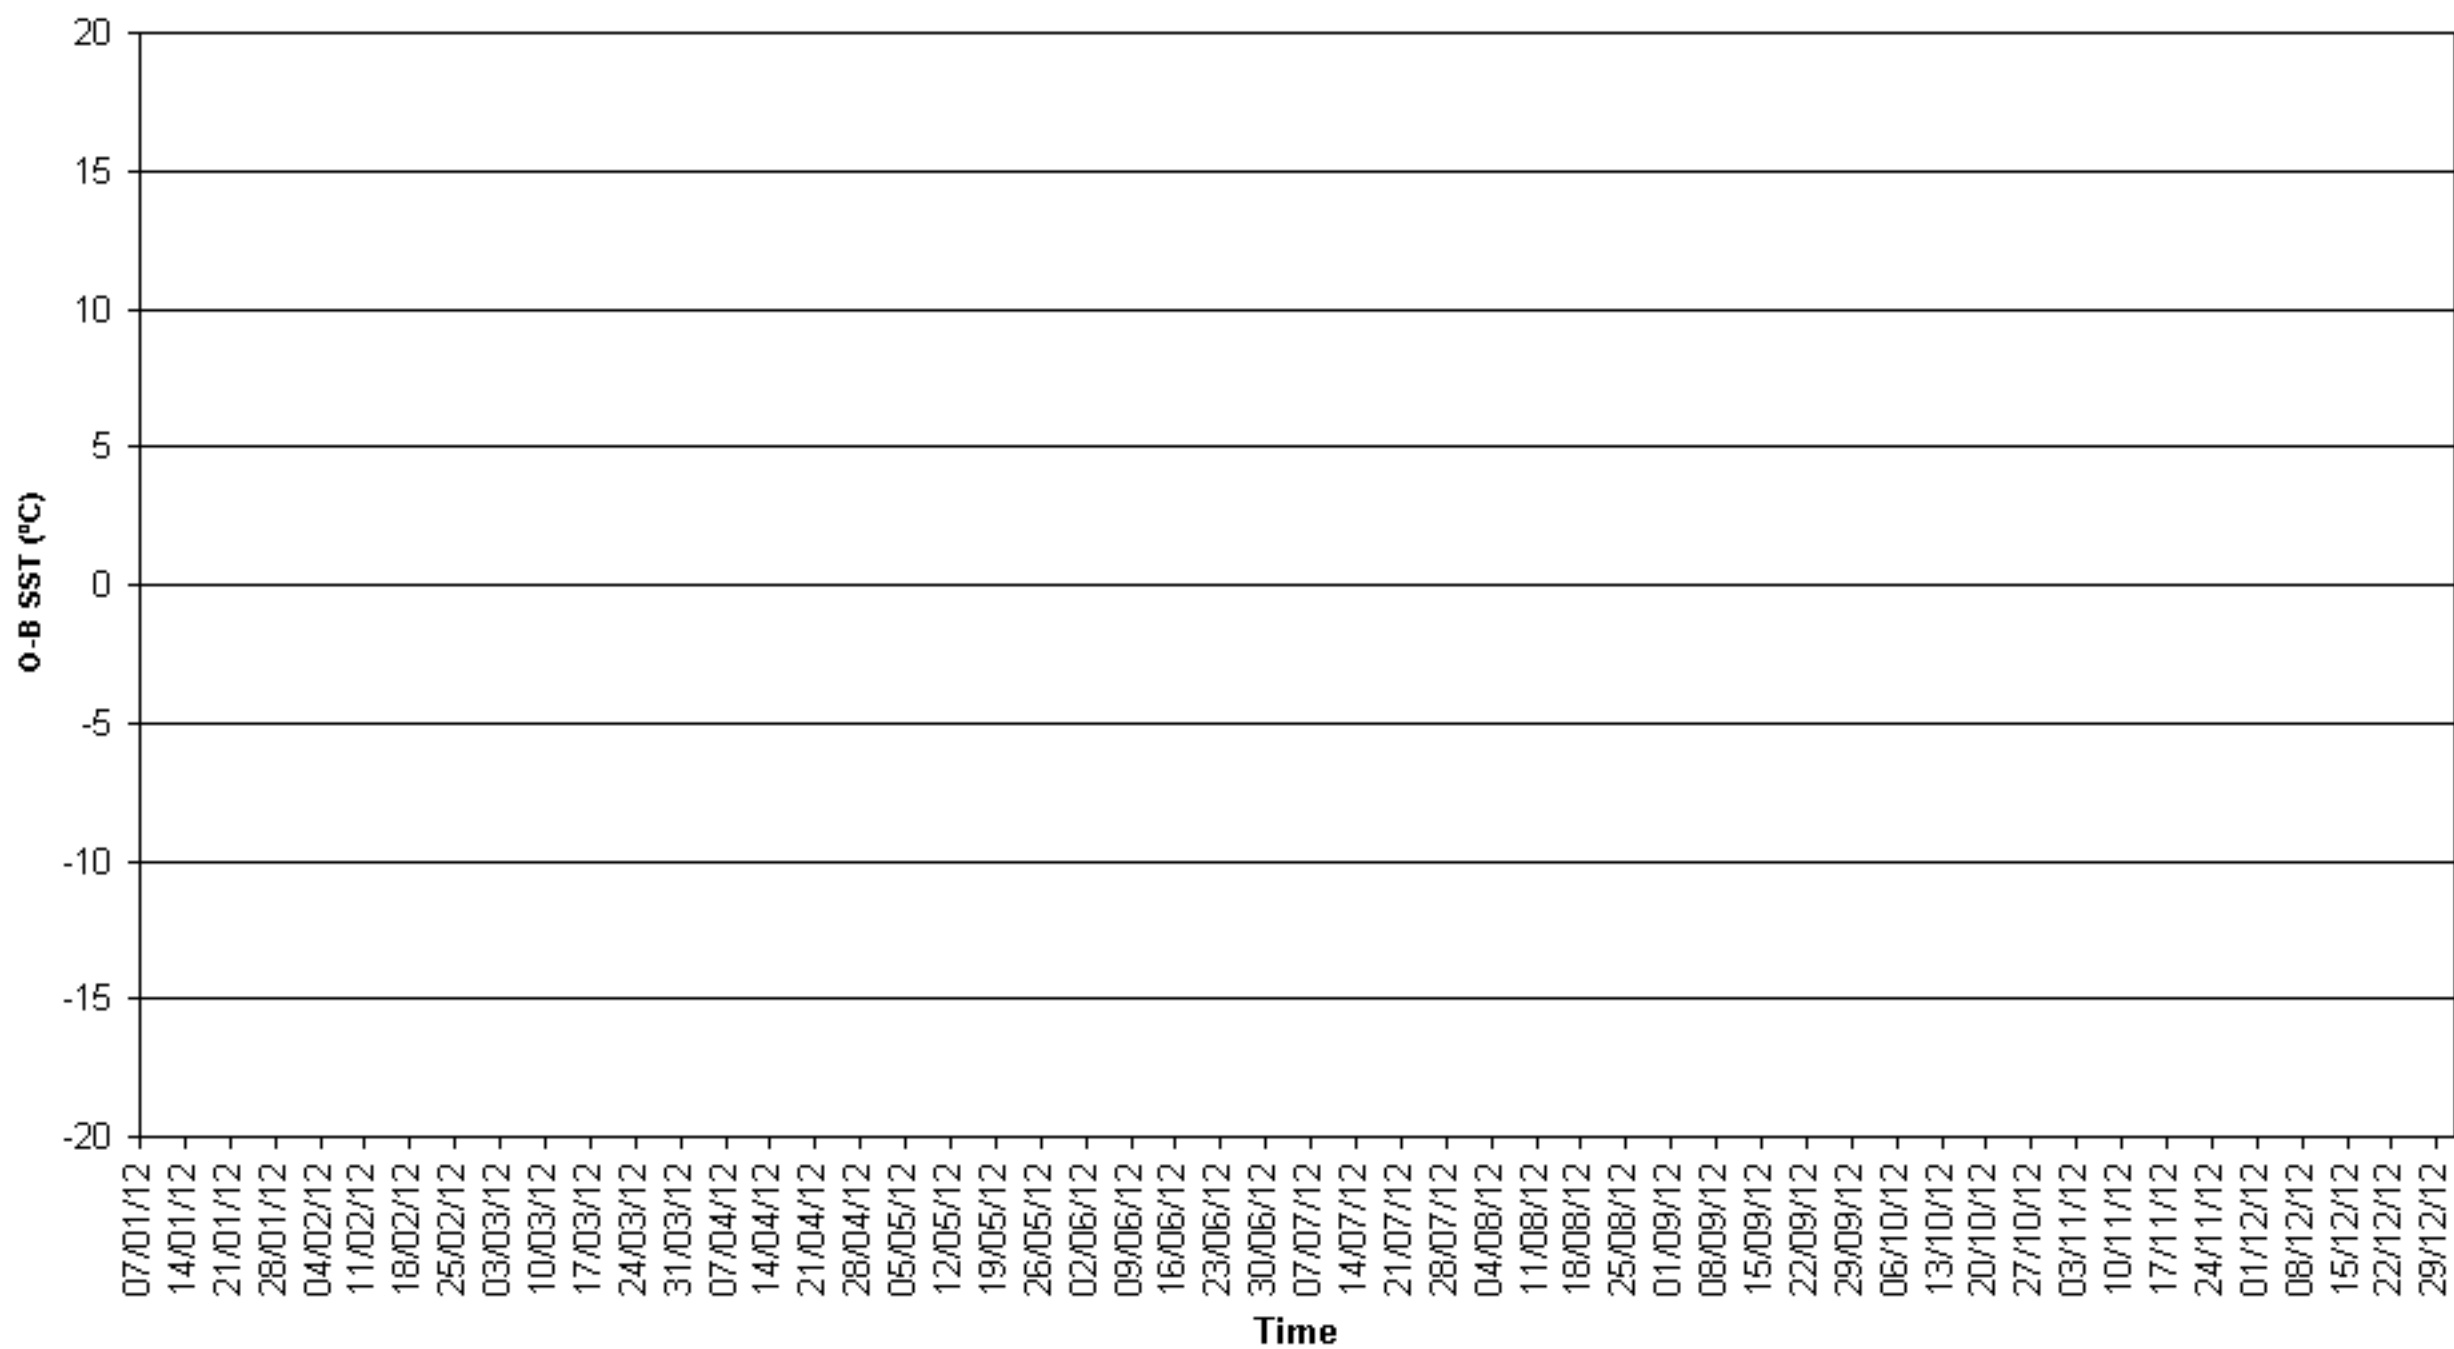


O-B SST (°C) for identifier 48728


Number of obs. plotted = 0 Number of outliers = 363

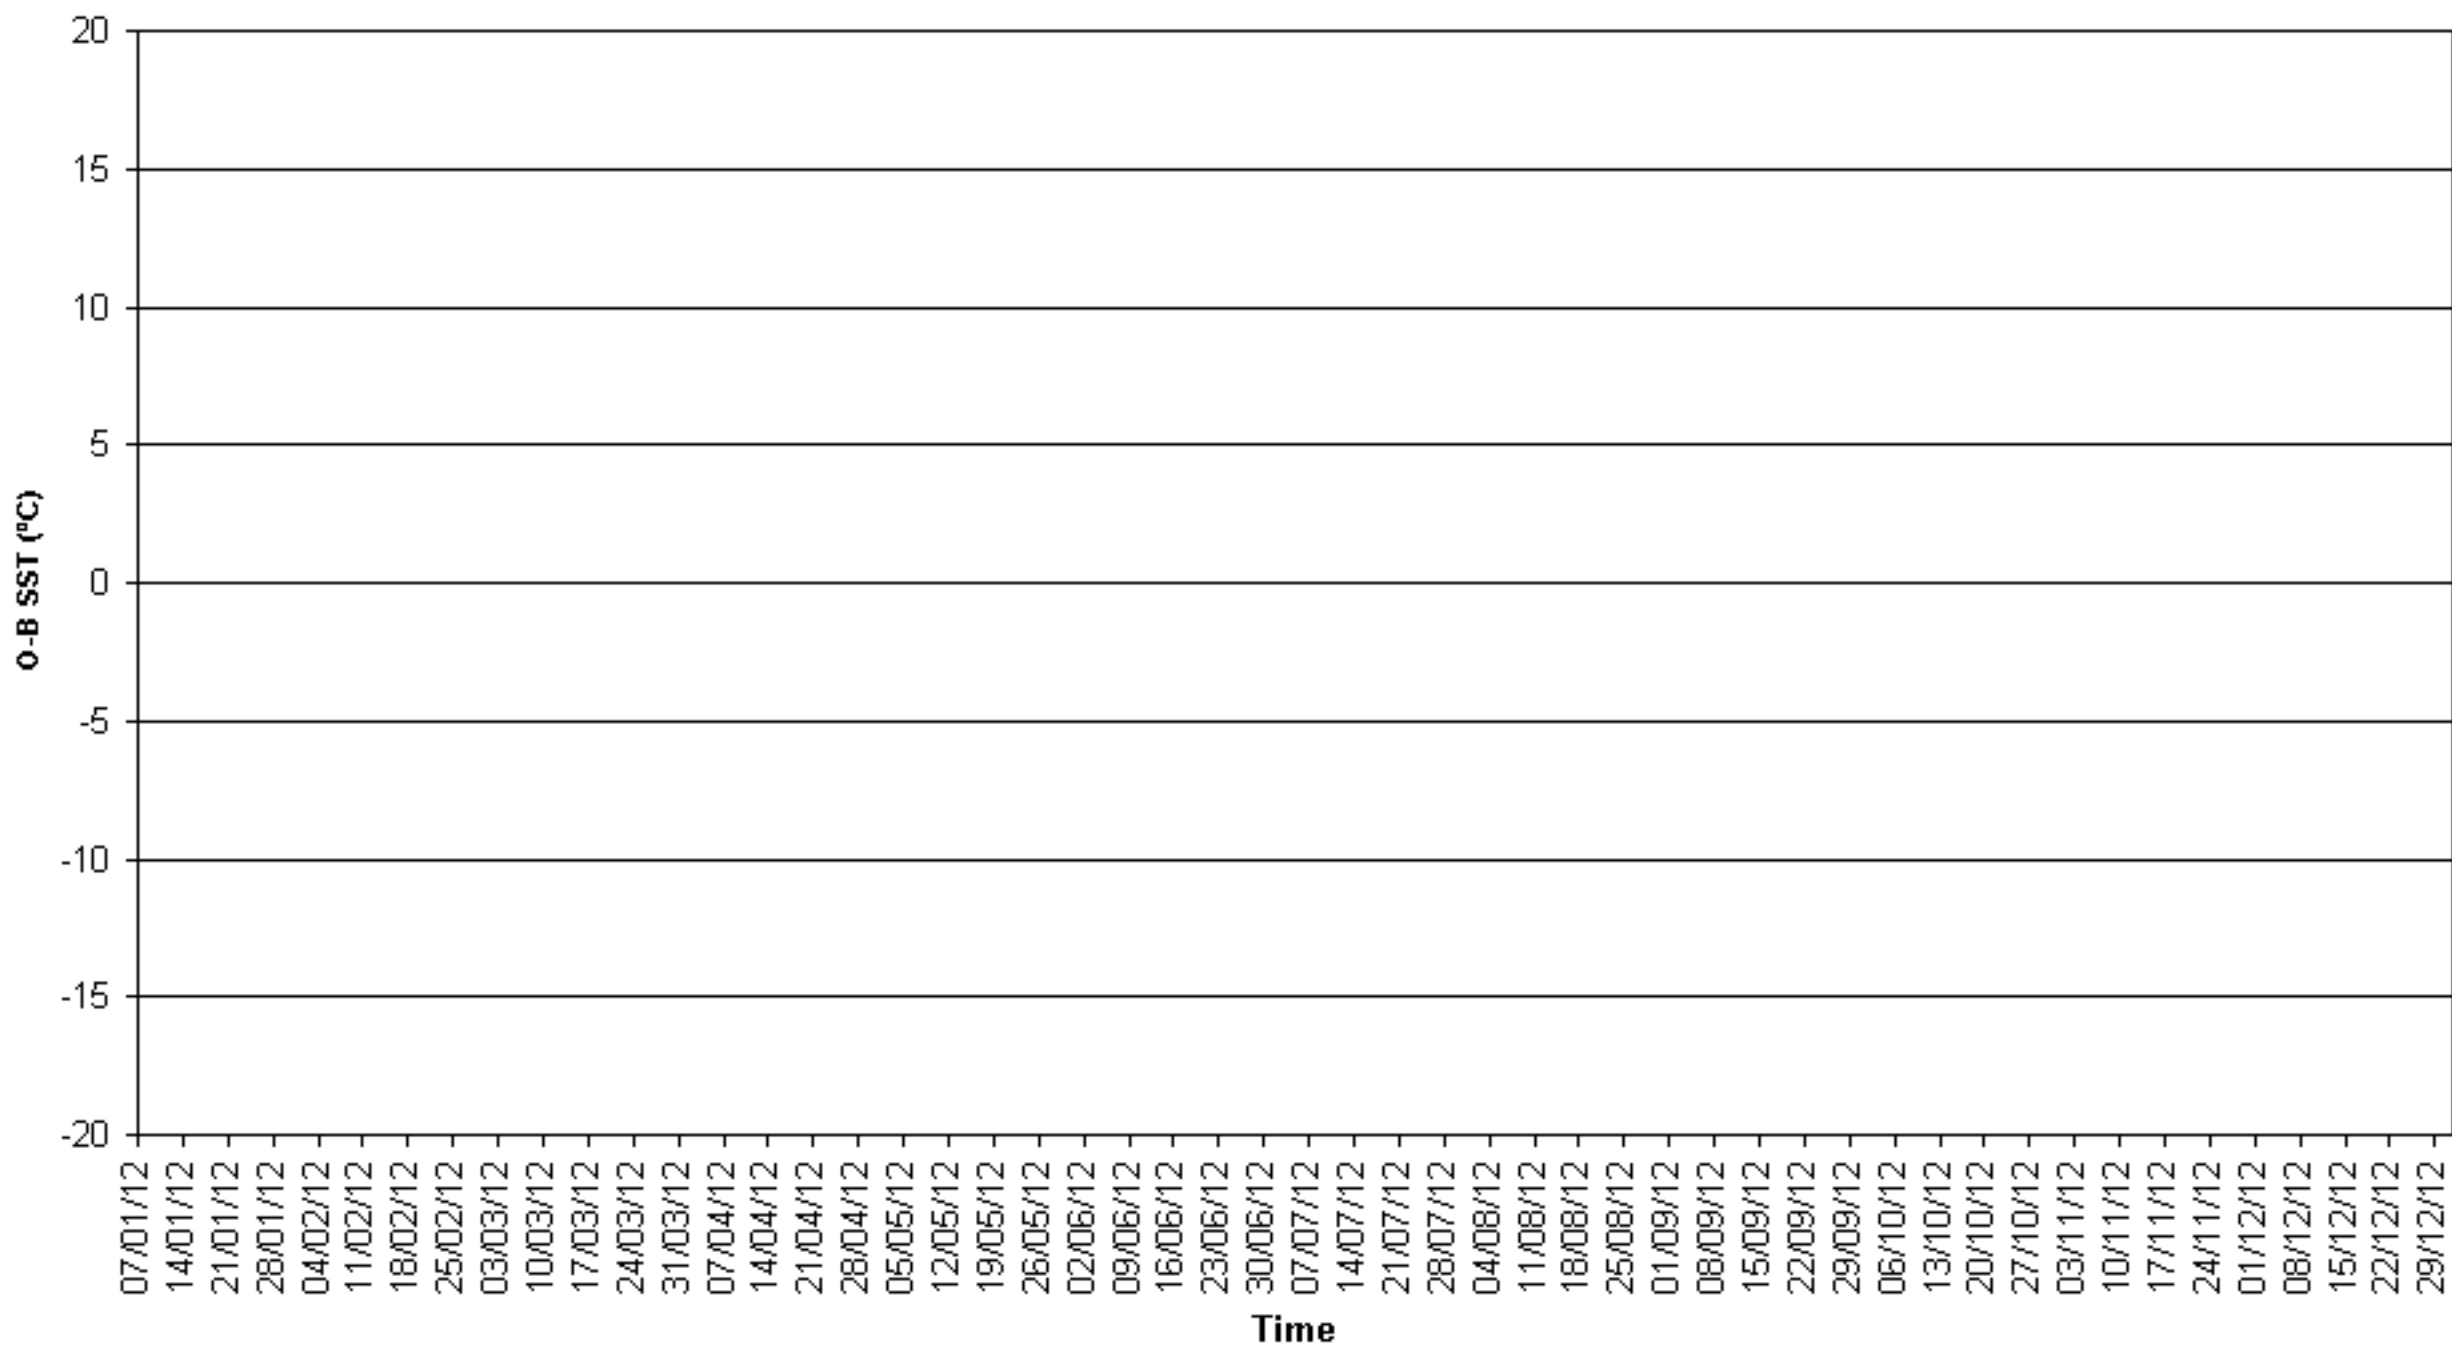


O-B SST (°C) for identifier 51616
Number of obs. plotted = 48 Number of outliers = 5

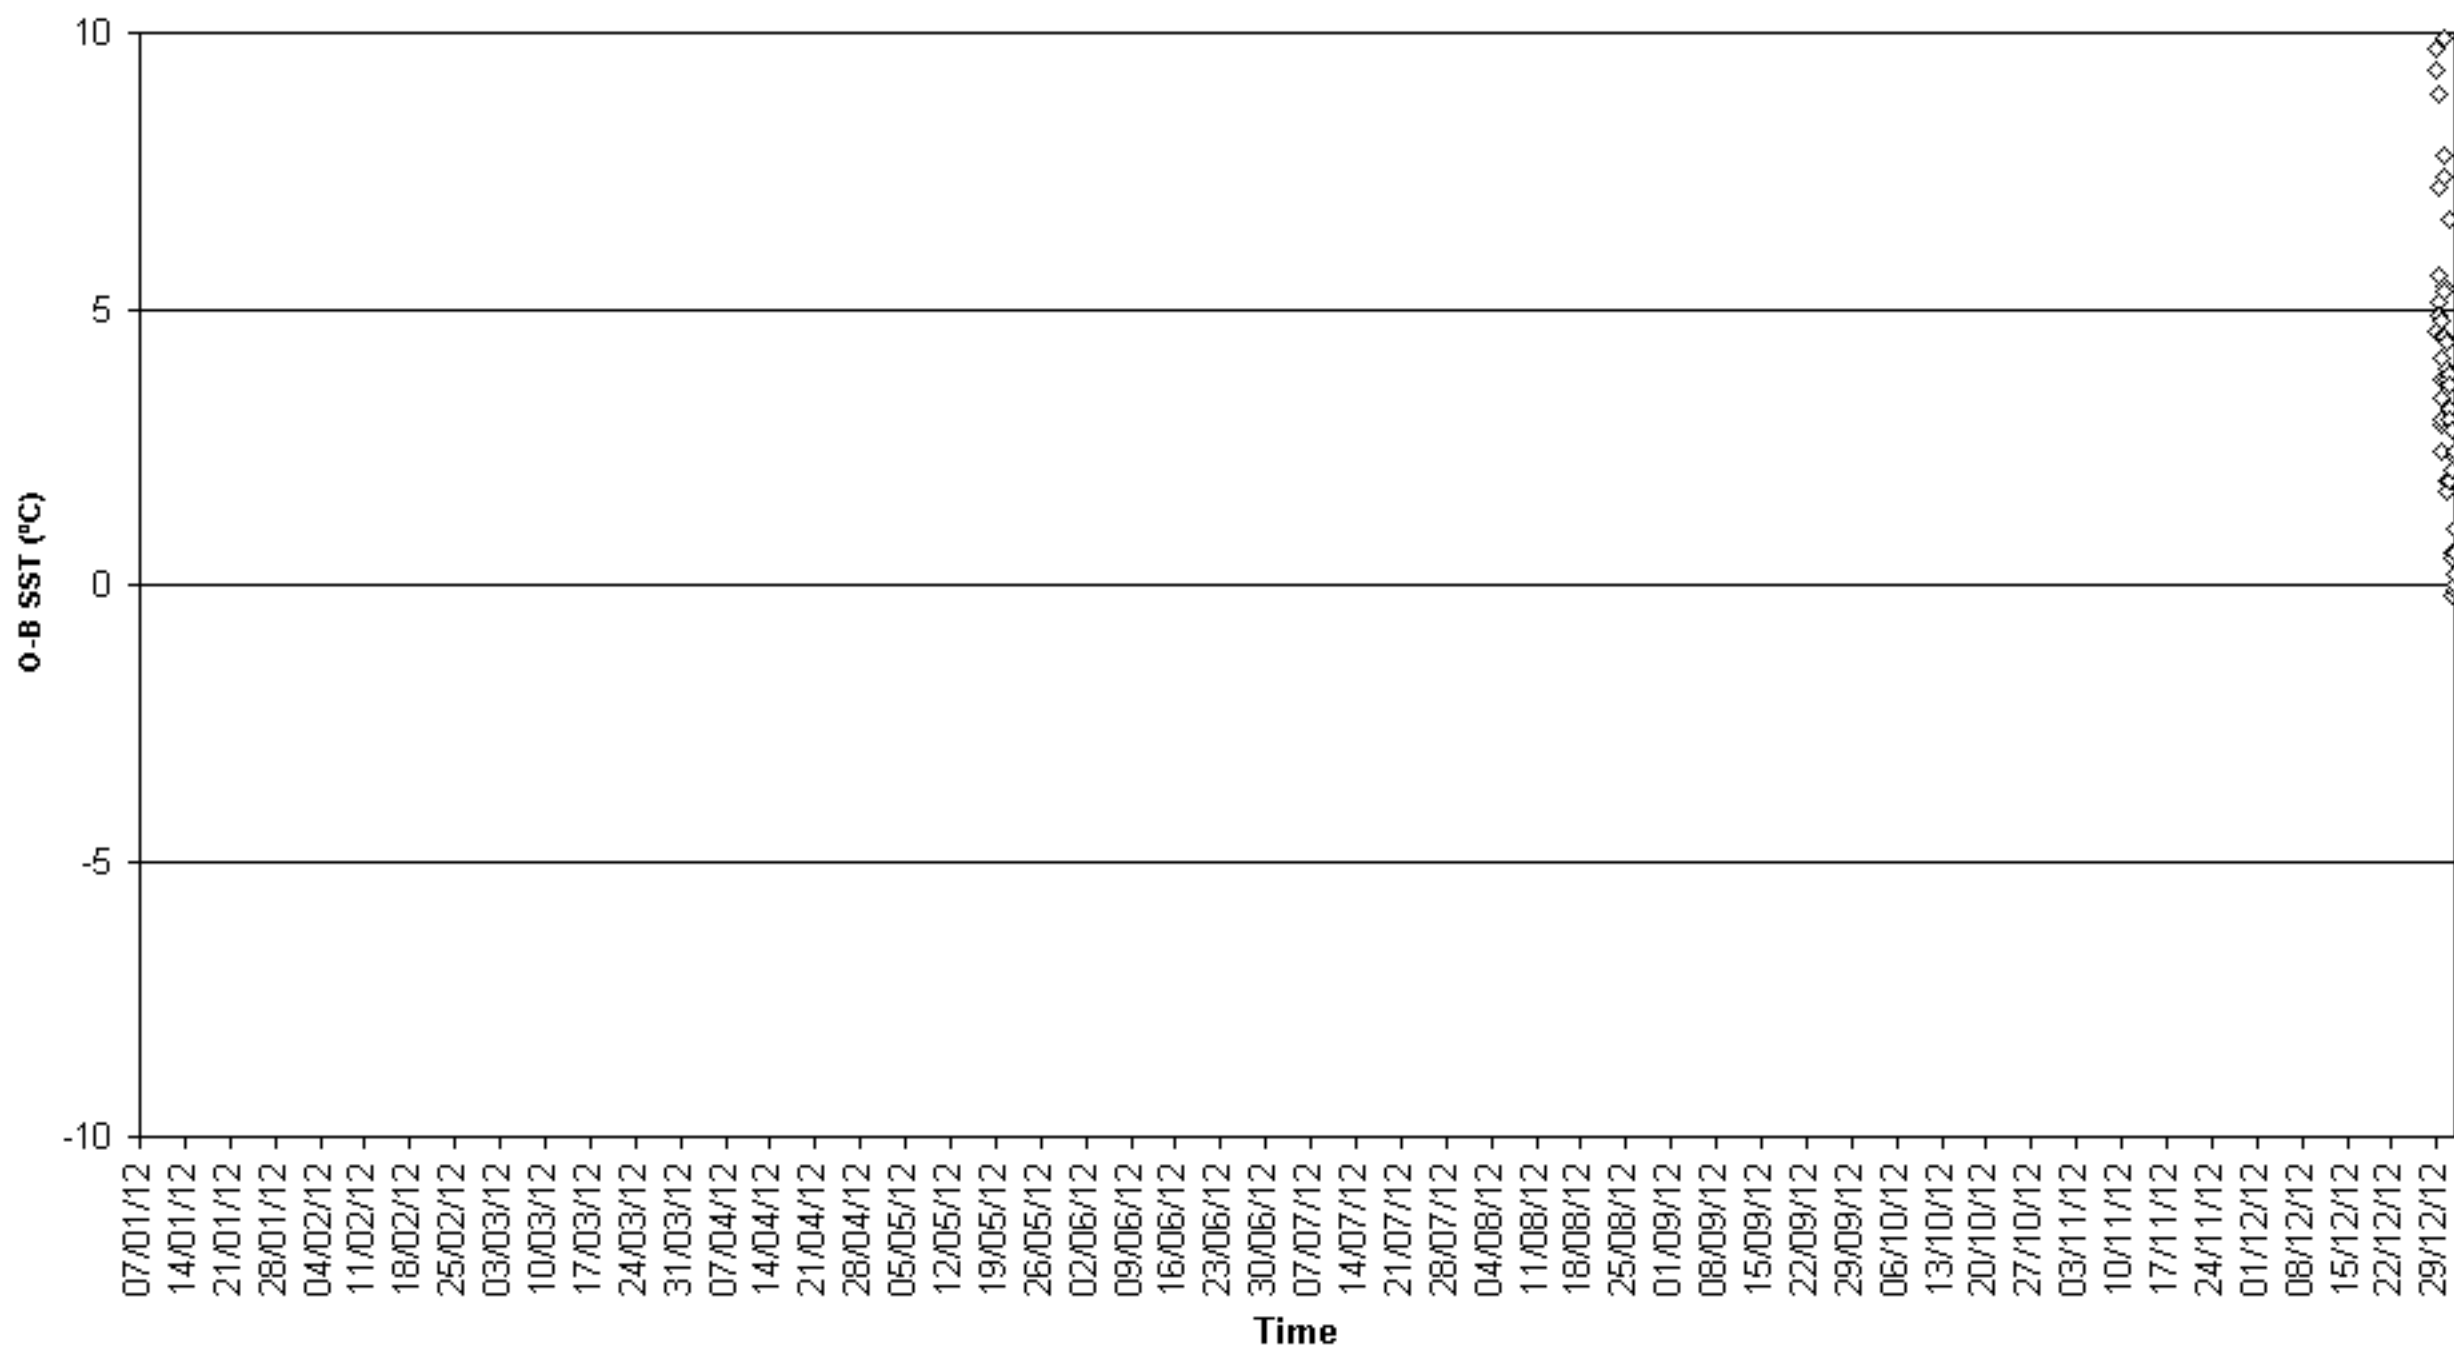


O-B SST (°C) for identifier 52812
Number of obs. plotted = 3 Number of outliers = 38

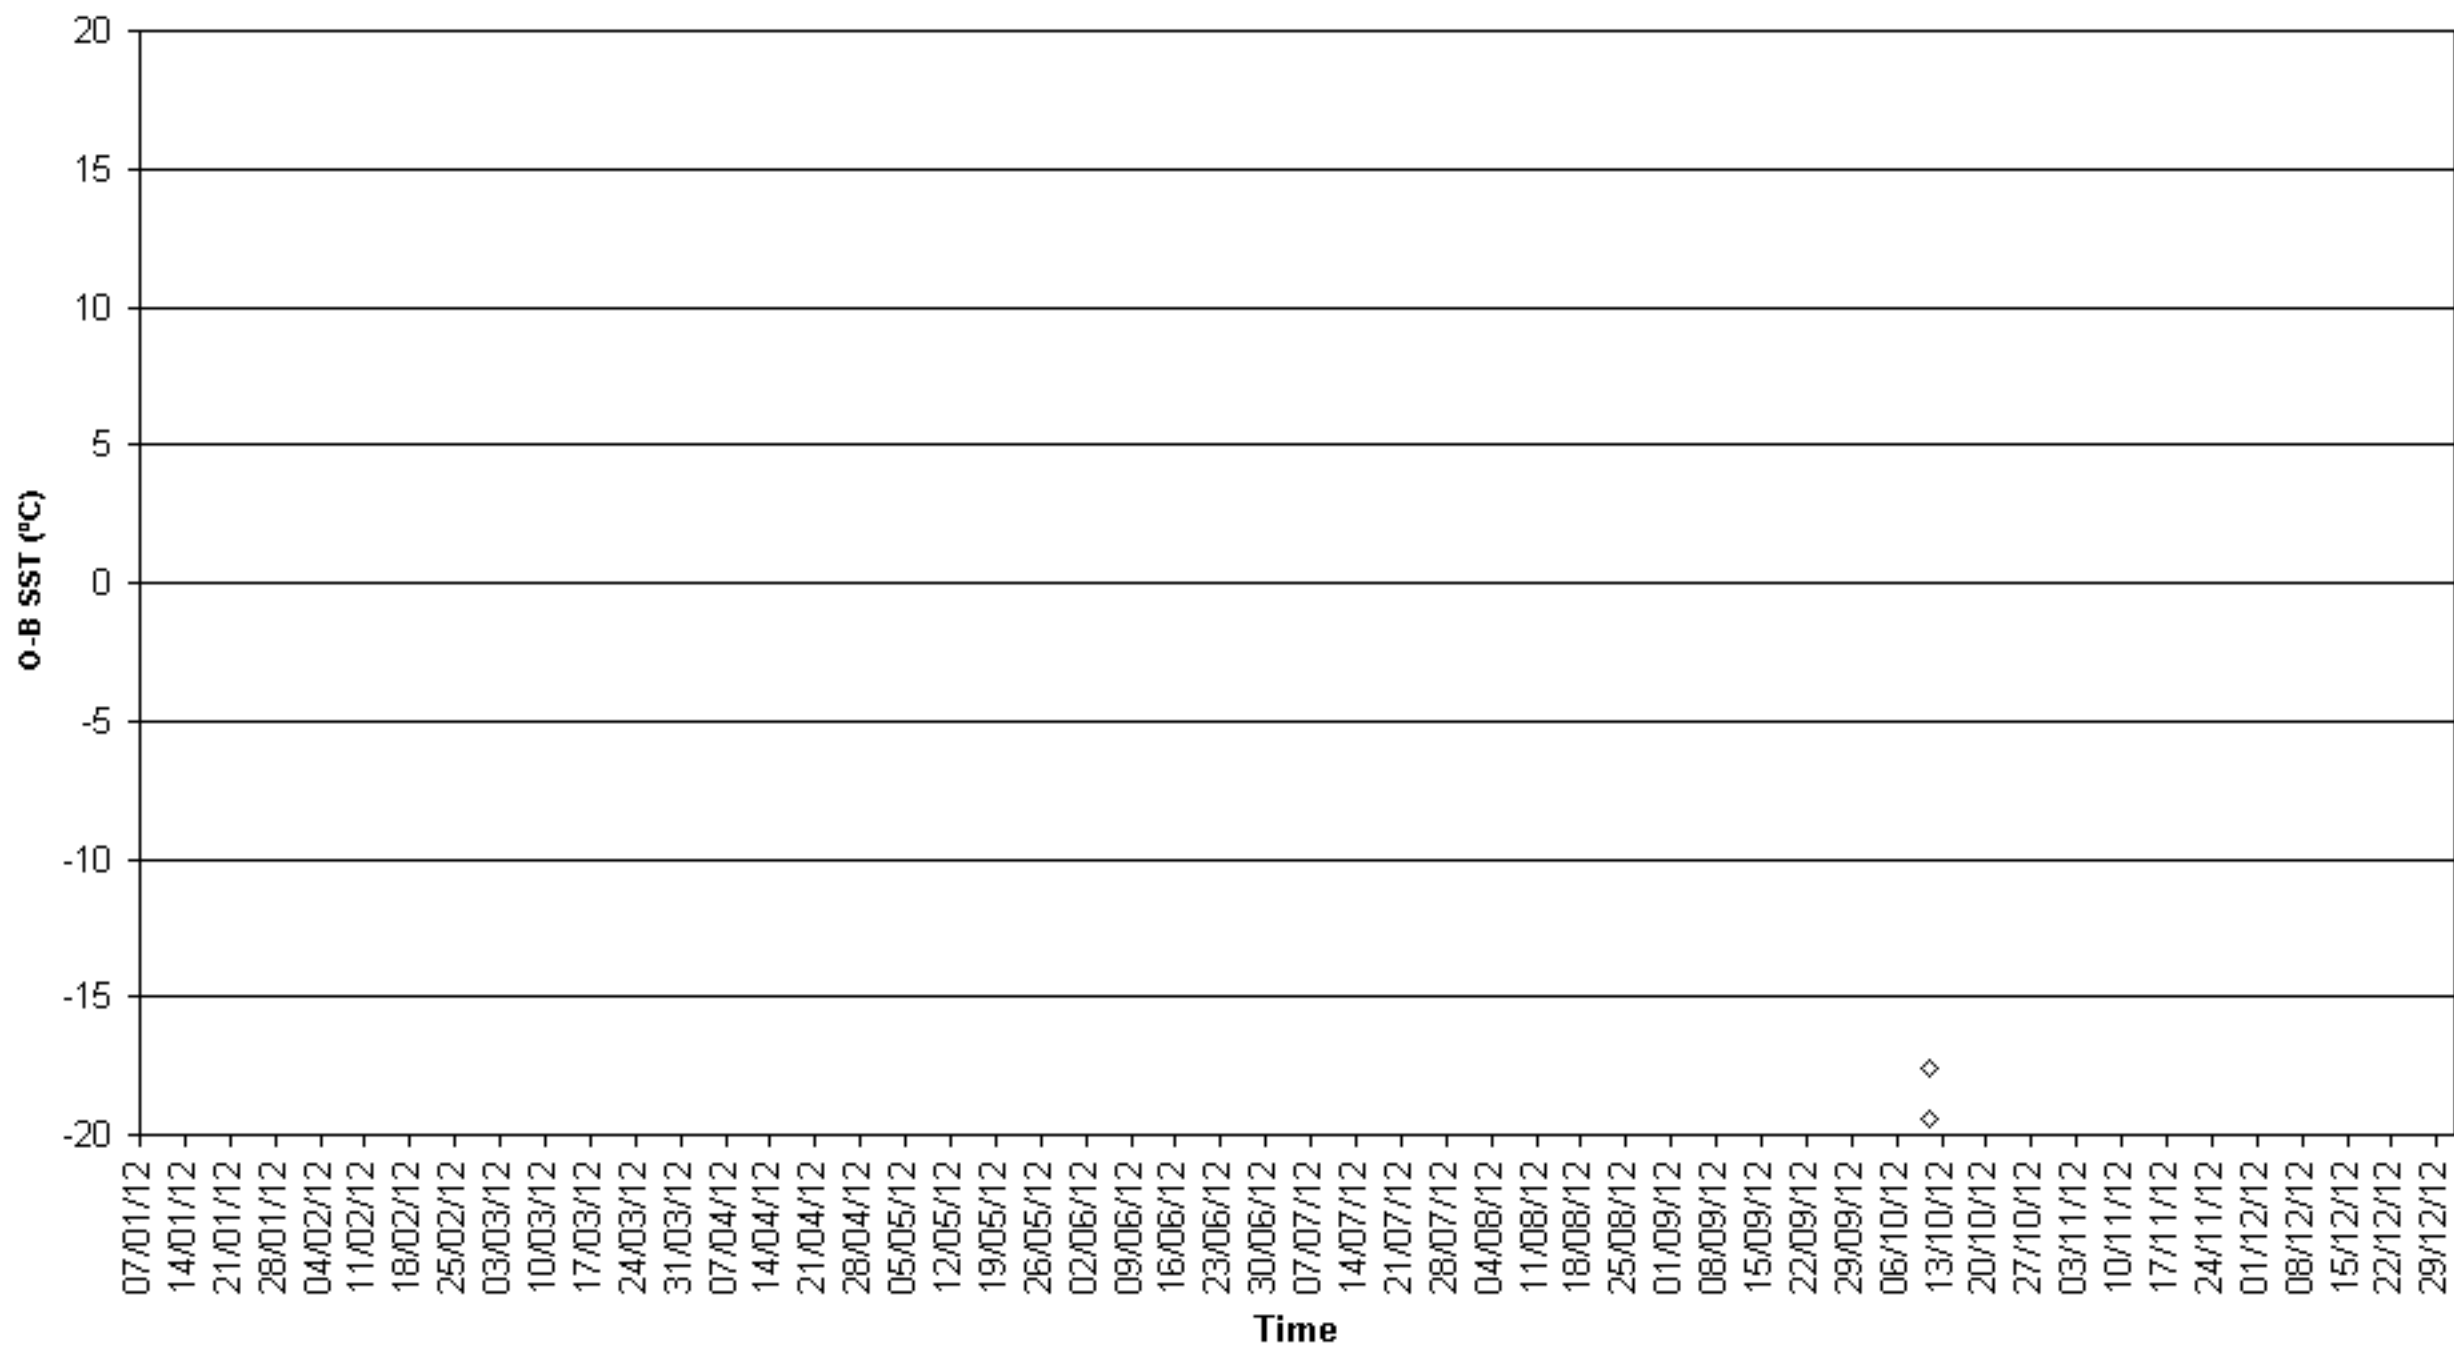


O-B SST (°C) for identifier 54954
Number of obs. plotted = 237 Number of outliers = 1

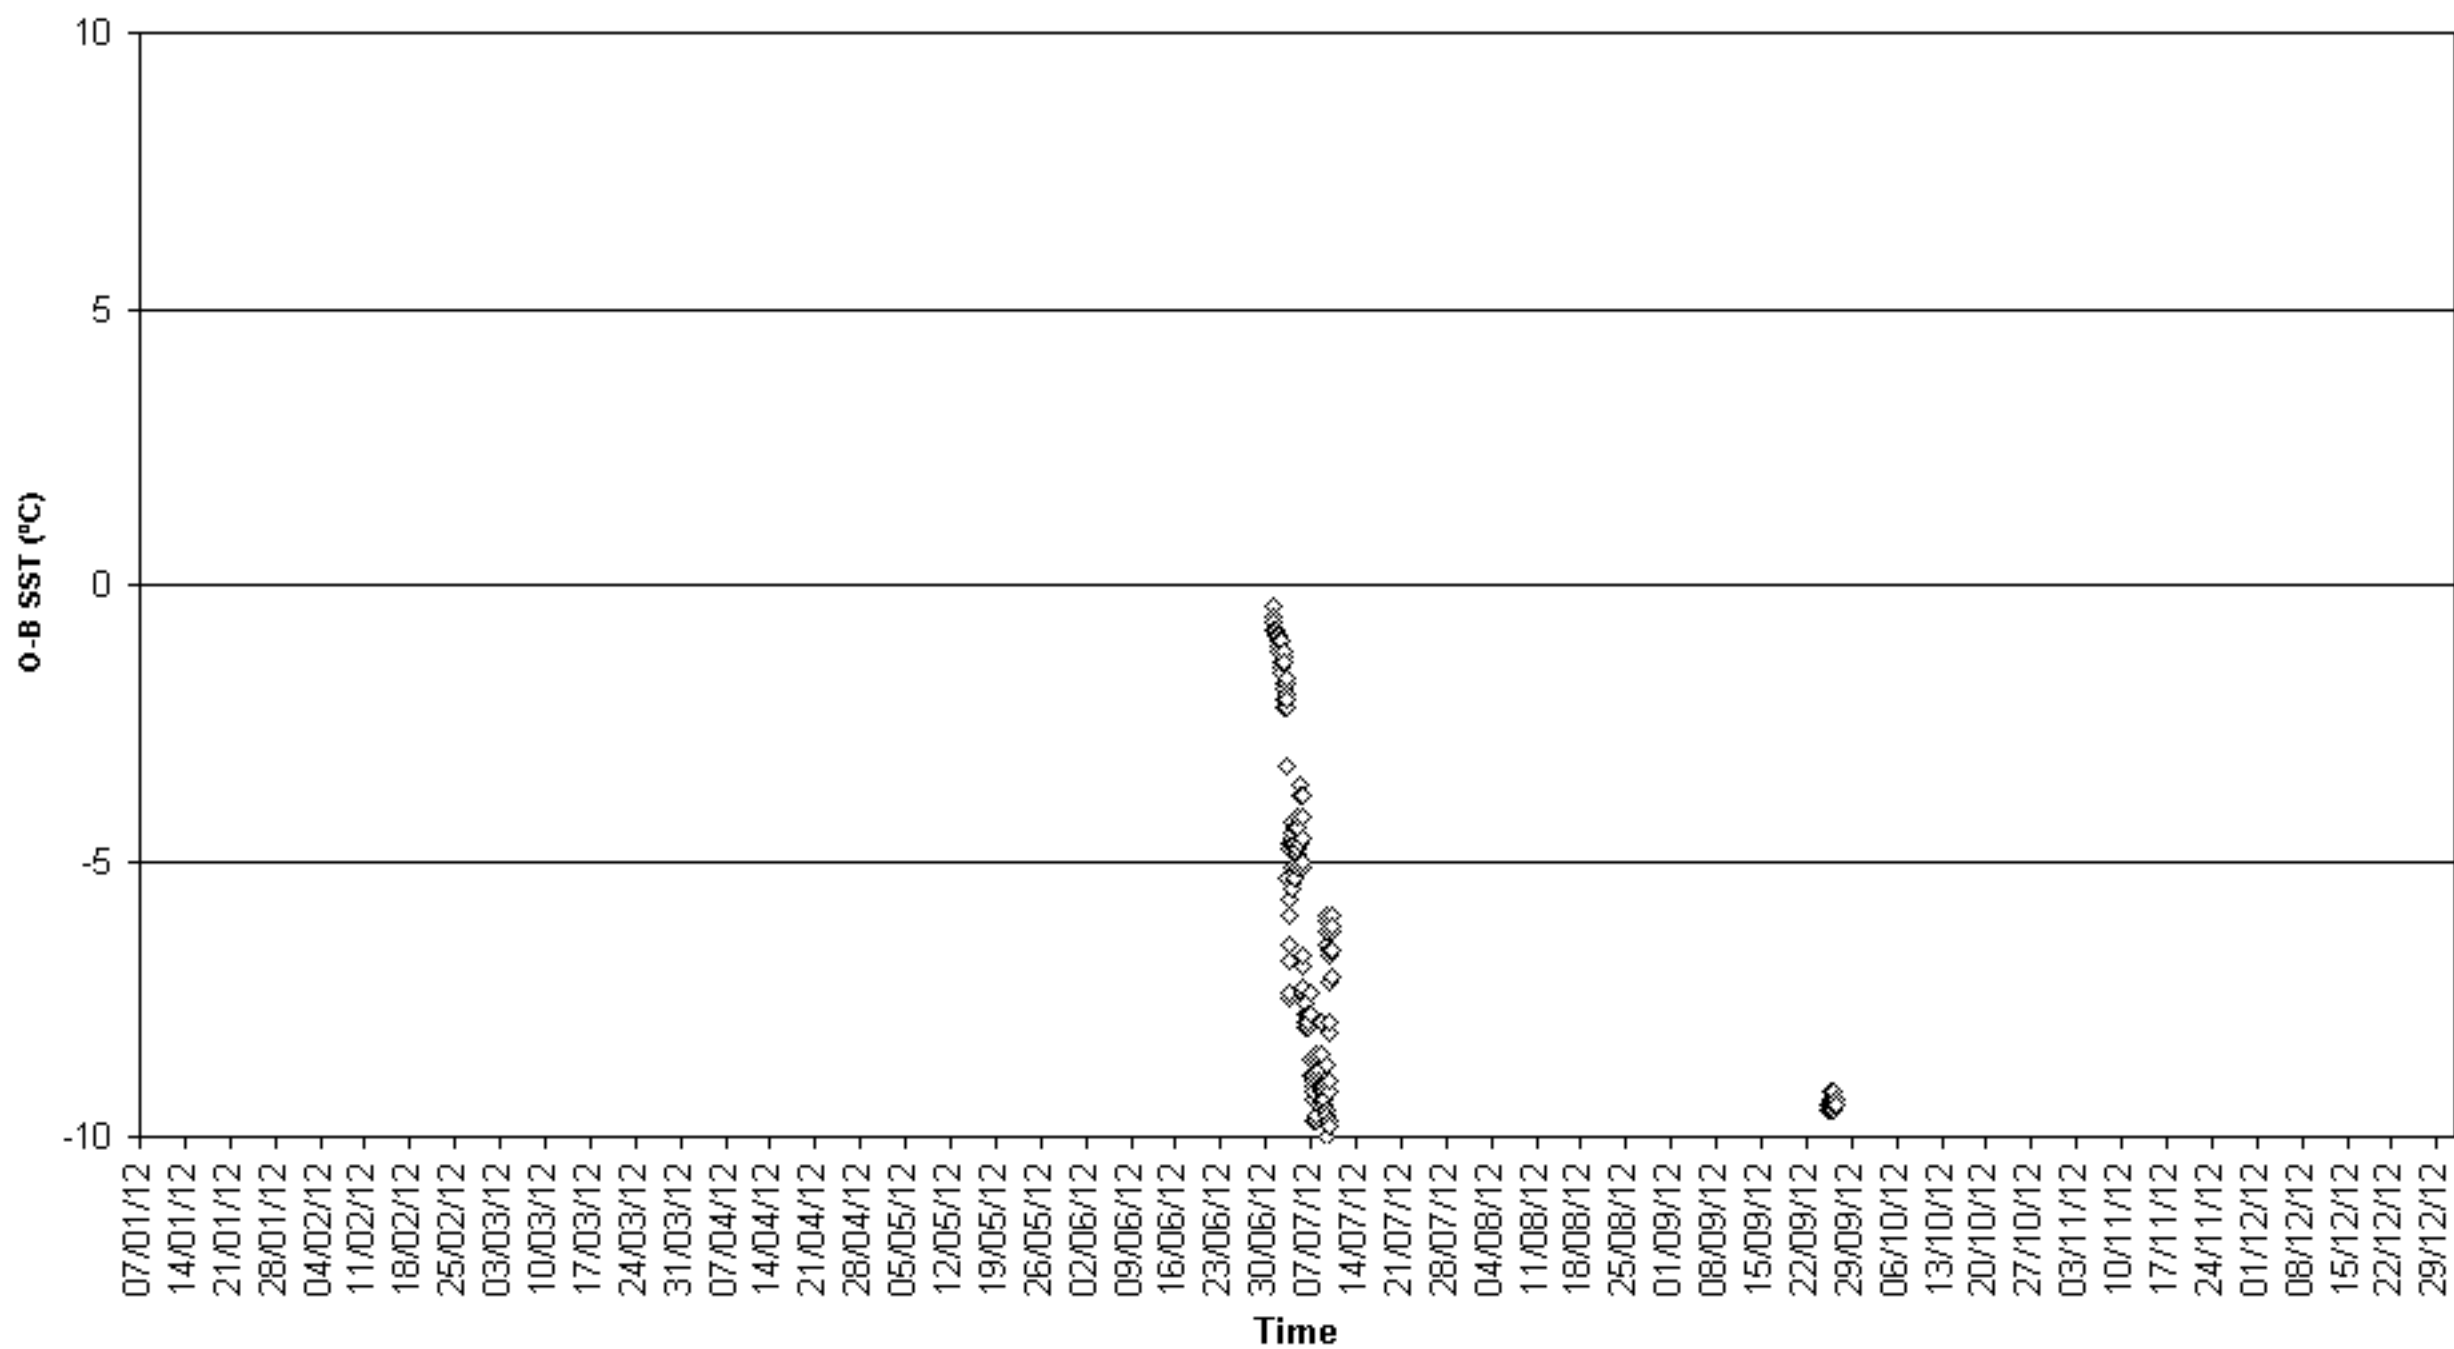


O-B SST (°C) for identifier 54955
Number of obs. plotted = 627 Number of outliers = 0

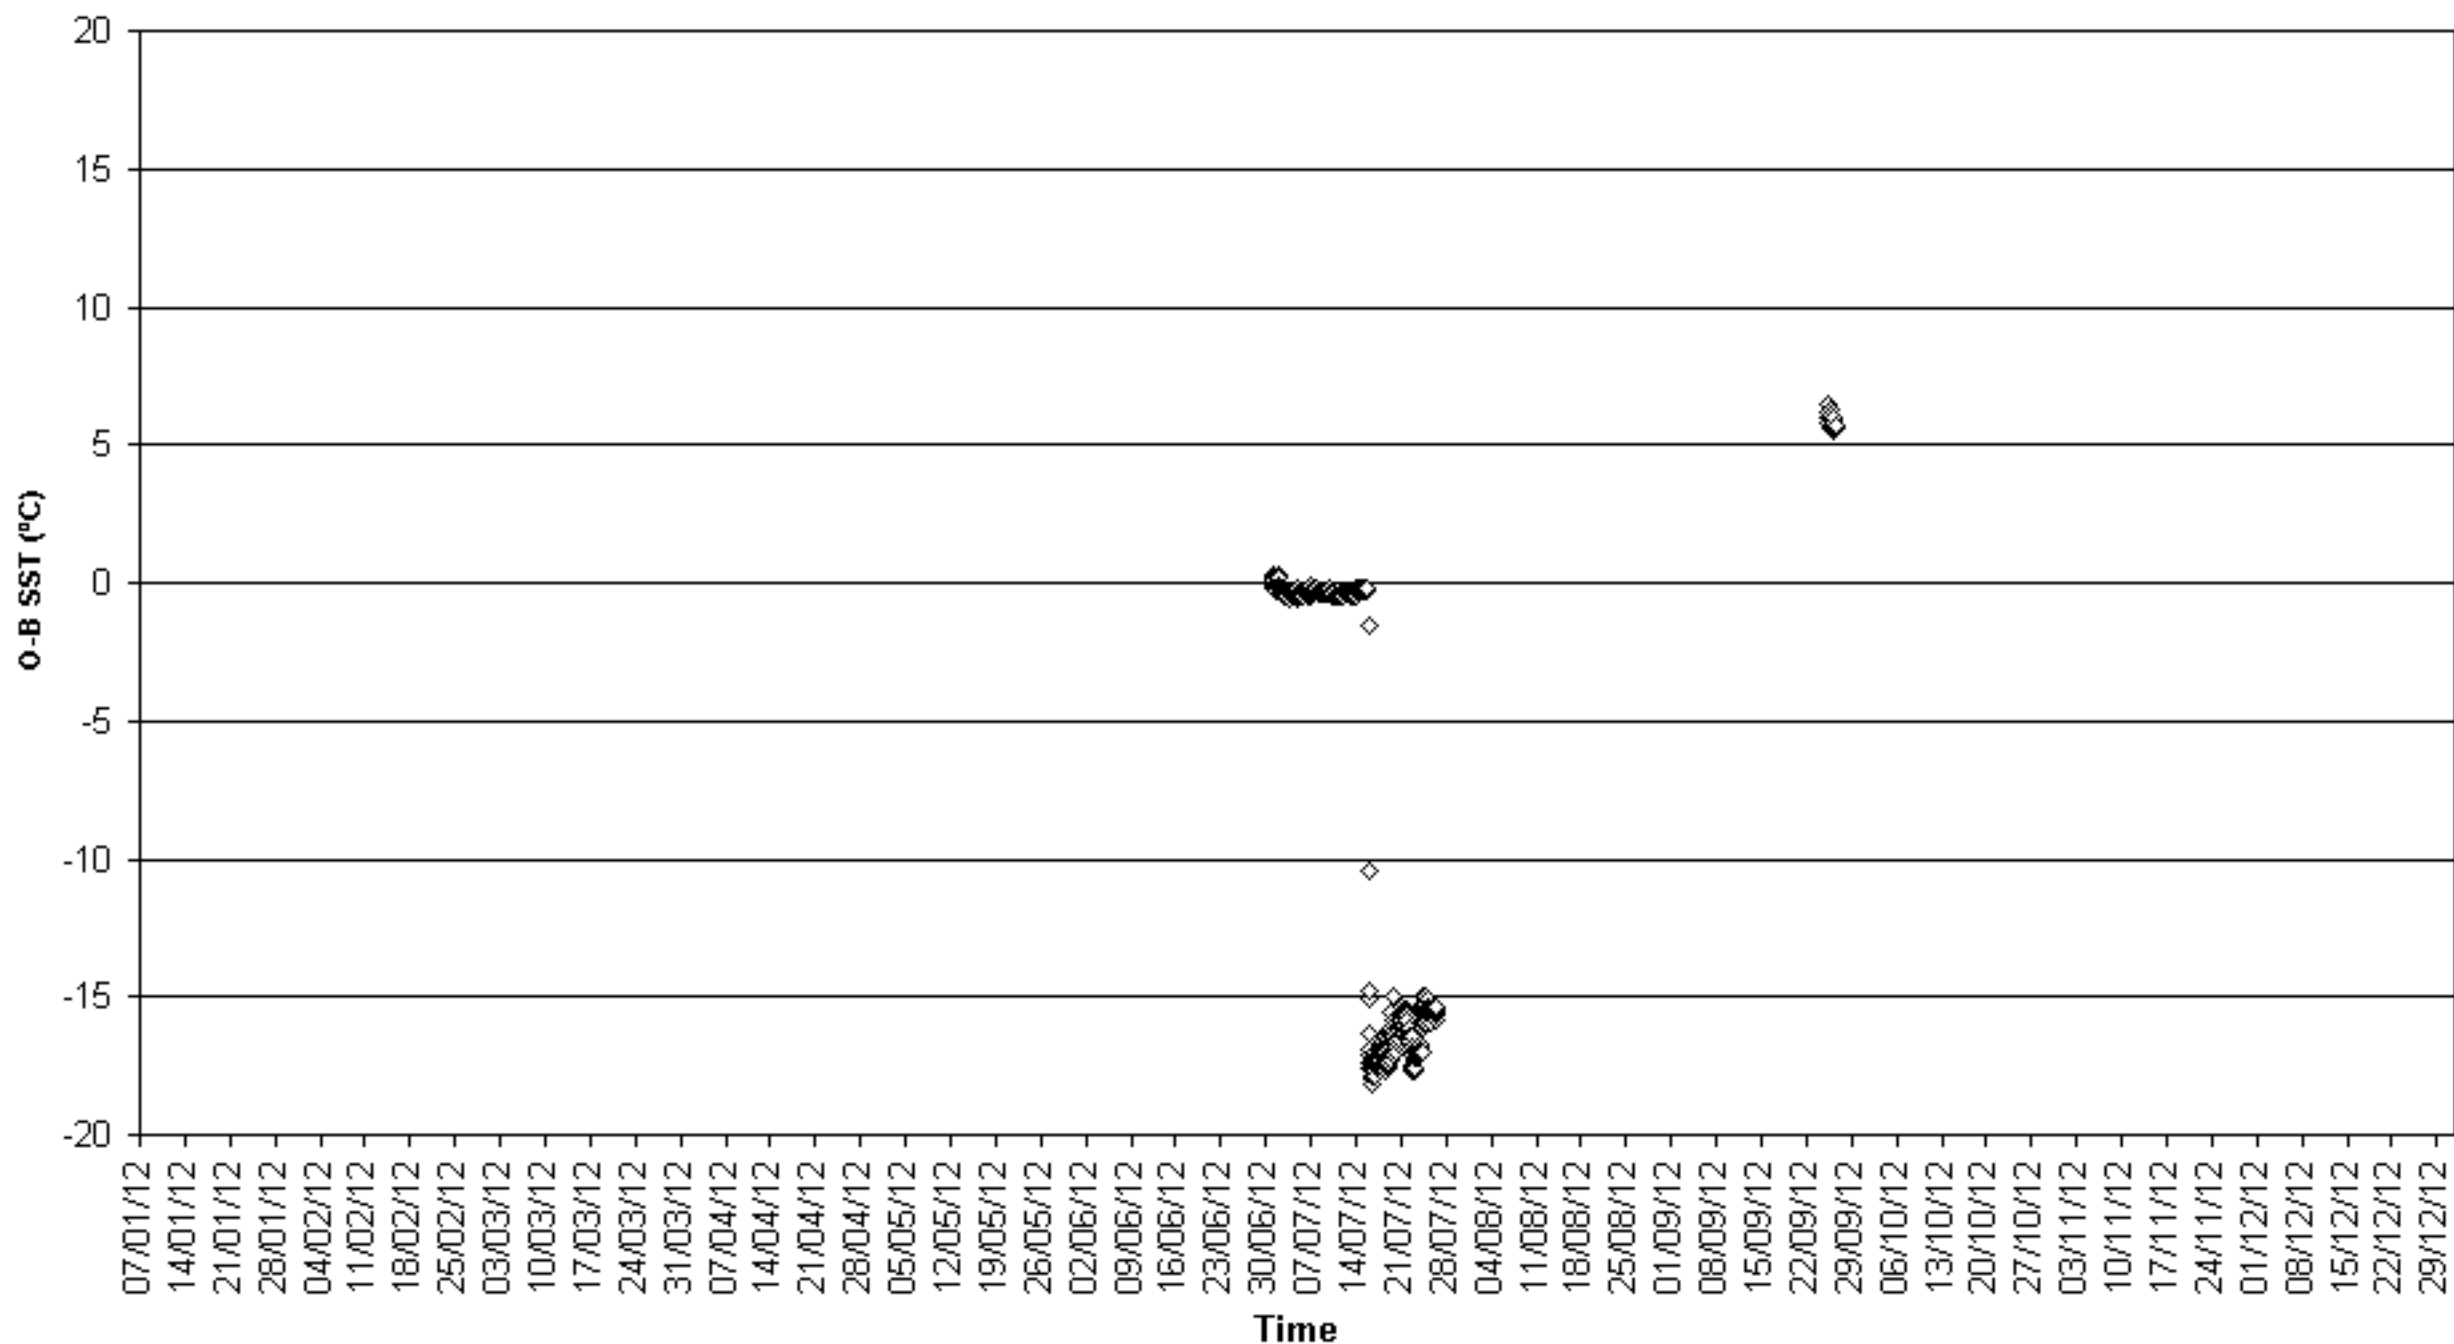


O-B SST ($^{\circ}$ C) for identifier 55564
Number of obs. plotted = 436 Number of outliers = 124

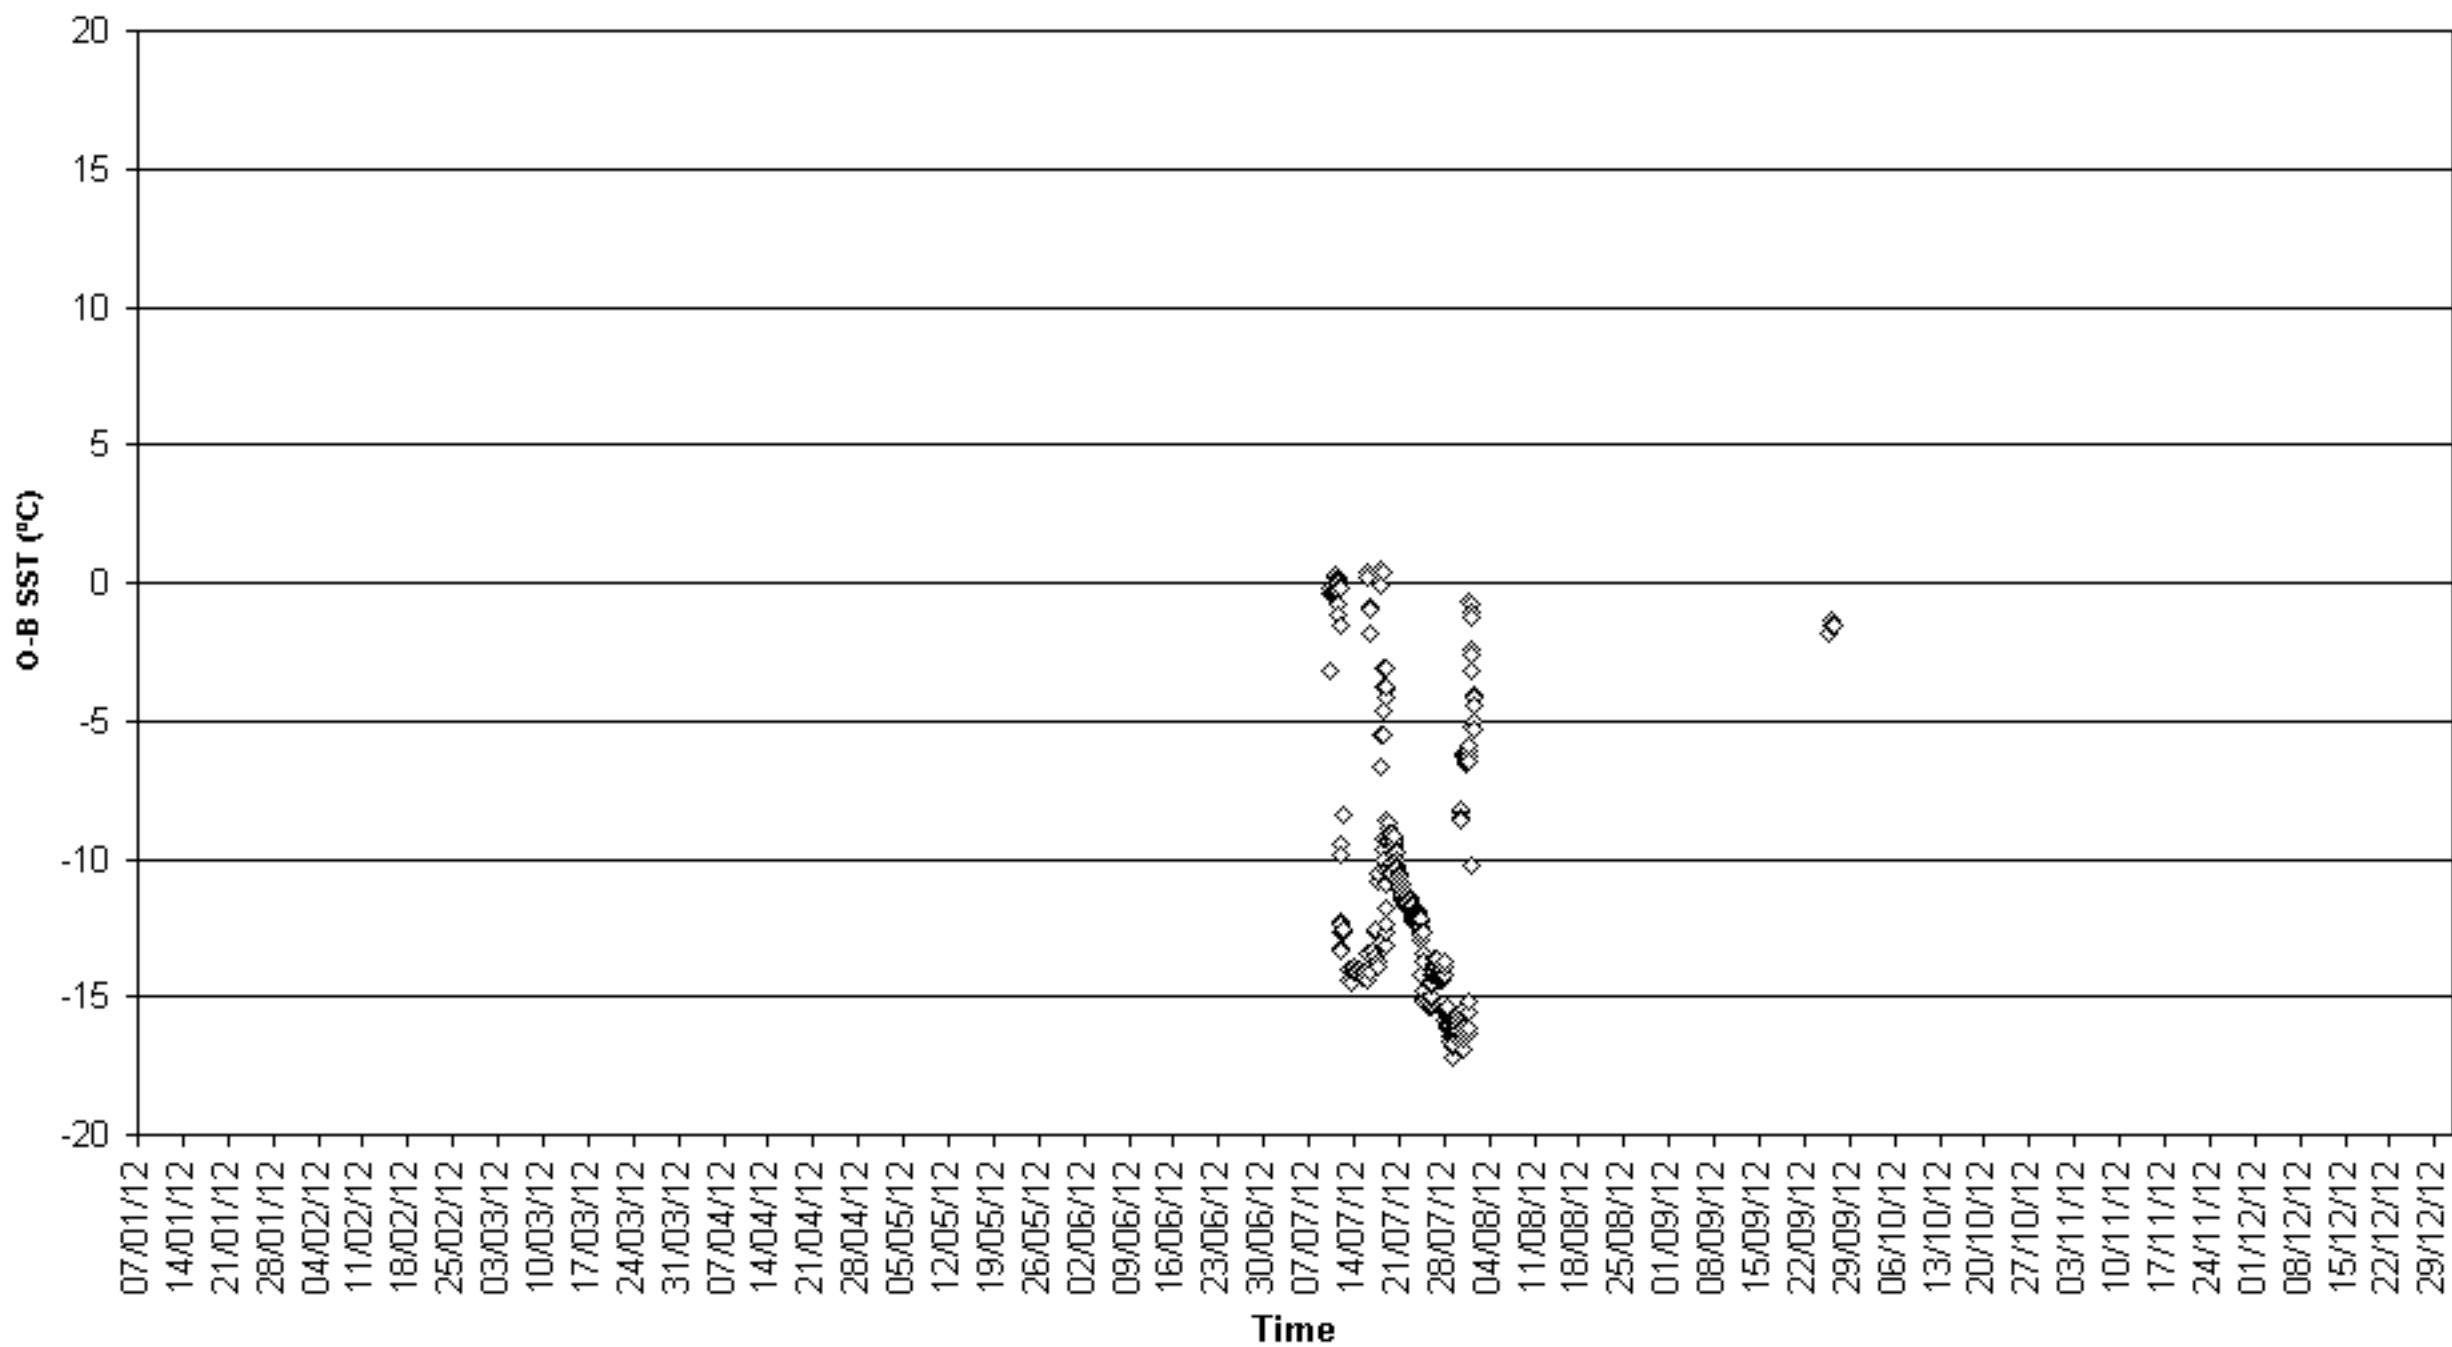


O-B SST (°C) for identifier 55931
Number of obs. plotted = 245 Number of outliers = 95

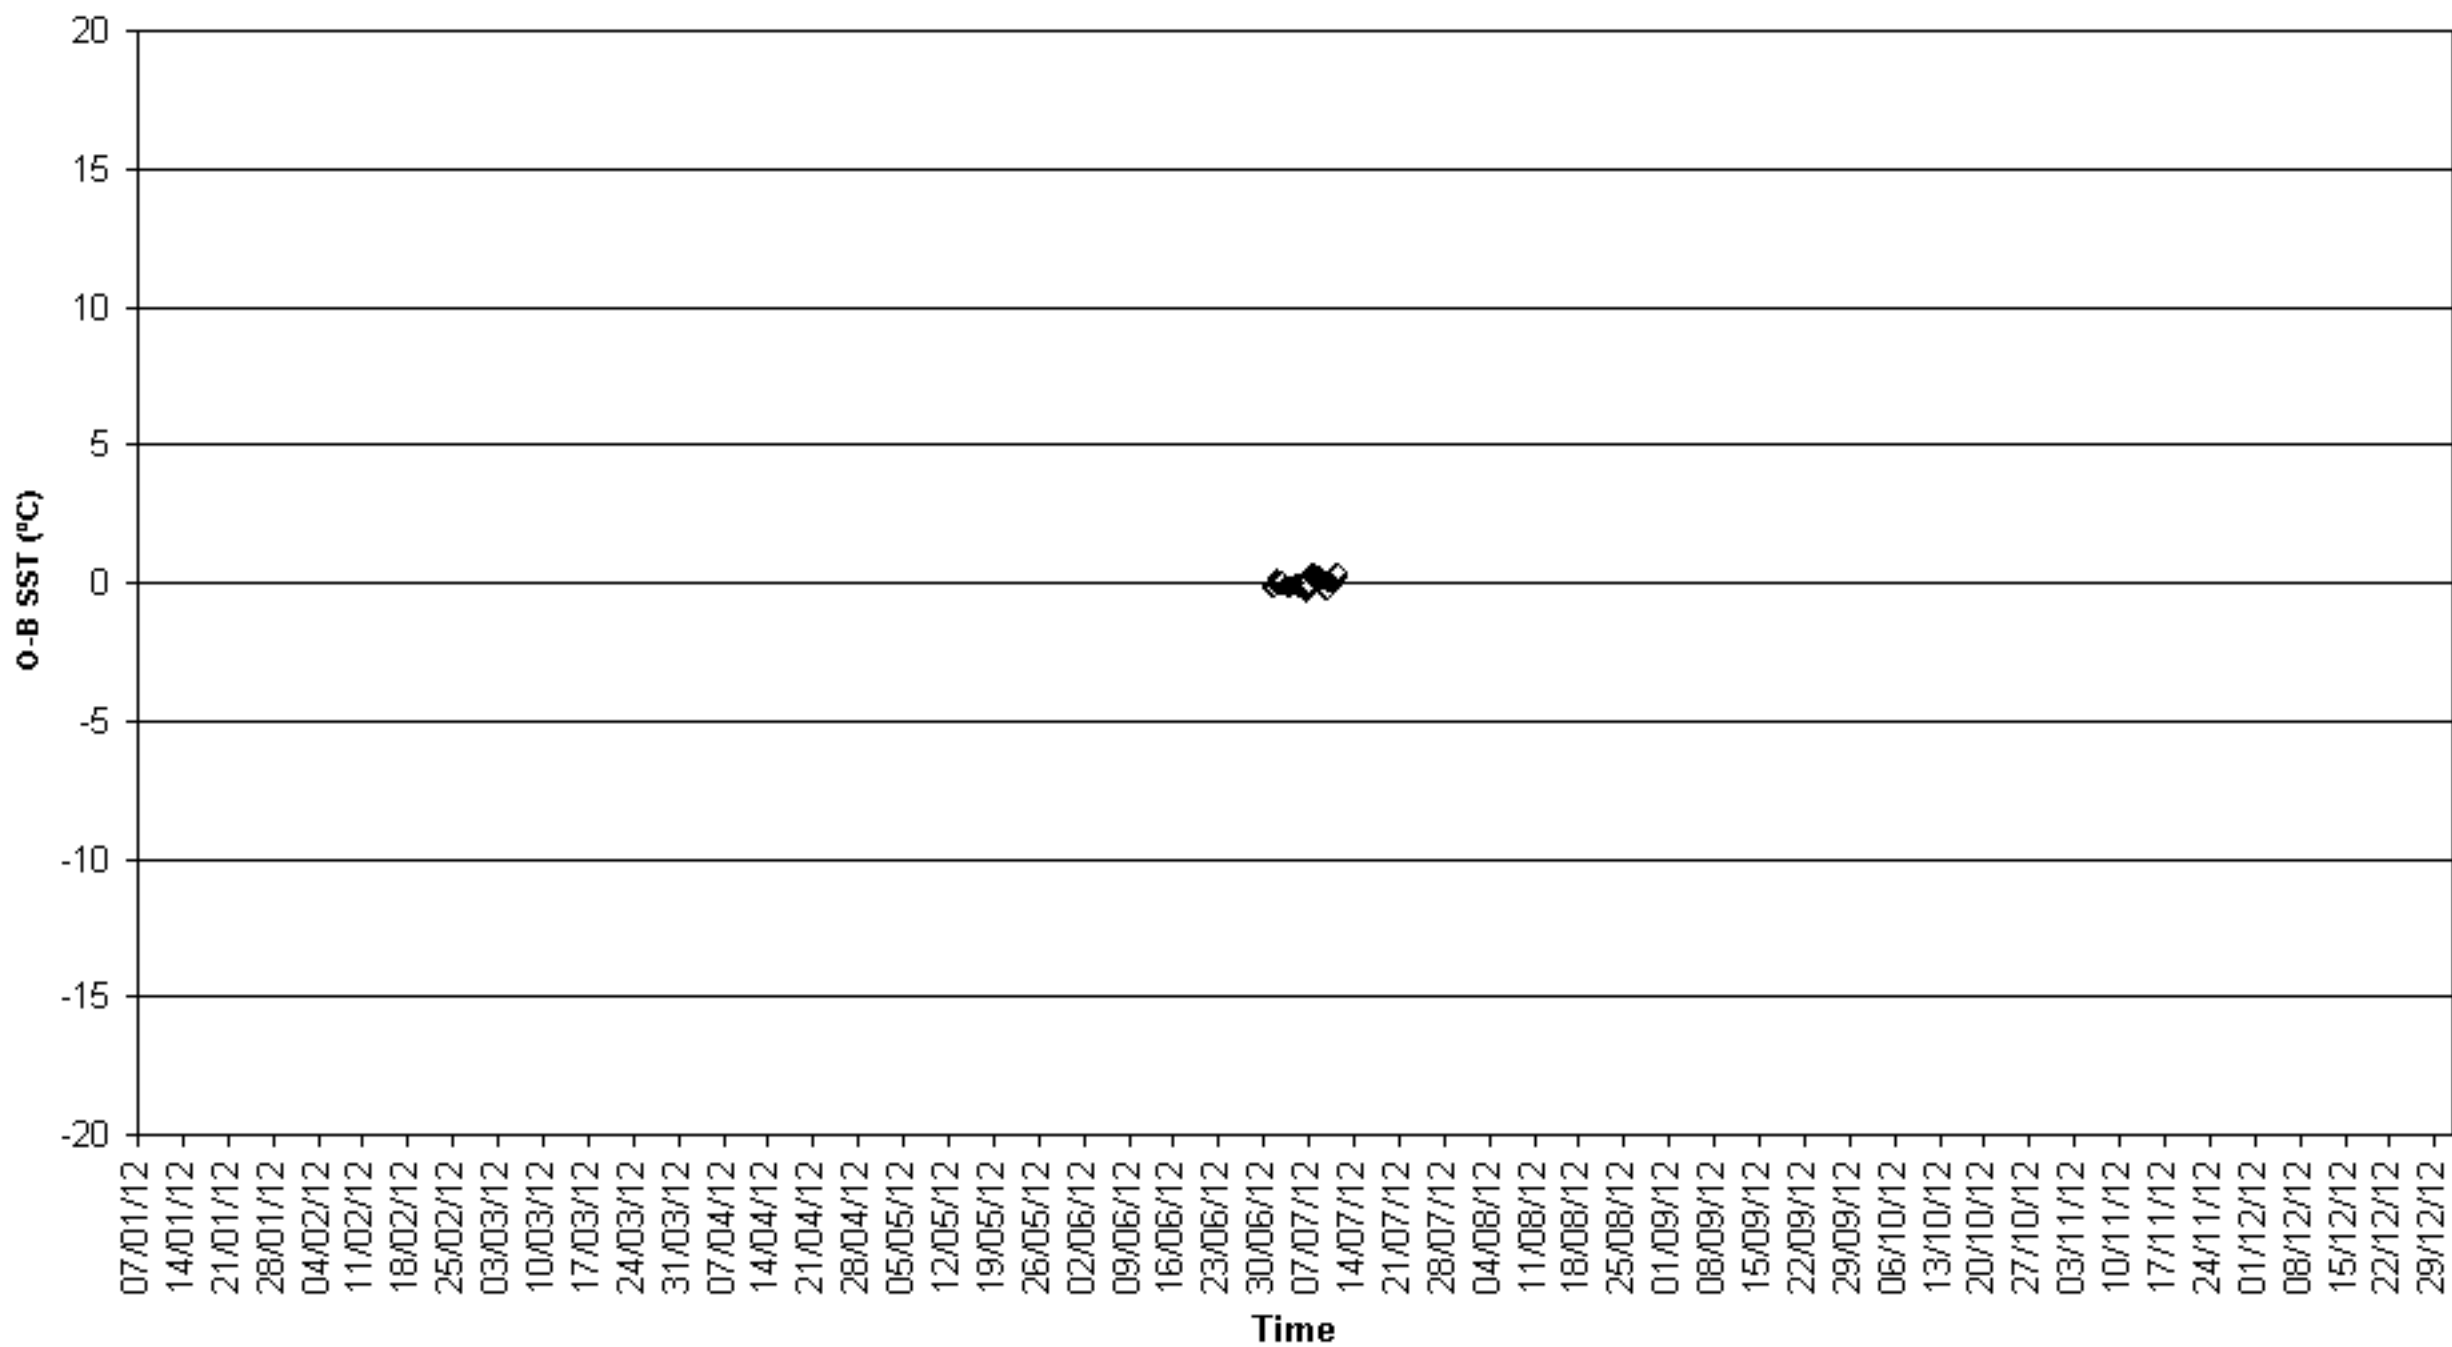


O-B SST (°C) for identifier 56554
Number of obs. plotted = 564 Number of outliers = 308

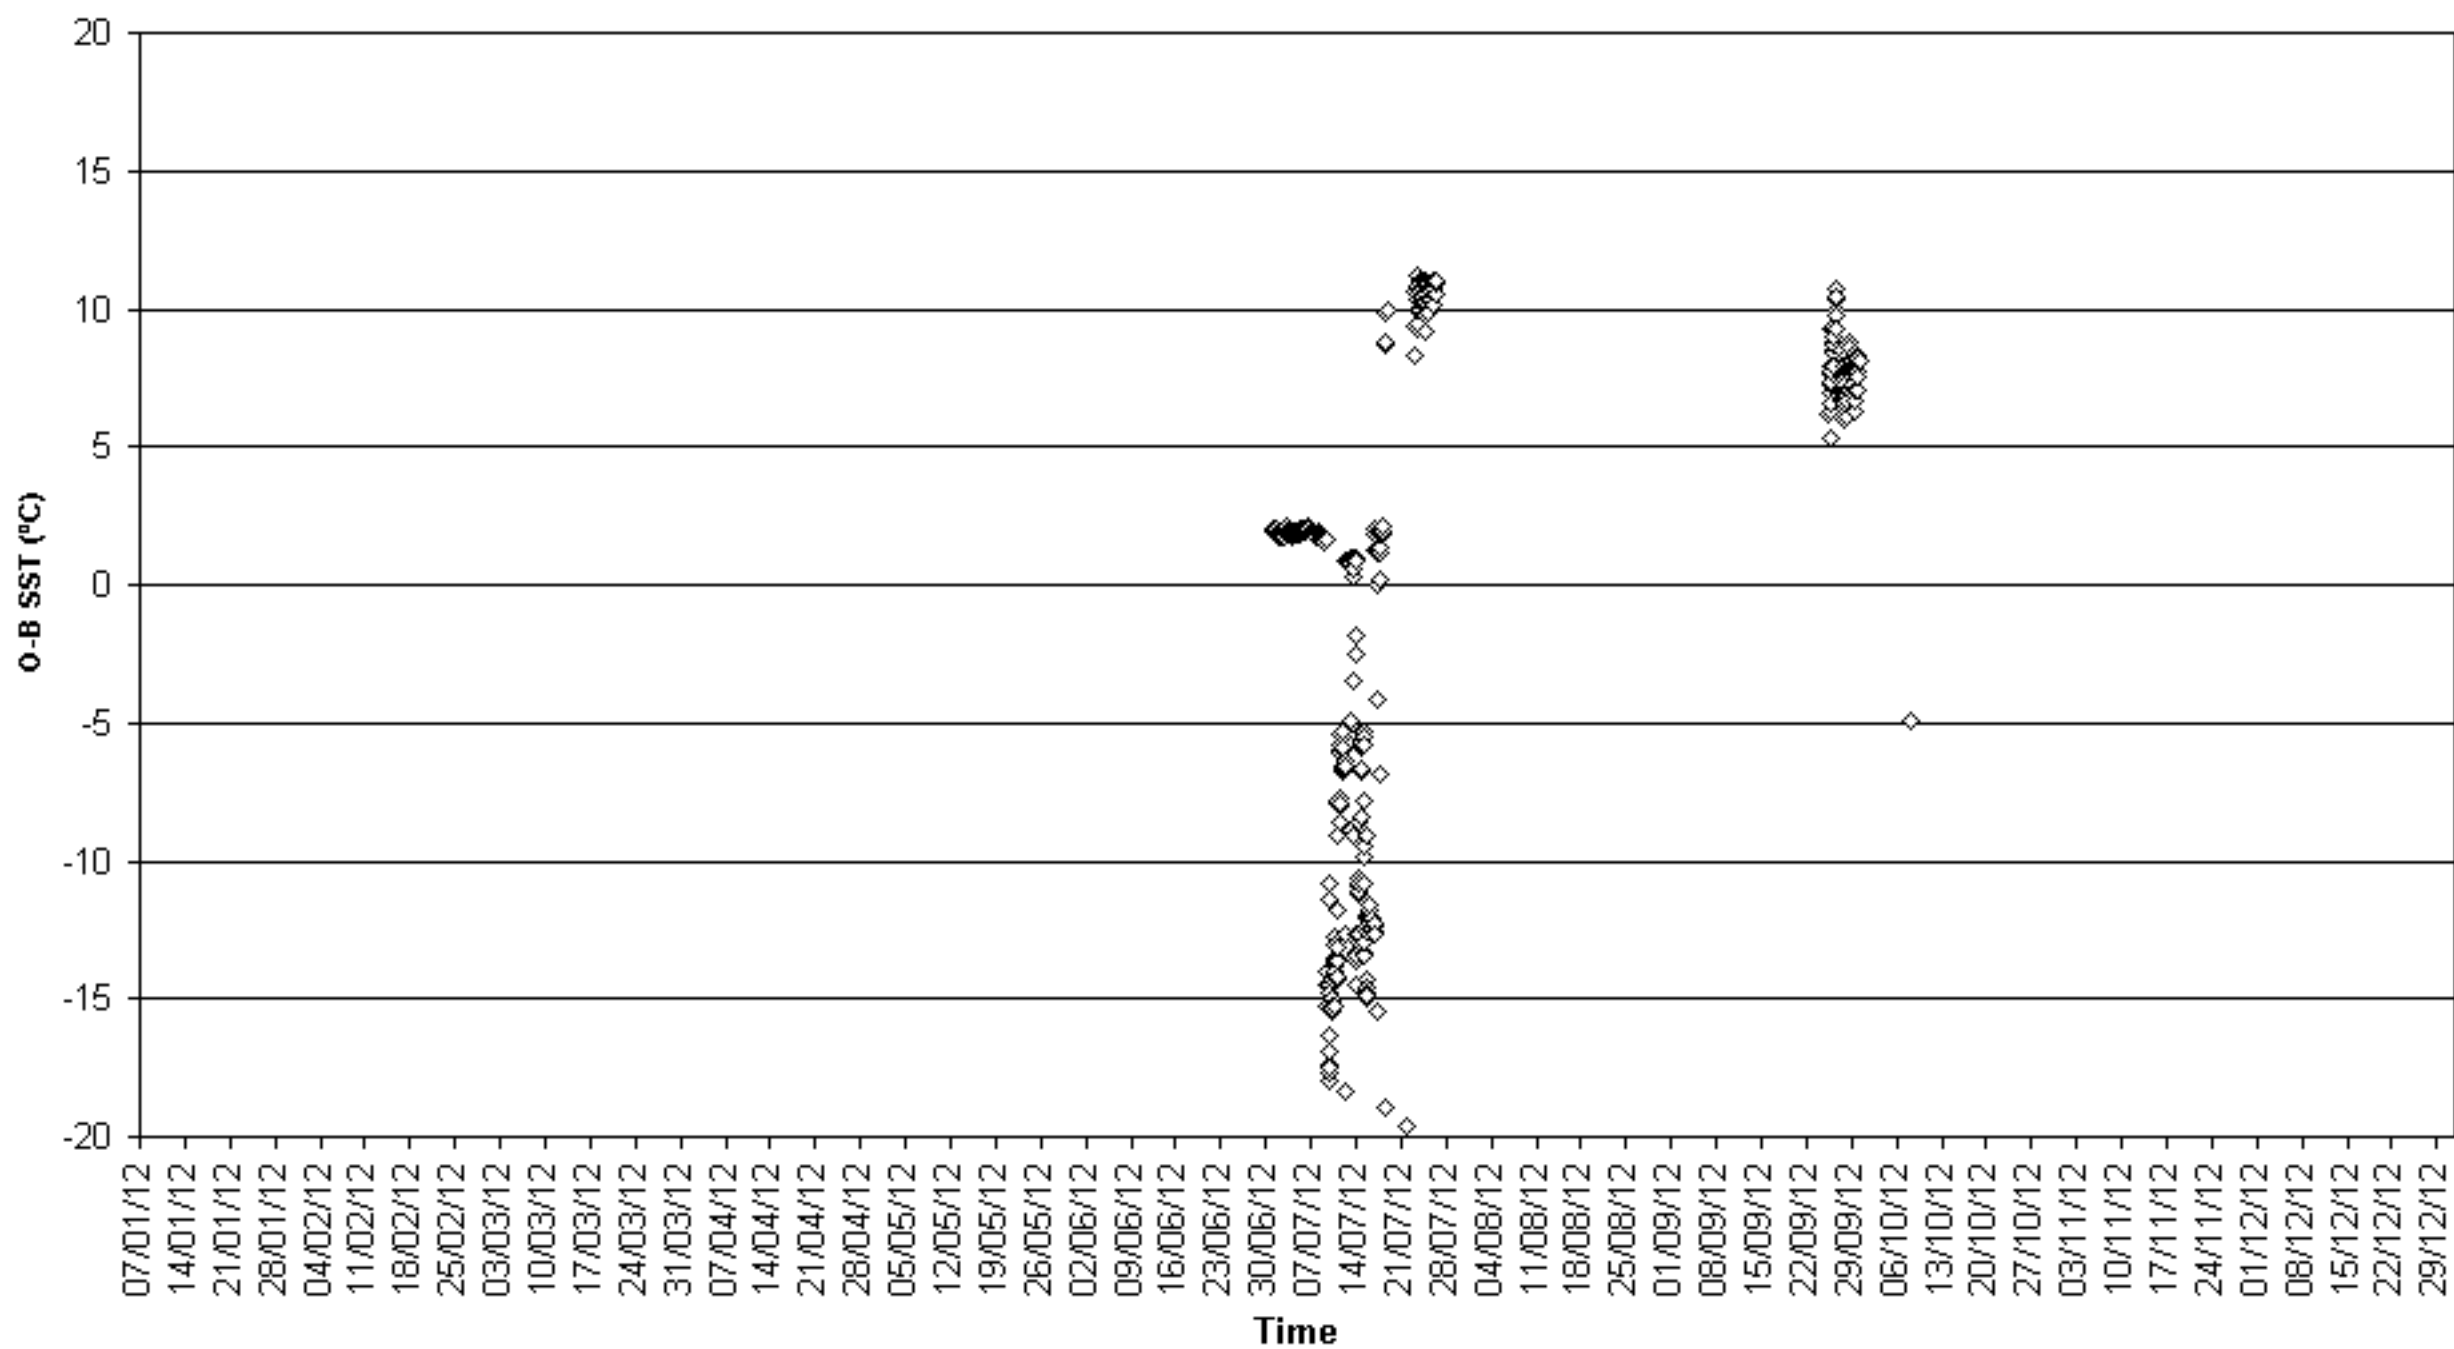


O-B SST (°C) for identifier 56910
Number of obs. plotted = 280 Number of outliers = 104

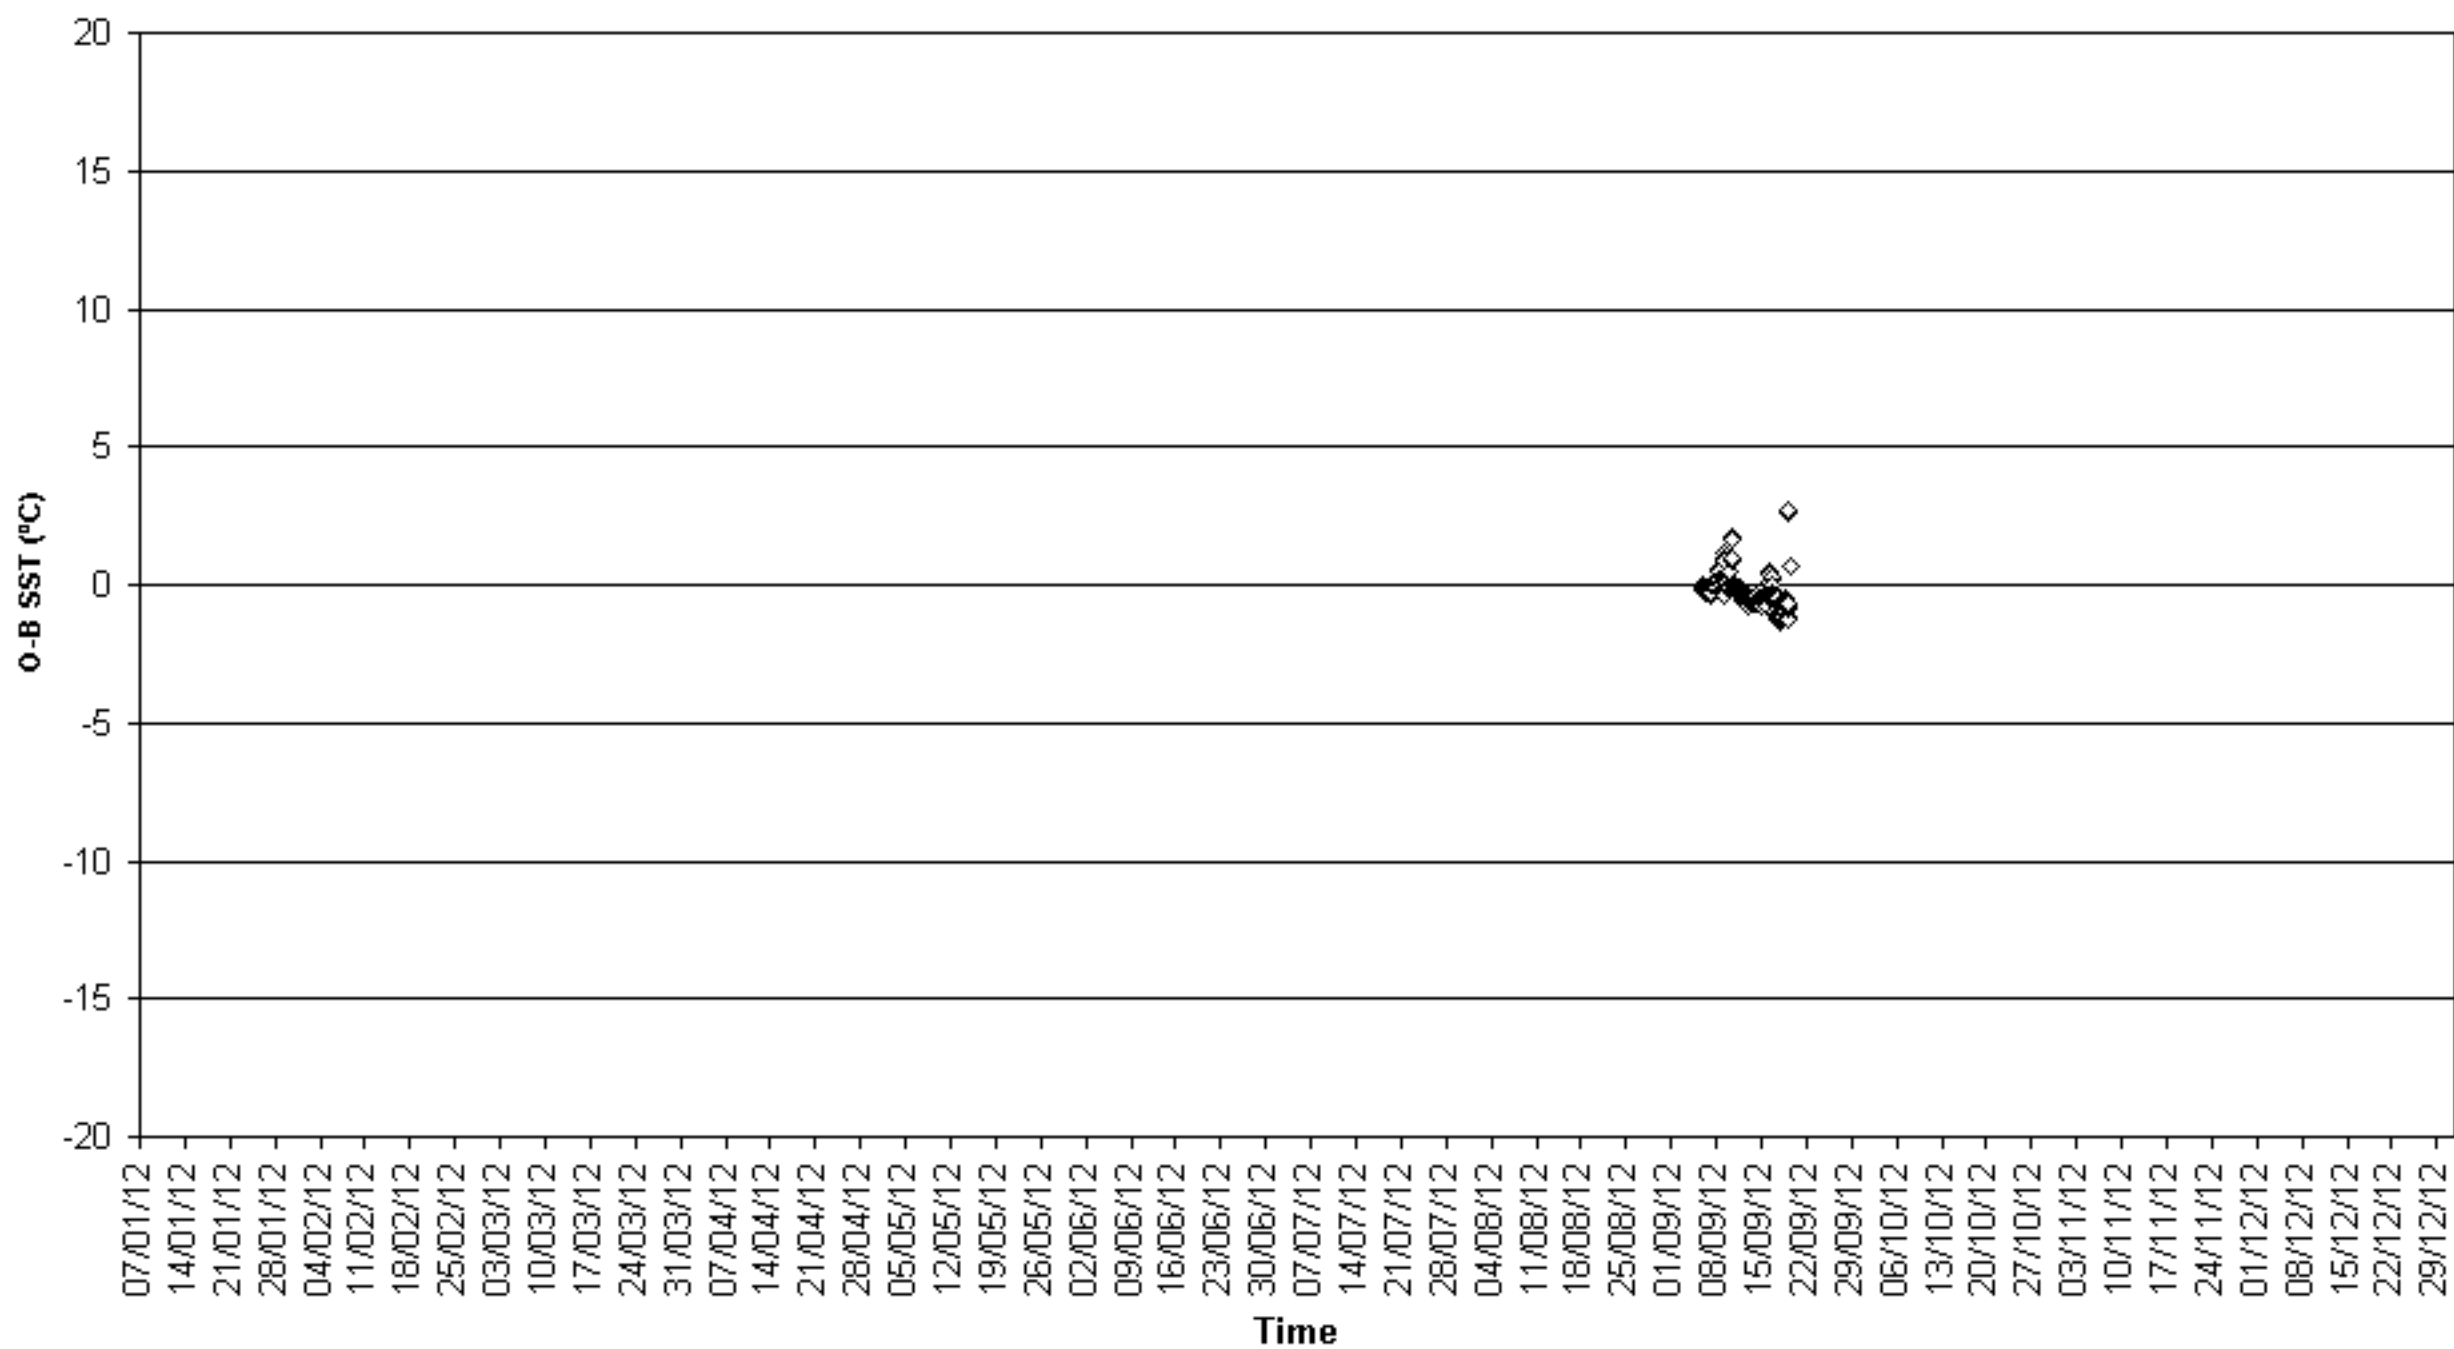


O-B SST (°C) for identifier 61689
Number of obs. plotted = 95 Number of outliers = 0

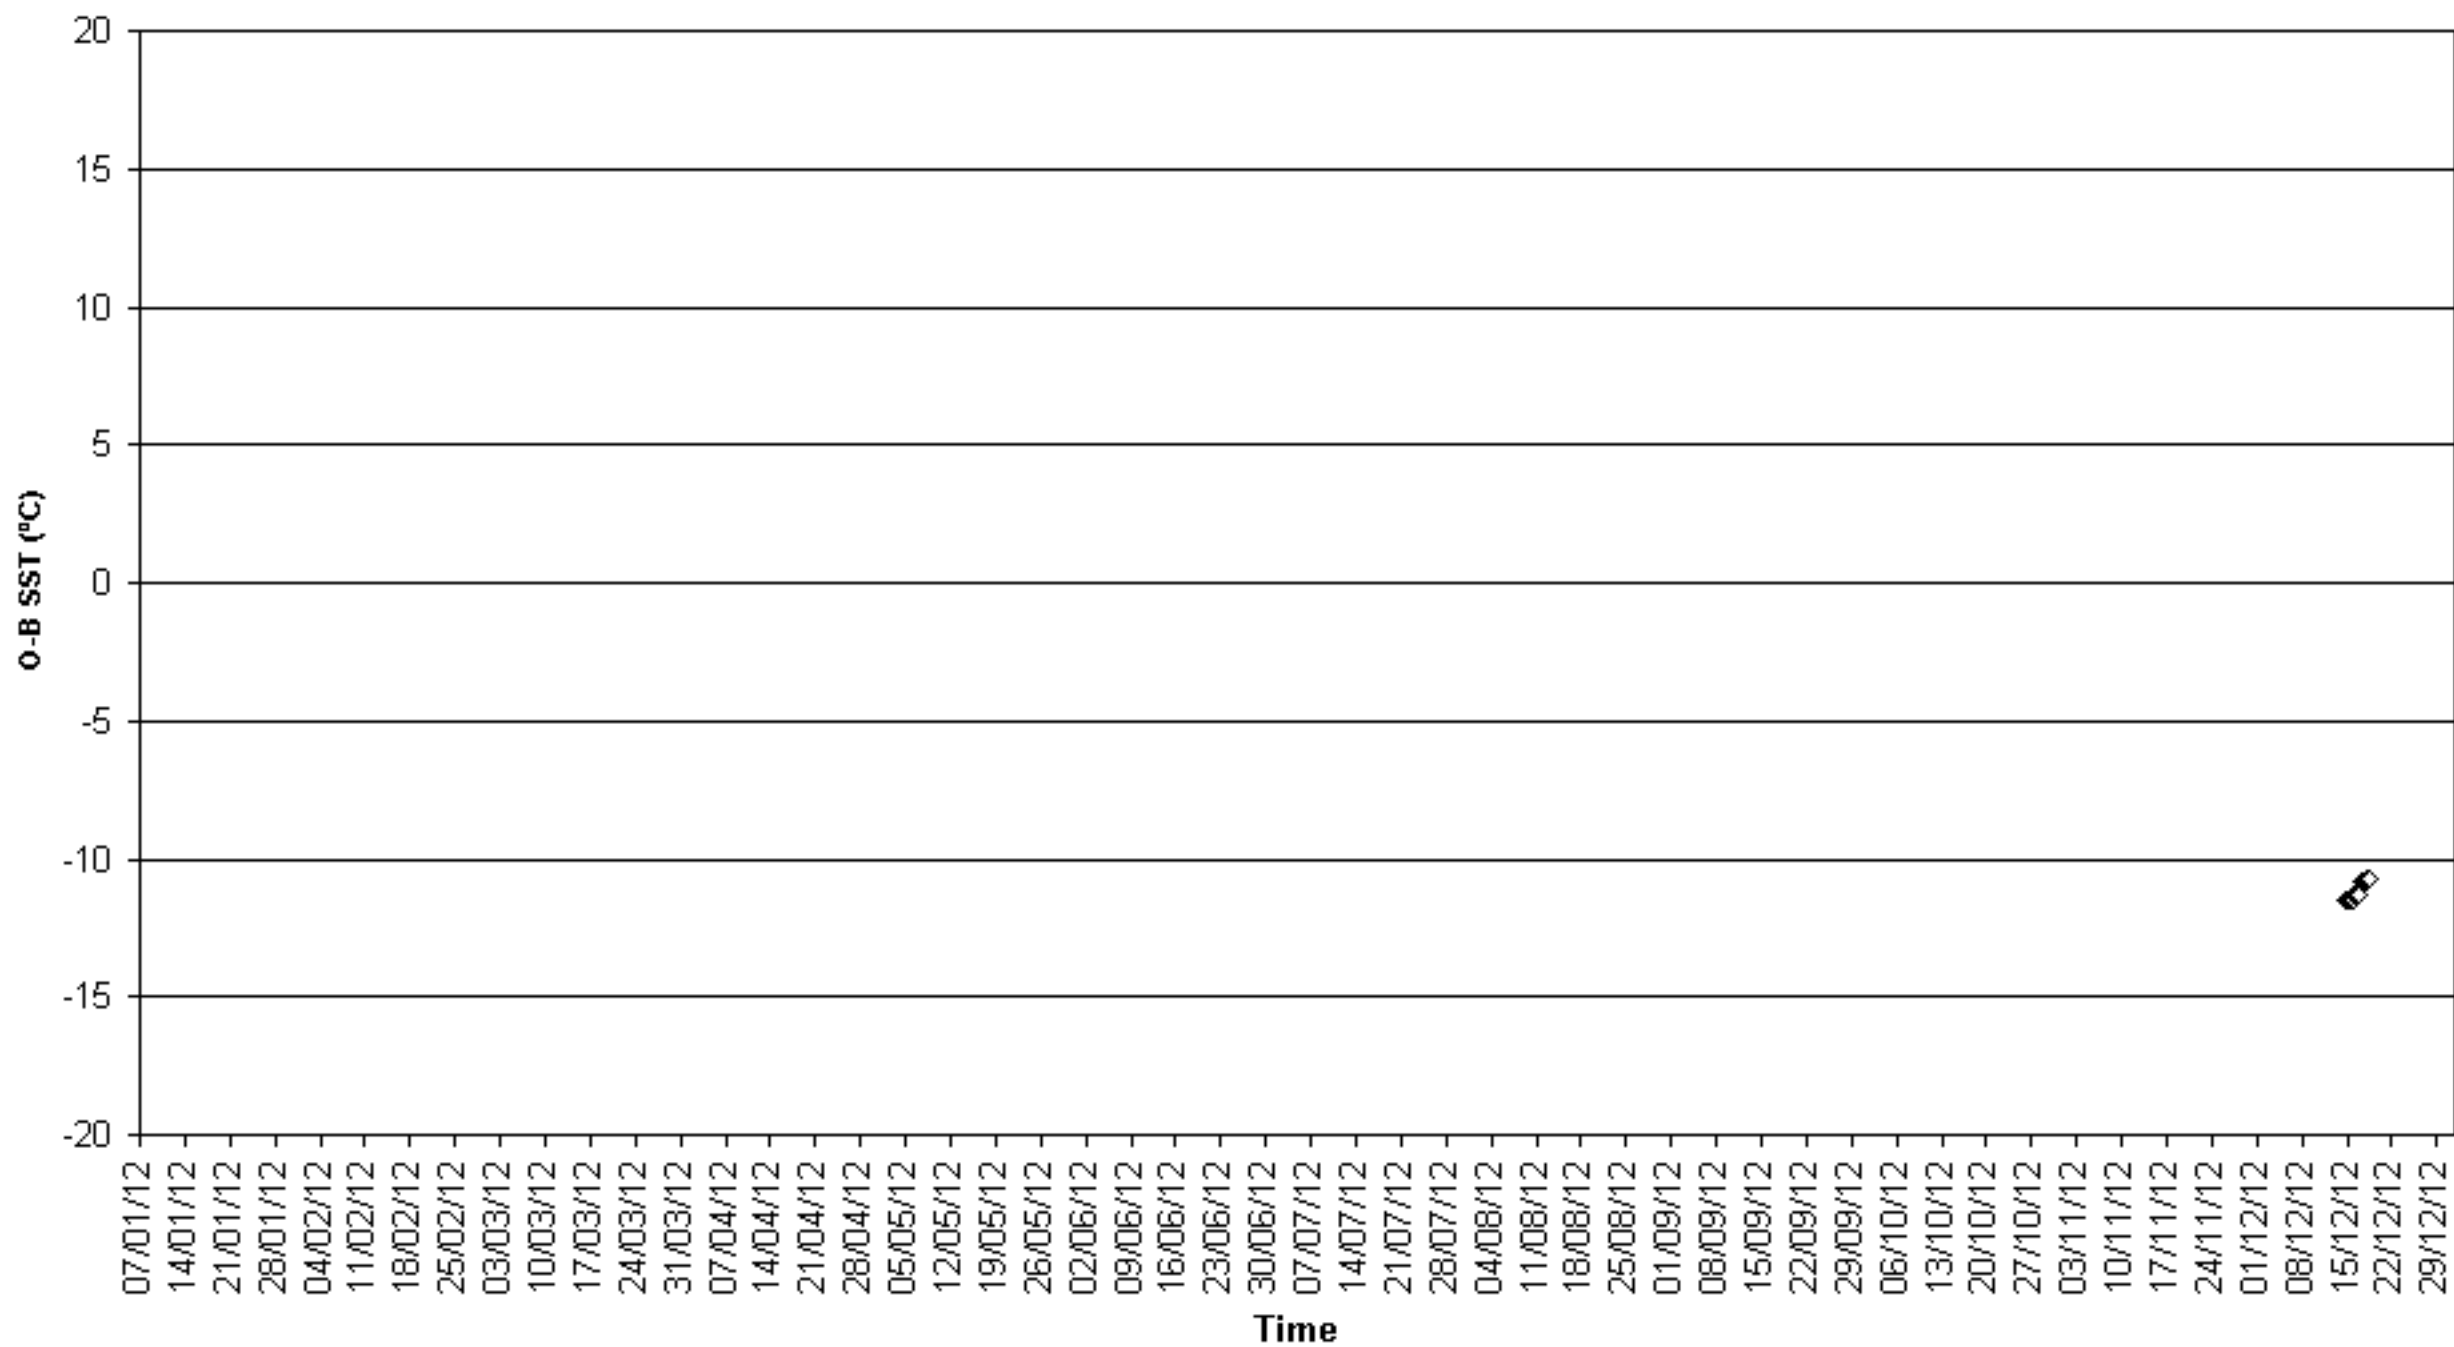


O-B SST (°C) for identifier 64722
Number of obs. plotted = 548 Number of outliers = 439

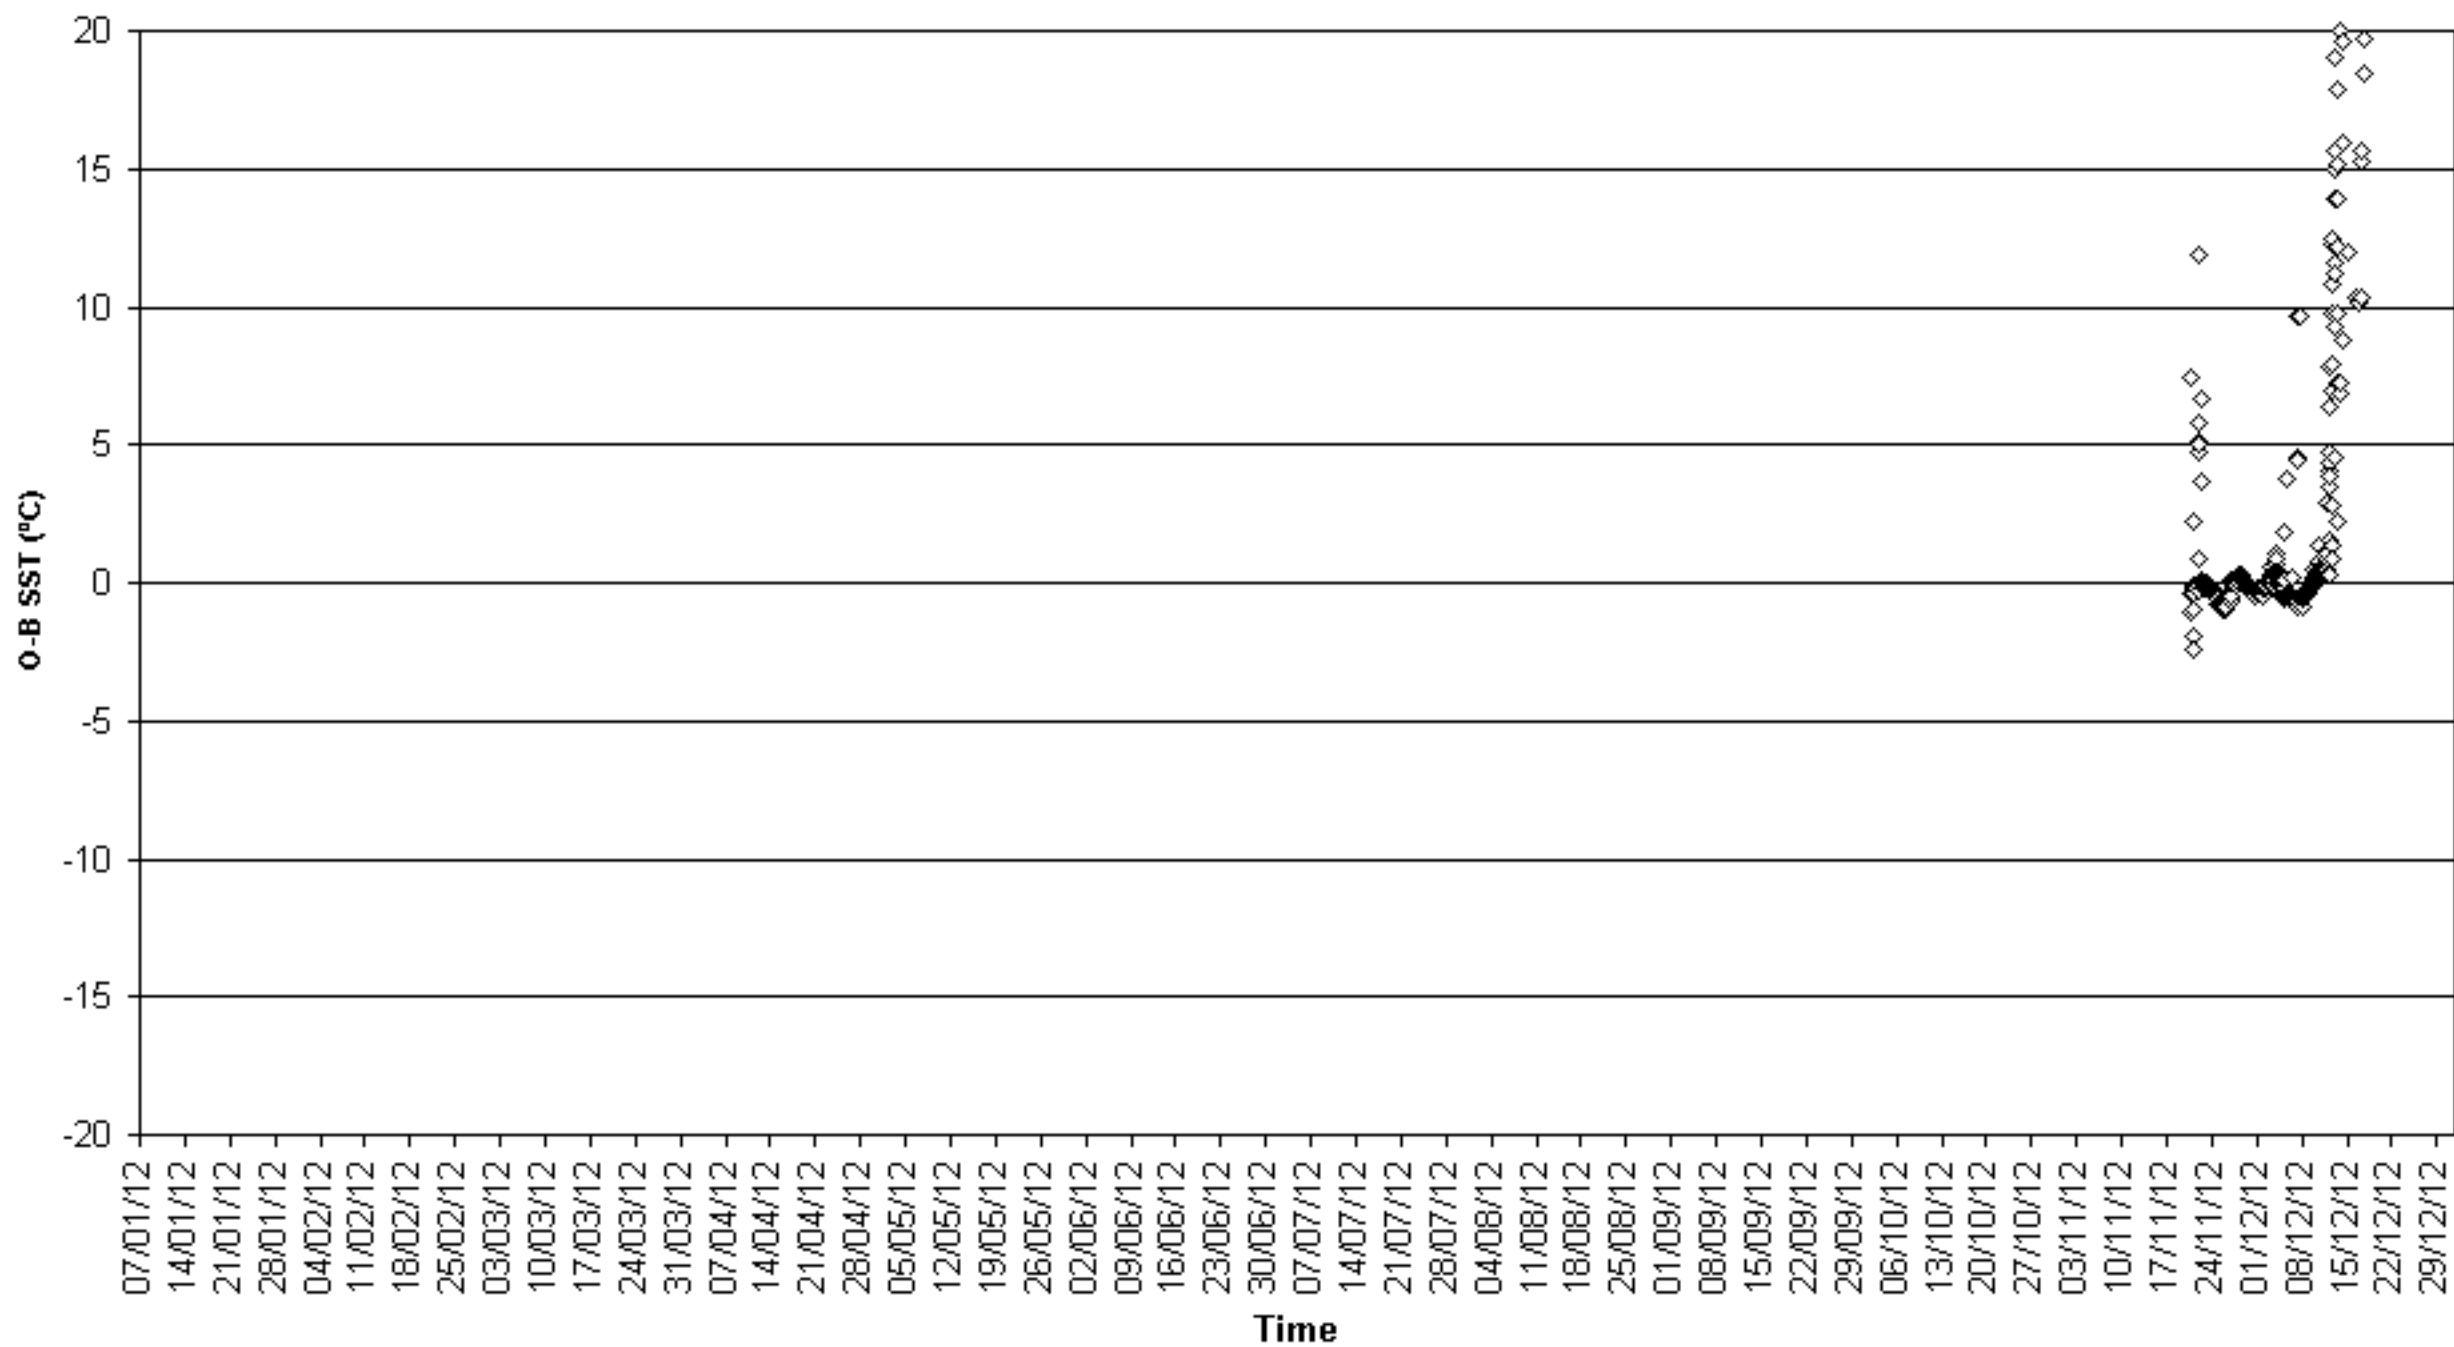


O-B SST (°C) for identifier 71572
Number of obs. plotted = 38 Number of outliers = 102

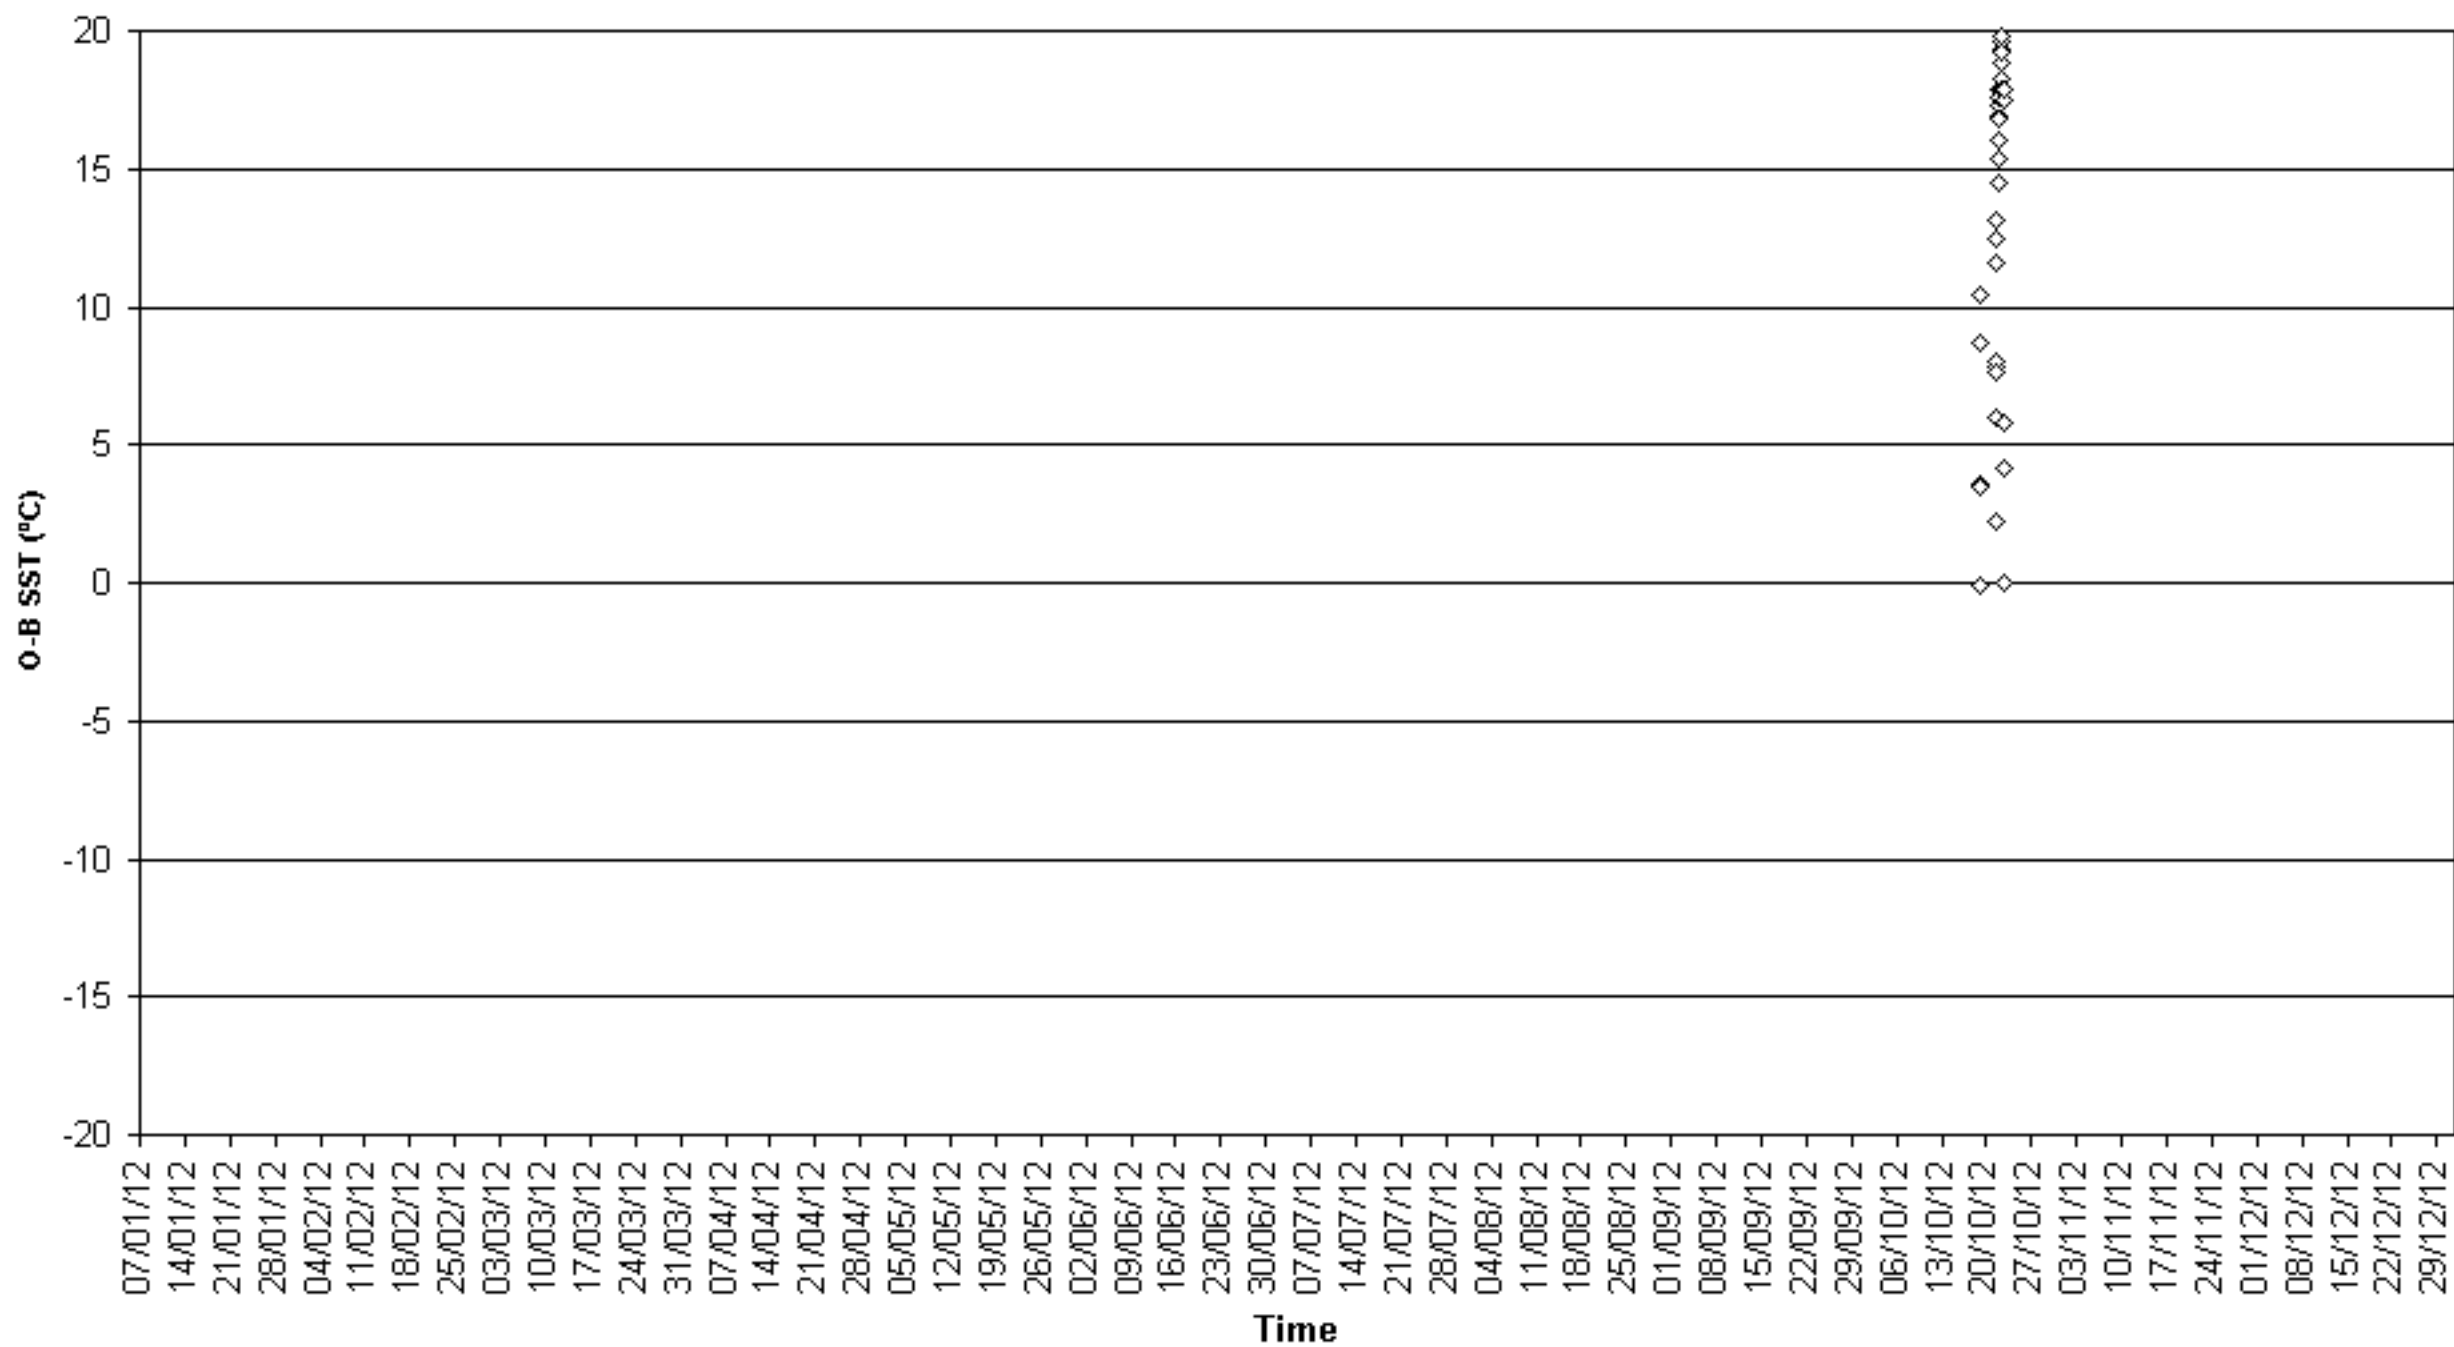


O-B SST (°C) for identifier 72829
Number of obs. plotted = 2066 Number of outliers = 172

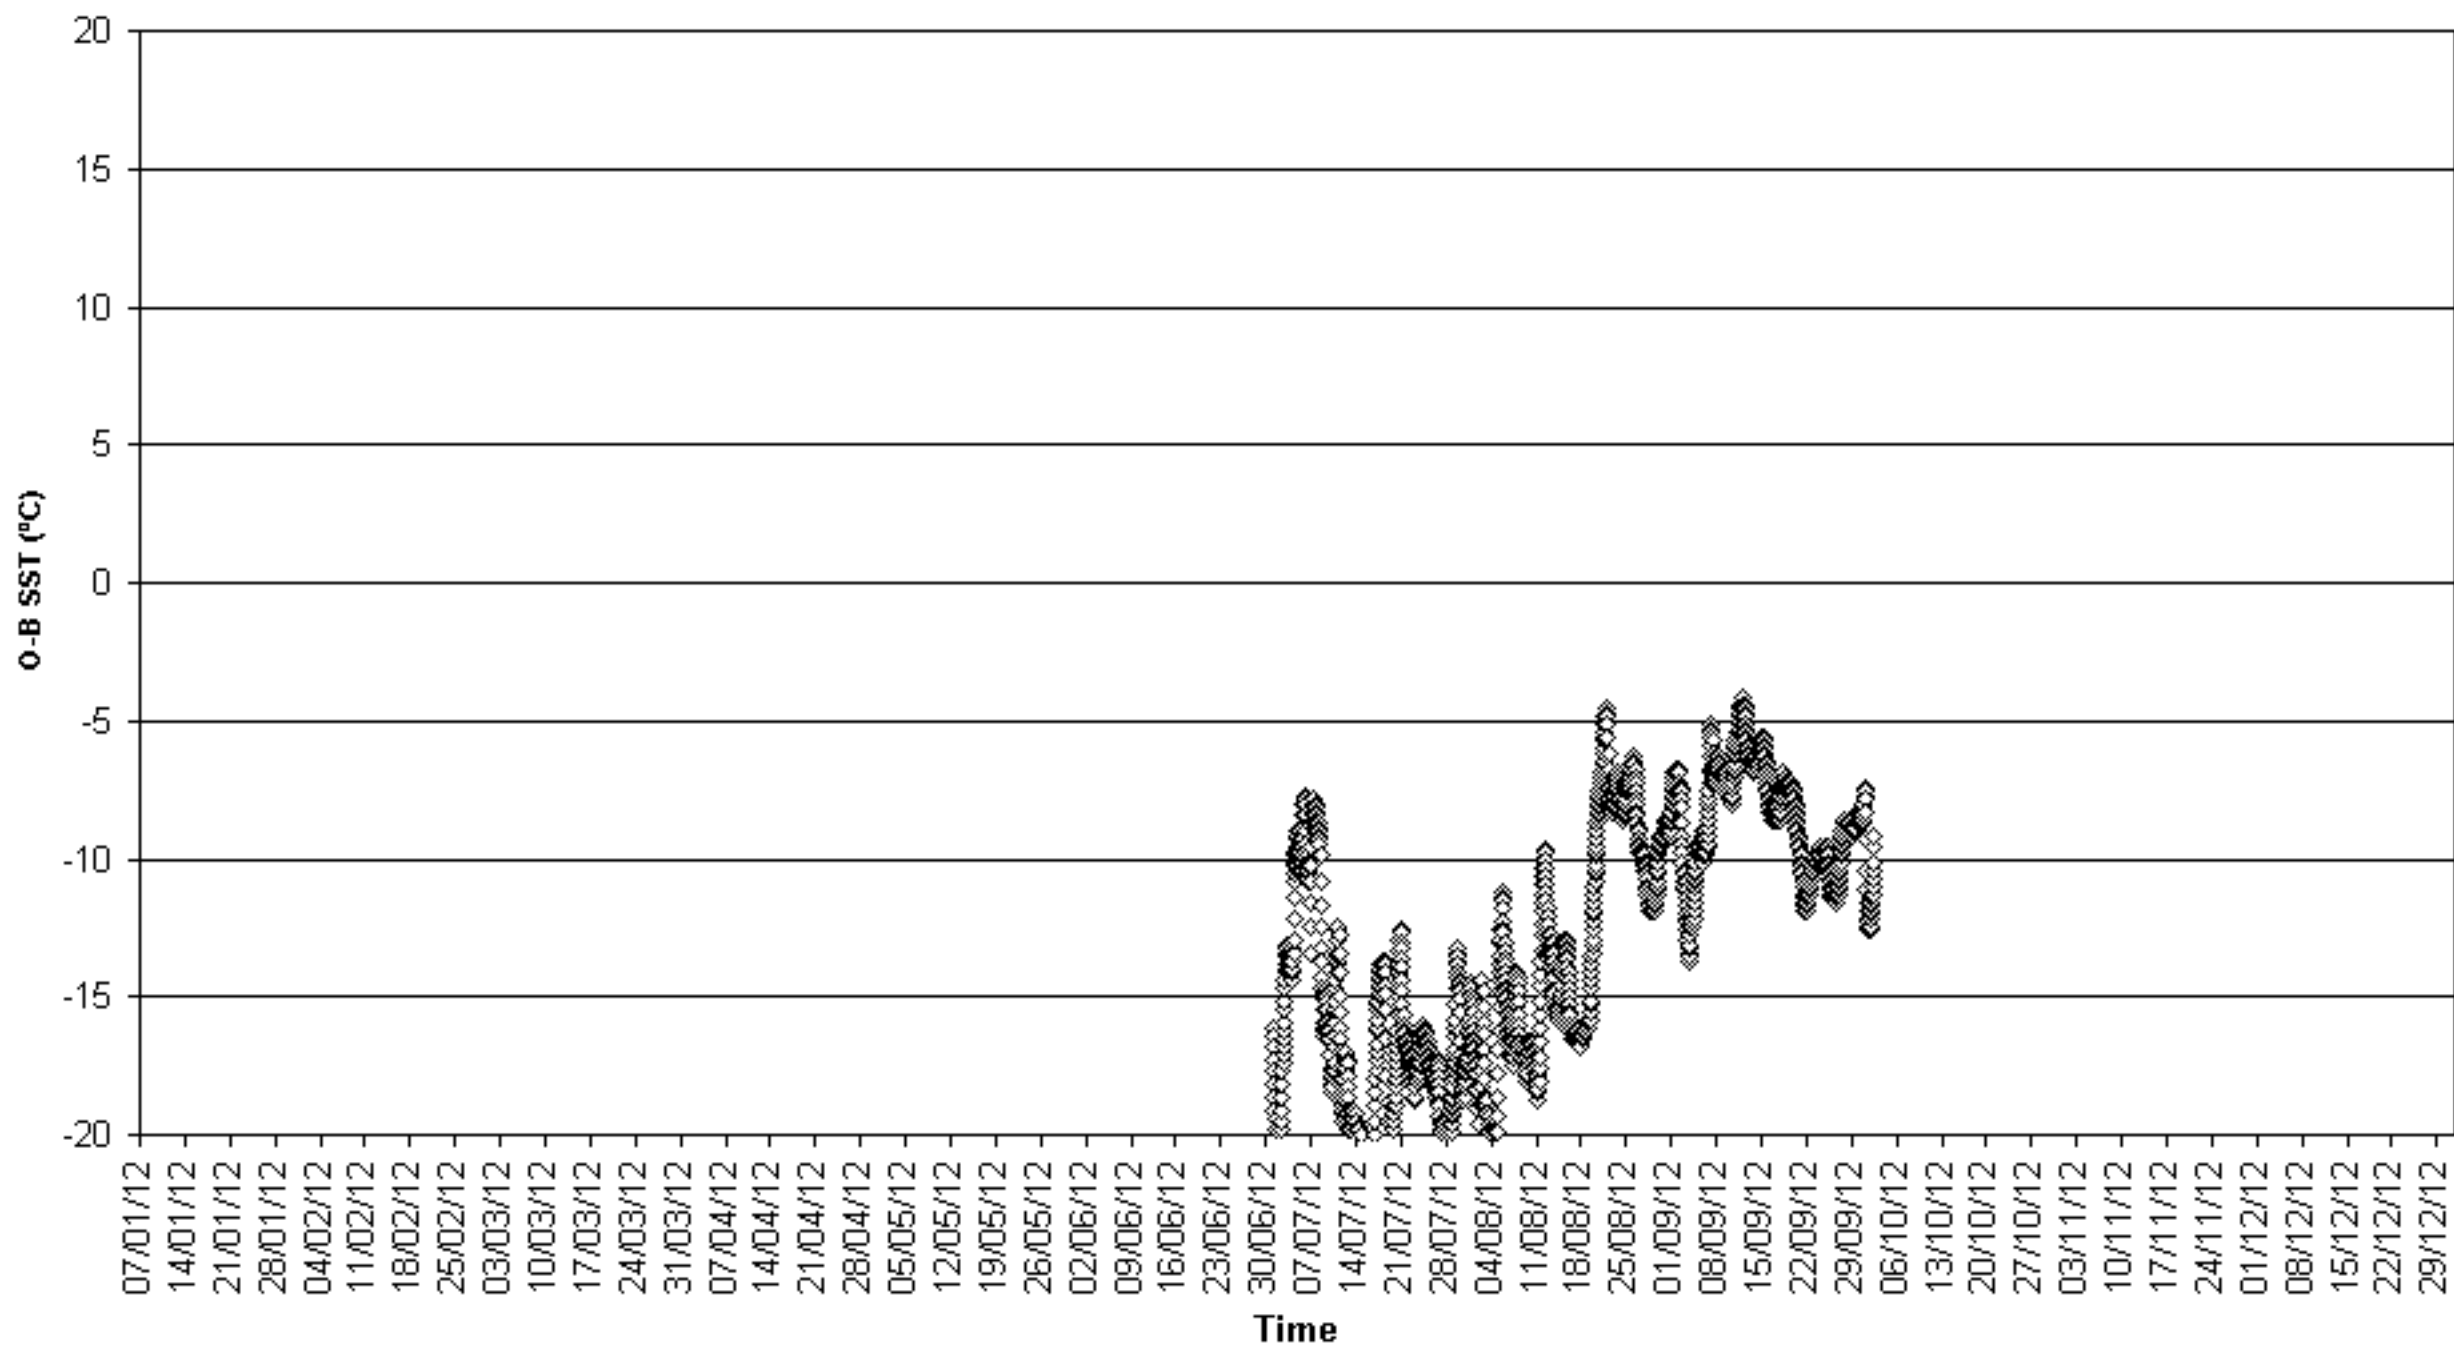


O-B SST (°C) for identifier 9MCY6
Number of obs. plotted = 71 Number of outliers = 11

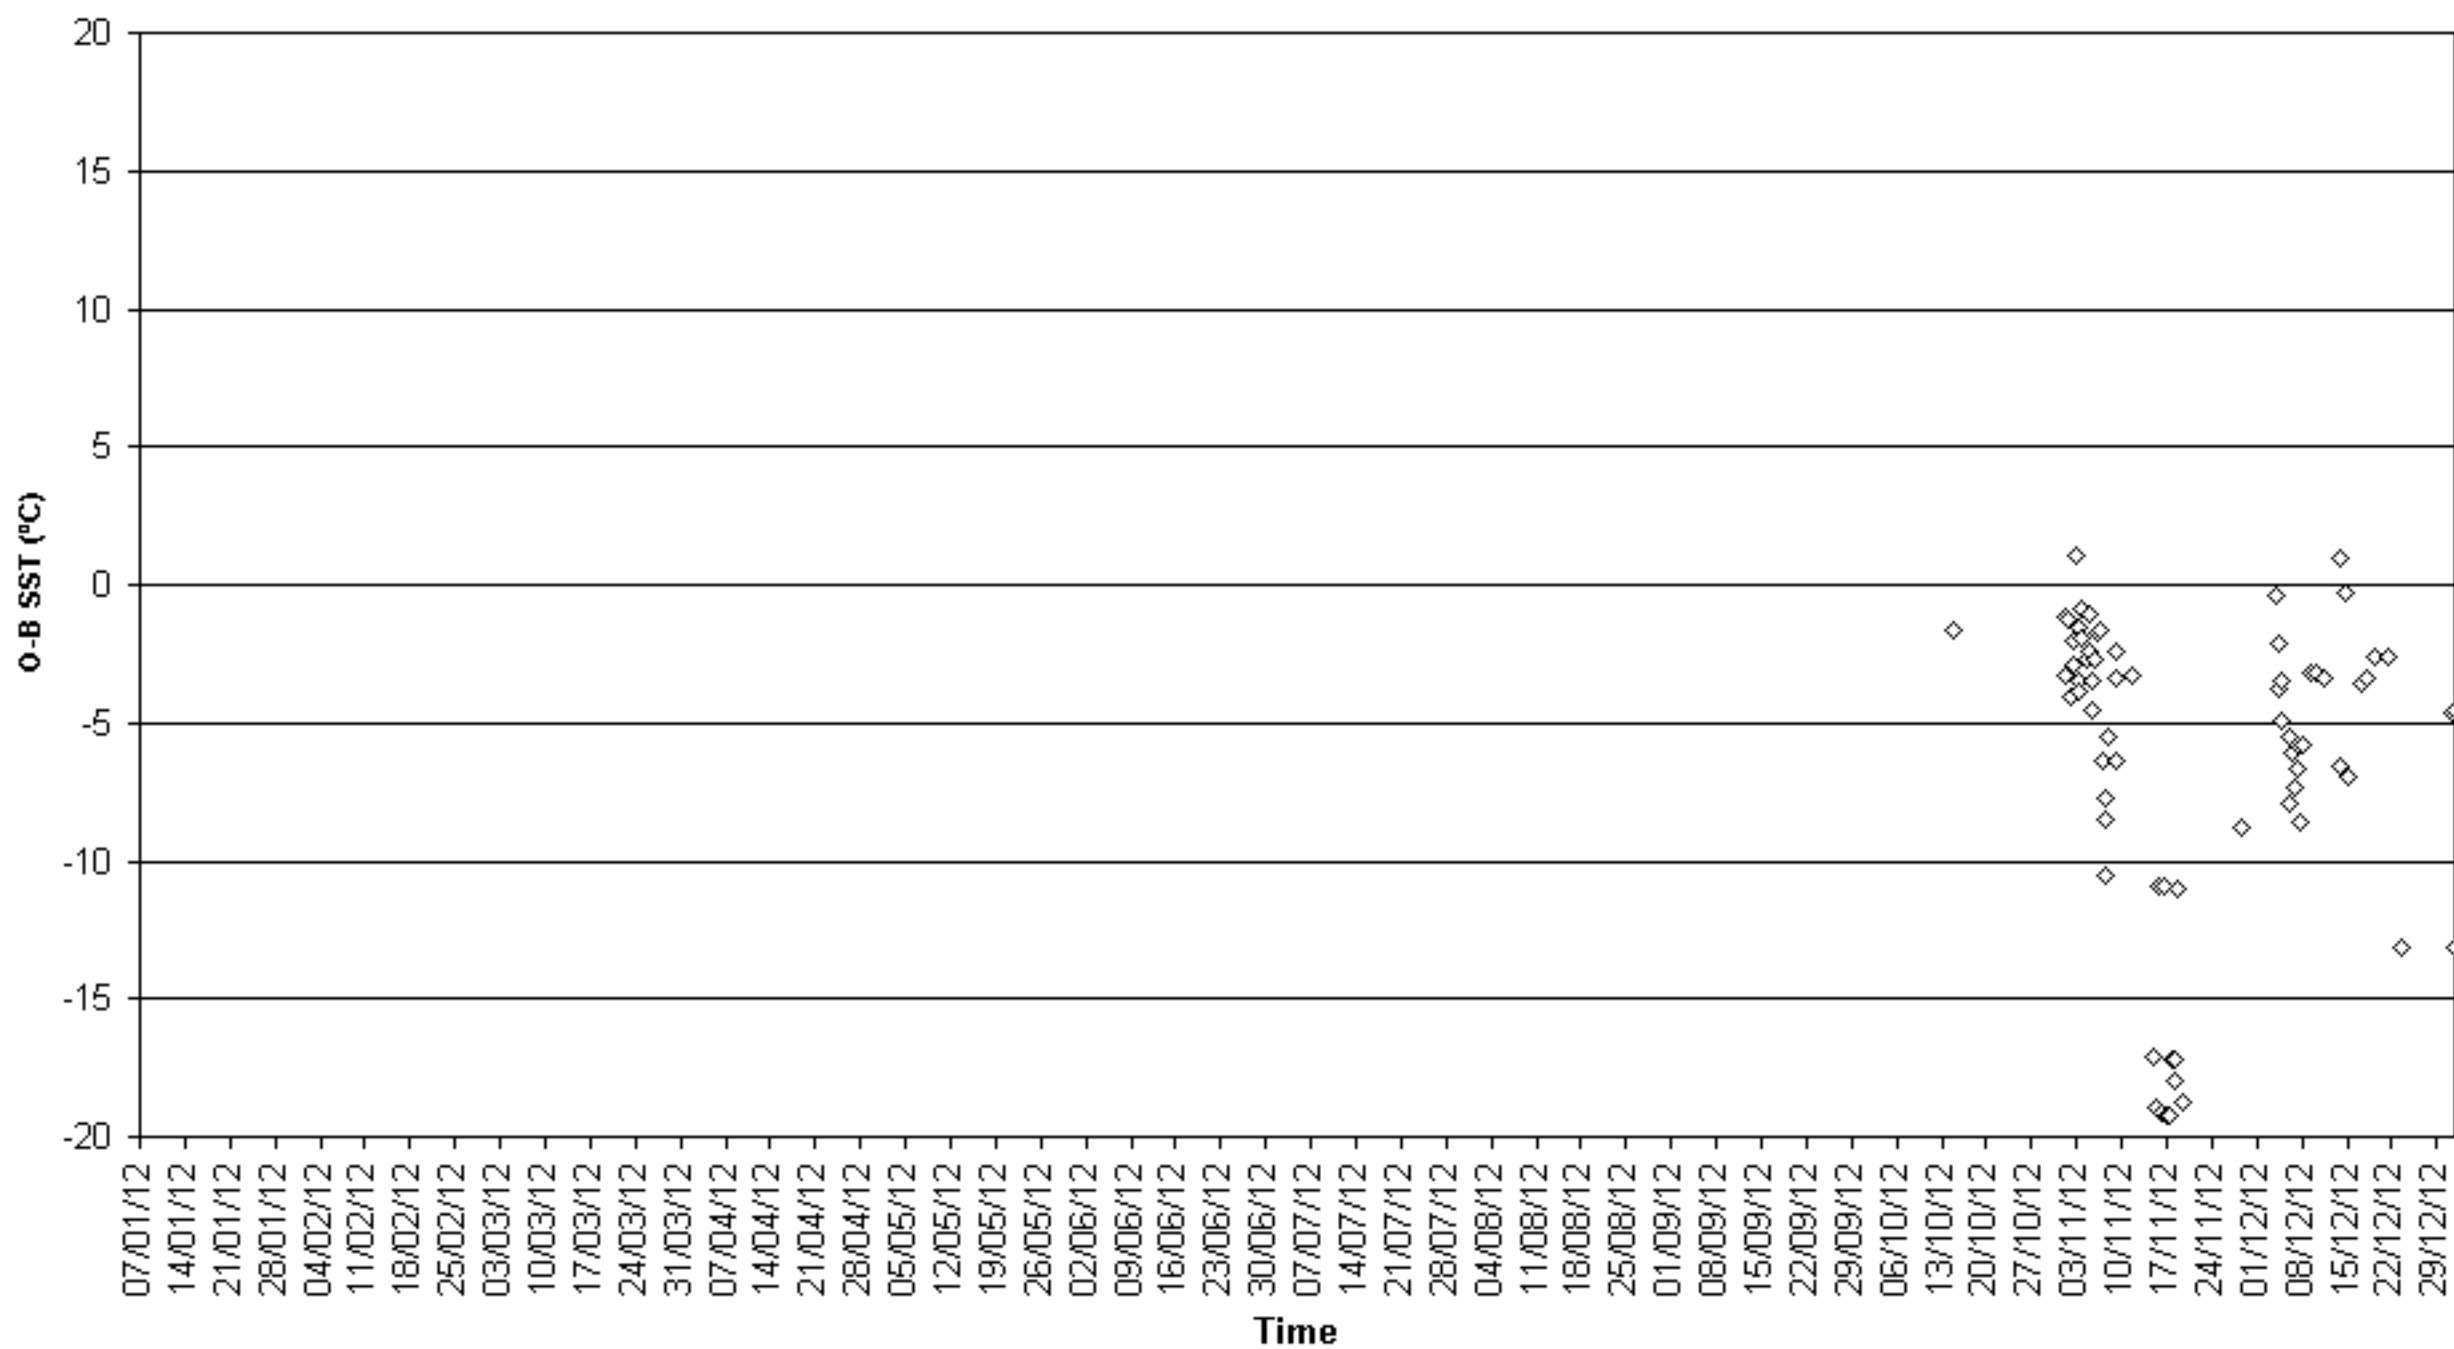


O-B SST (°C) for identifier A8IX8
Number of obs. plotted = 170 Number of outliers = 0

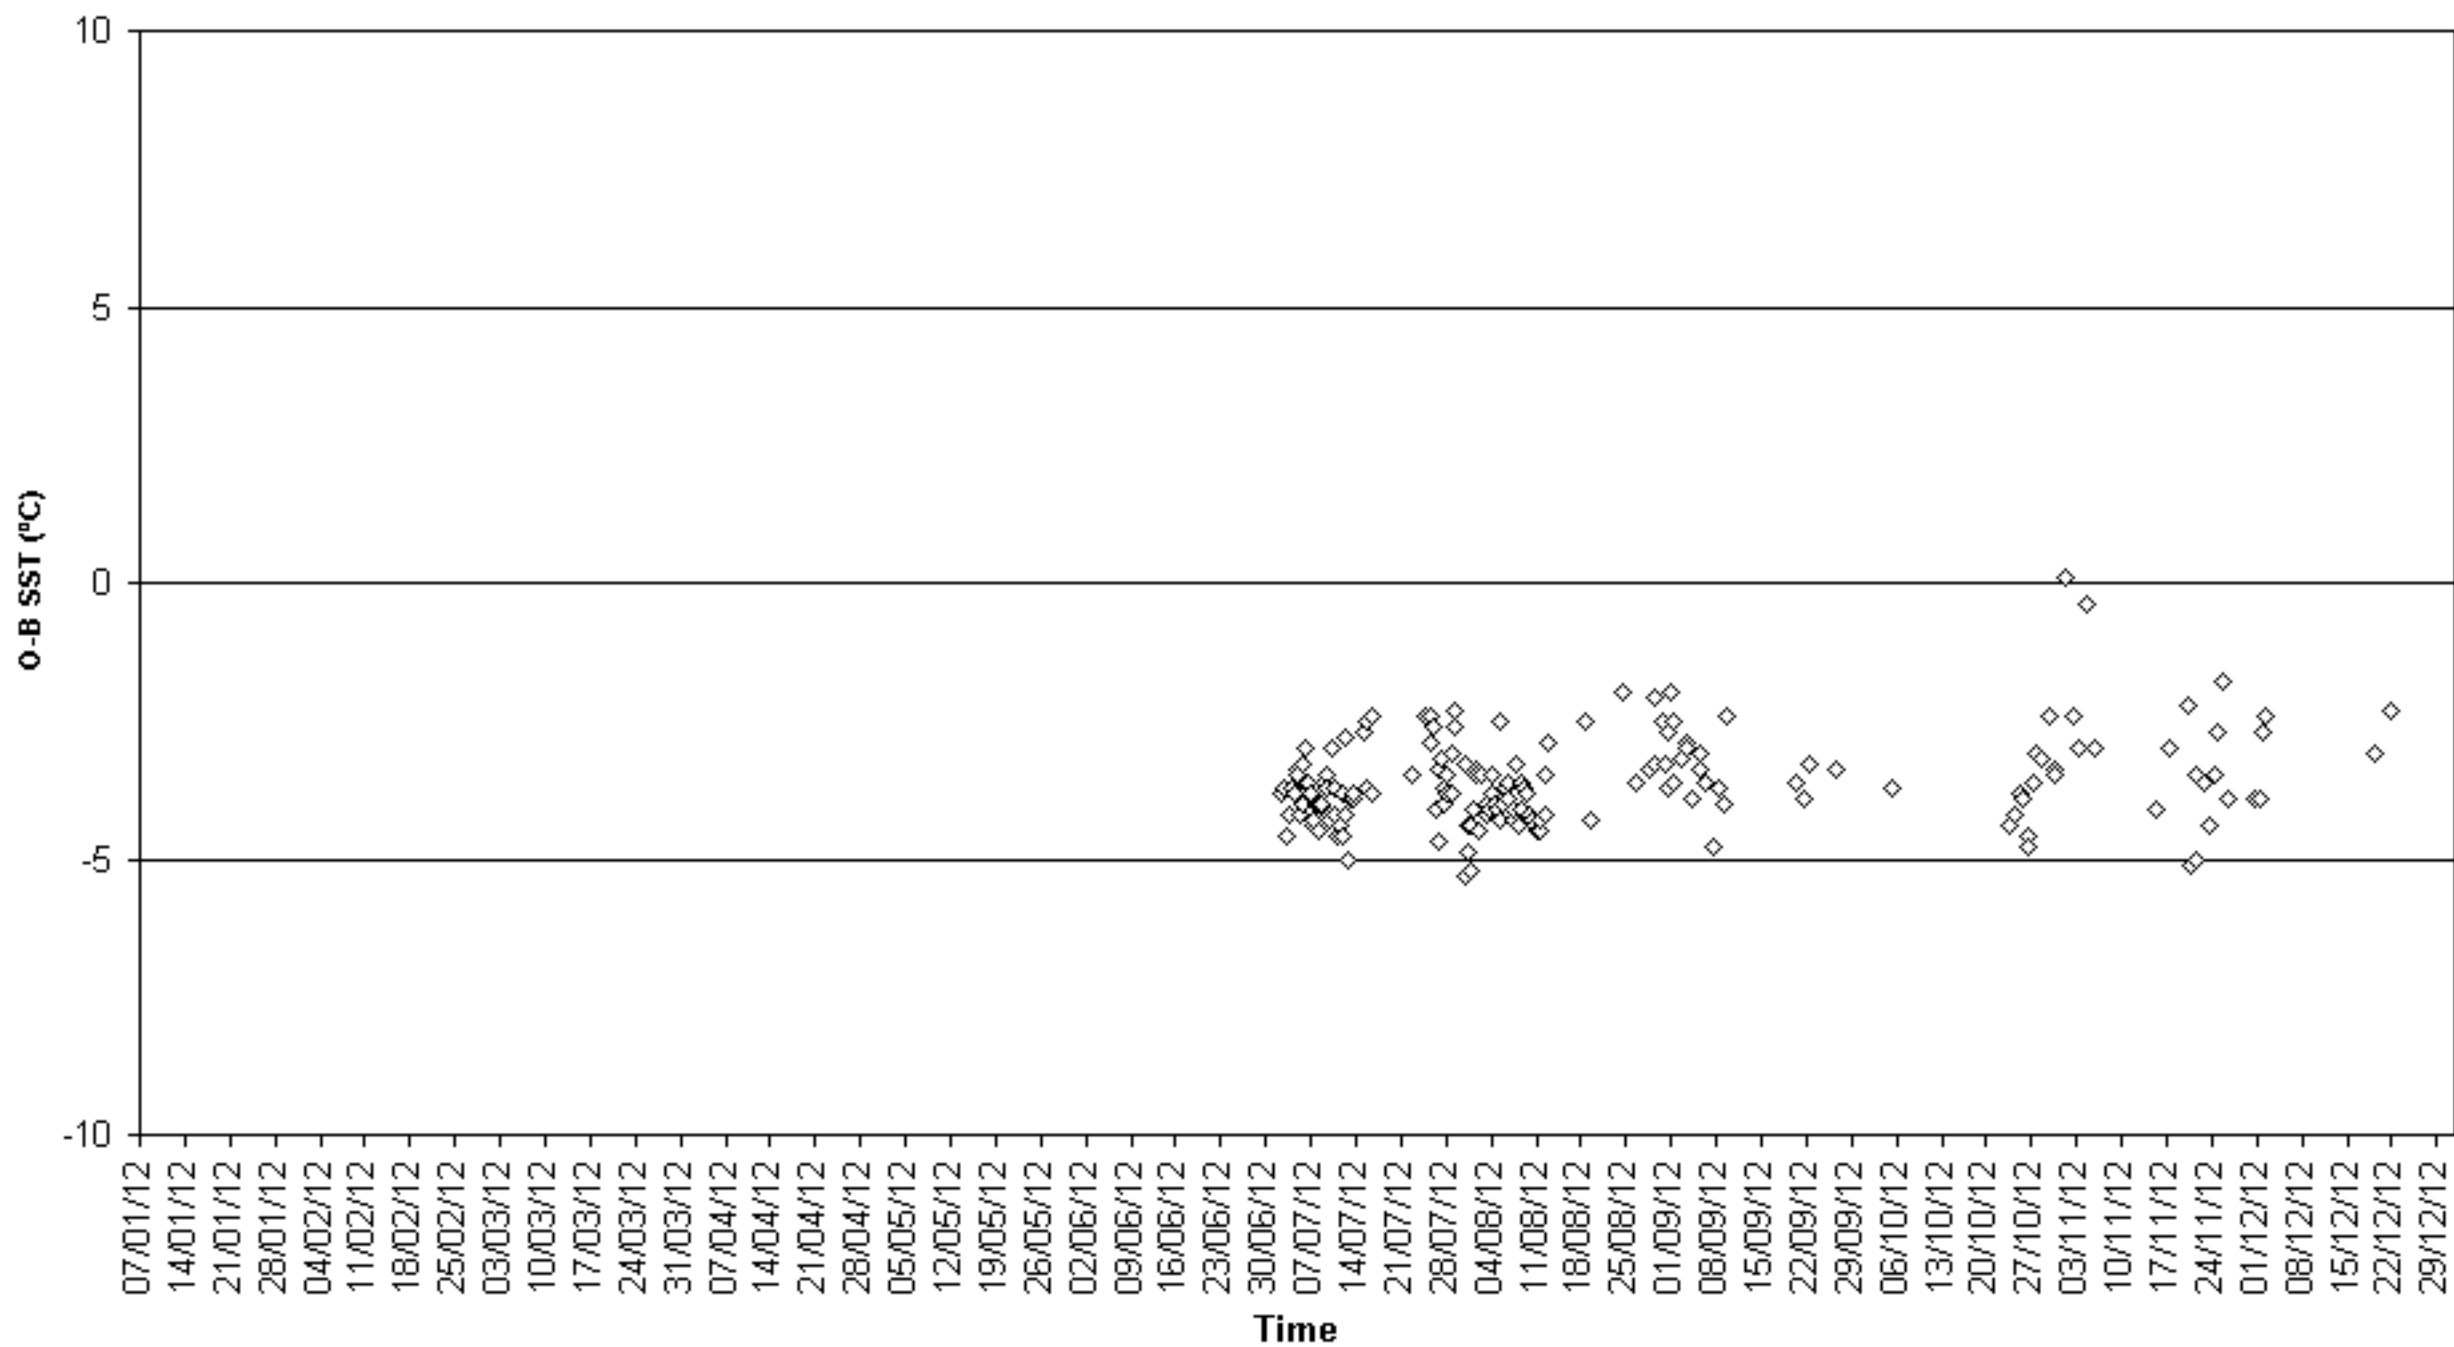


O-B SST (°C) for identifier A8MW6
Number of obs. plotted = 80 Number of outliers = 0

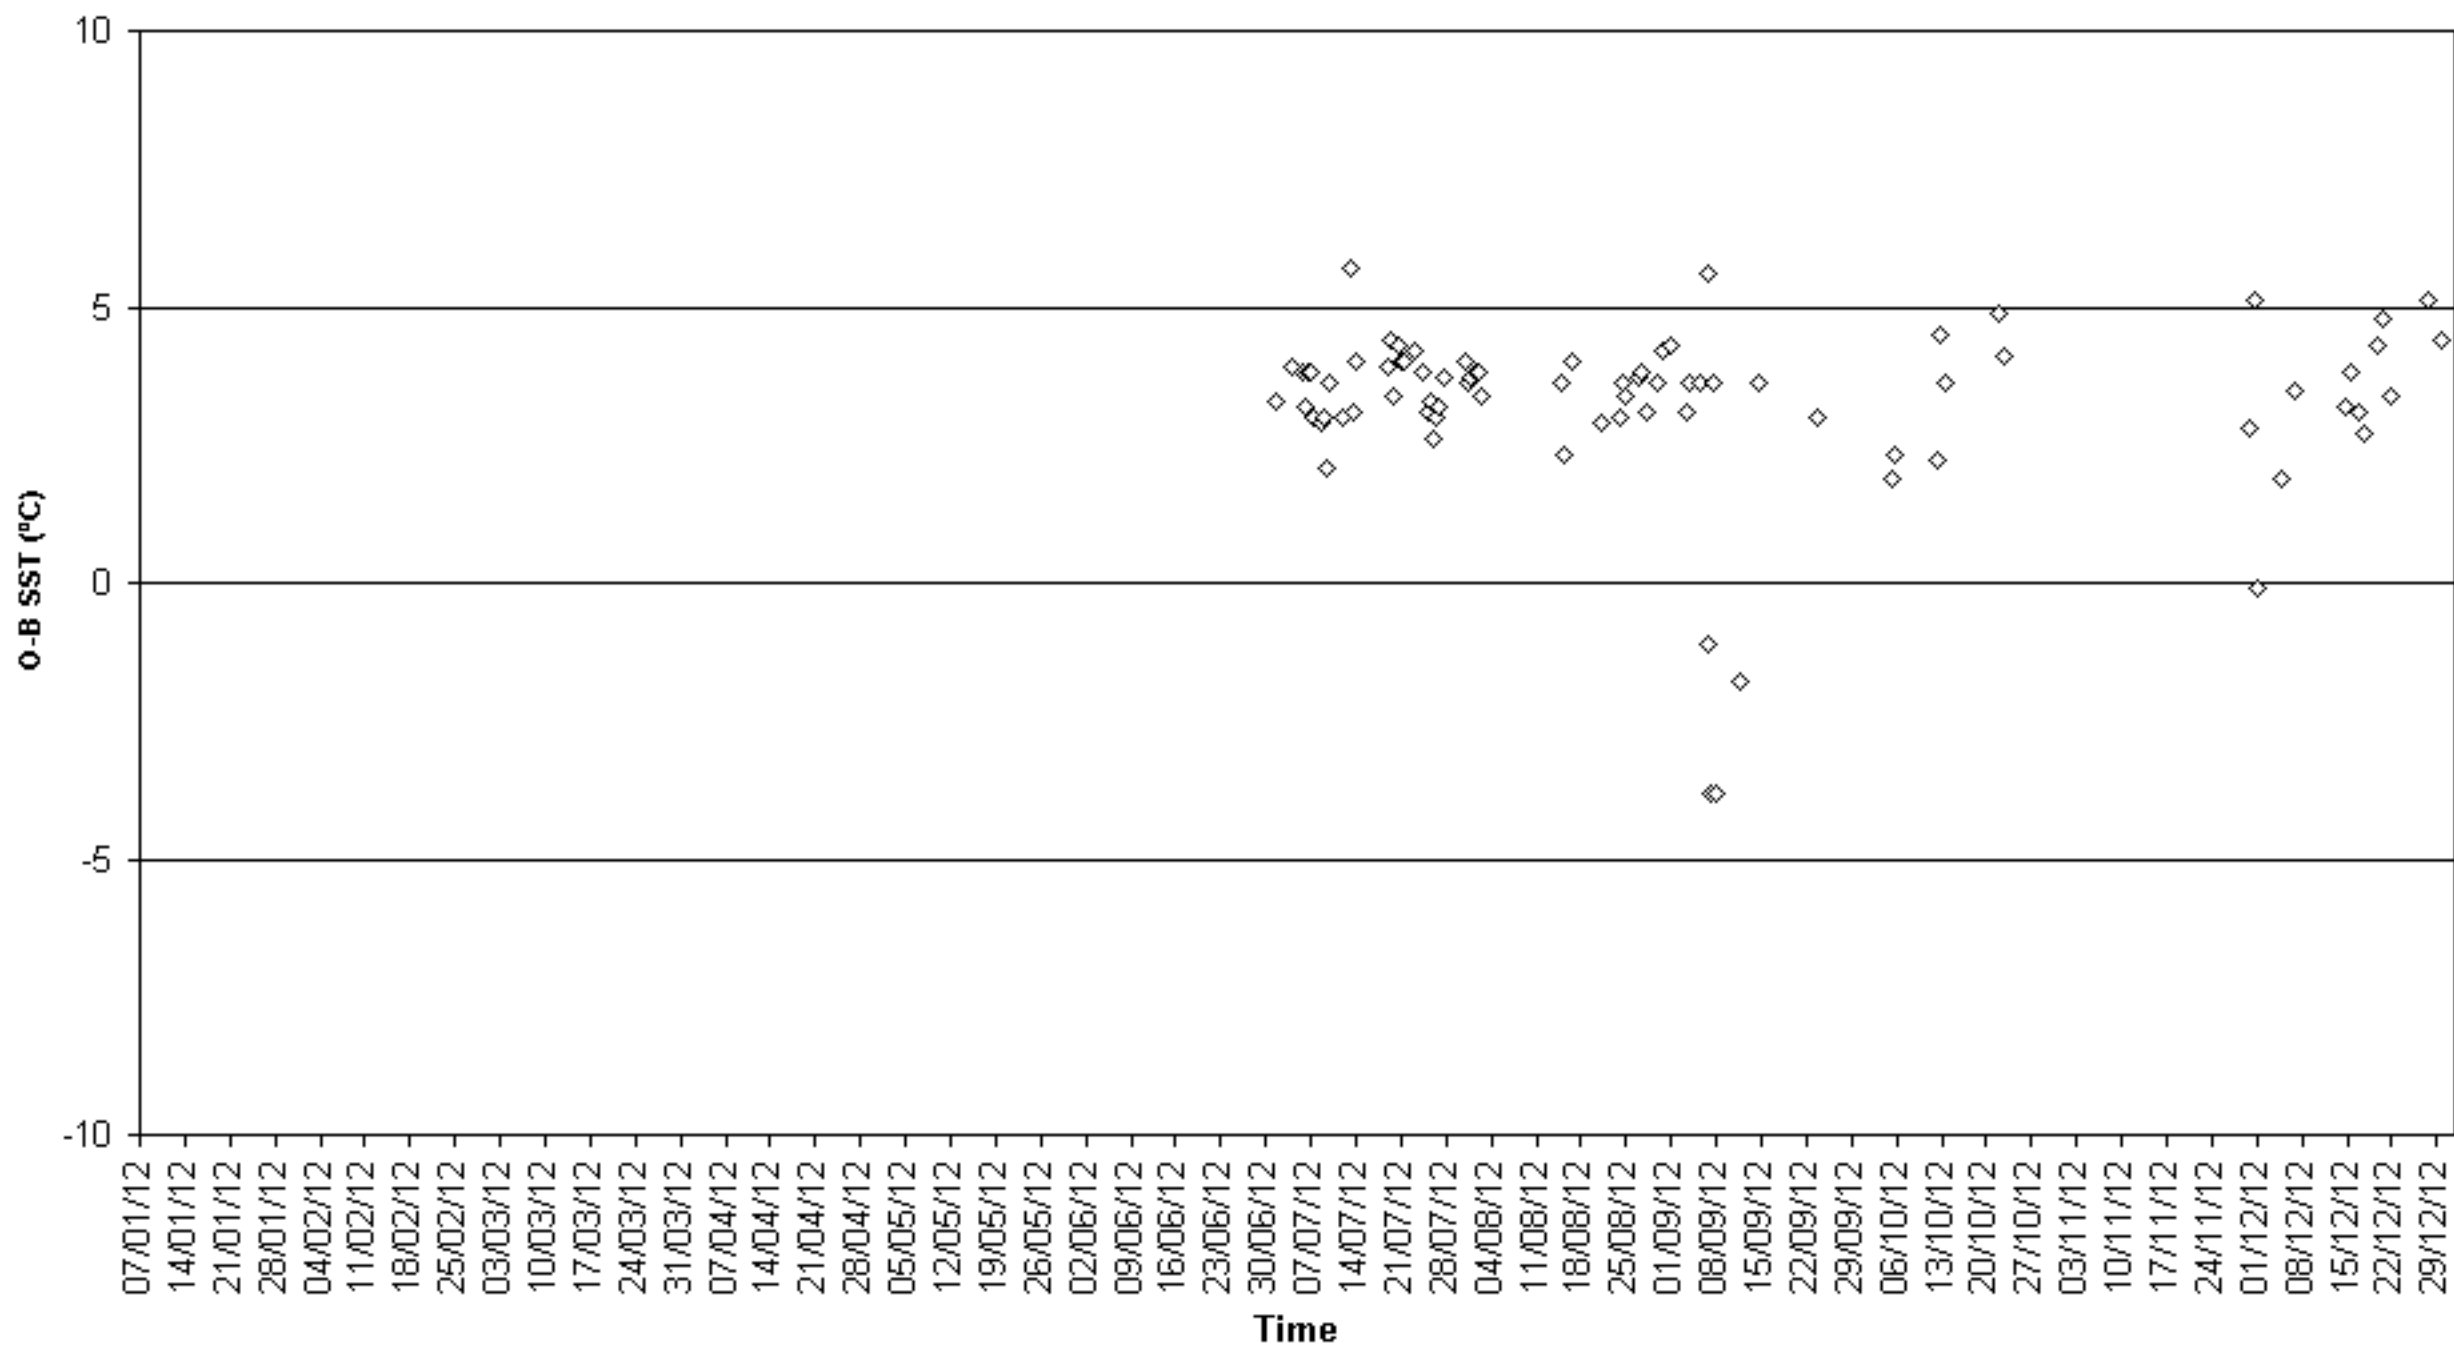


O-B SST (°C) for identifier A8PK9
Number of obs. plotted = 109 Number of outliers = 0

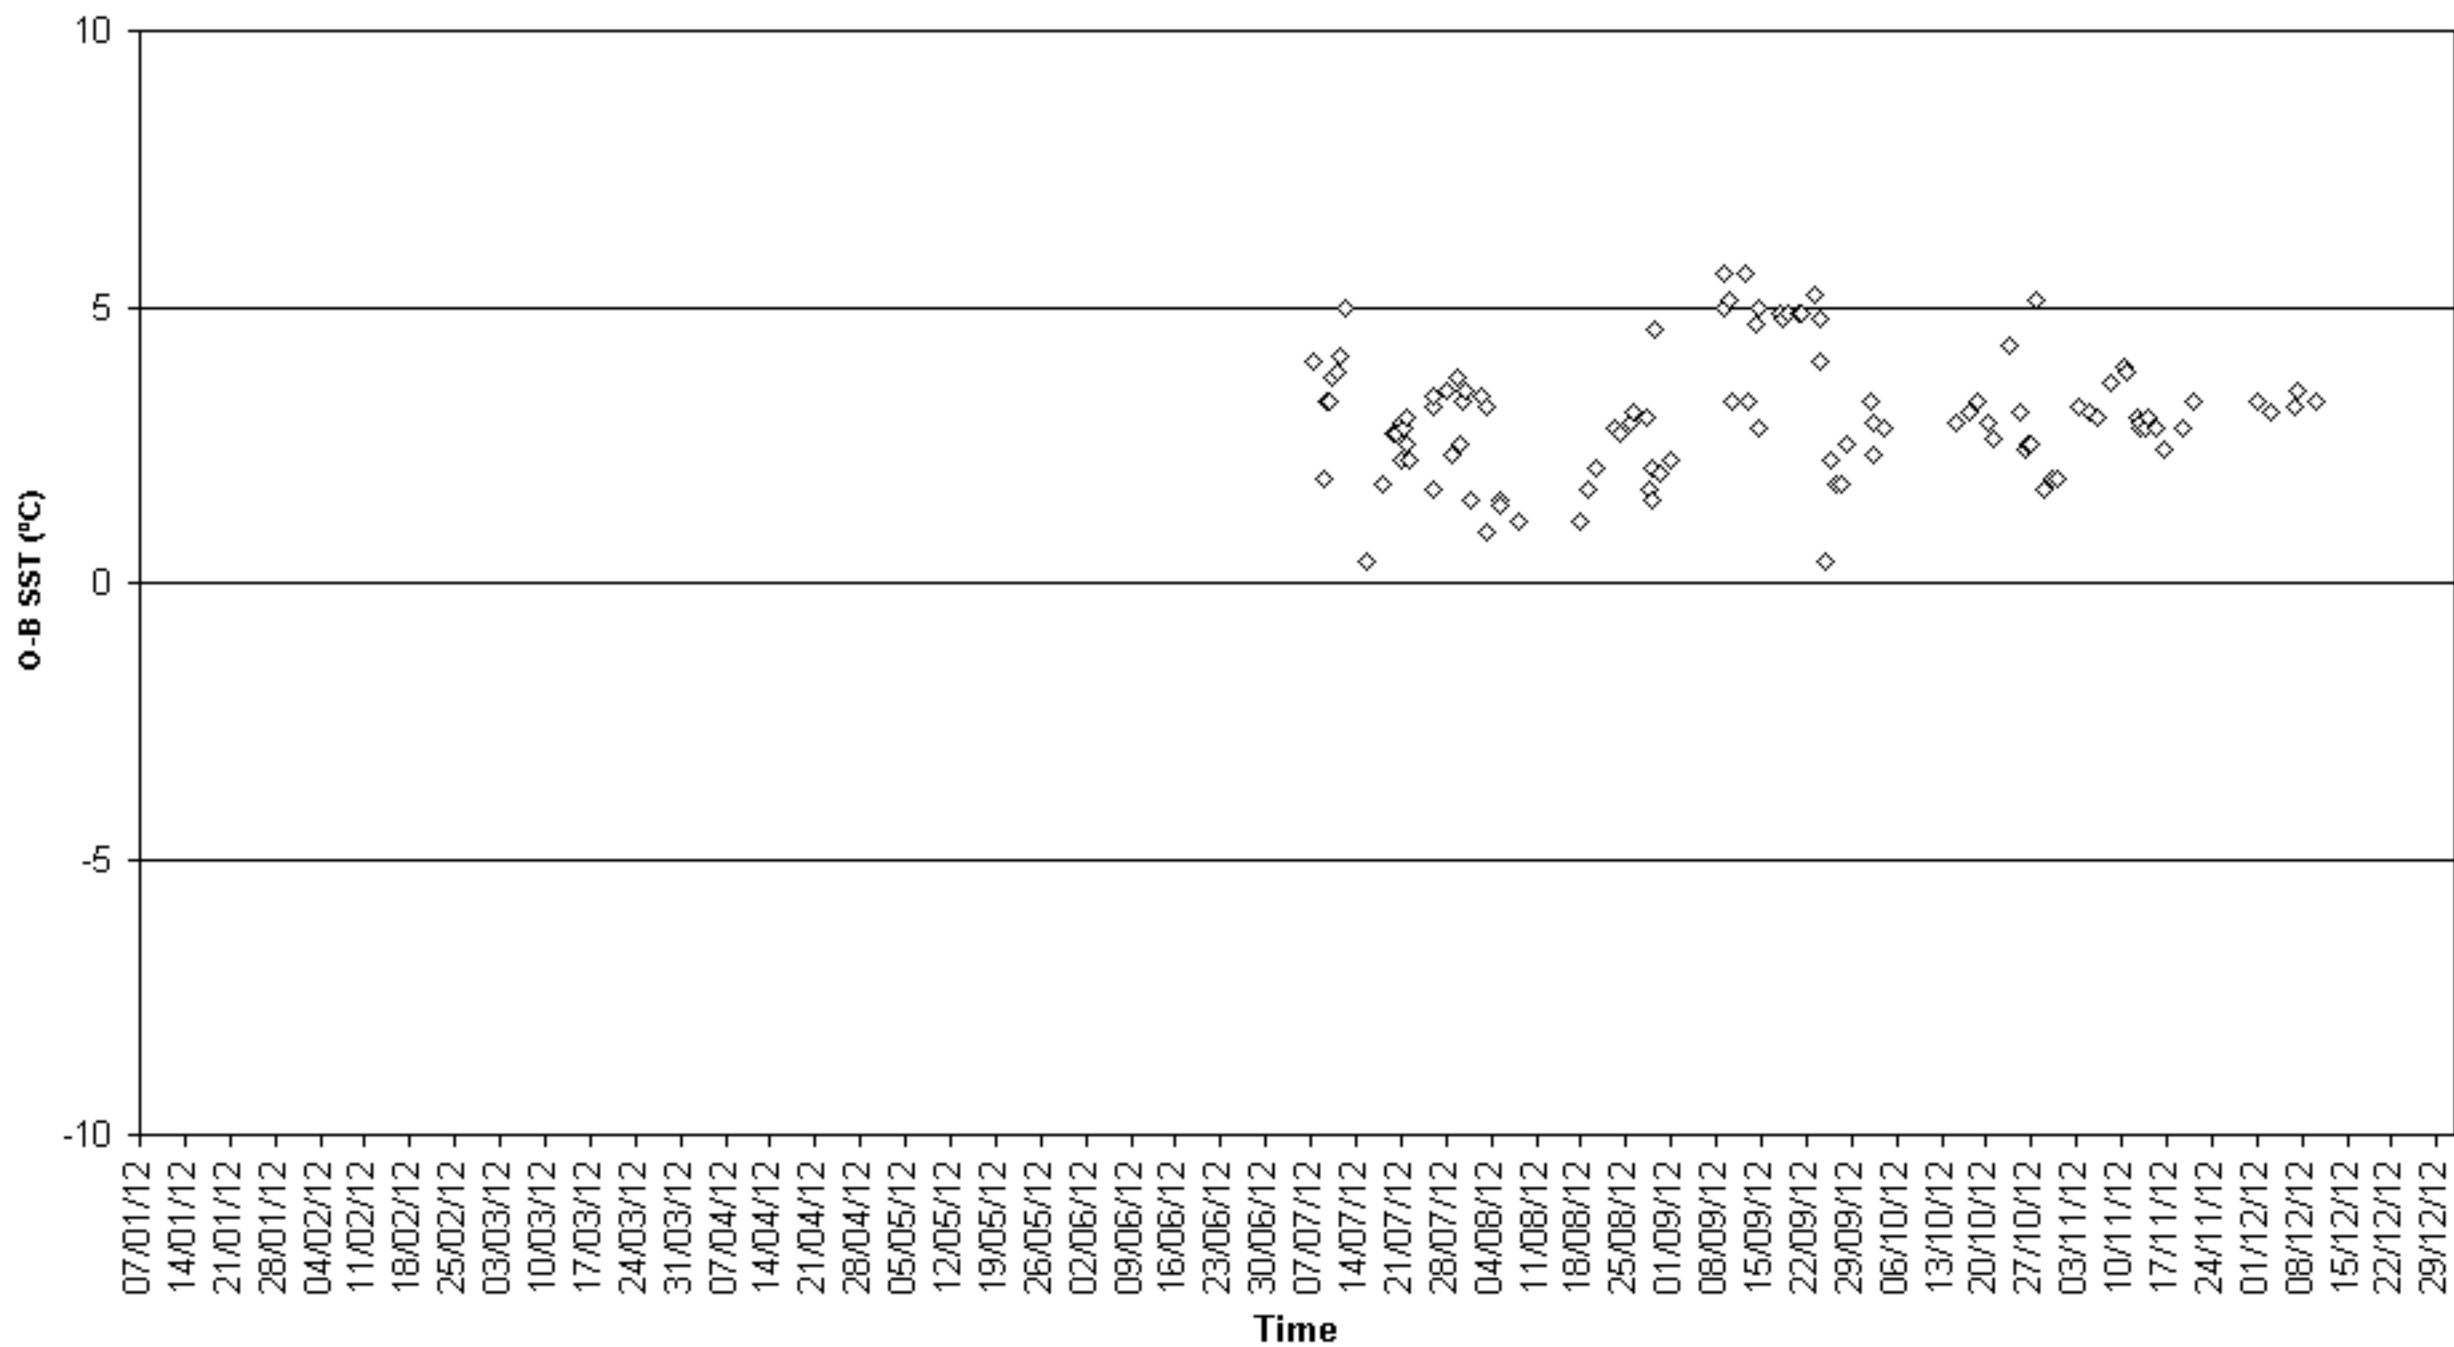


O-B SST (°C) for identifier A8VG7
Number of obs. plotted = 170 Number of outliers = 6

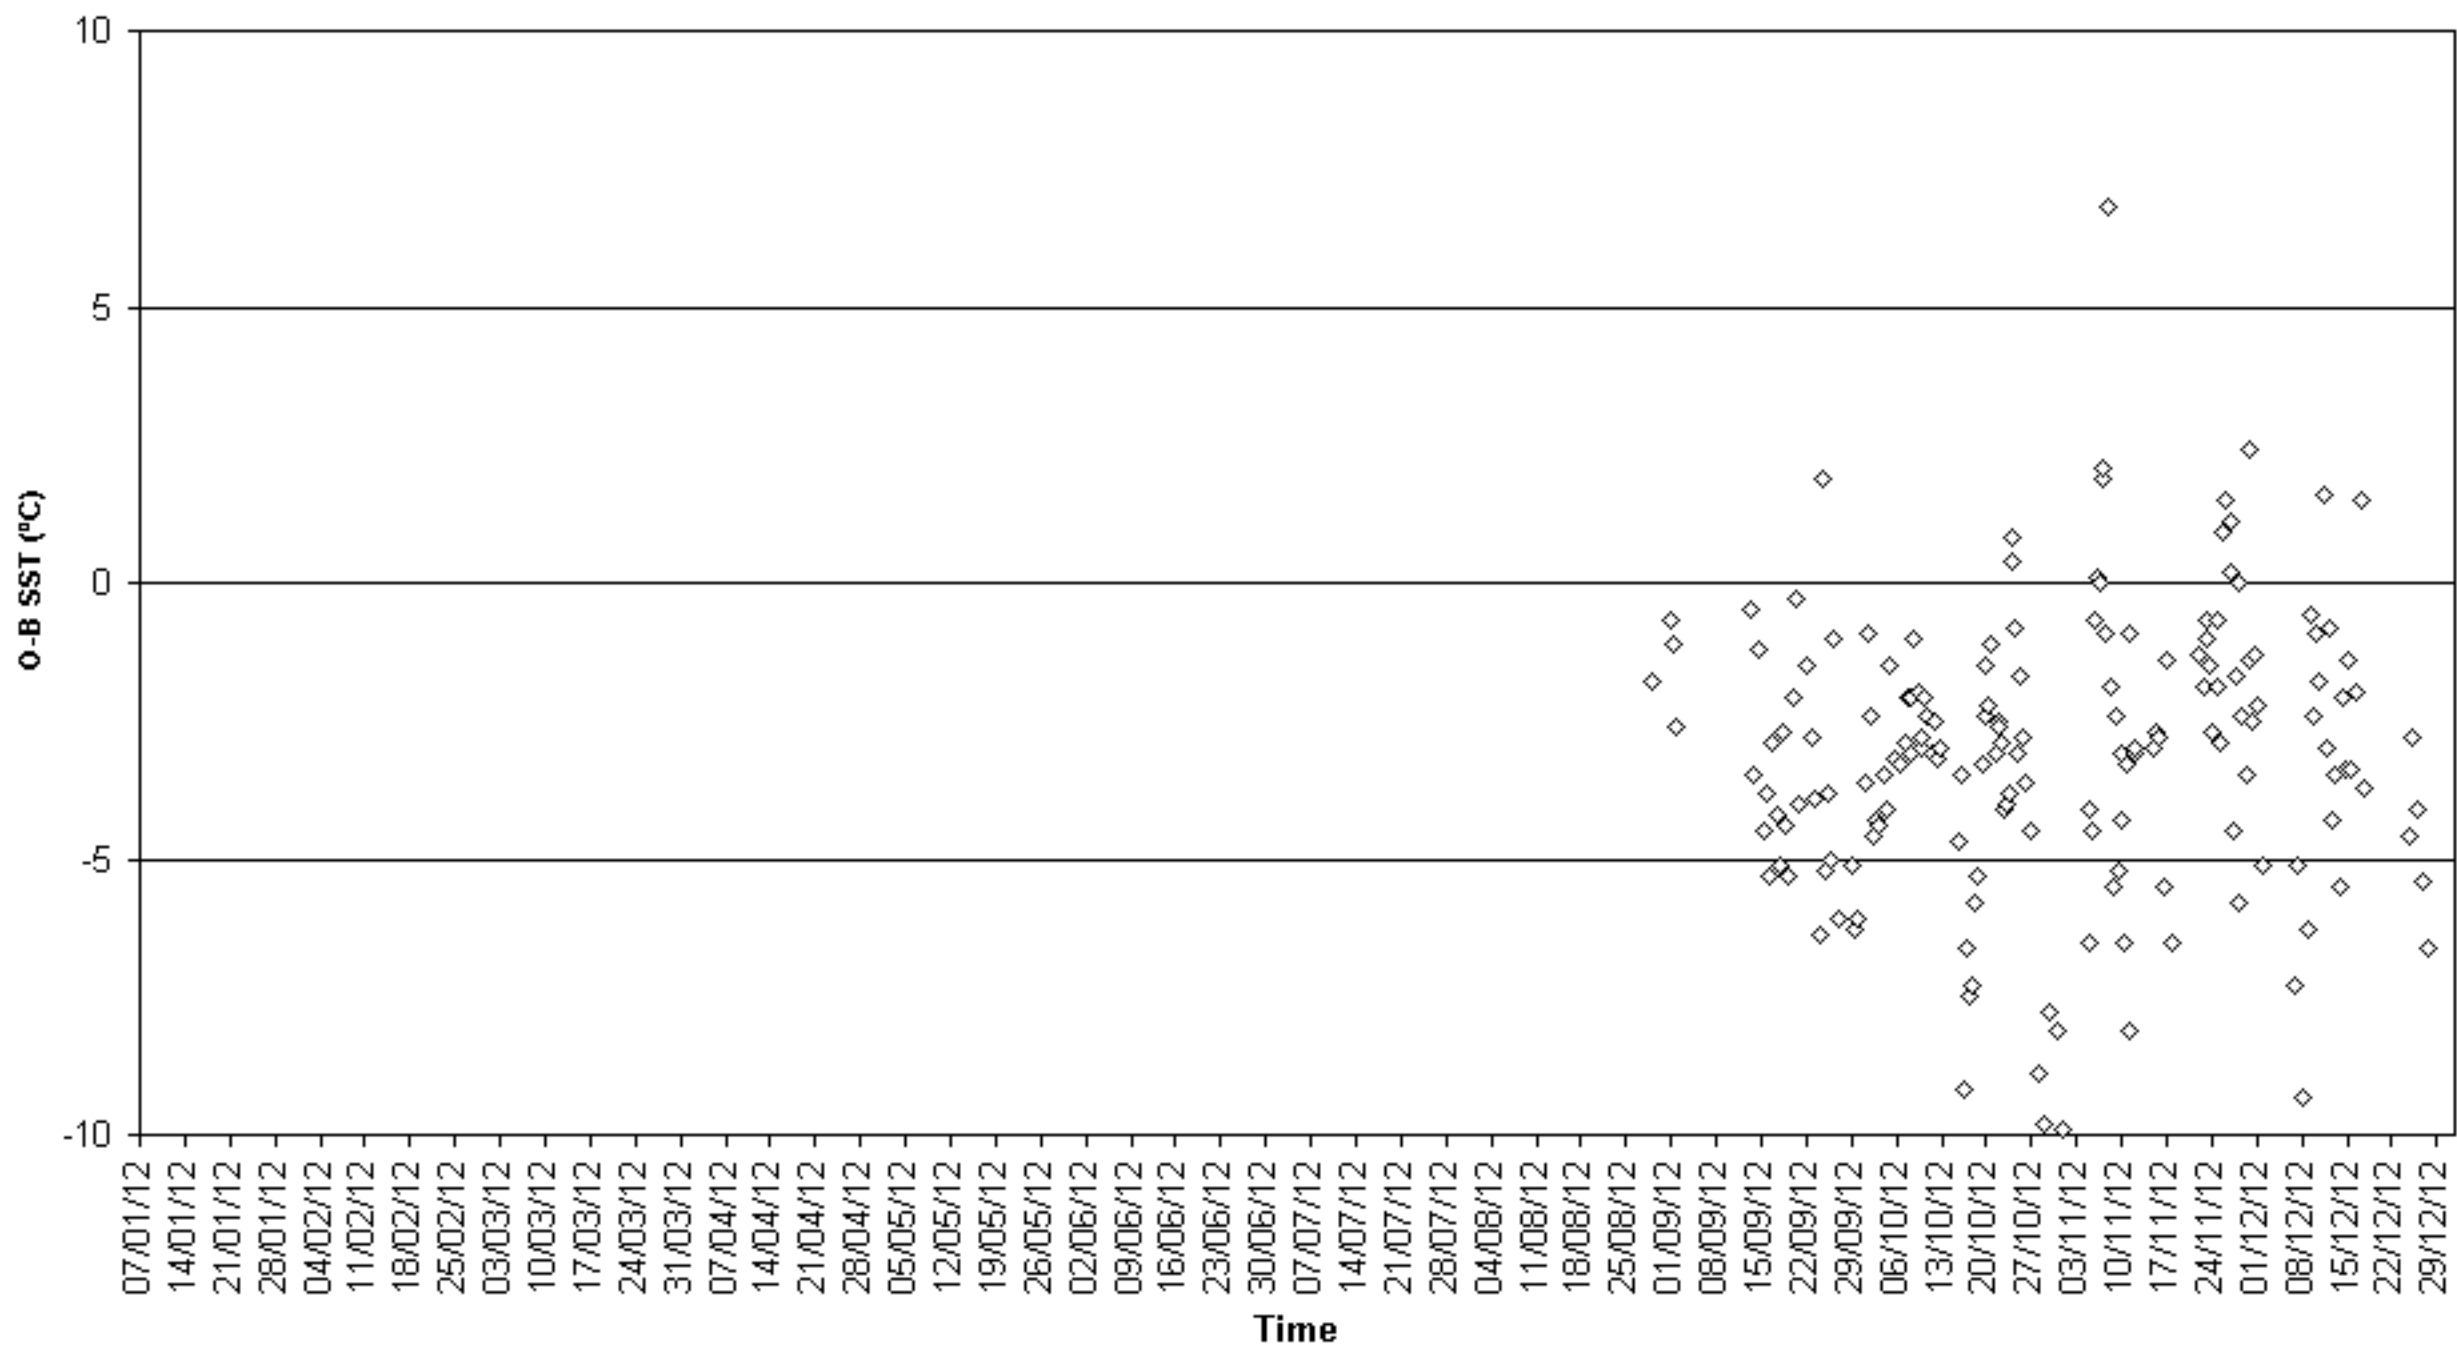


O-B SST (°C) for identifier A8WC8
Number of obs. plotted = 188 Number of outliers = 3

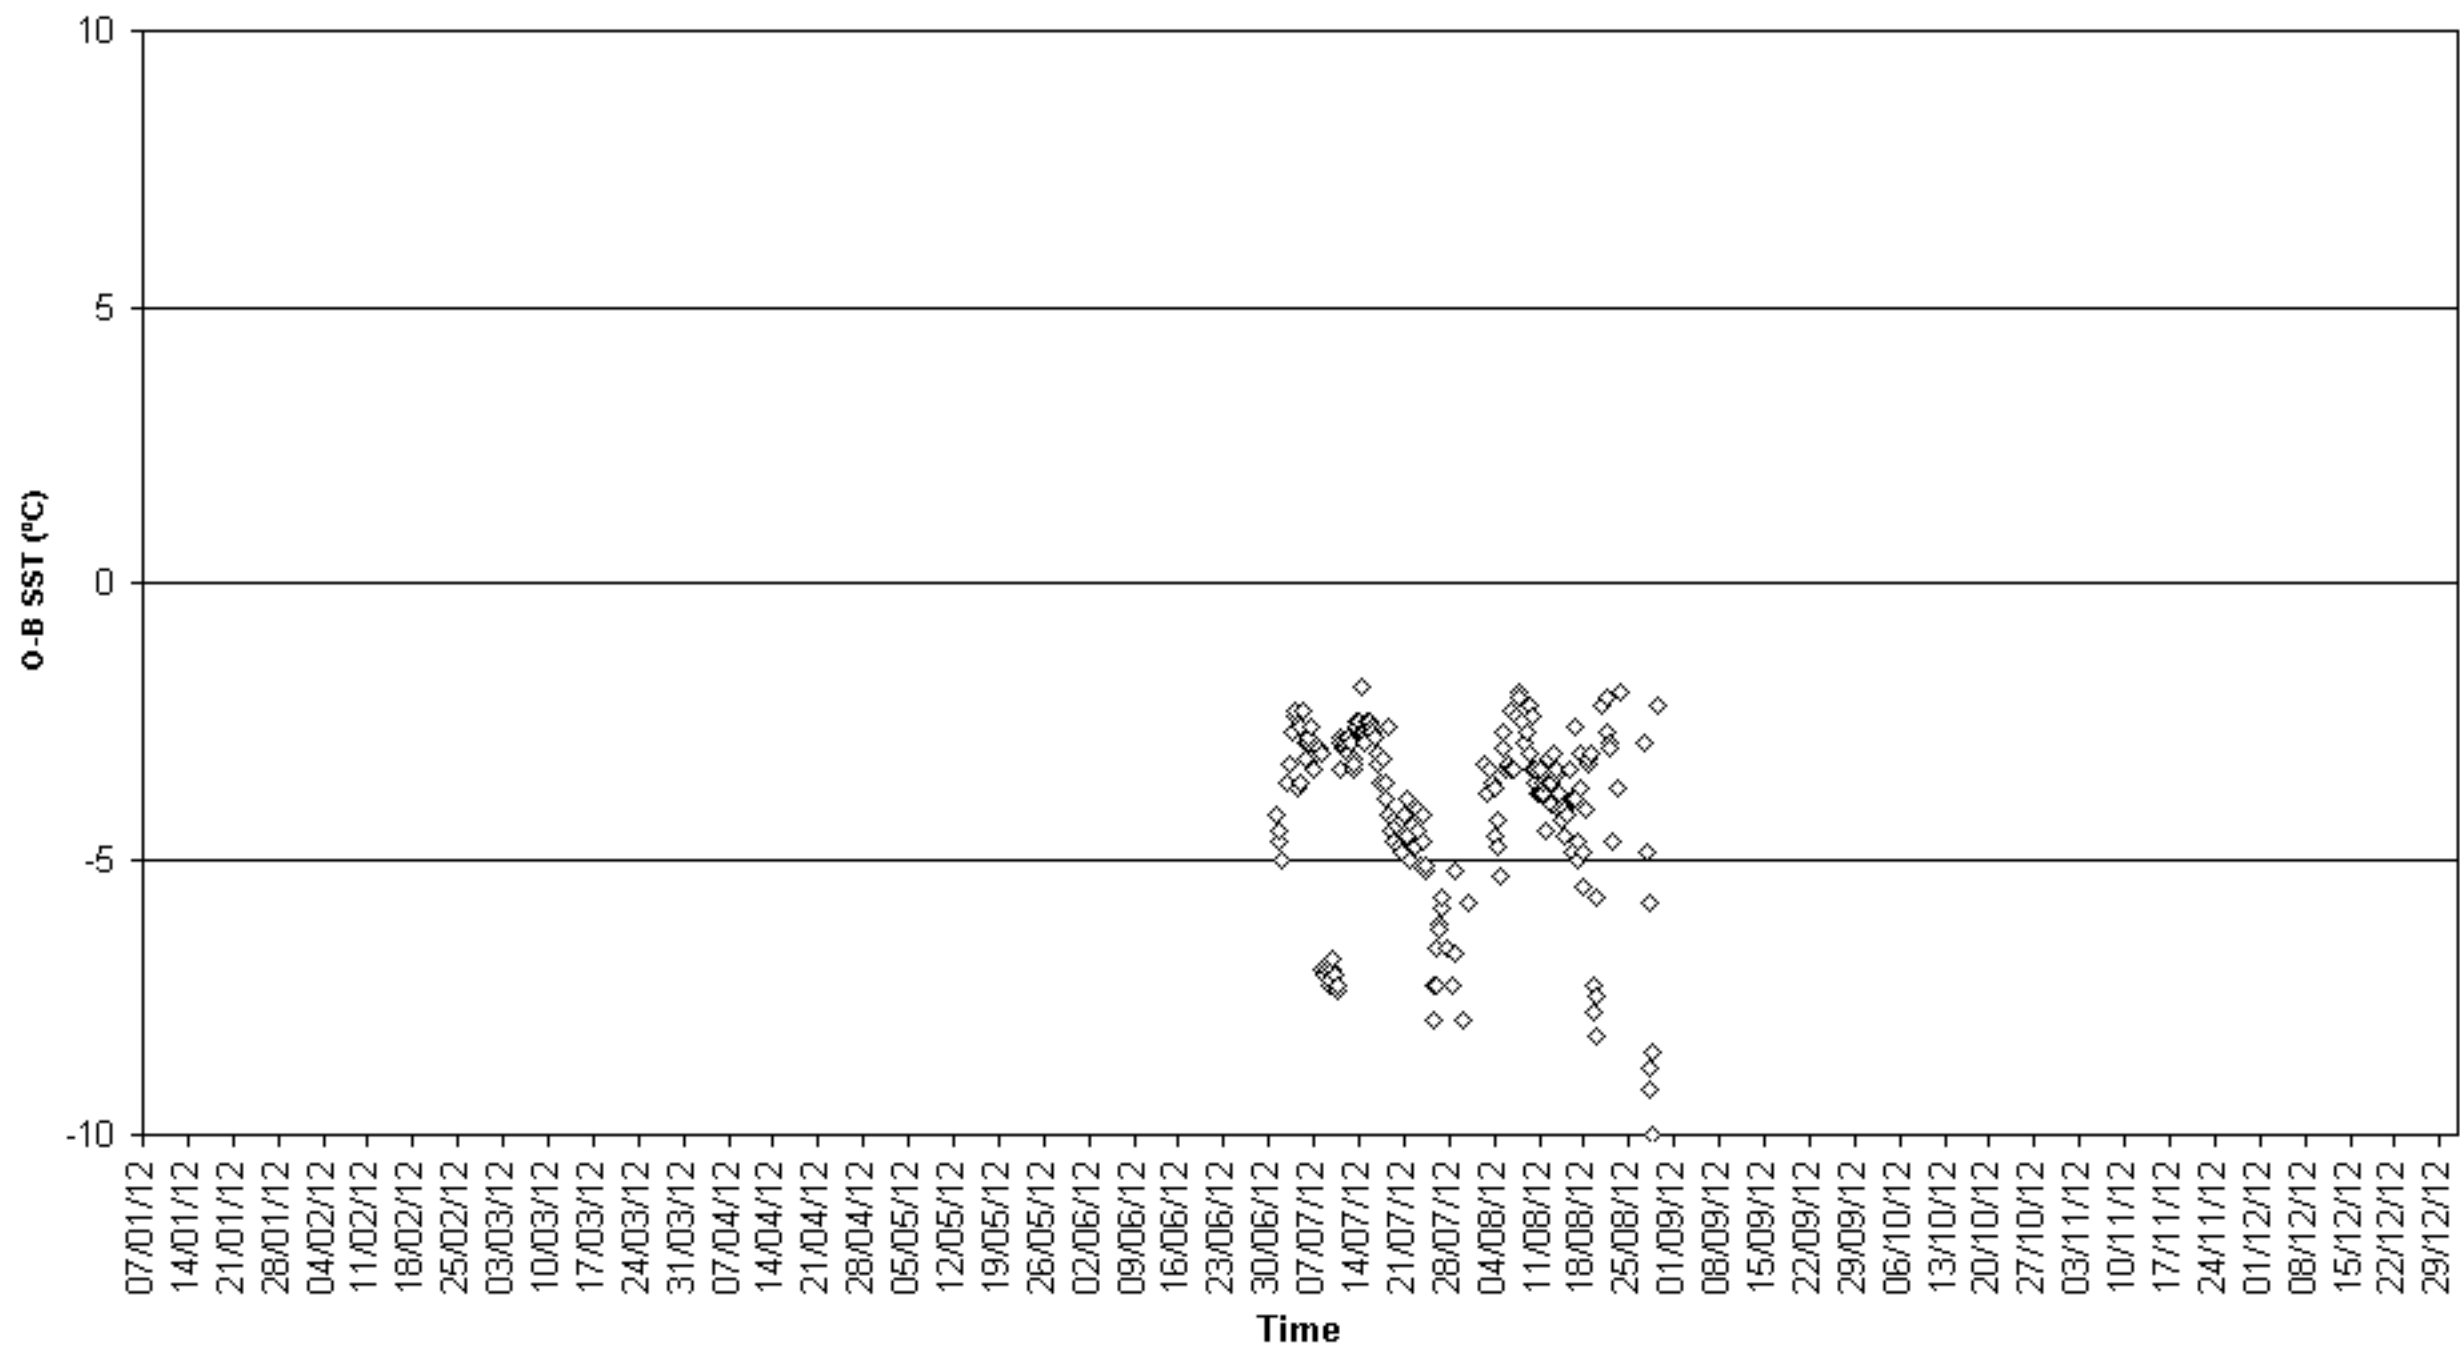


O-B SST (°C) for identifier BSH05
Number of obs. plotted = 1573 Number of outliers = 0

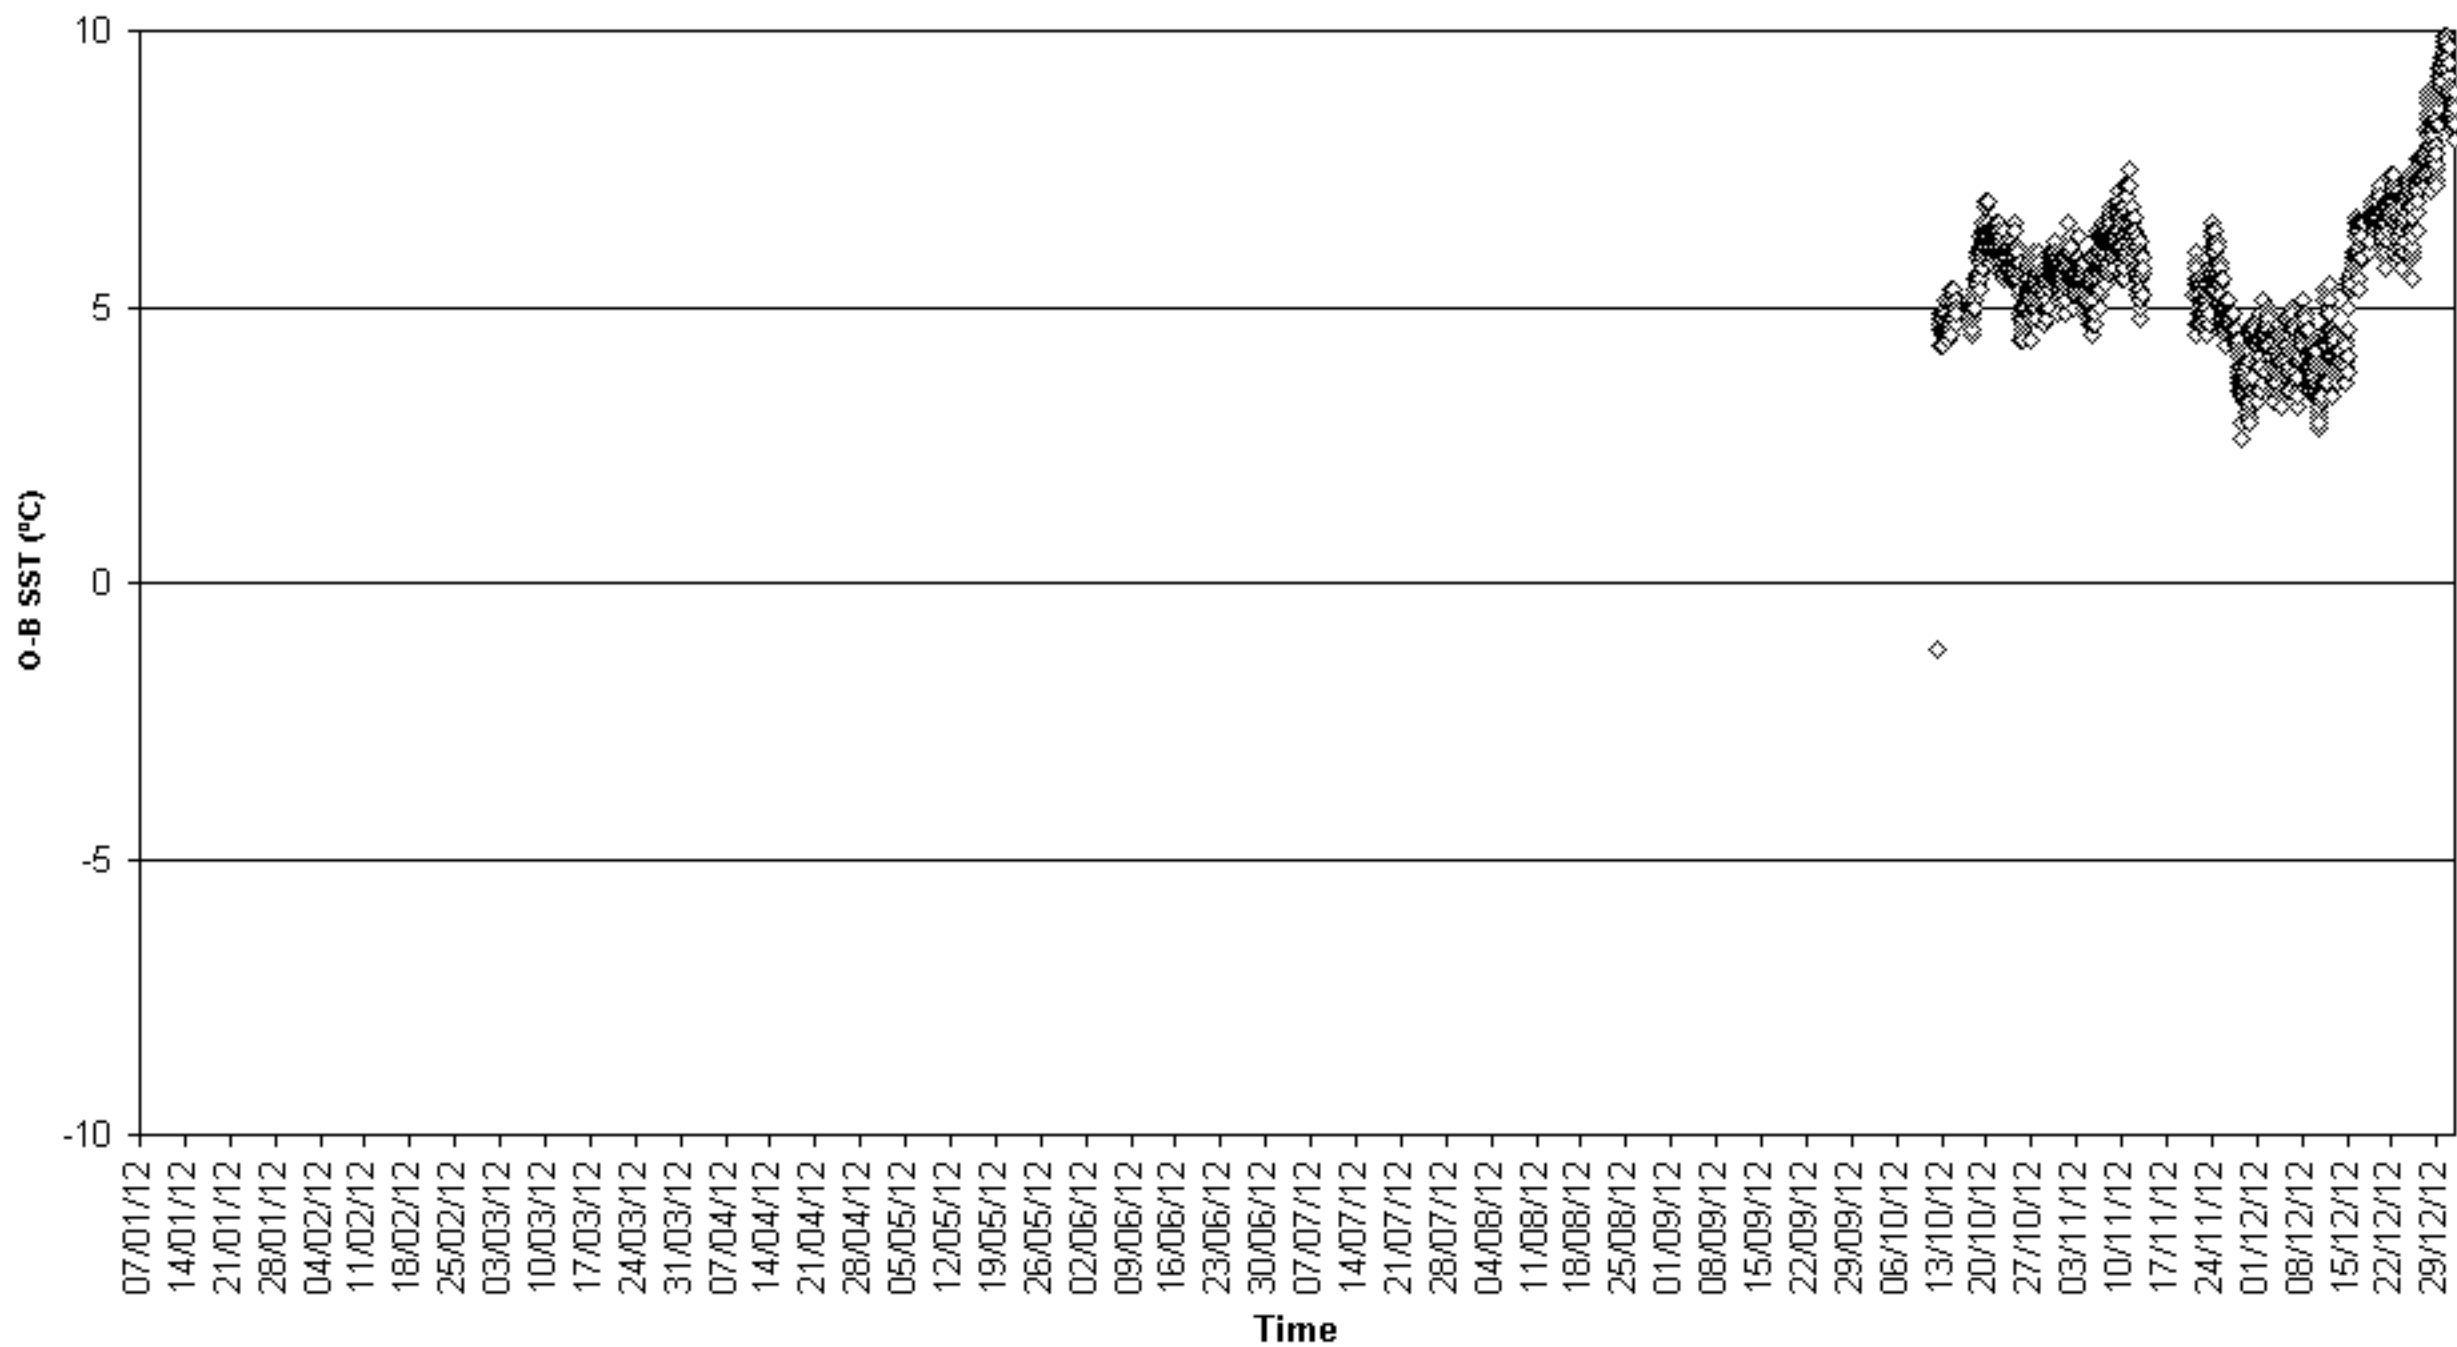


O-B SST (°C) for identifier C6CN4
Number of obs. plotted = 121 Number of outliers = 4

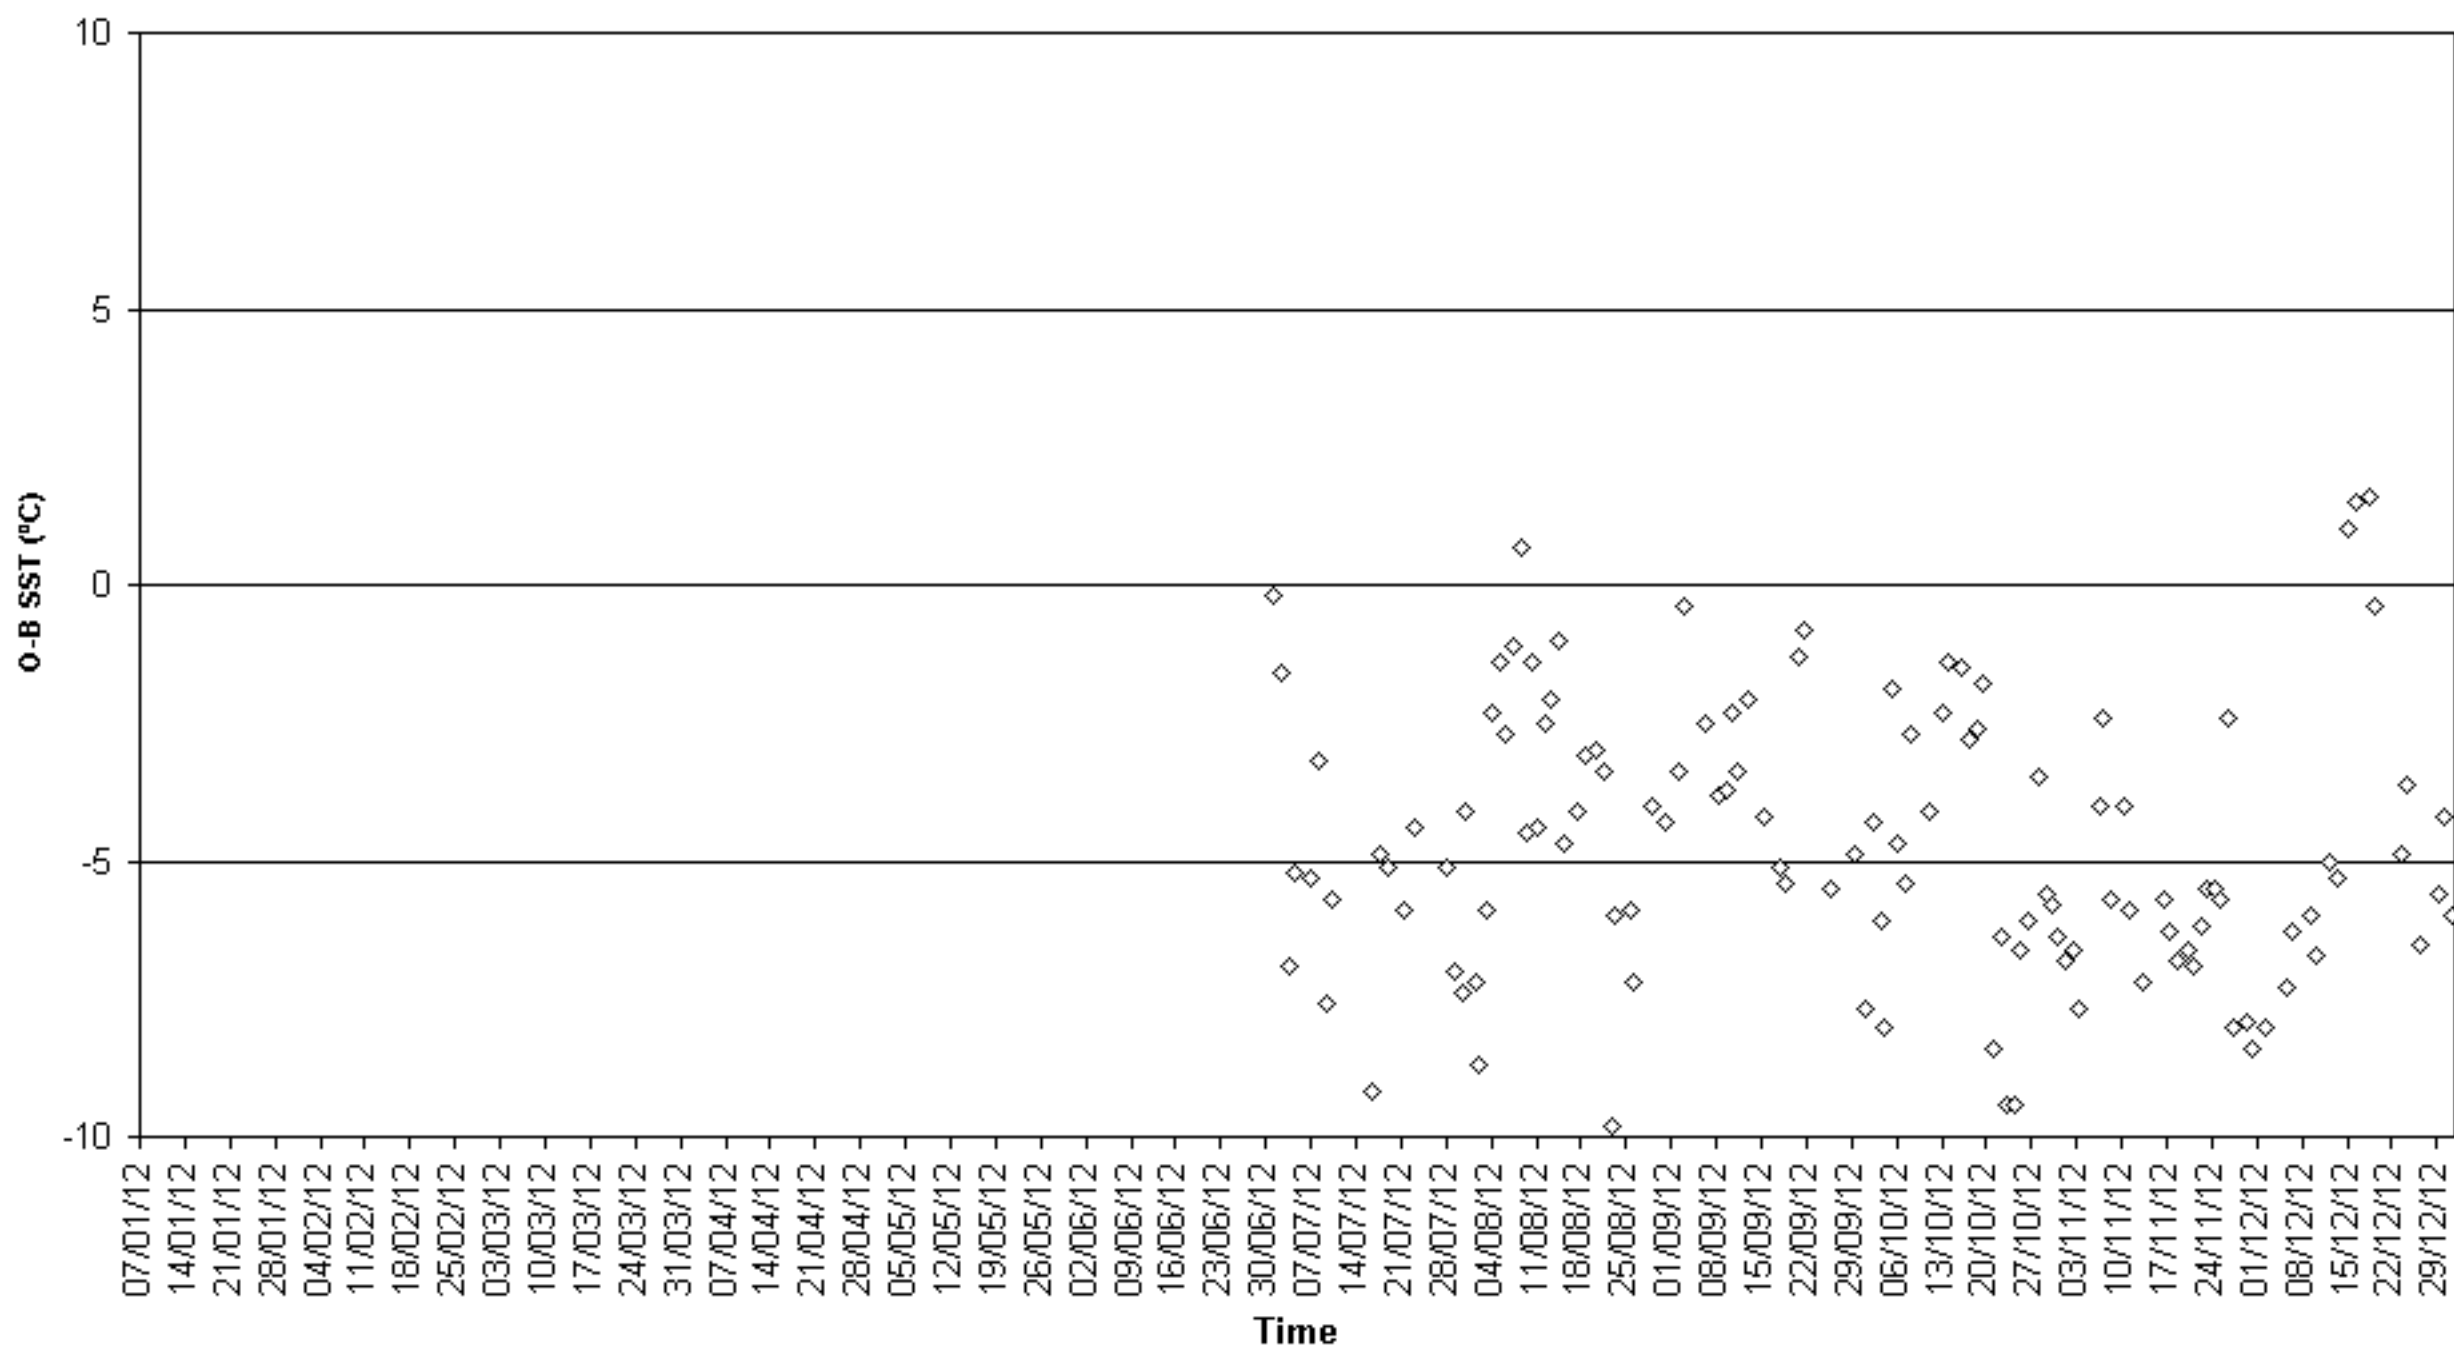


O-B SST (°C) for identifier C6SD9
Number of obs. plotted = 327 Number of outliers = 2

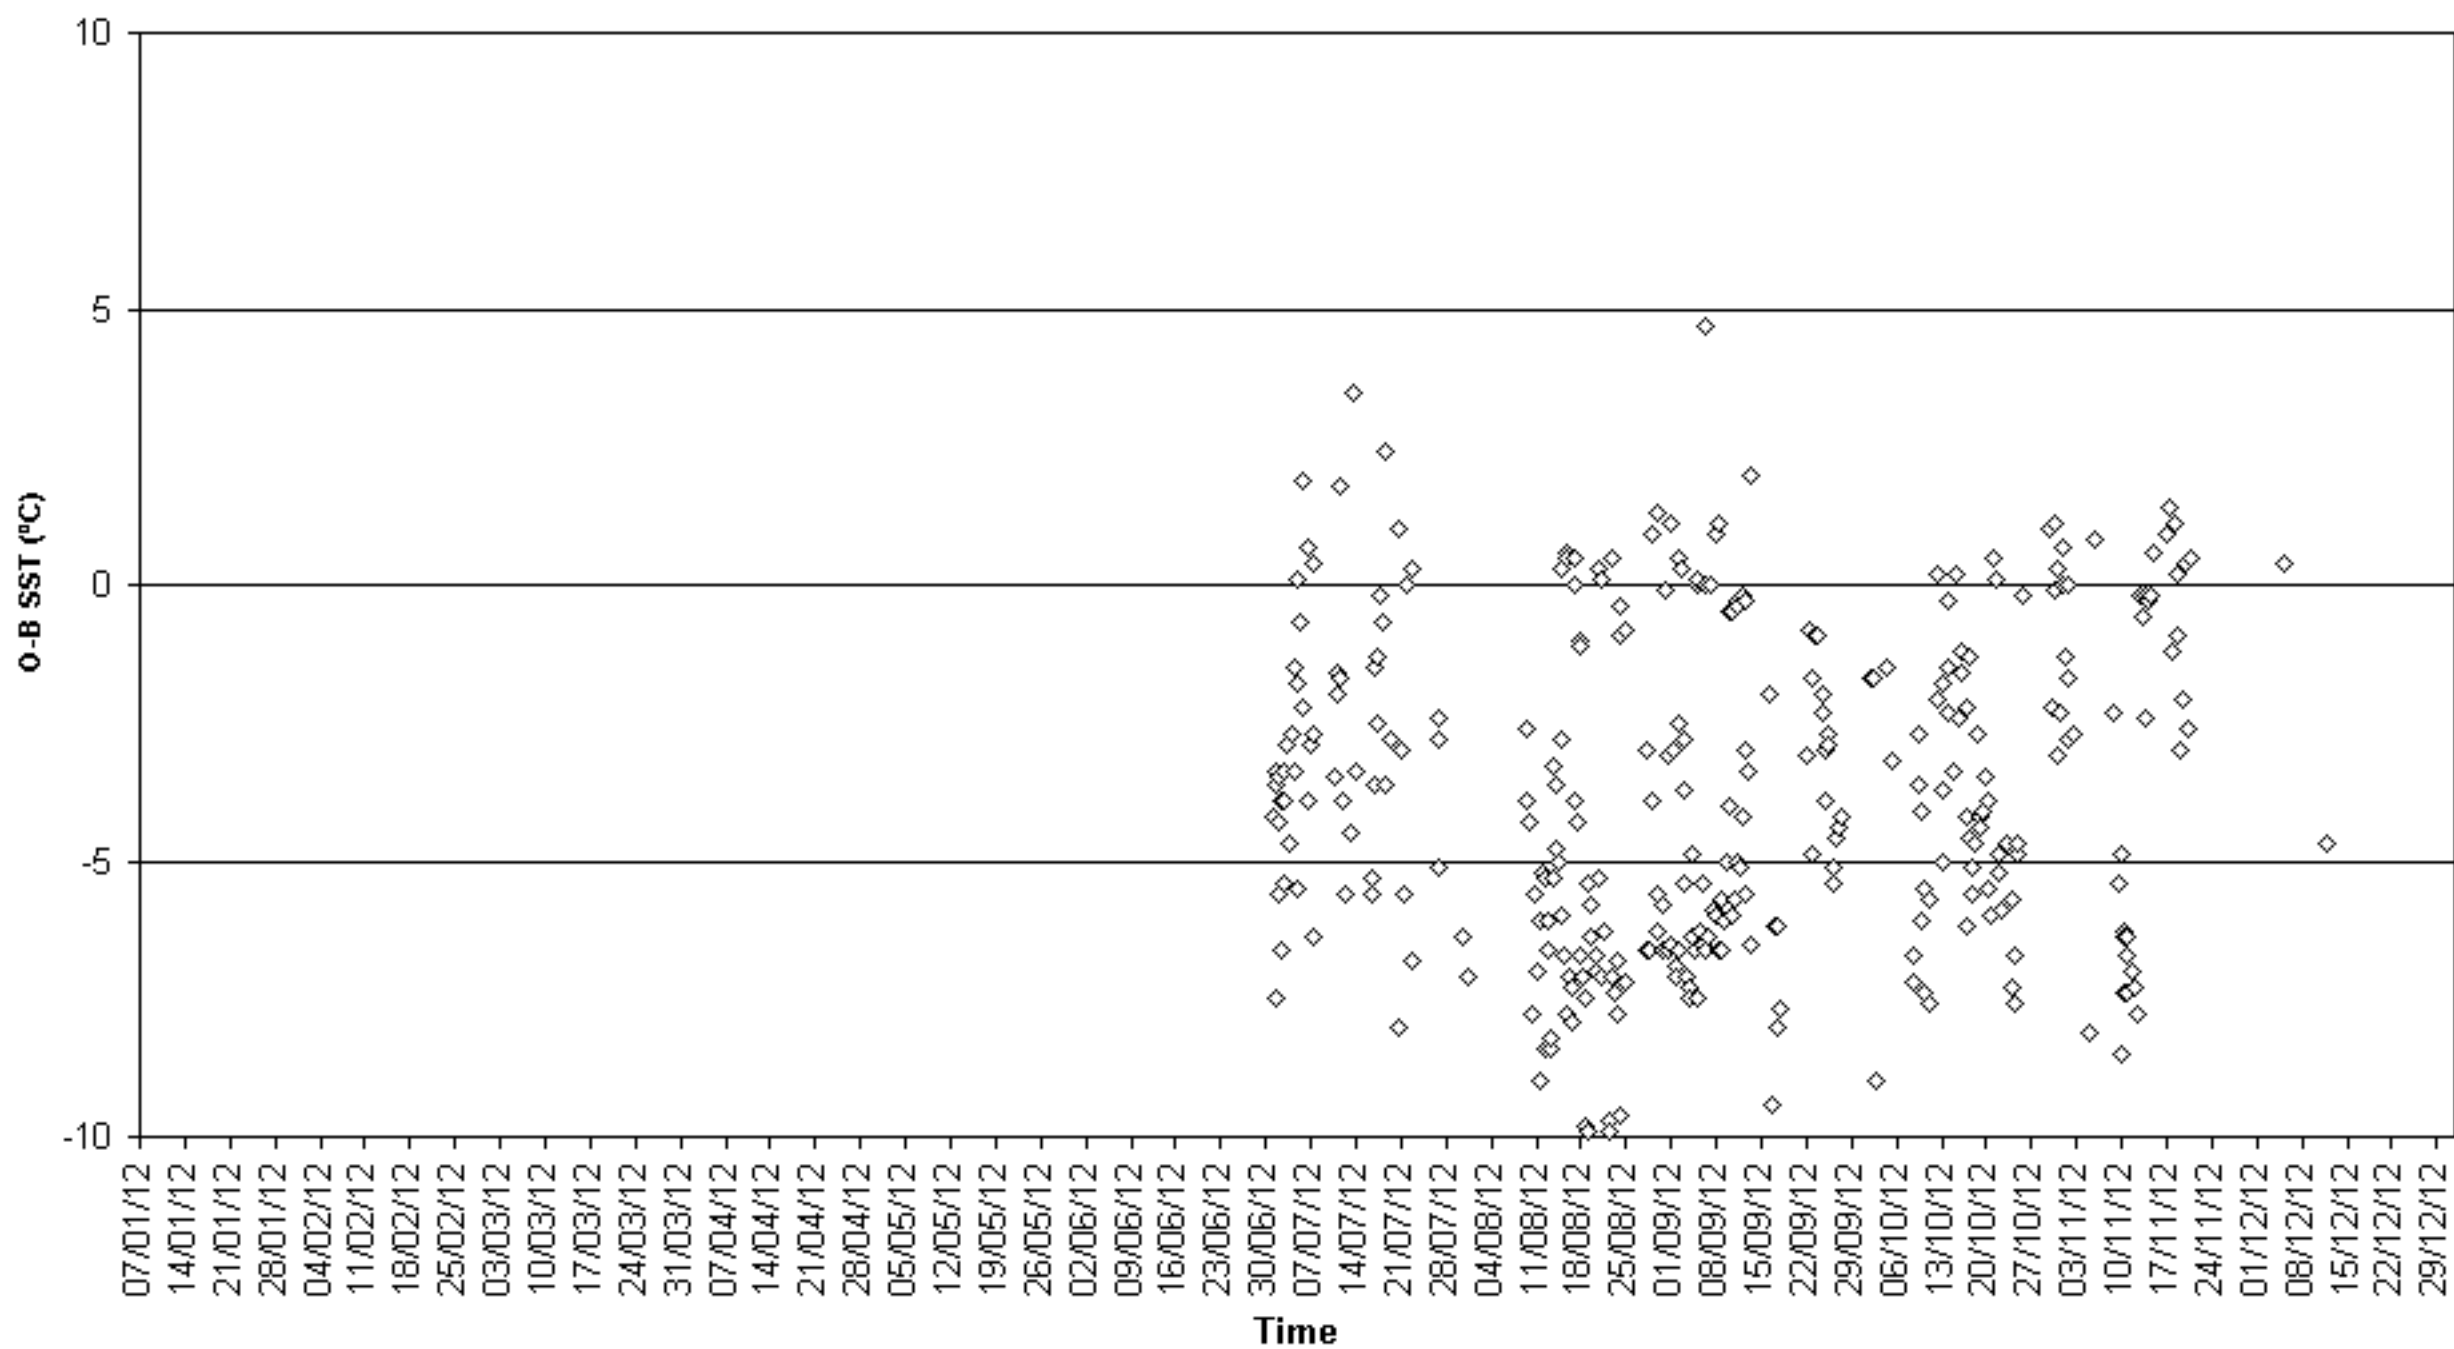


O-B SST (°C) for identifier C6YT4
Number of obs. plotted = 196 Number of outliers = 0

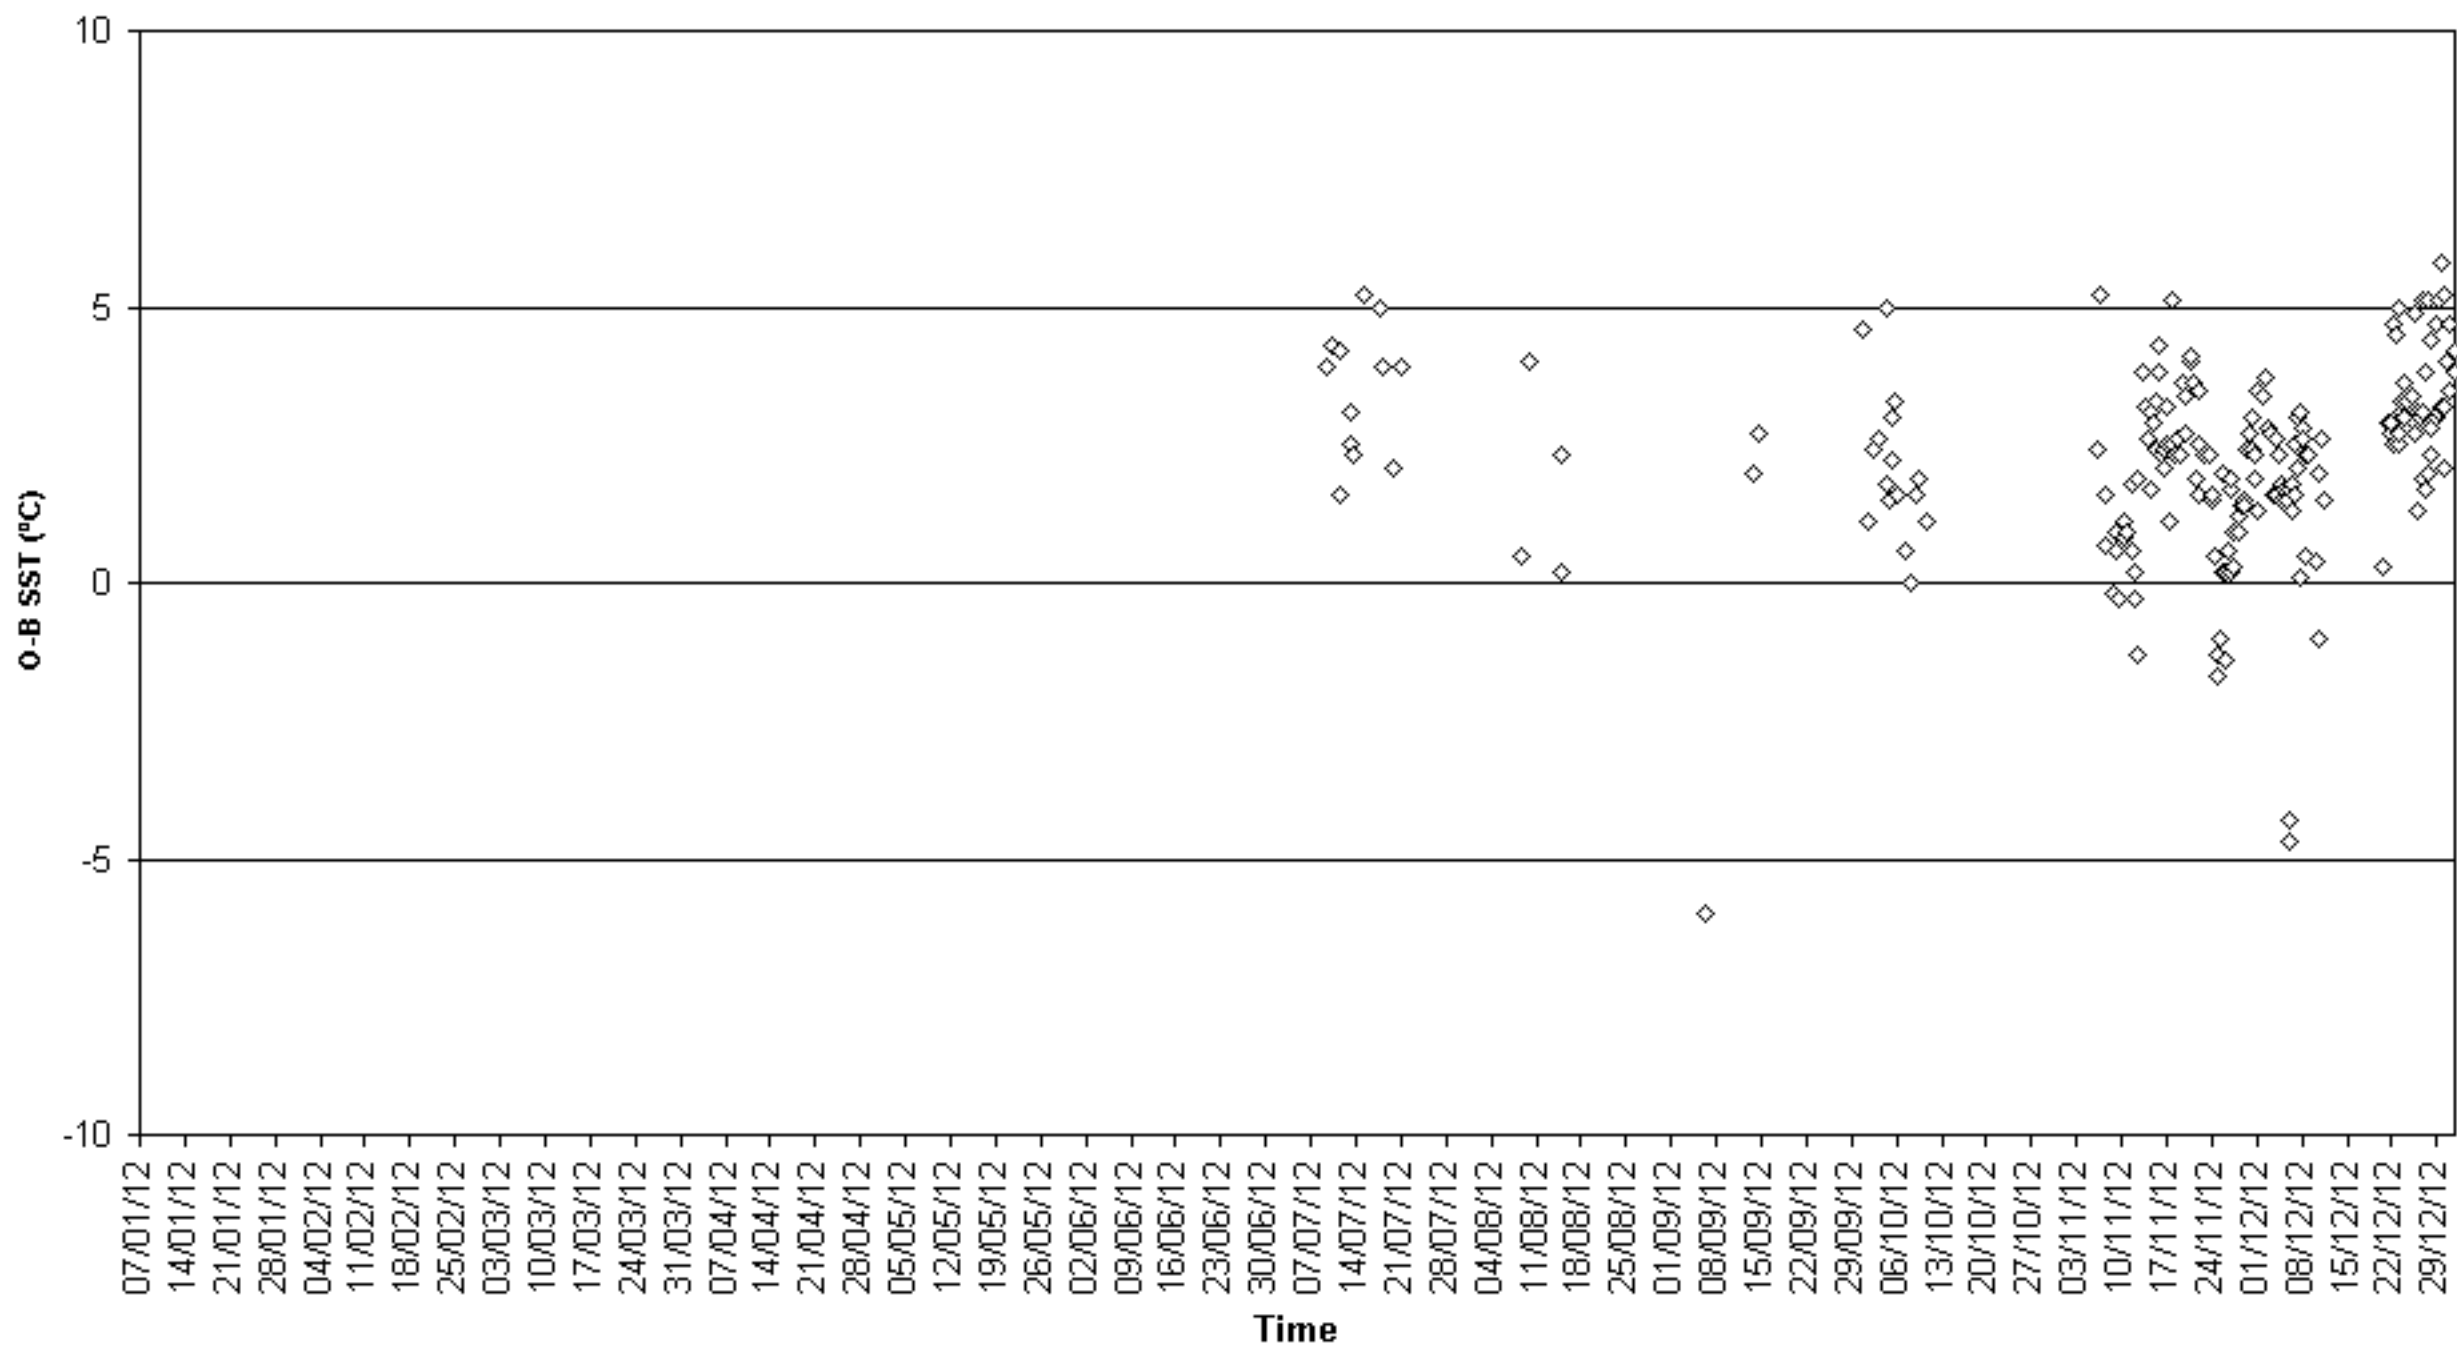


O-B SST (°C) for identifier DGTX
Number of obs. plotted = 220 Number of outliers = 0

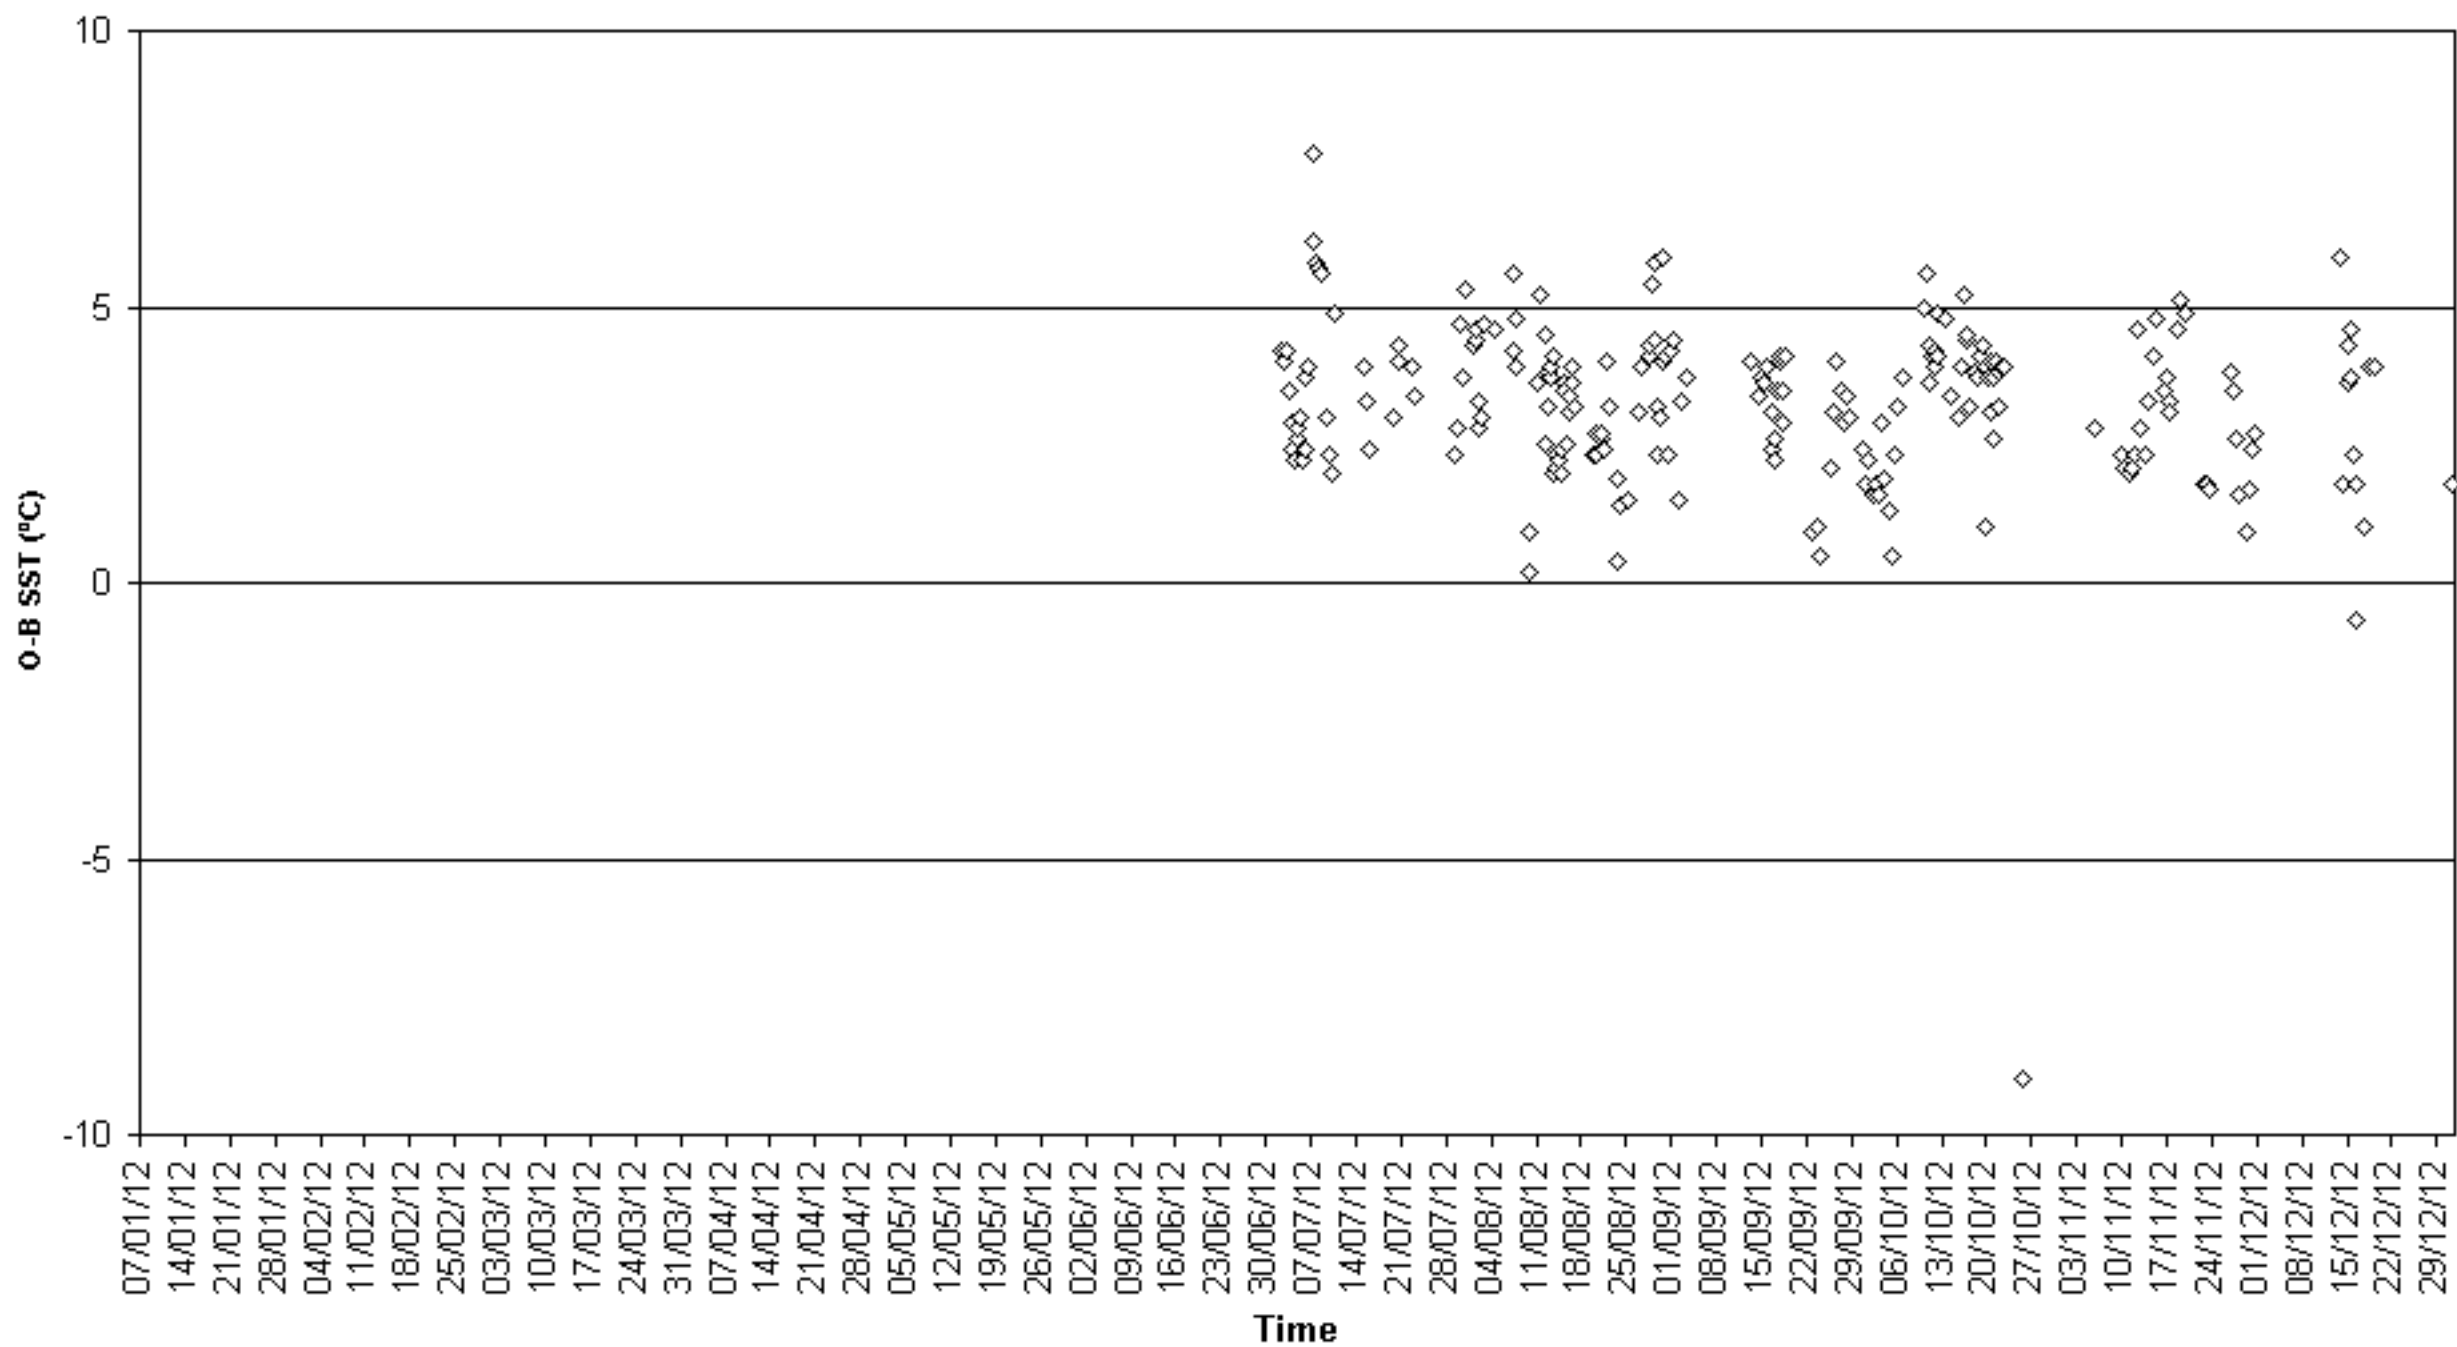


O-B SST (°C) for identifier HO7723
Number of obs. plotted = 1 Number of outliers = 61

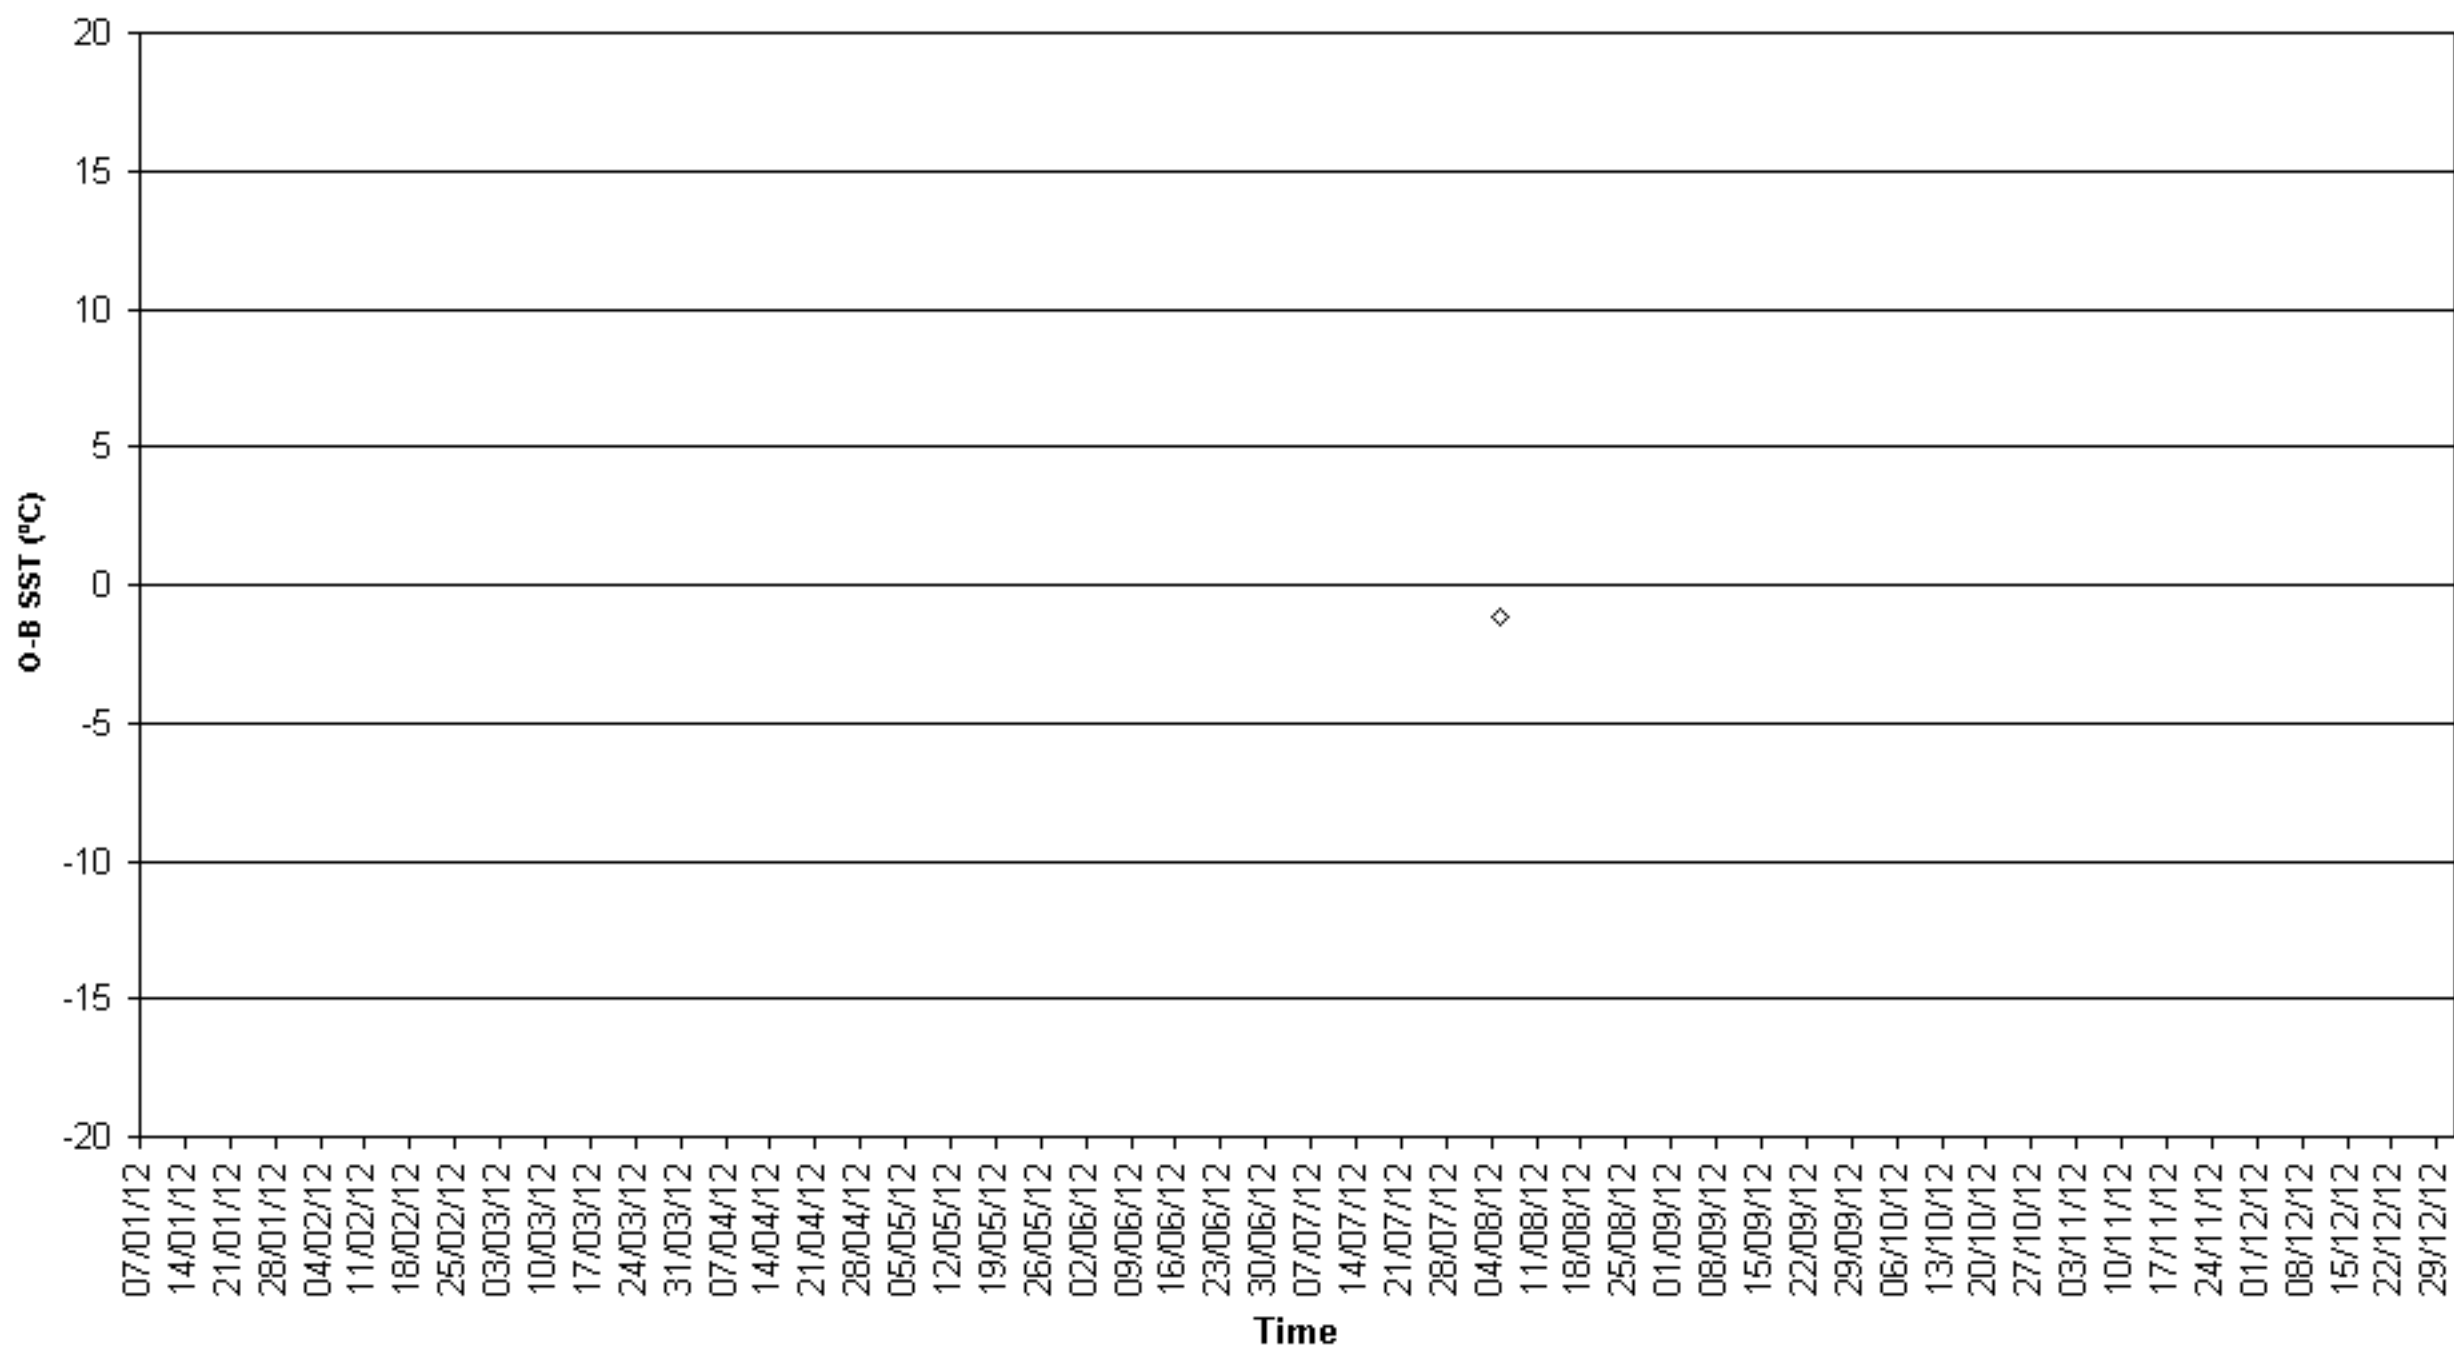

O-B SST (°C) for identifier IBQQ
Number of obs. plotted = 48 Number of outliers = 1

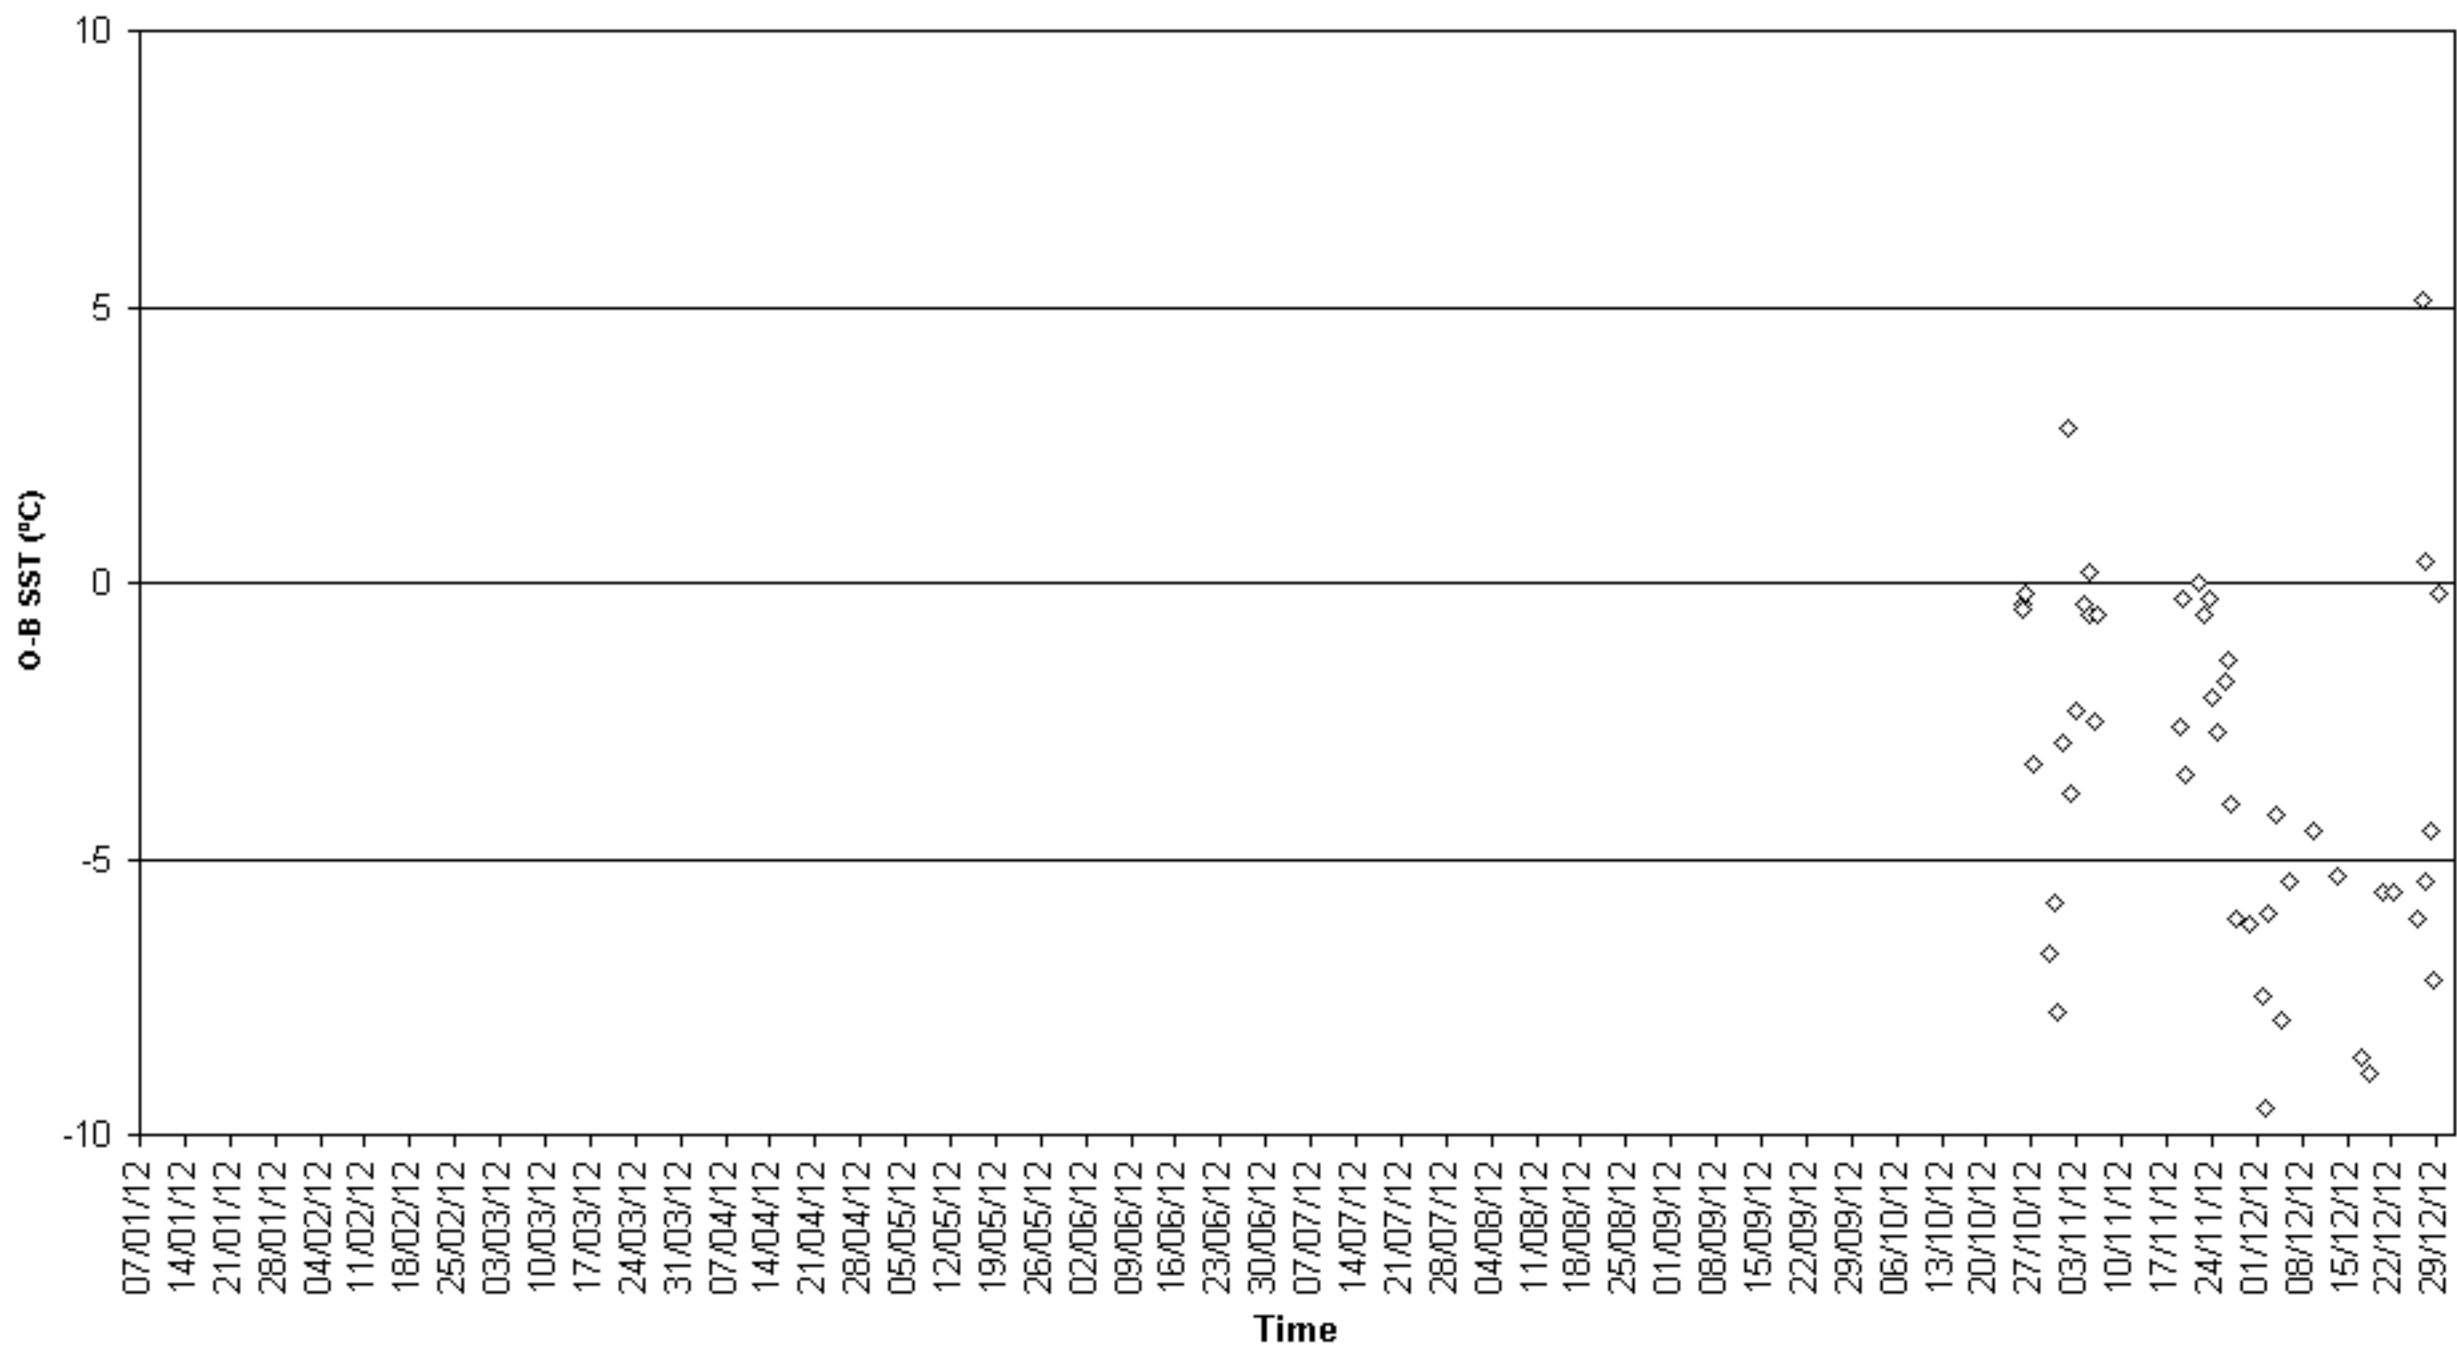


O-B SST (°C) for identifier ICSW
Number of obs. plotted = 326 Number of outliers = 4

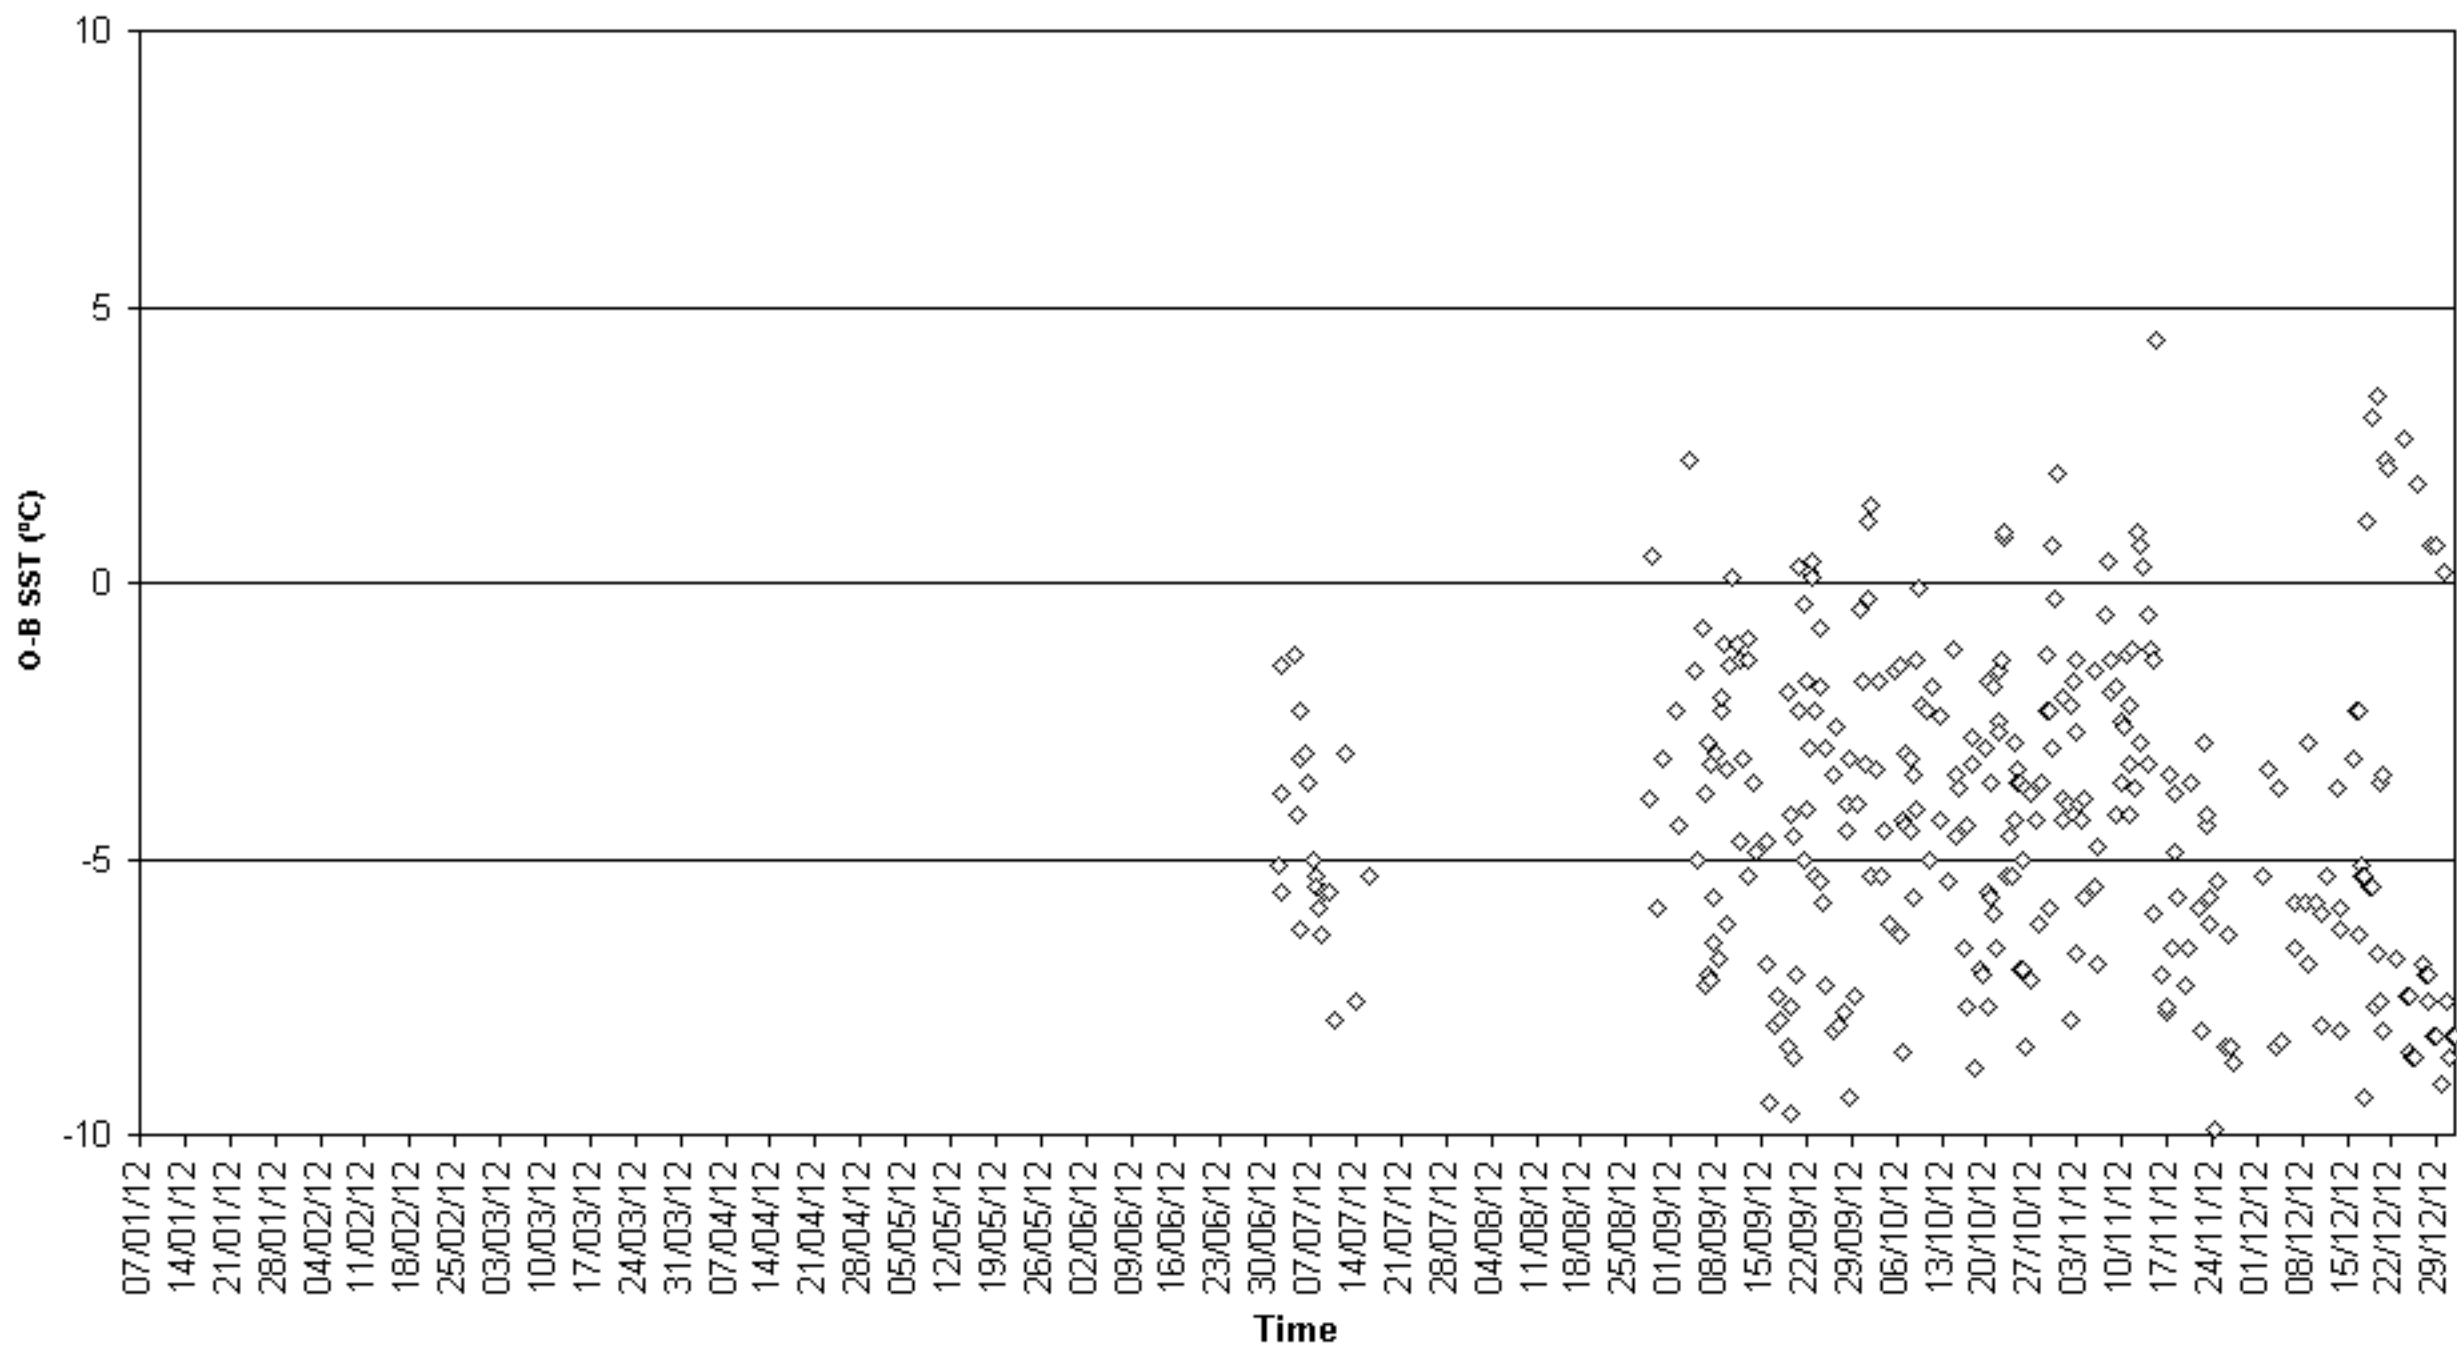


O-B SST (°C) for identifier J8AZ2


Number of obs. plotted = 348 Number of outliers = 14

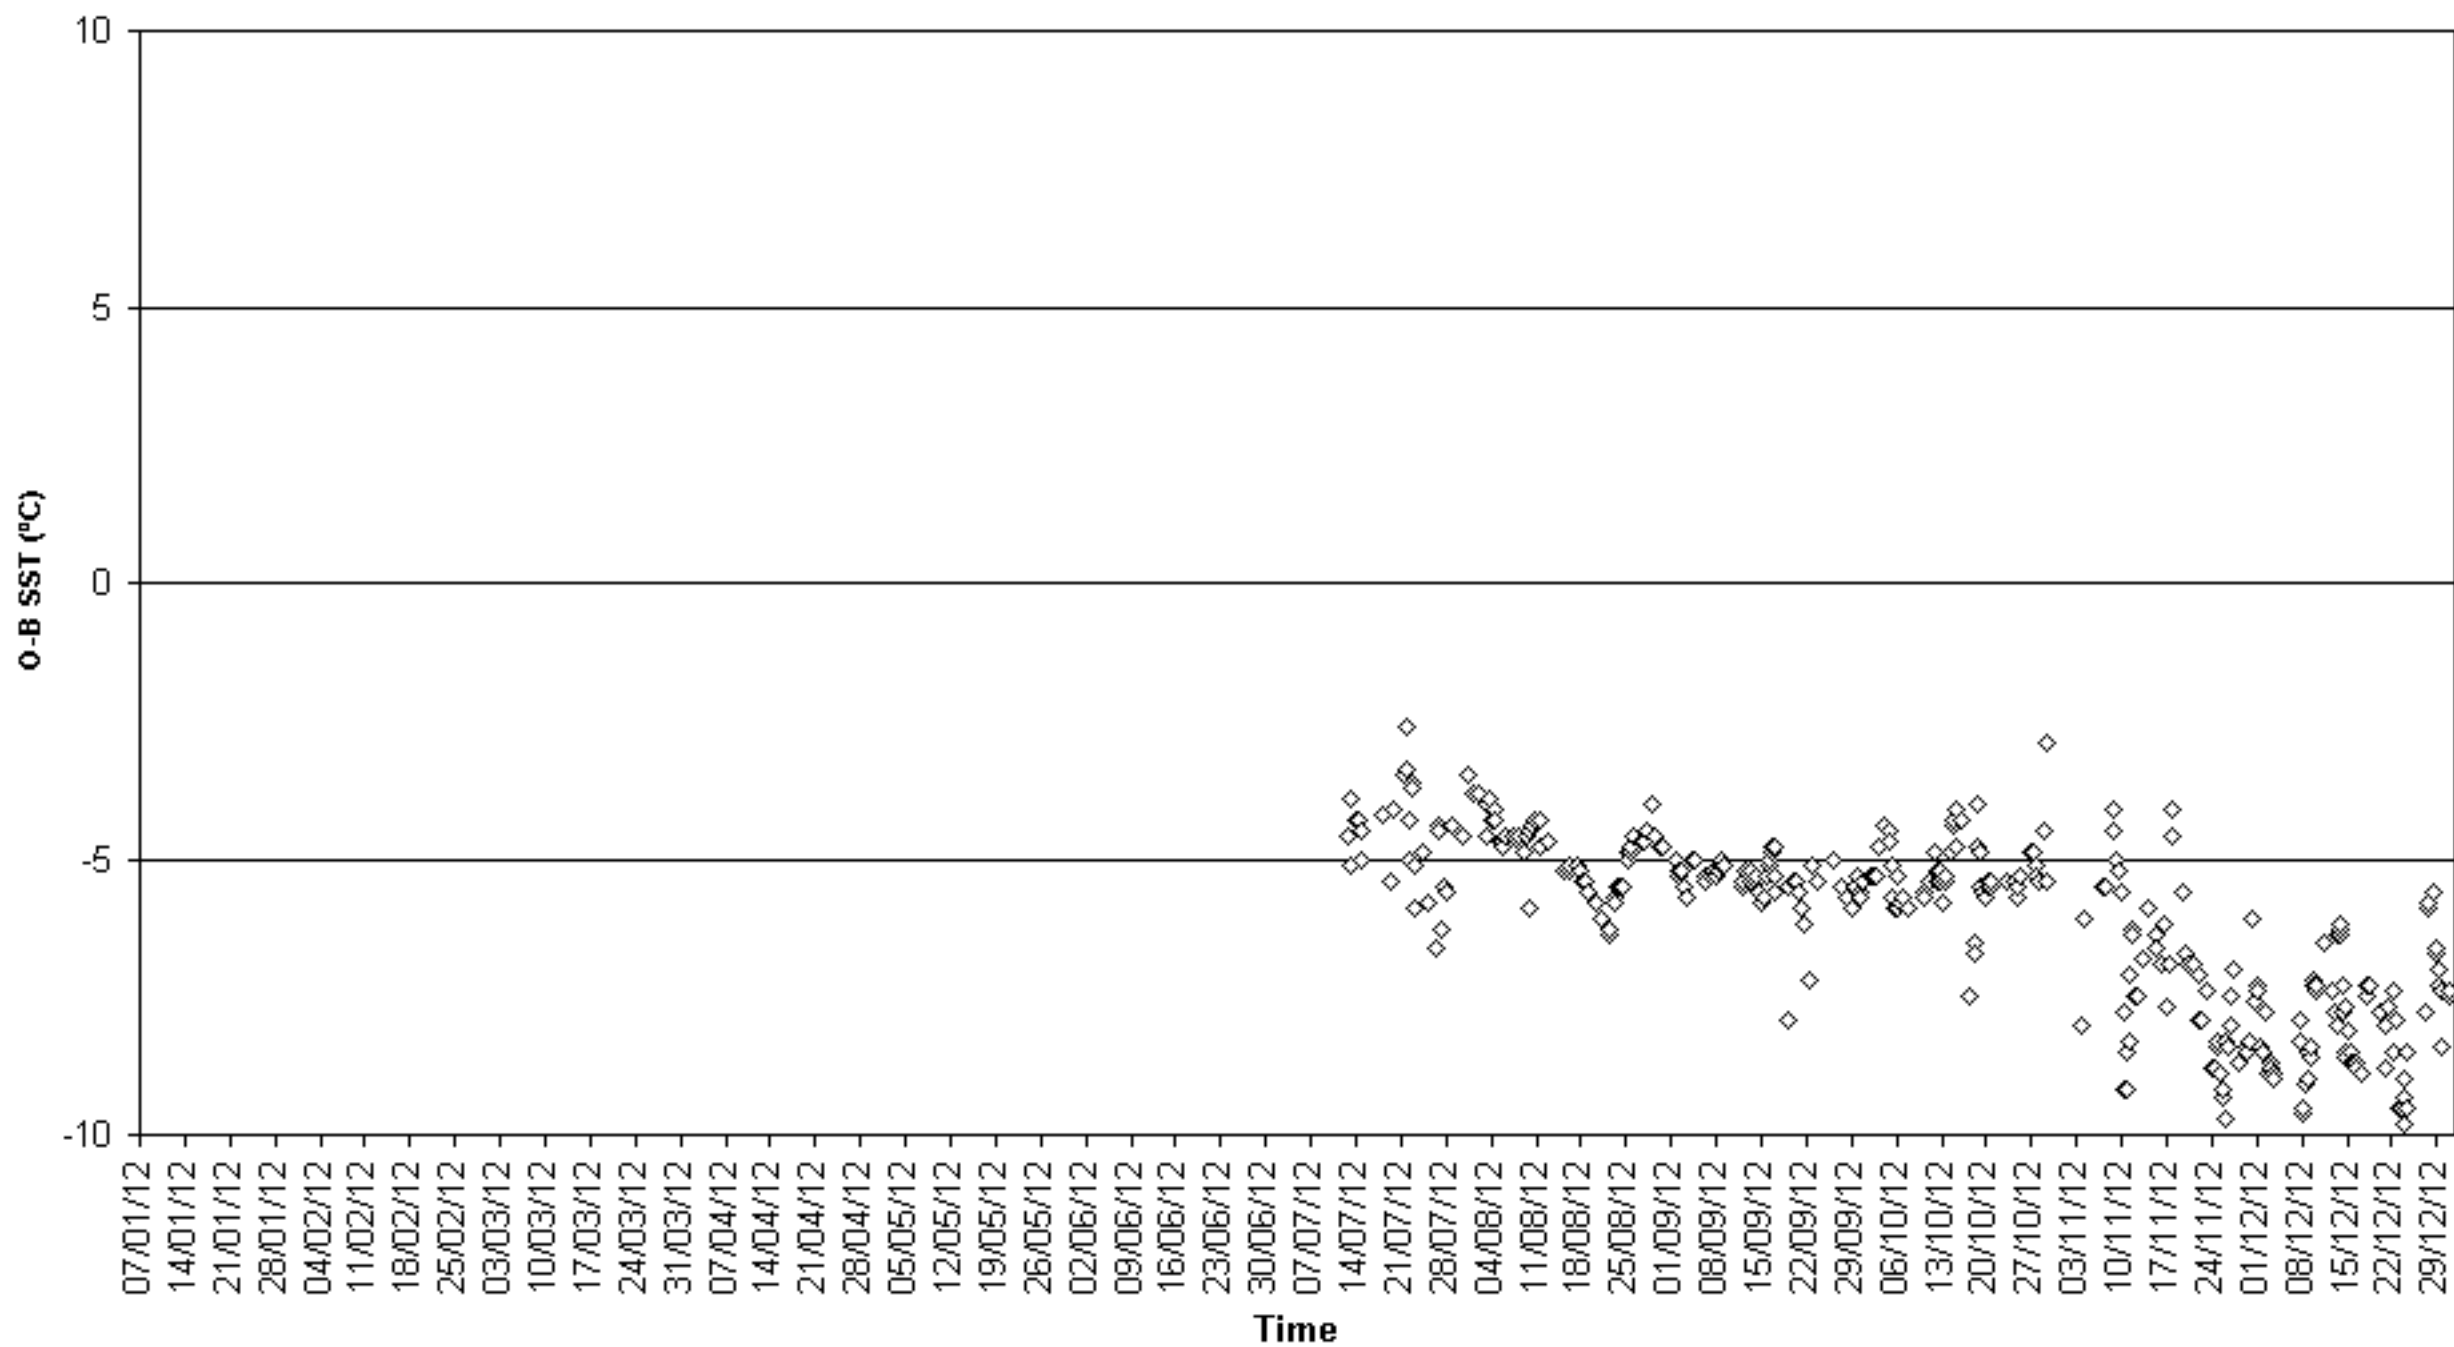


O-B SST (°C) for identifier KIRH
Number of obs. plotted = 507 Number of outliers = 2

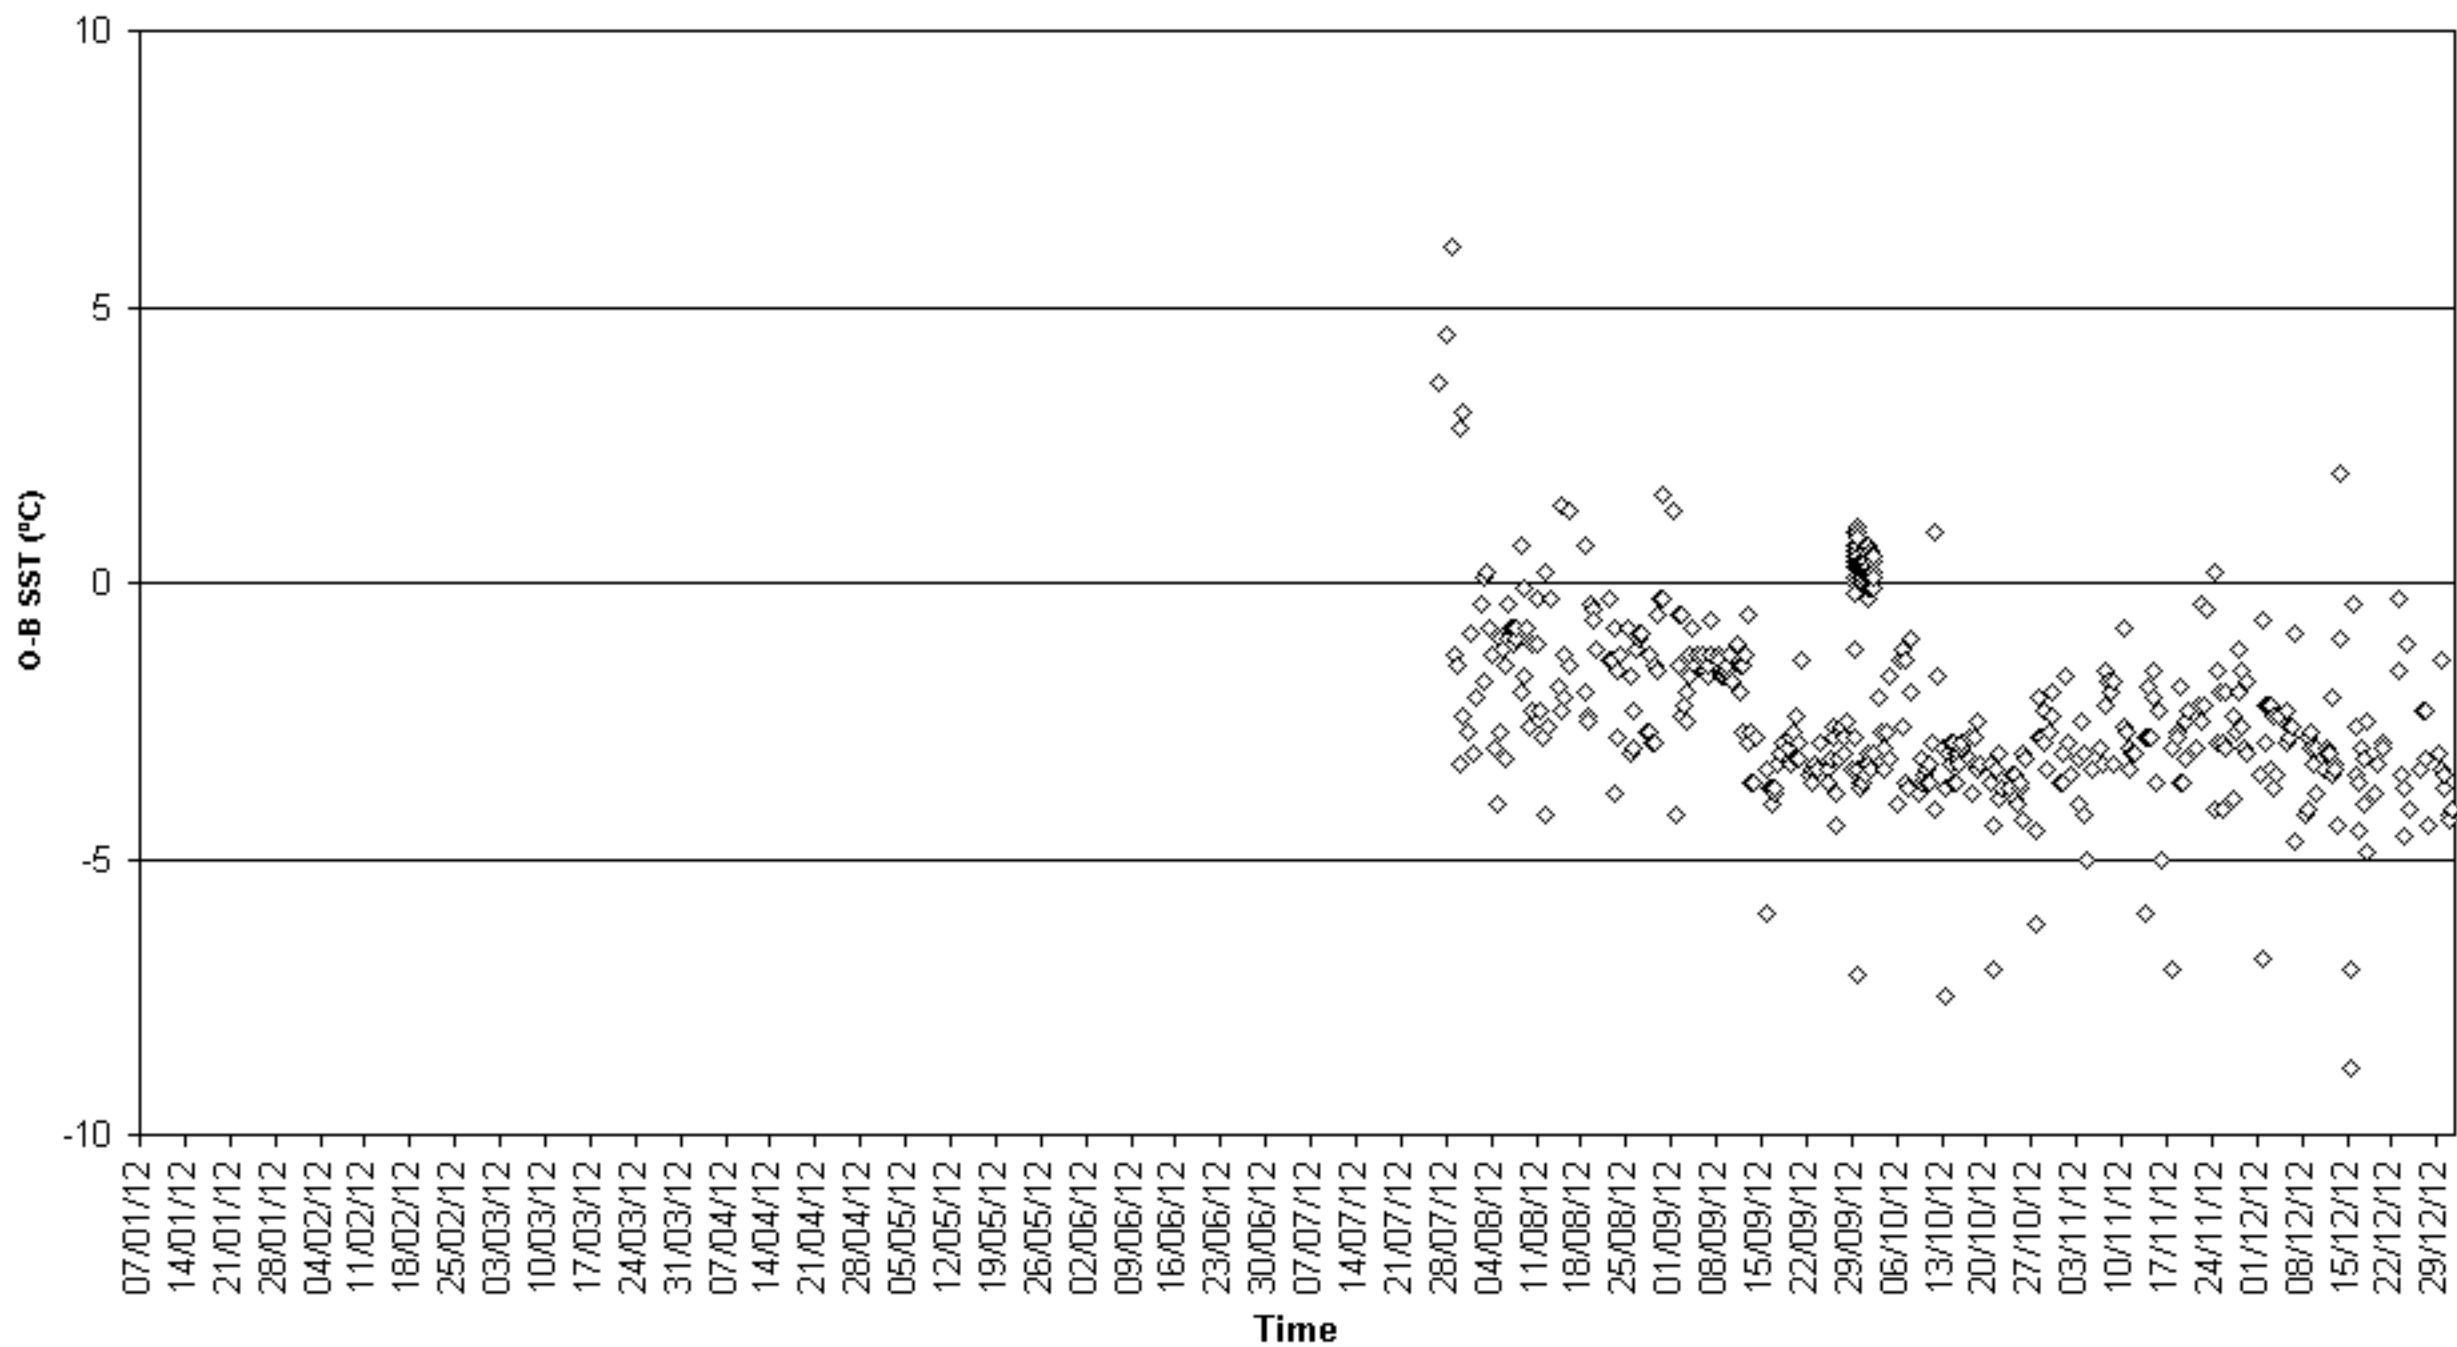


O-B SST (°C) for identifier MCLJ8
Number of obs. plotted = 58 Number of outliers = 0

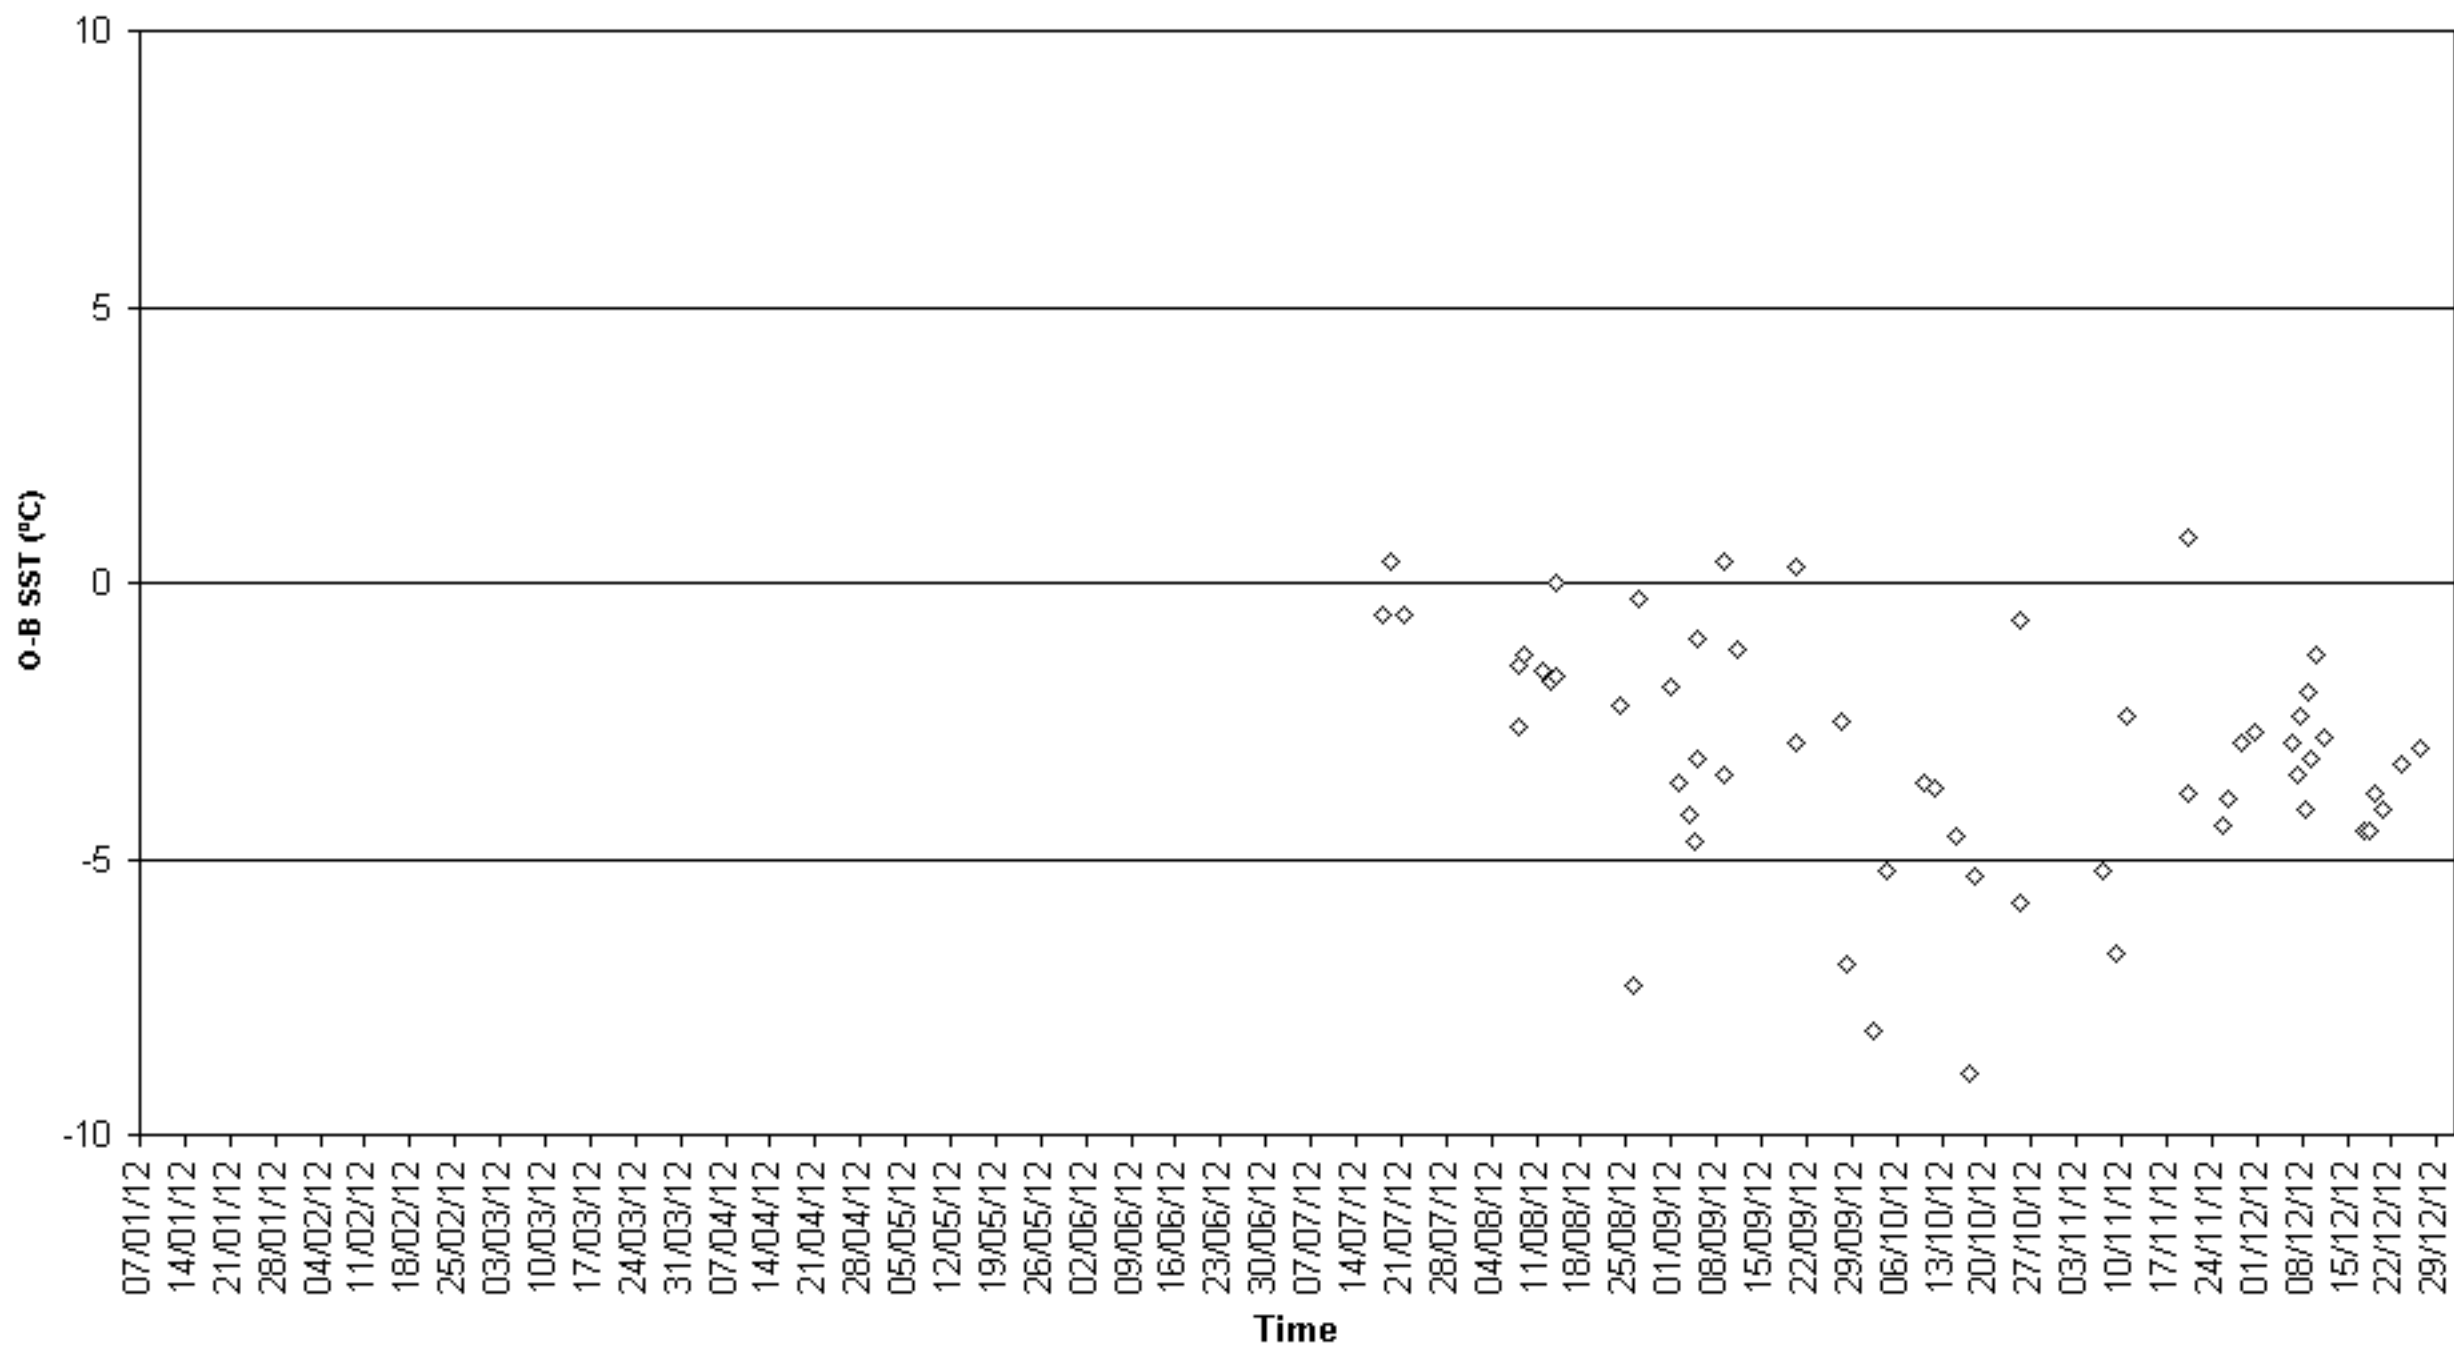


O-B SST (°C) for identifier PBHZ
Number of obs. plotted = 59 Number of outliers = 0

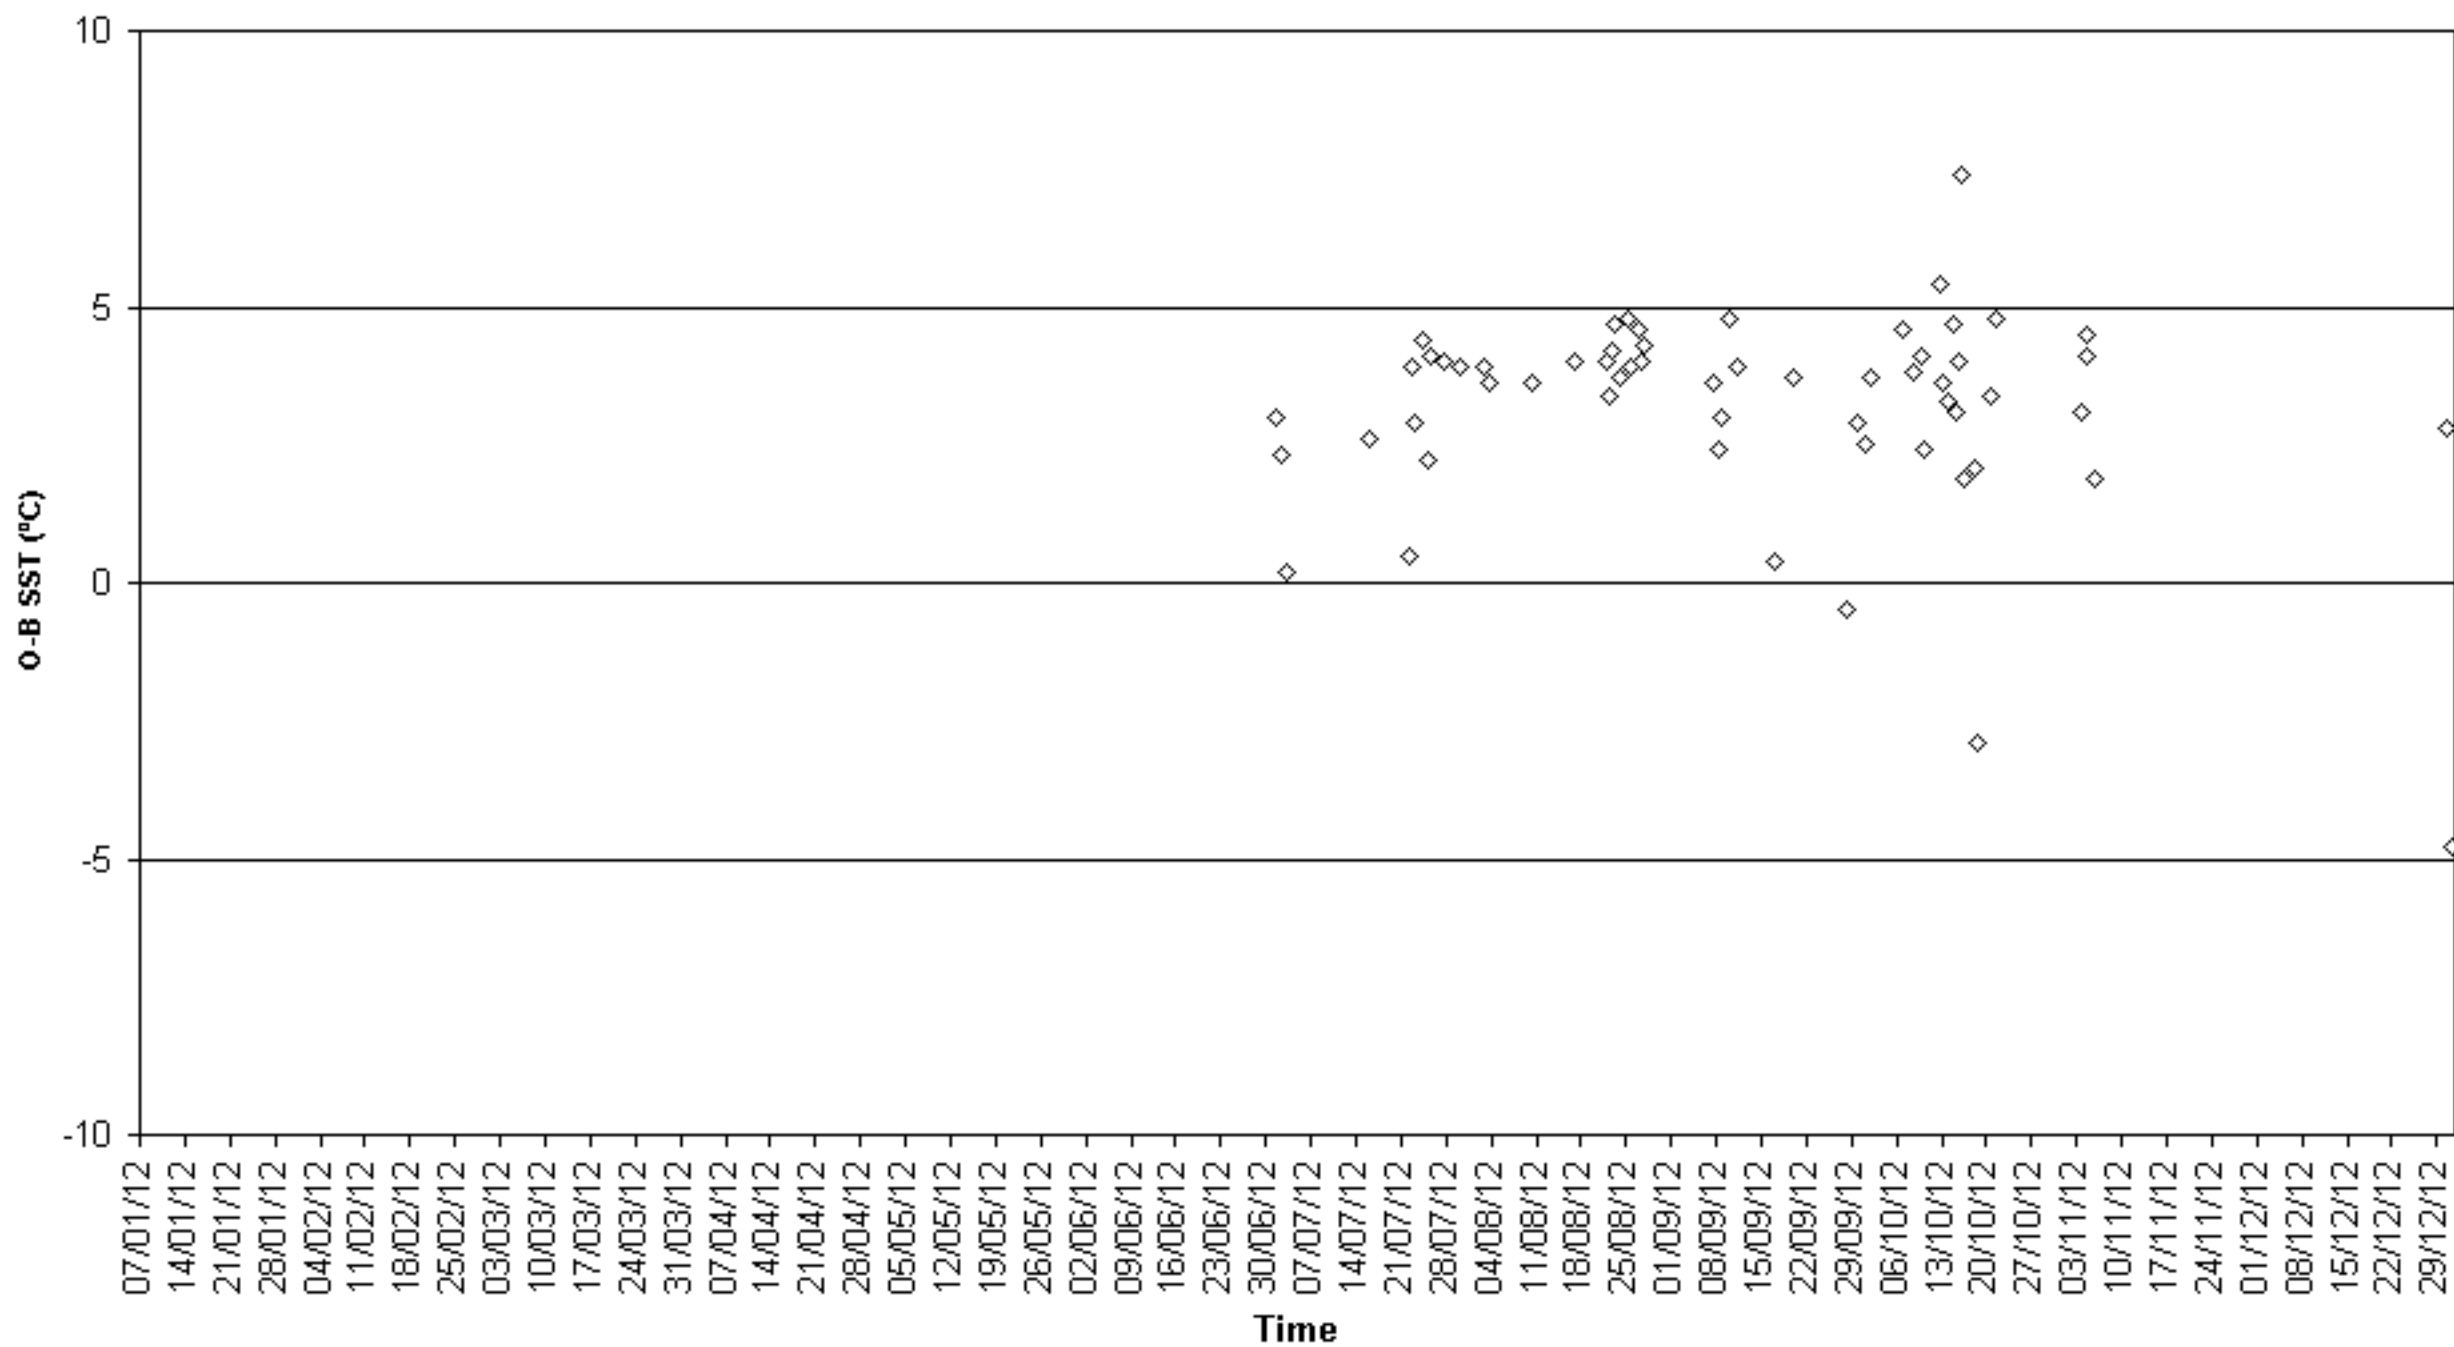


O-B SST (°C) for identifier ROSS
Number of obs. plotted = 646 Number of outliers = 0

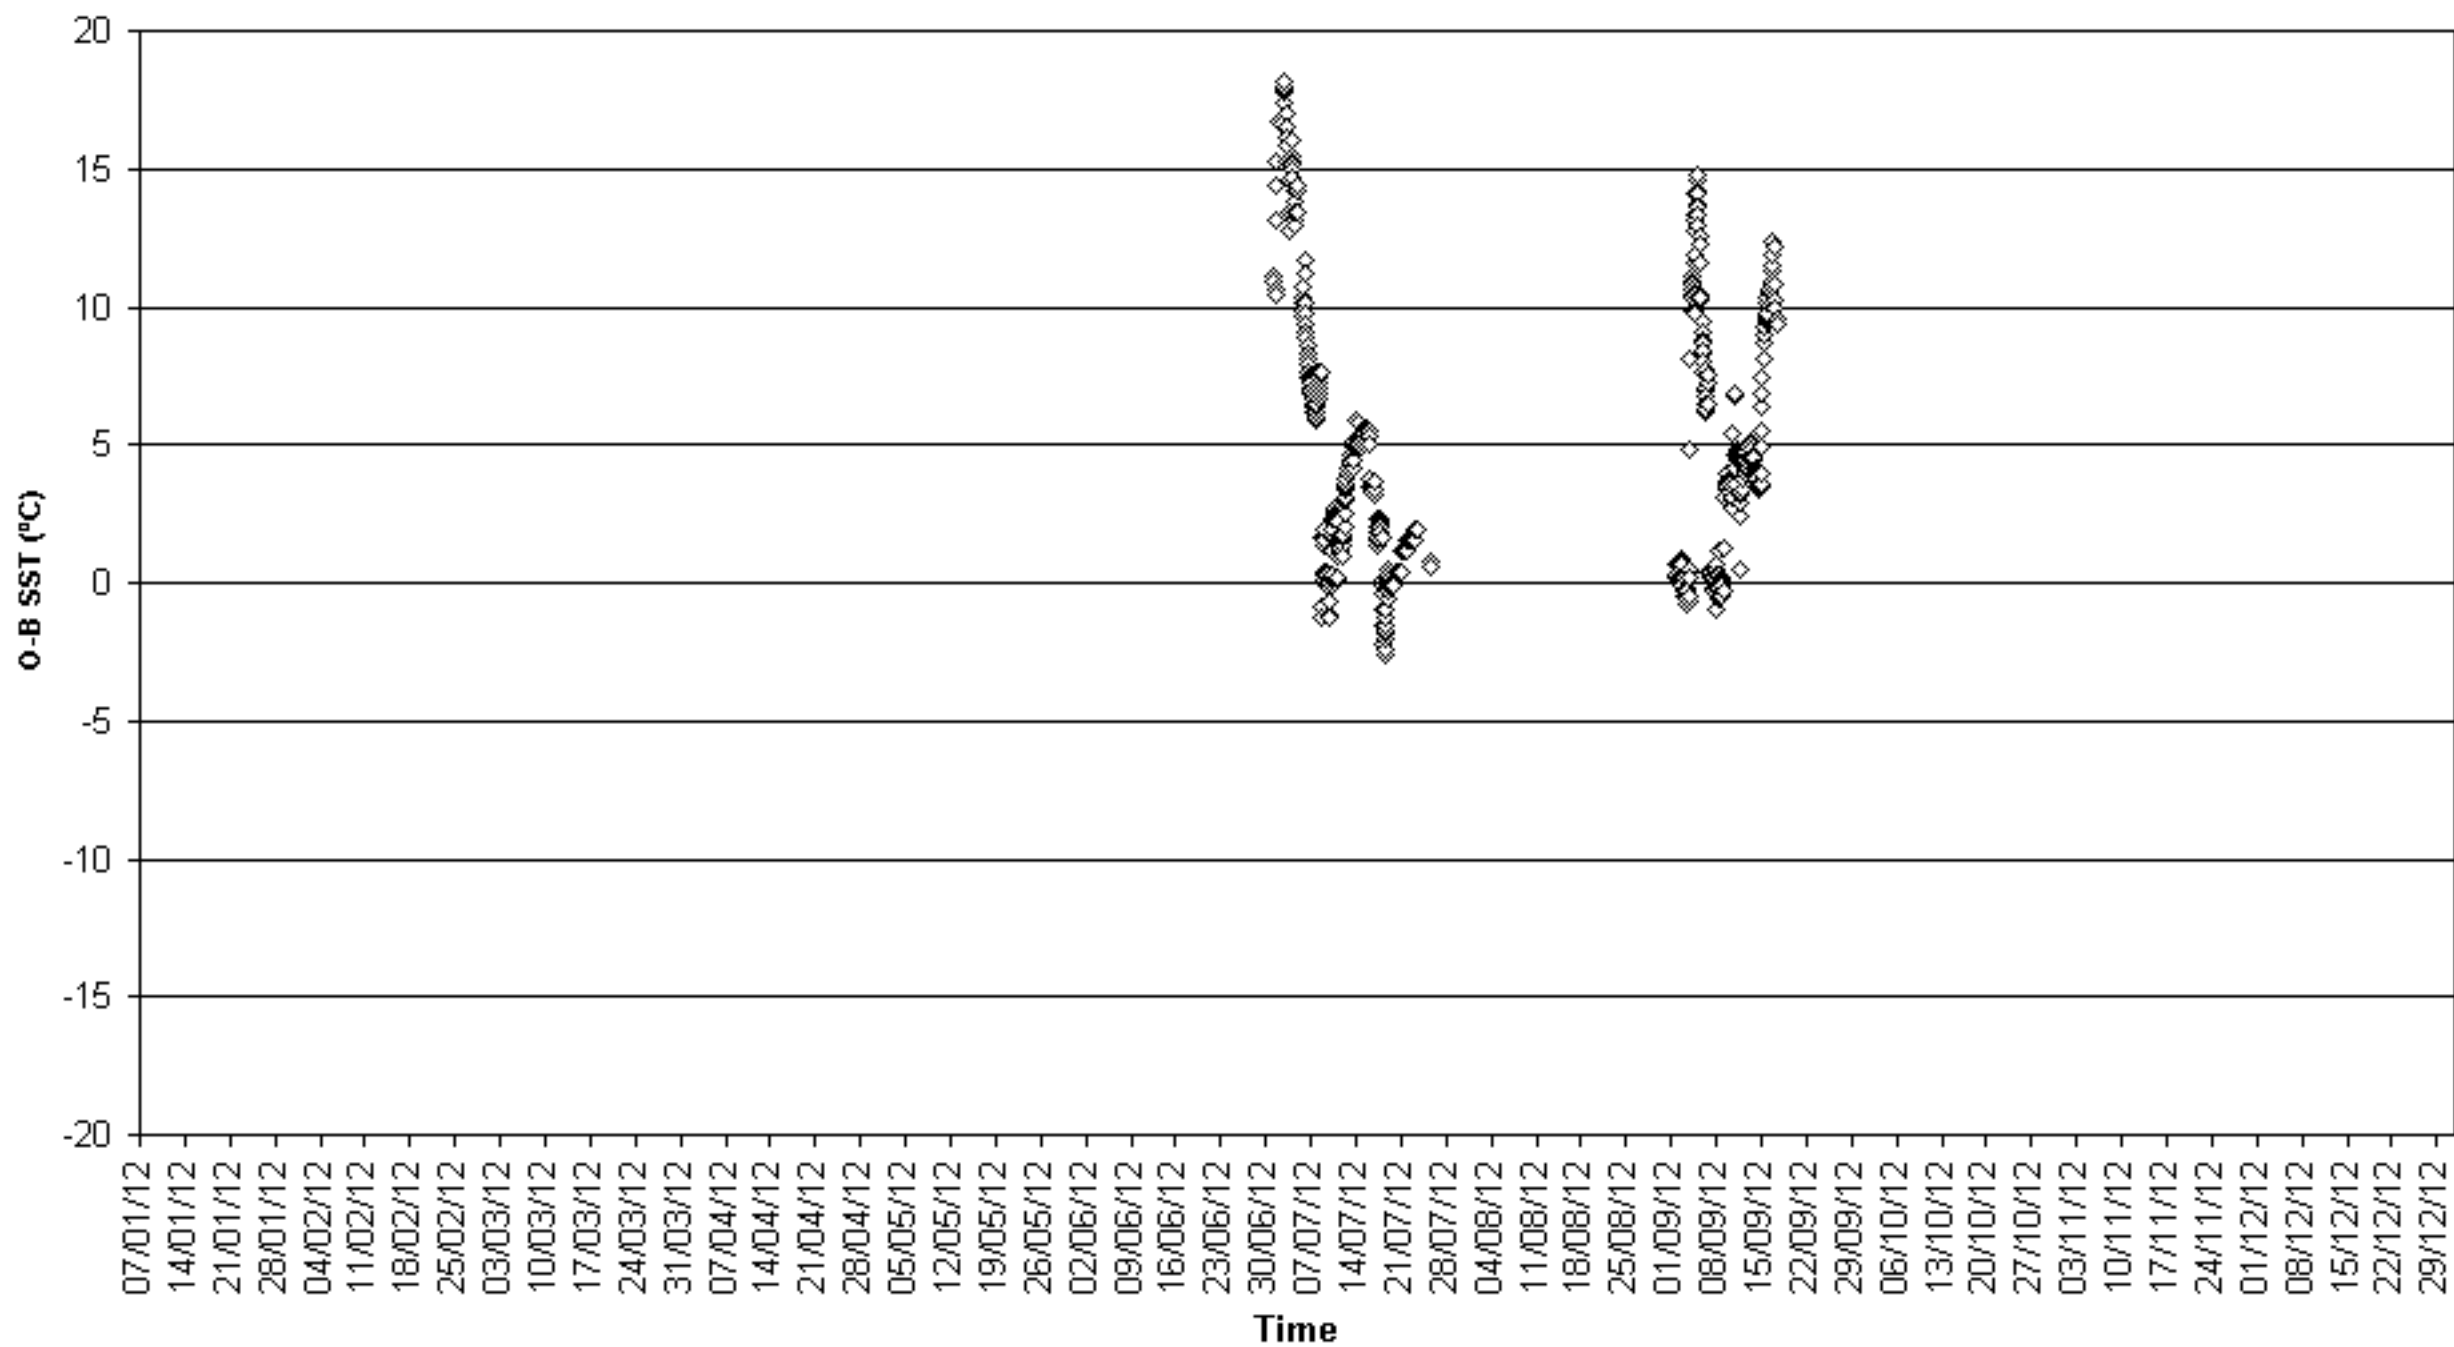


O-B SST (°C) for identifier S6TB
Number of obs. plotted = 66 Number of outliers = 1

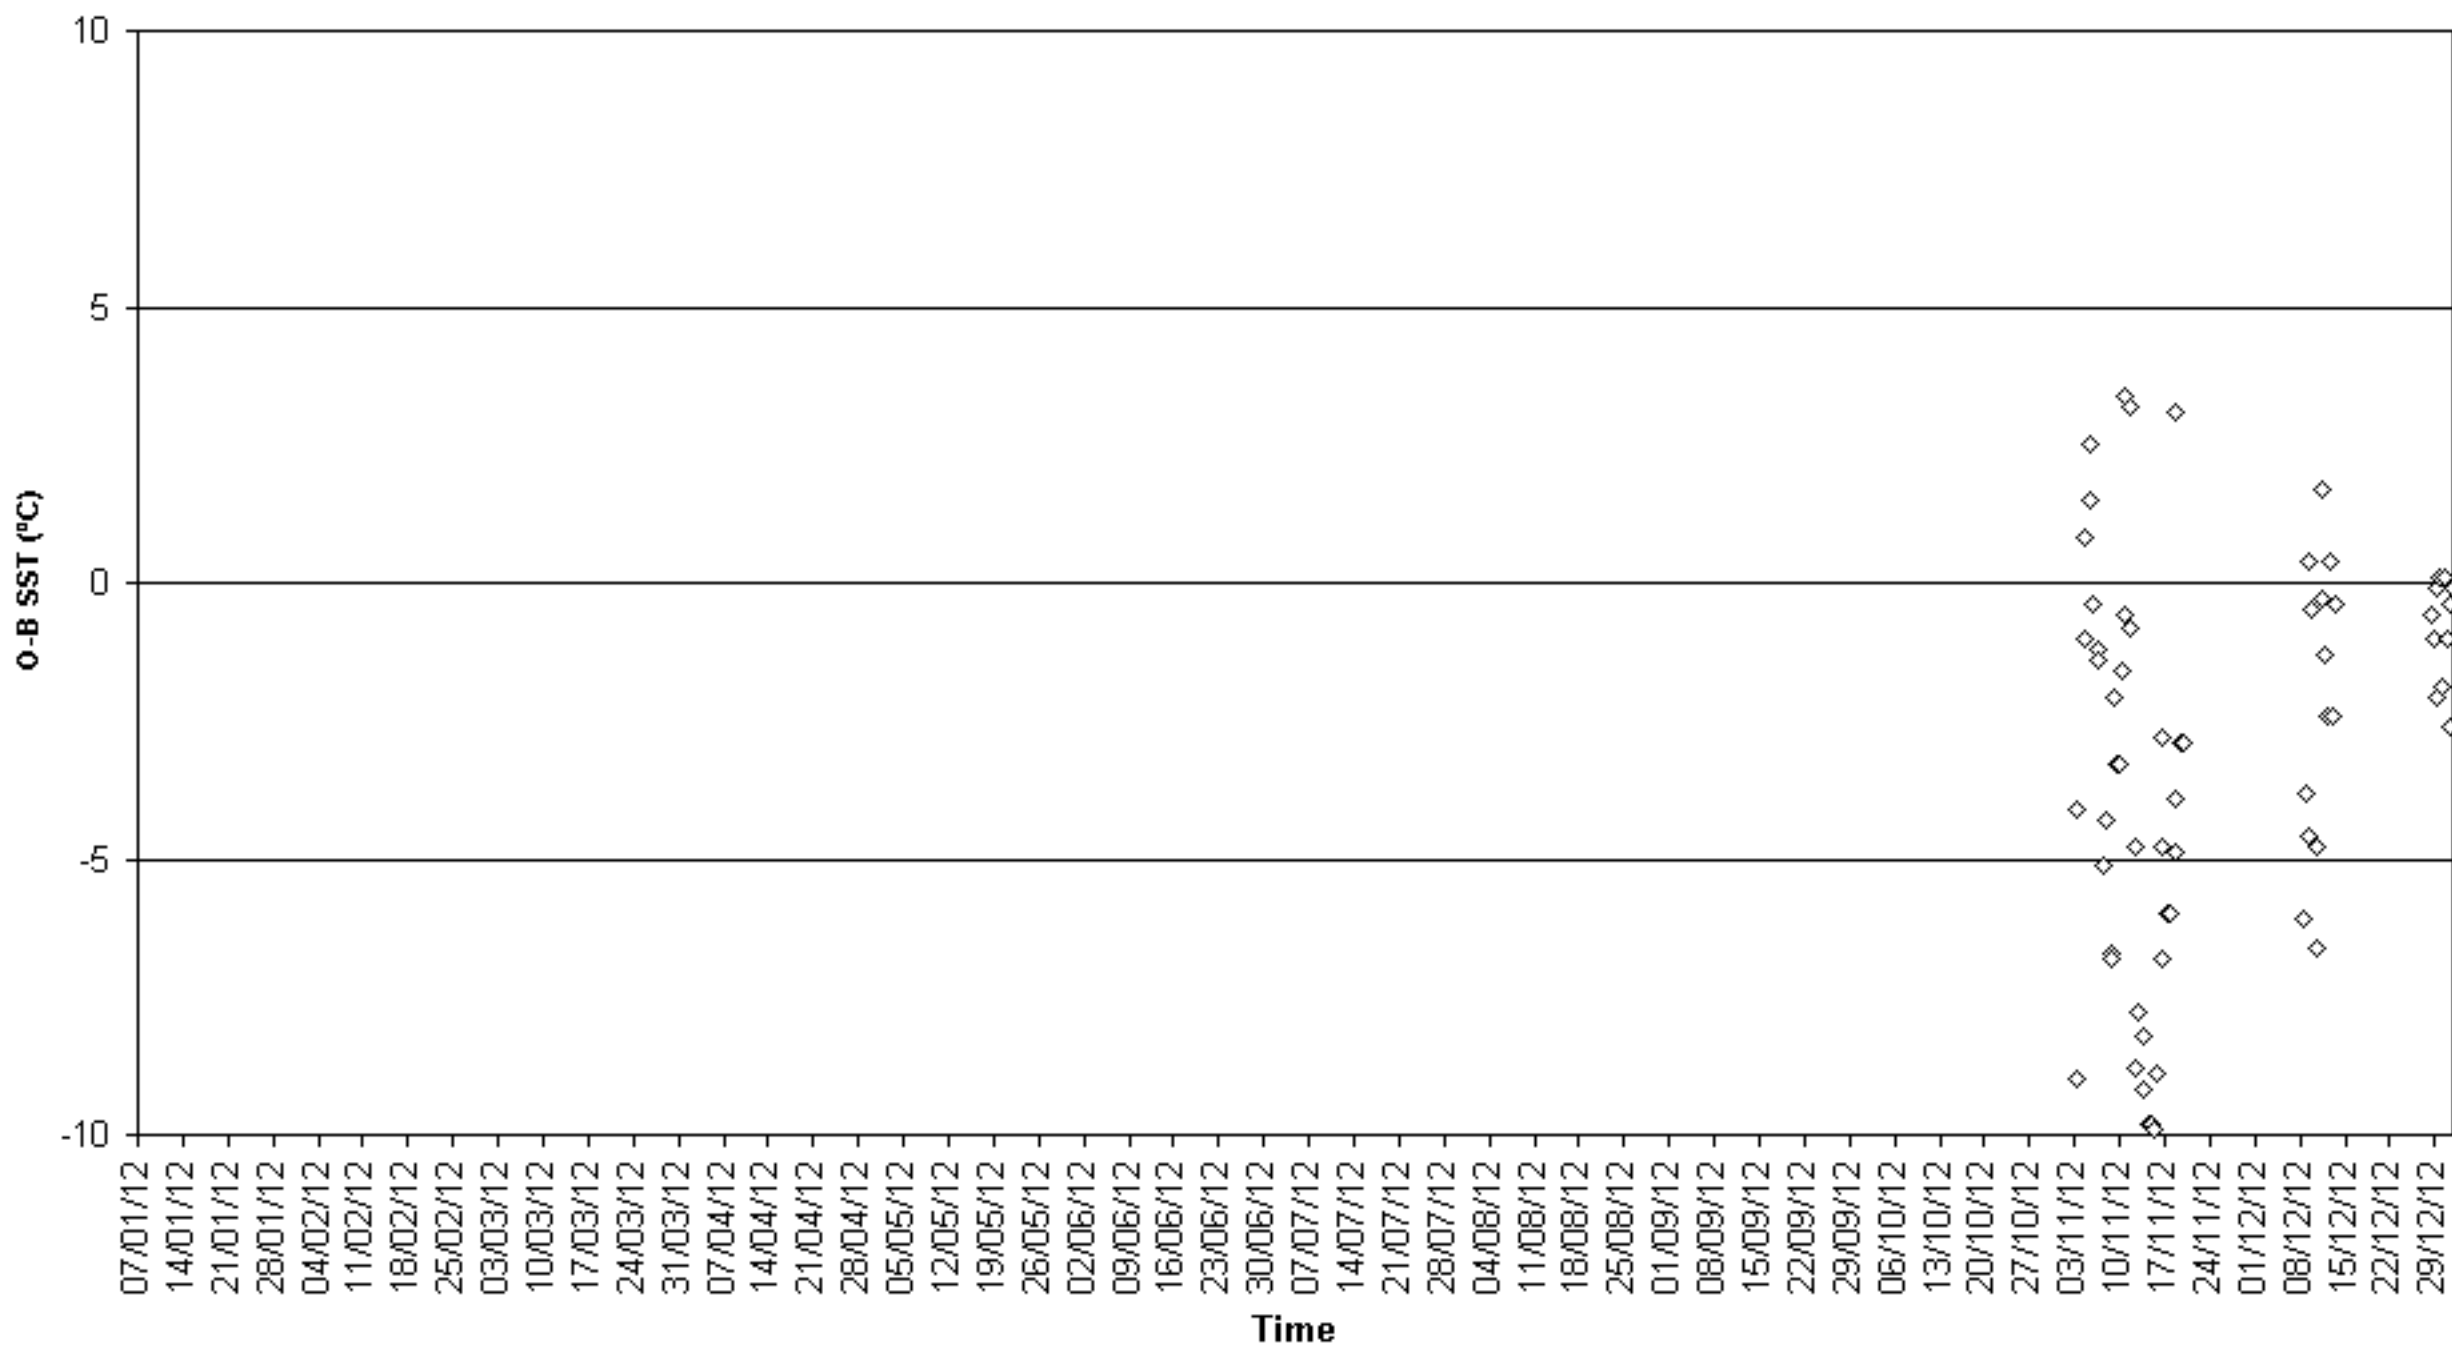


O-B SST (°C) for identifier UASX
Number of obs. plotted = 56 Number of outliers = 3

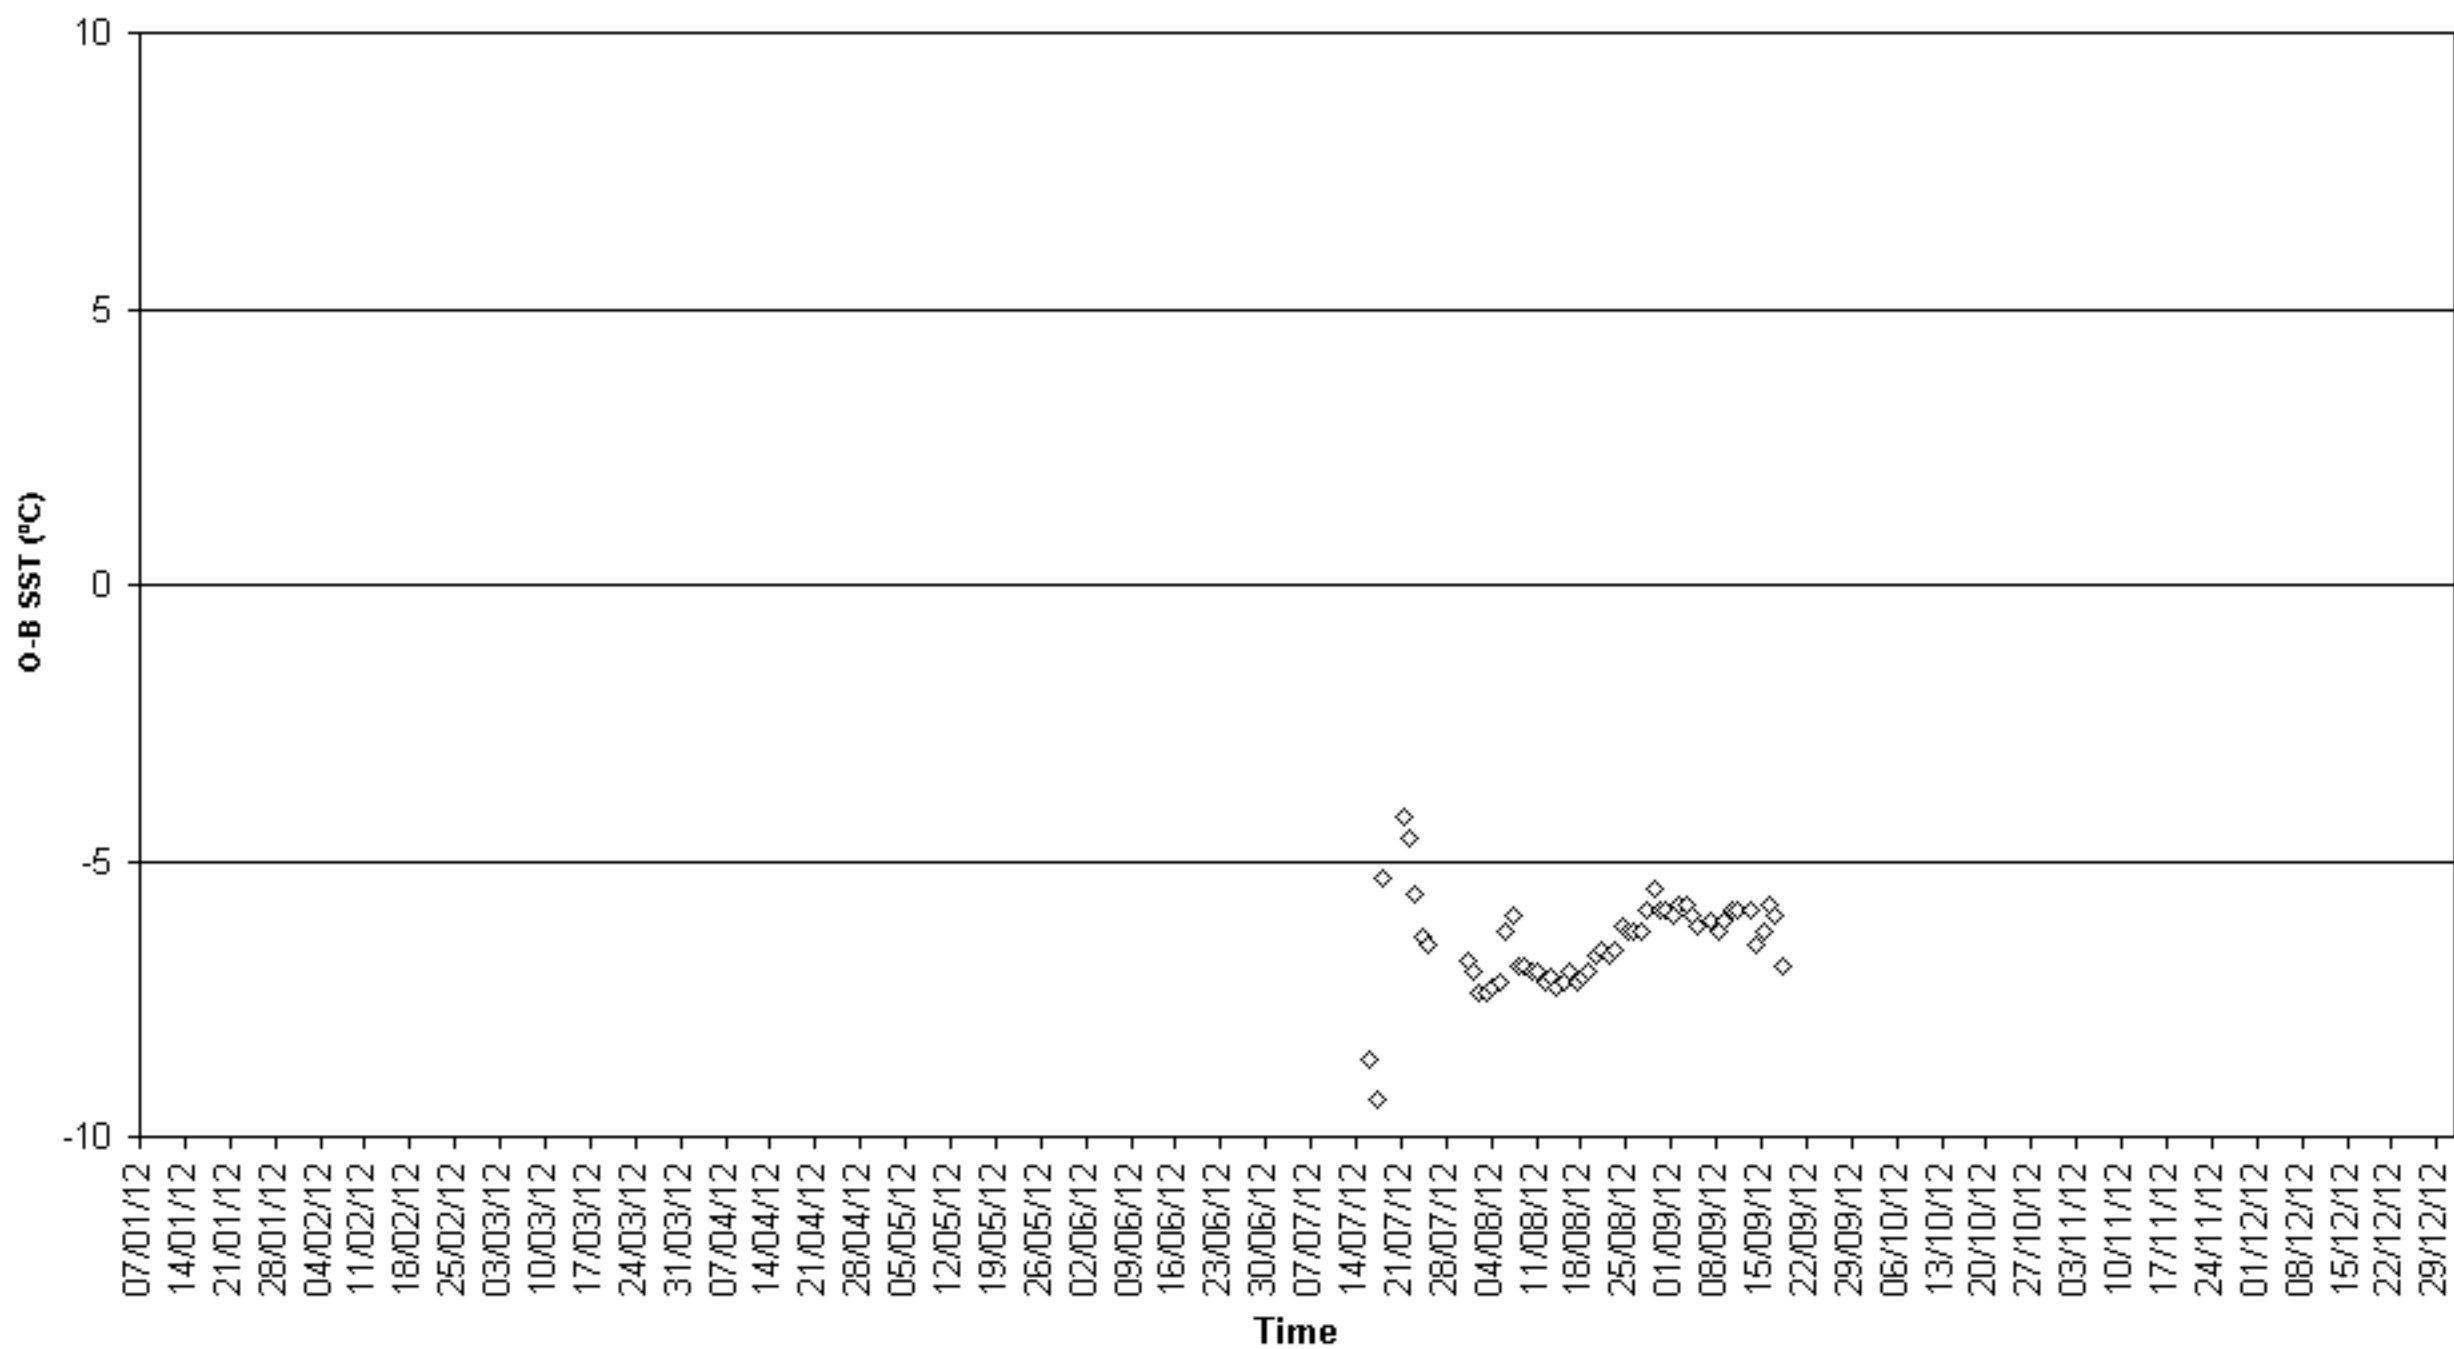


O-B SST (°C) for identifier UCDM
Number of obs. plotted = 45 Number of outliers = 0

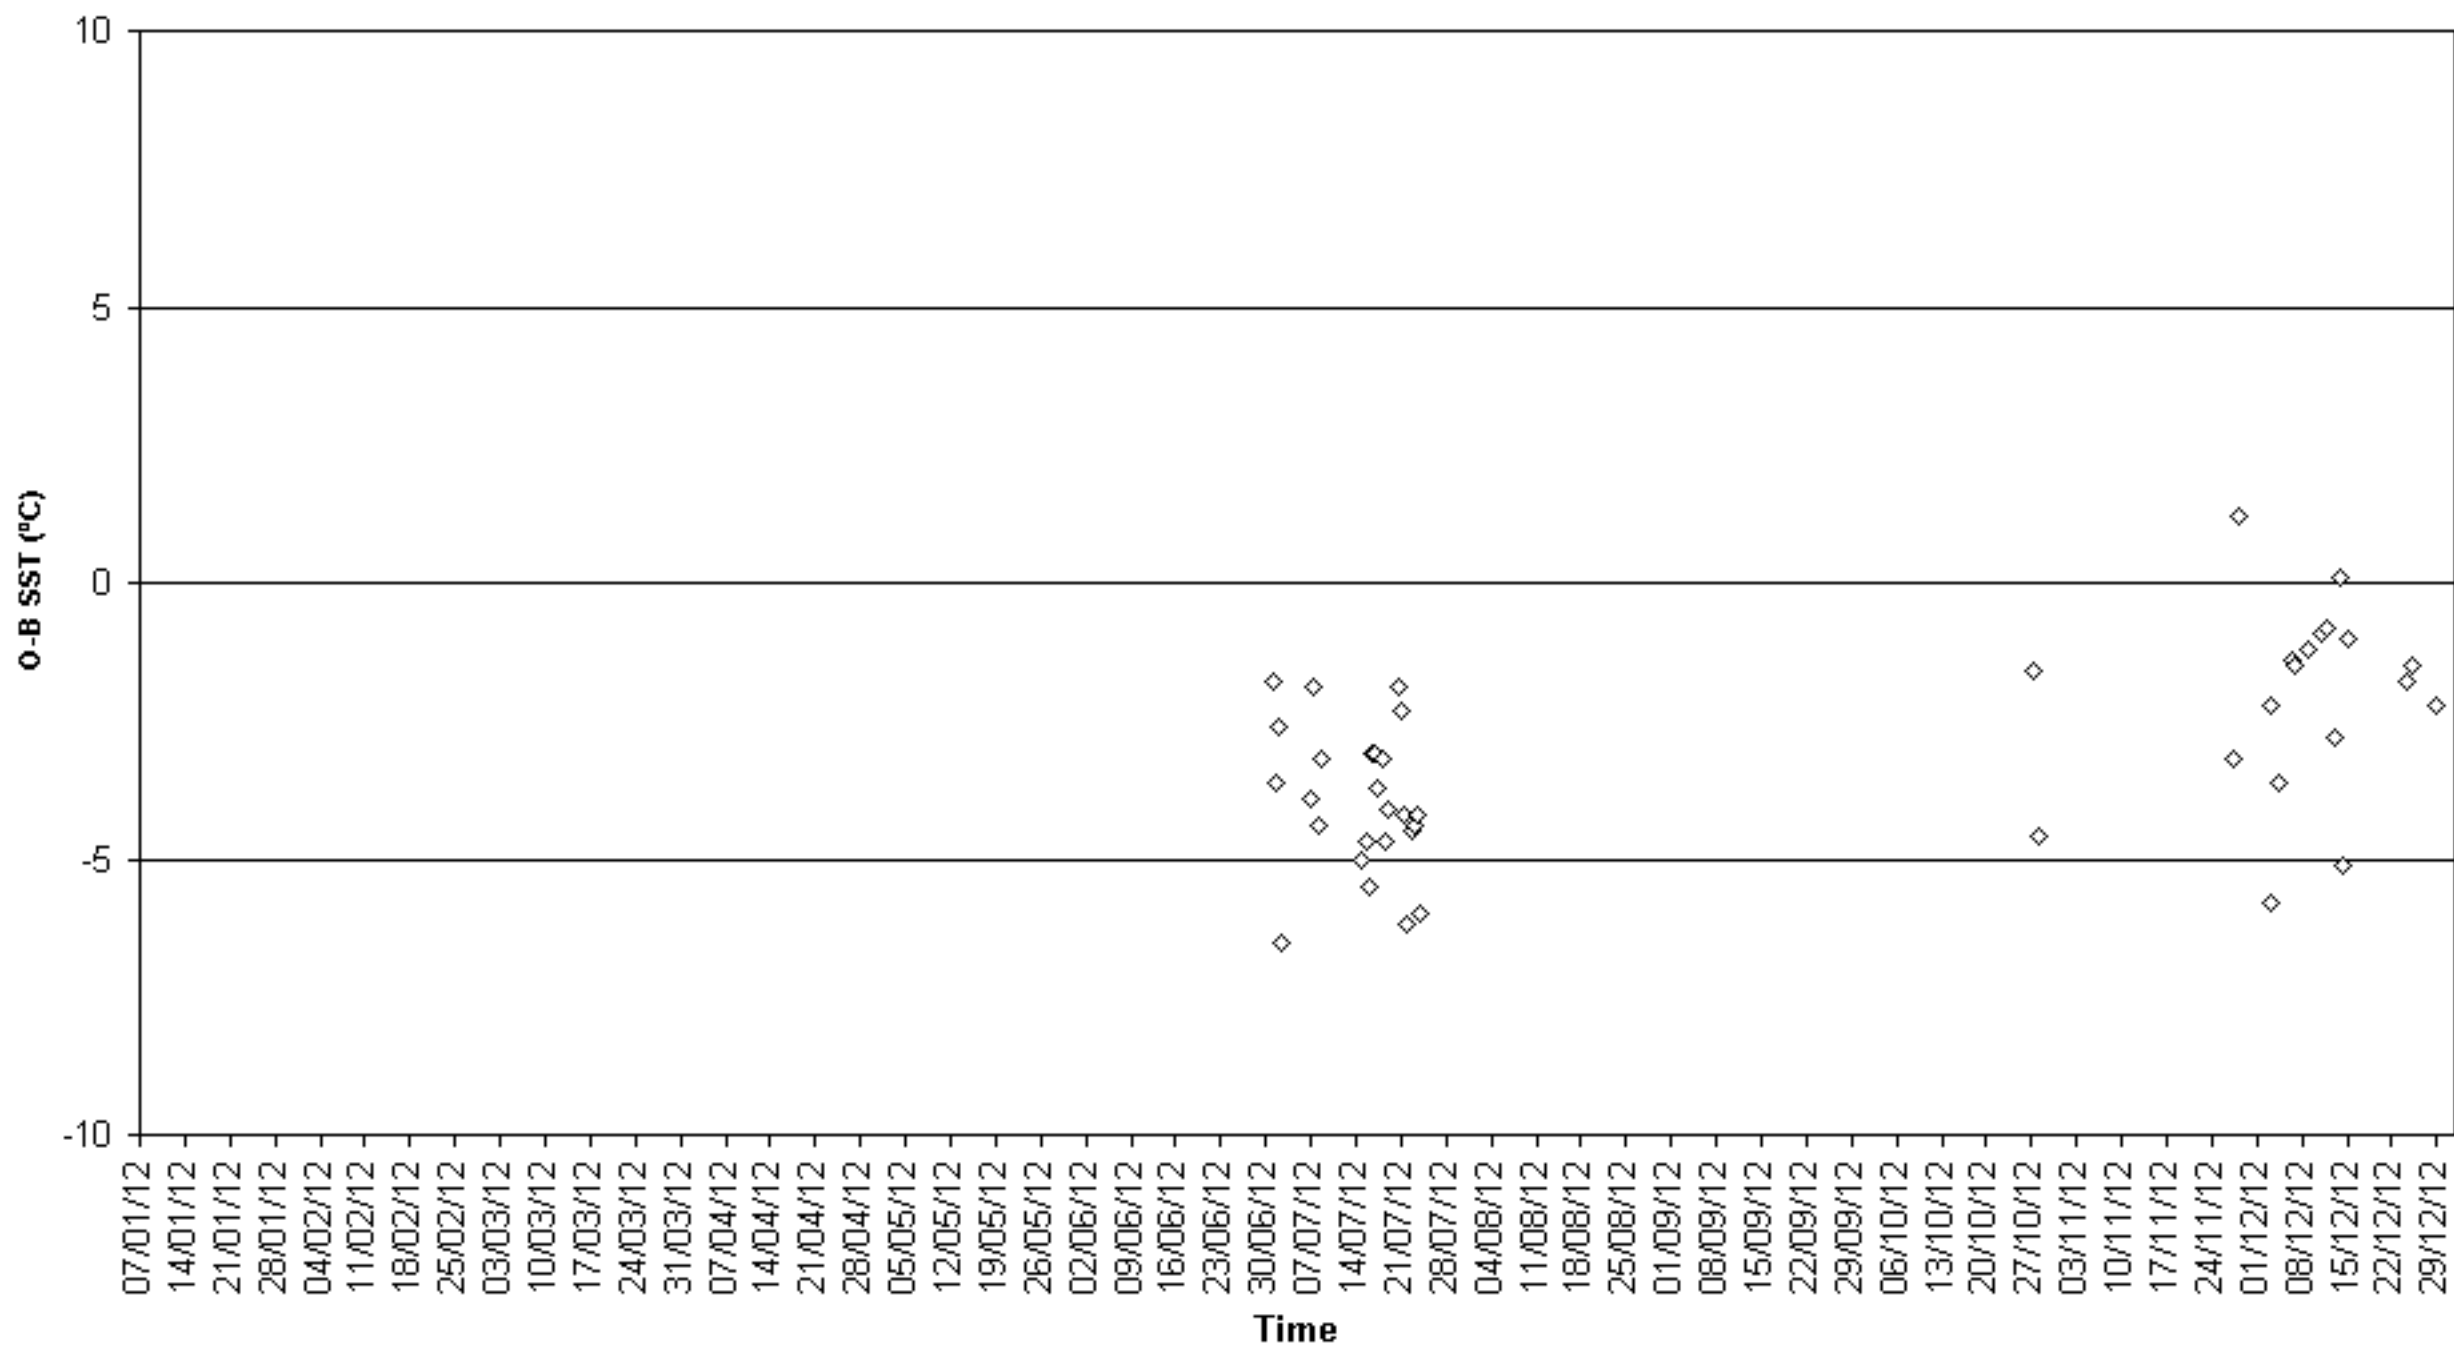


O-B SST (°C) for identifier UCDN
Number of obs. plotted = 53 Number of outliers = 0

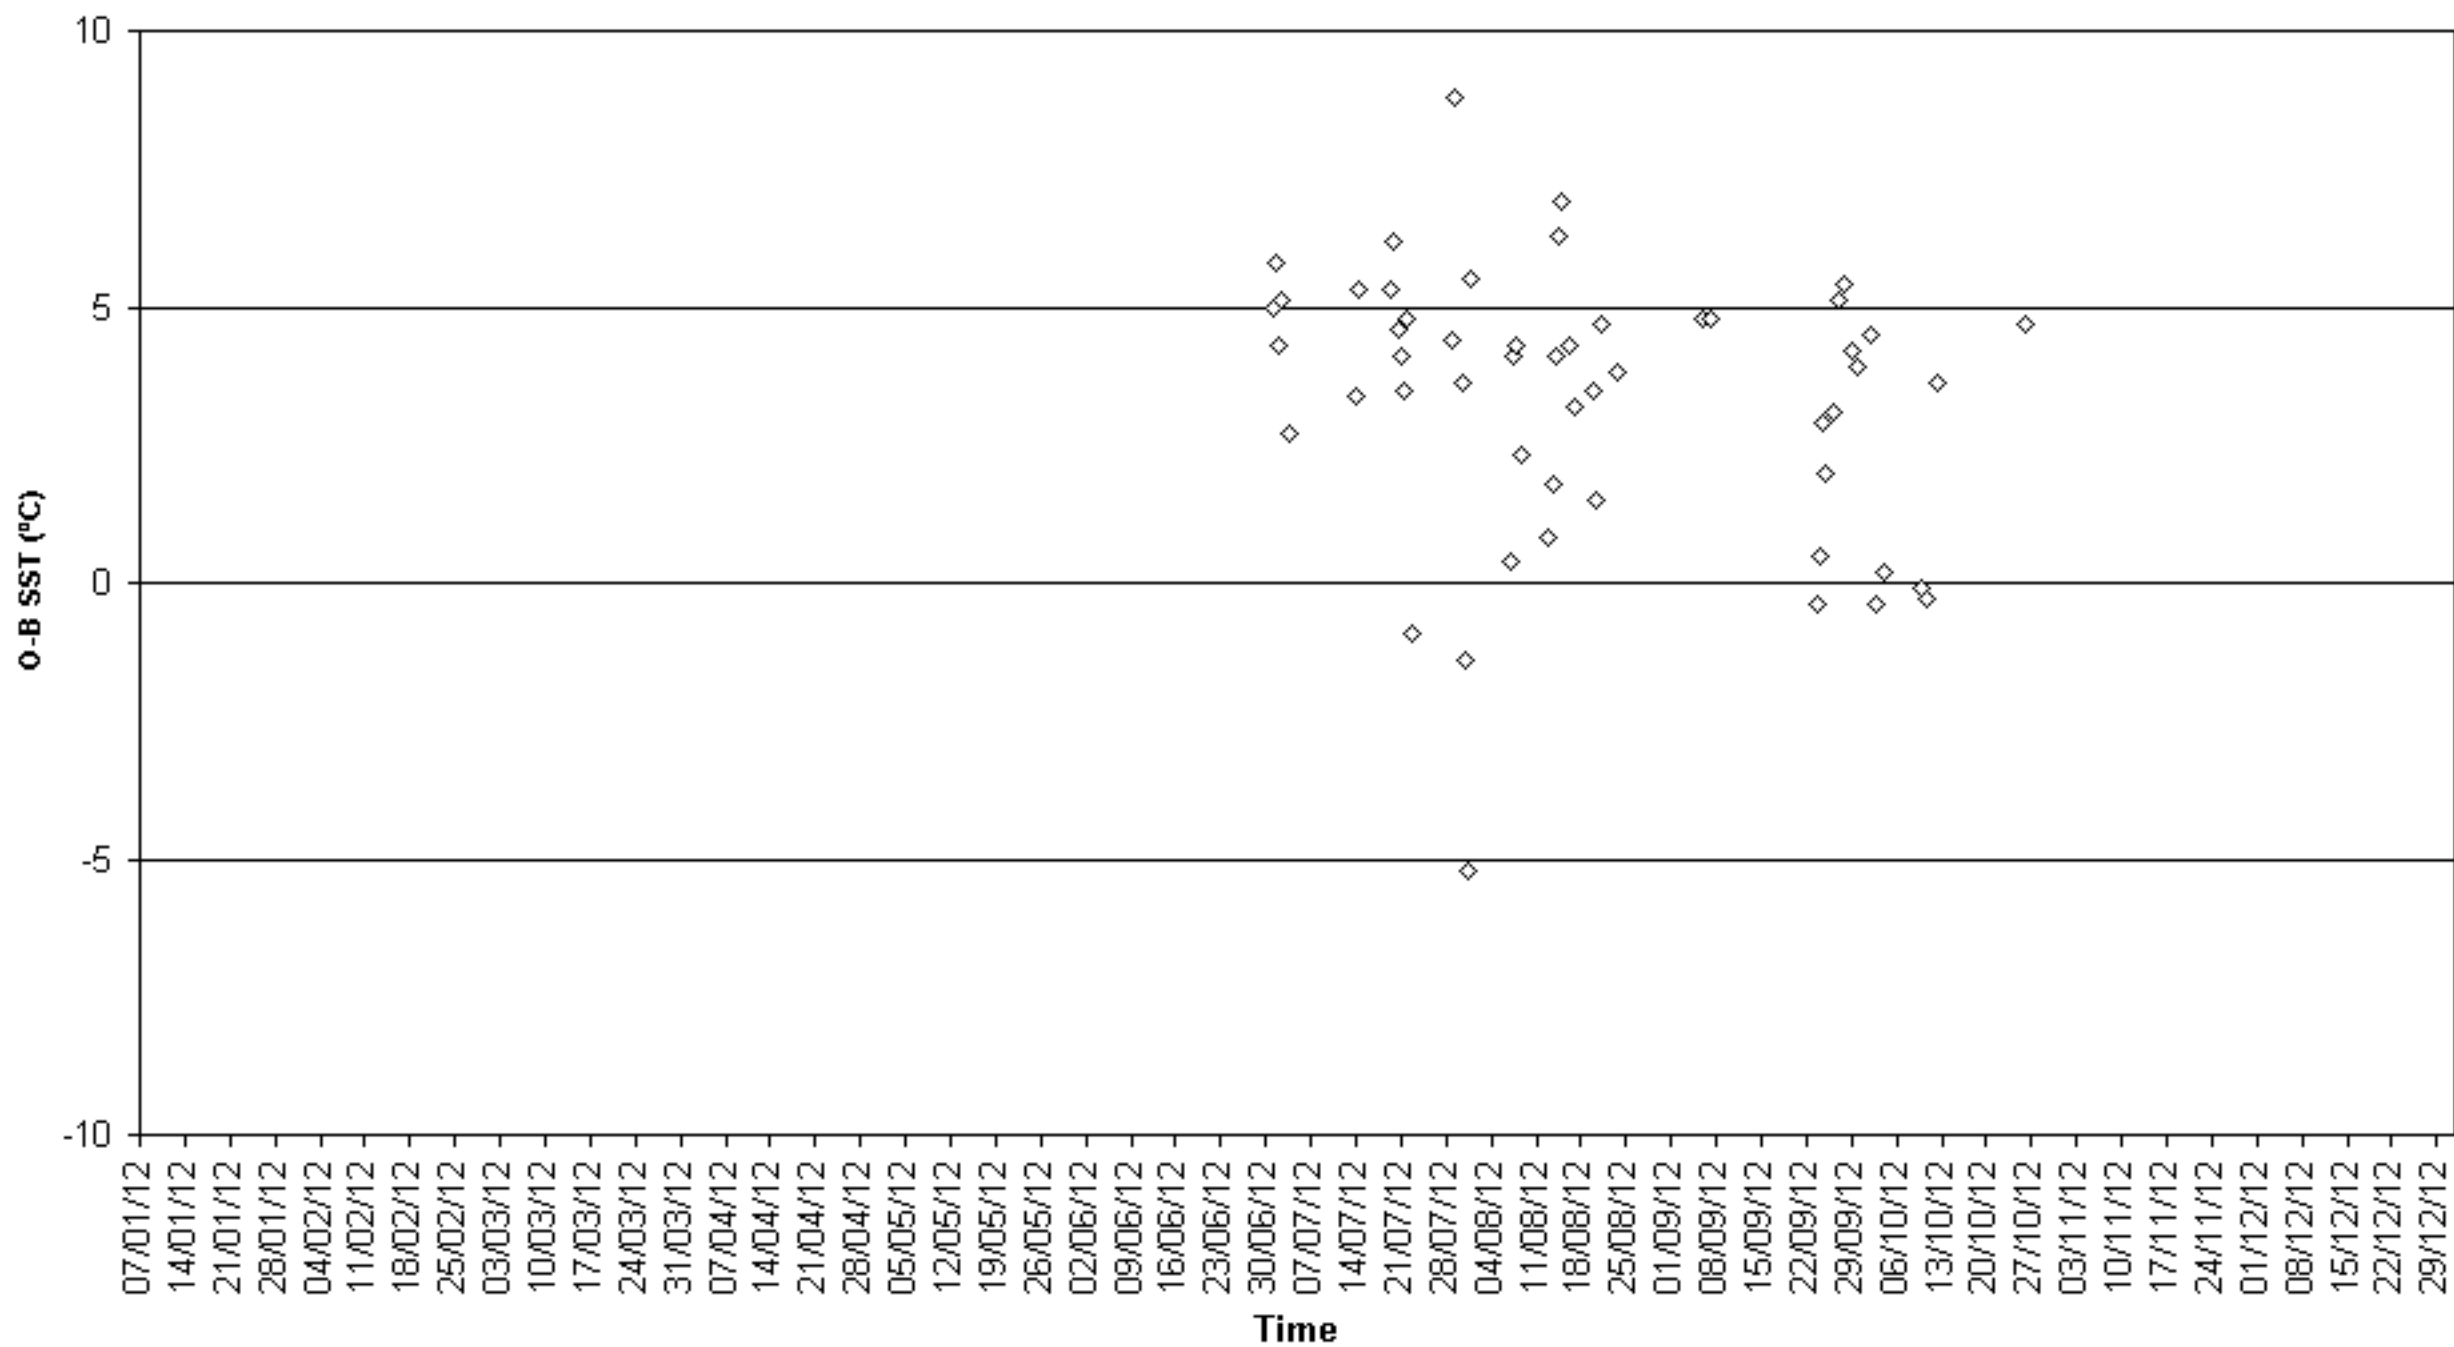


O-B SST (°C) for identifier UCJX
Number of obs. plotted = 127 Number of outliers = 1

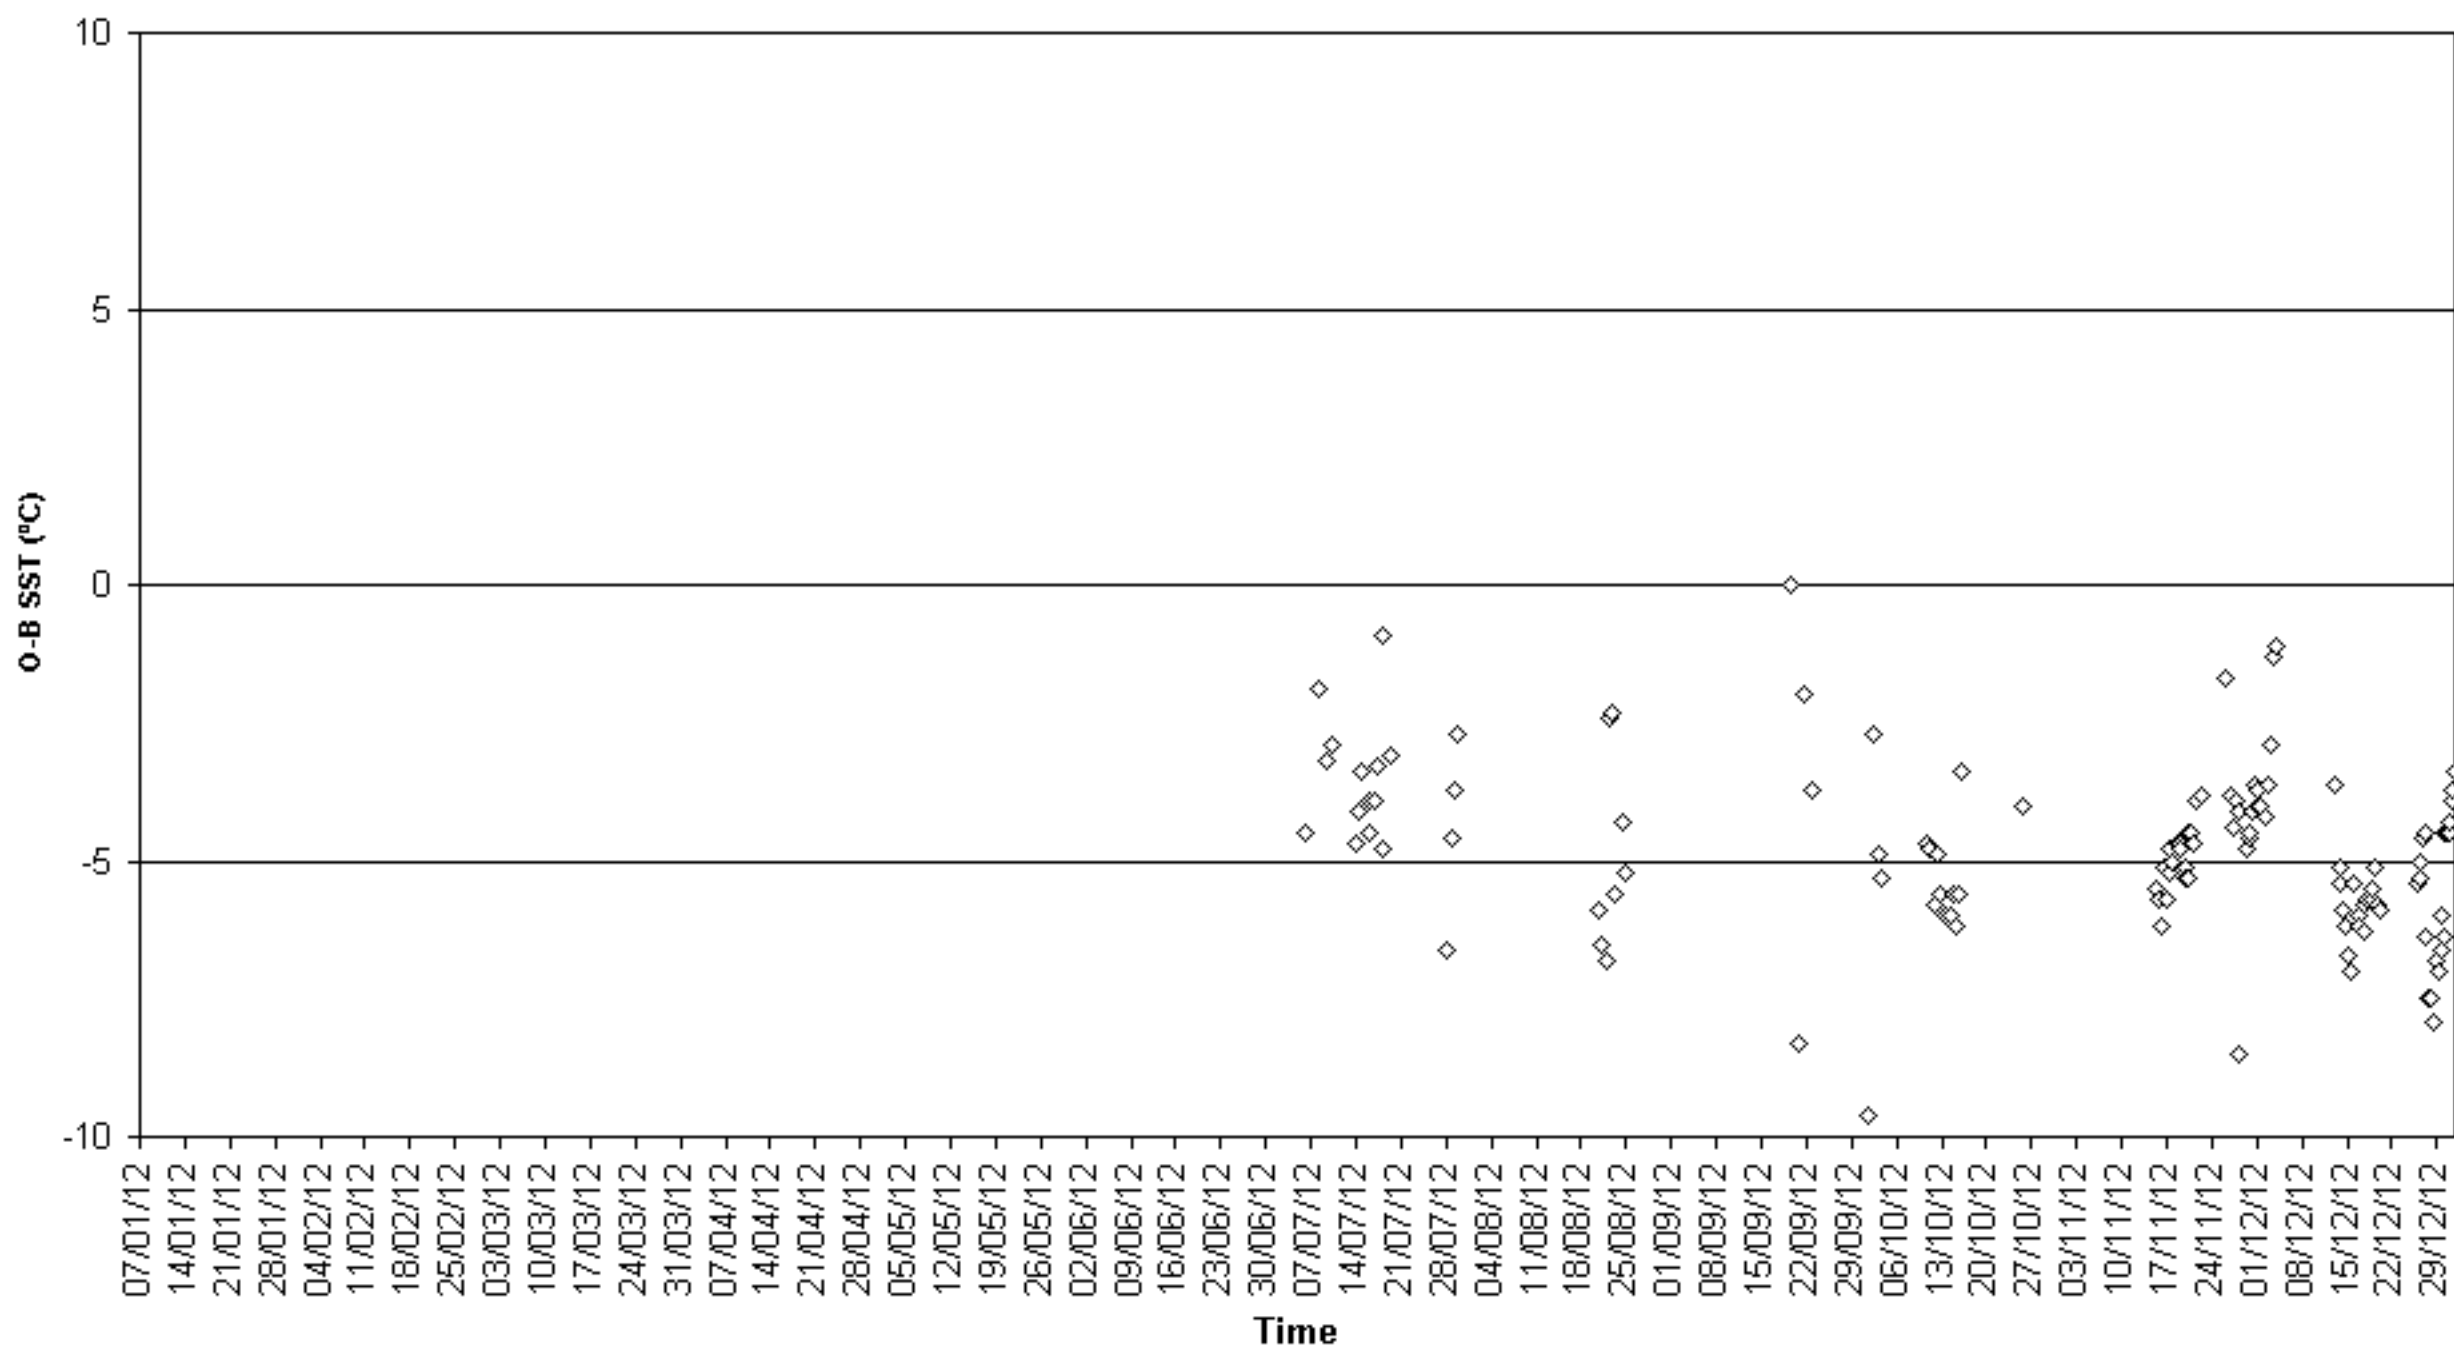


O-B SST (°C) for identifier UIAC
Number of obs. plotted = 73 Number of outliers = 0

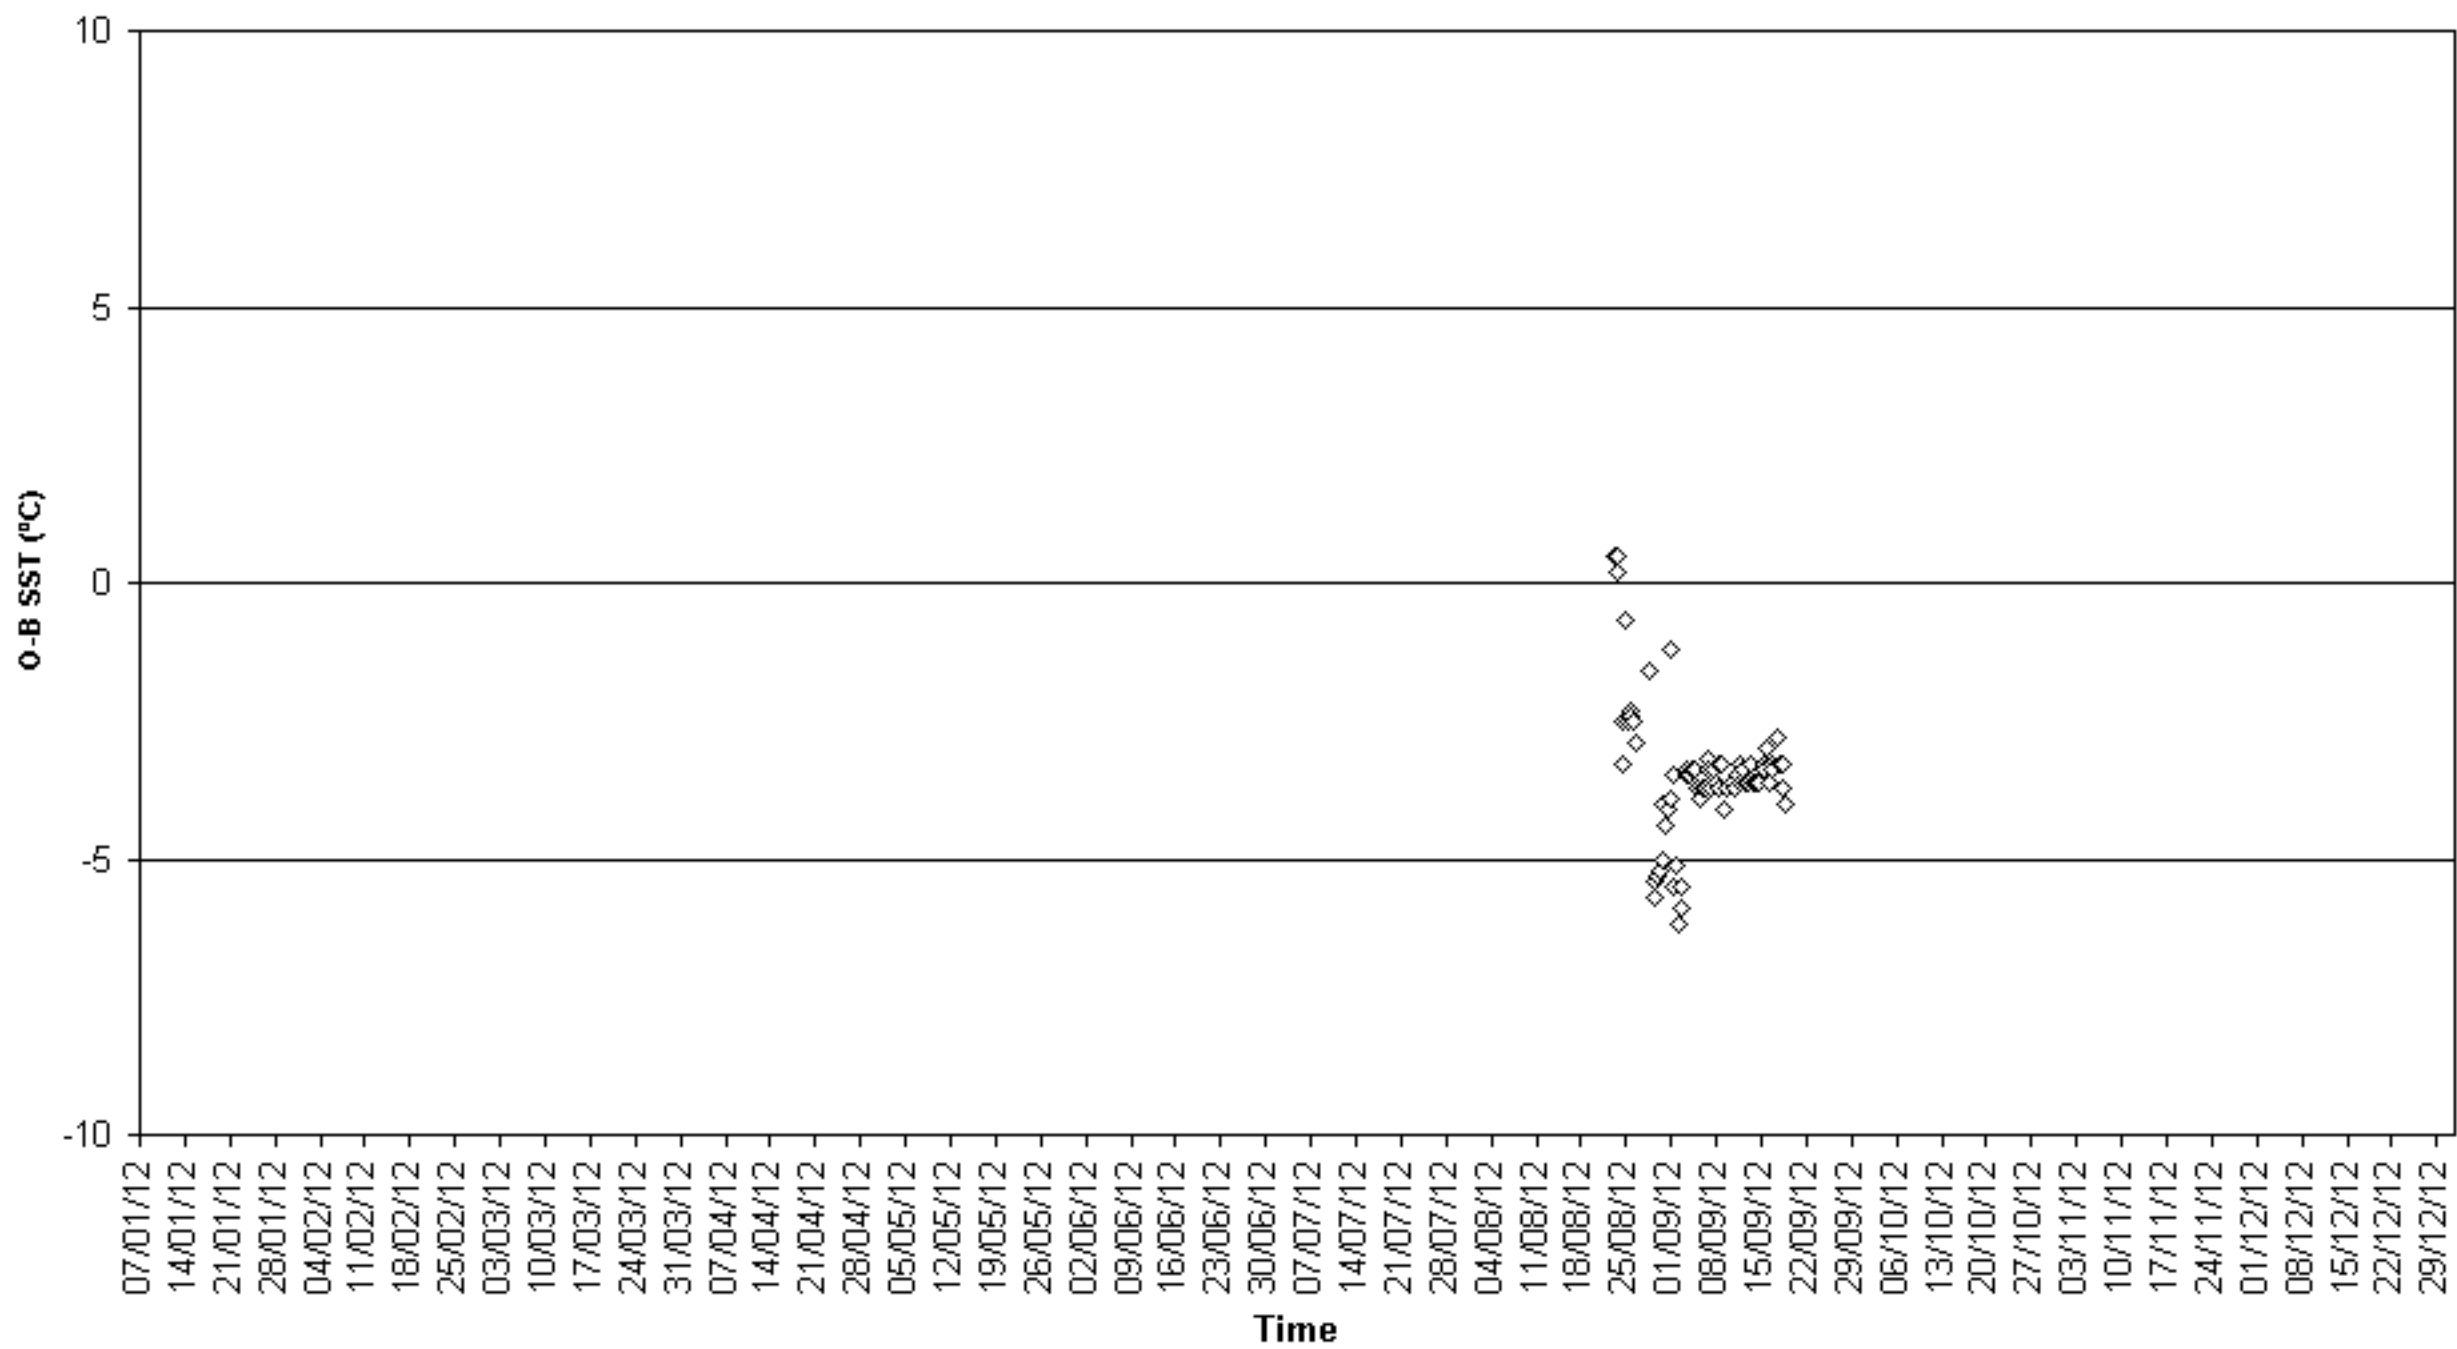


O-B SST (°C) for identifier V7QK3
Number of obs. plotted = 250 Number of outliers = 0

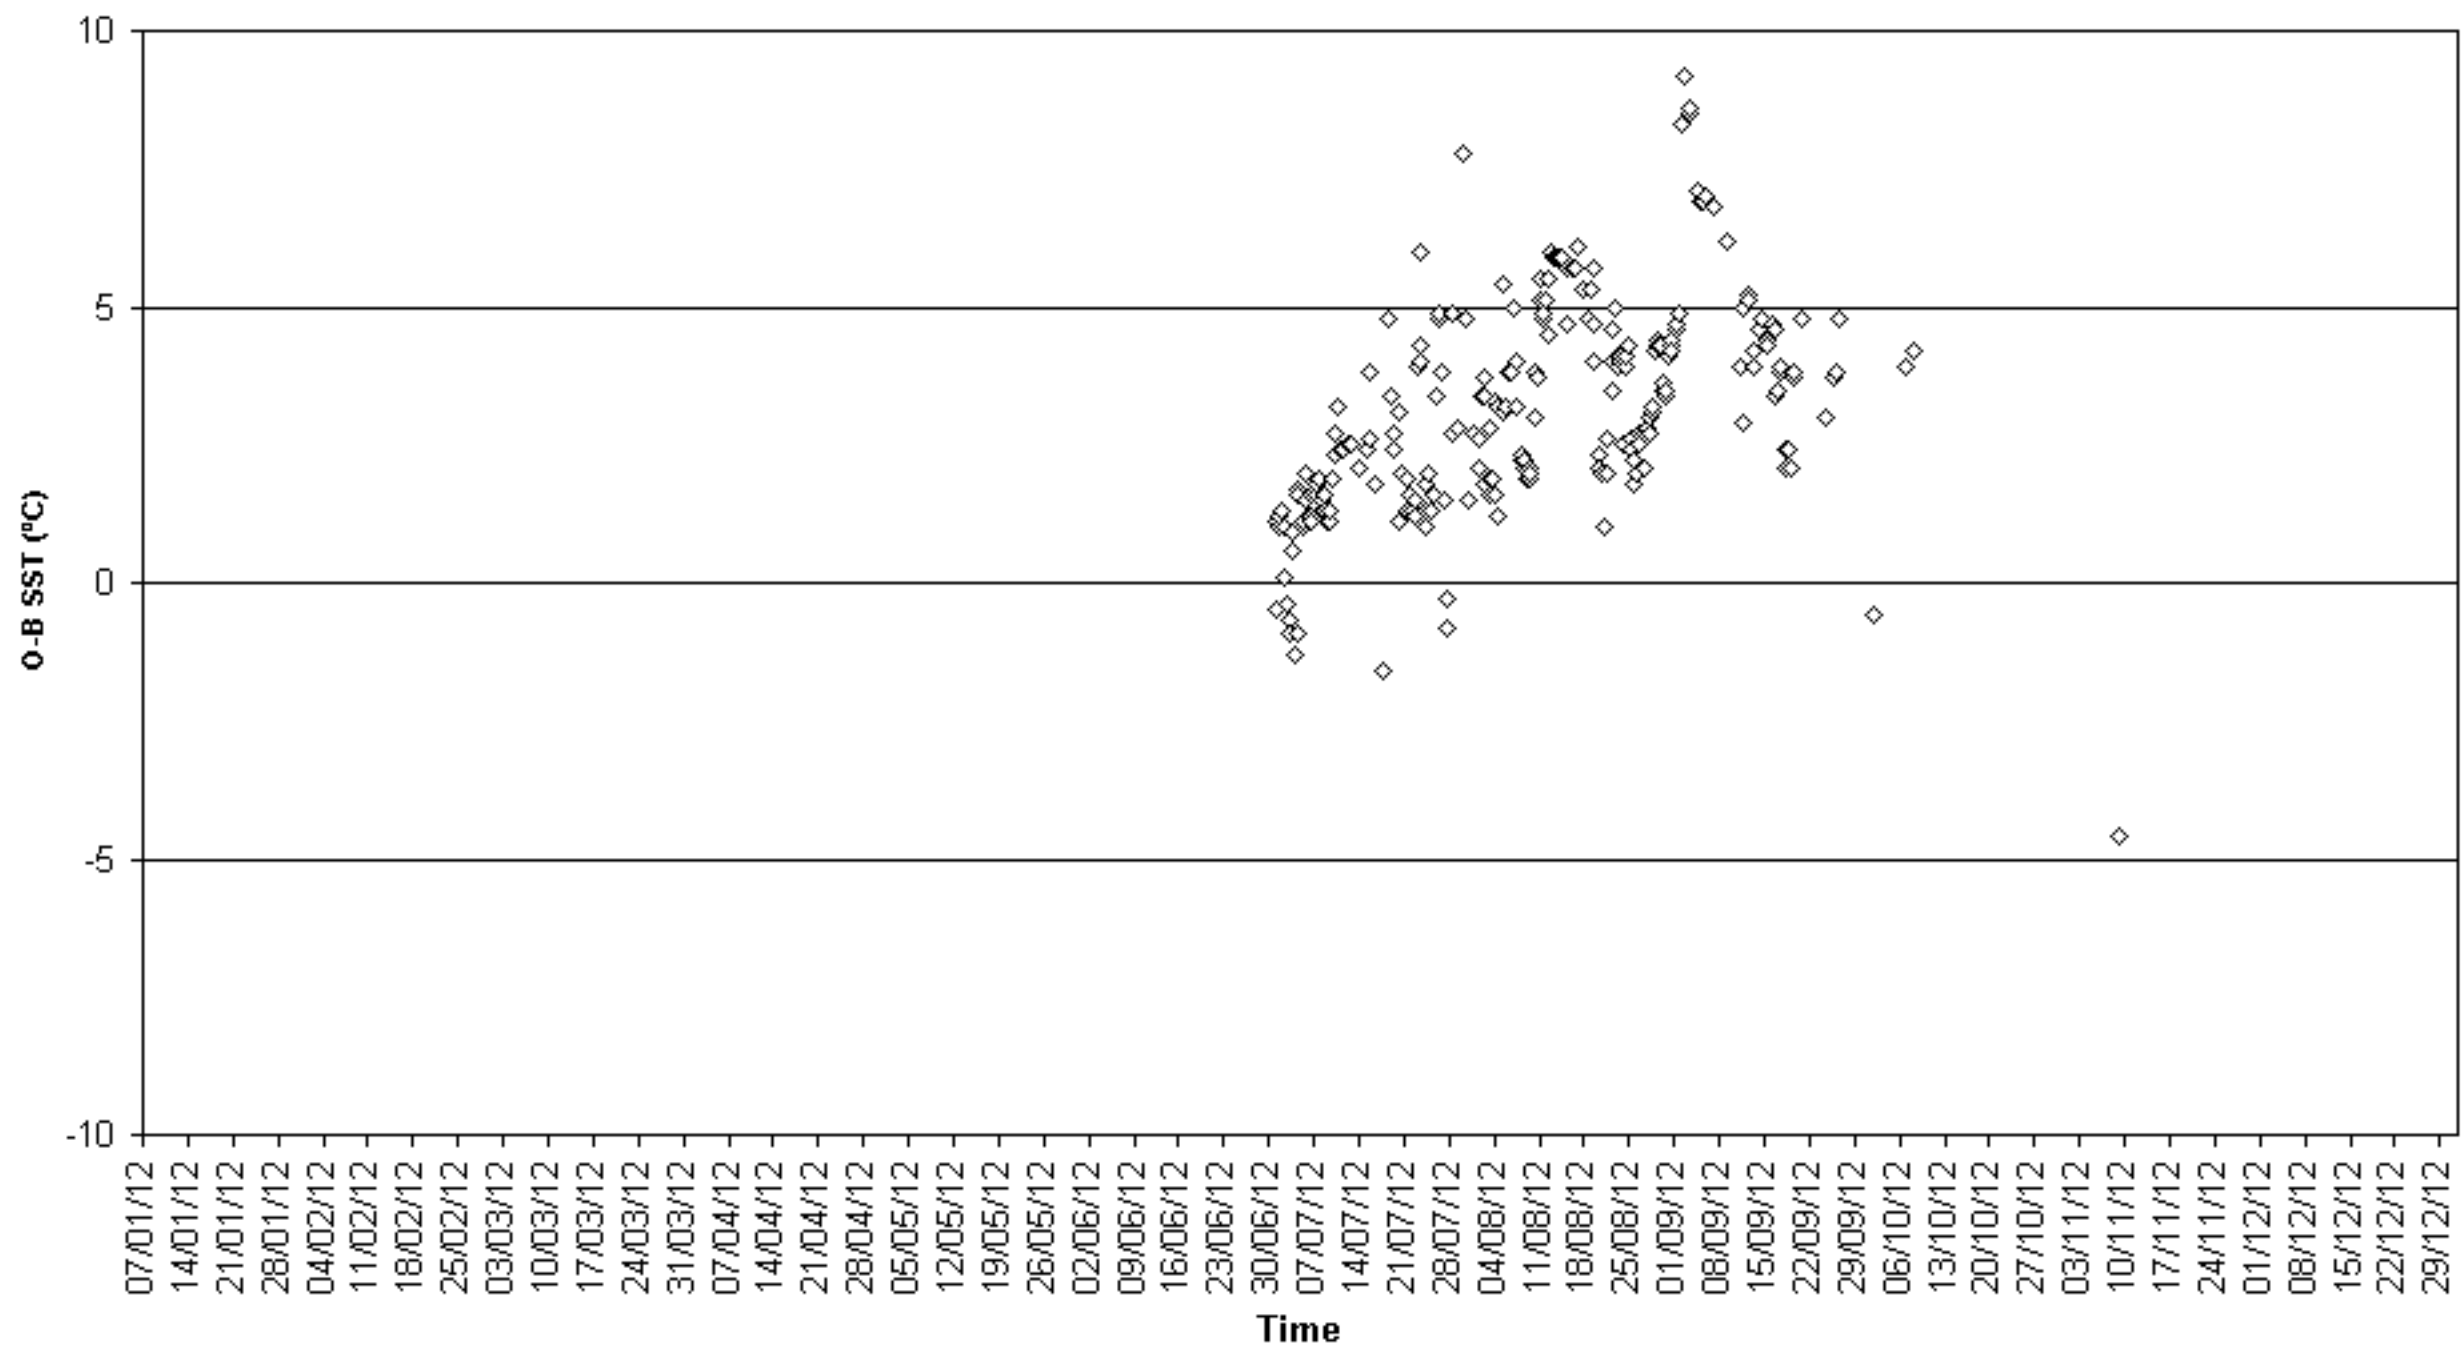


O-B SST (°C) for identifier V7SY6
Number of obs. plotted = 138 Number of outliers = 5

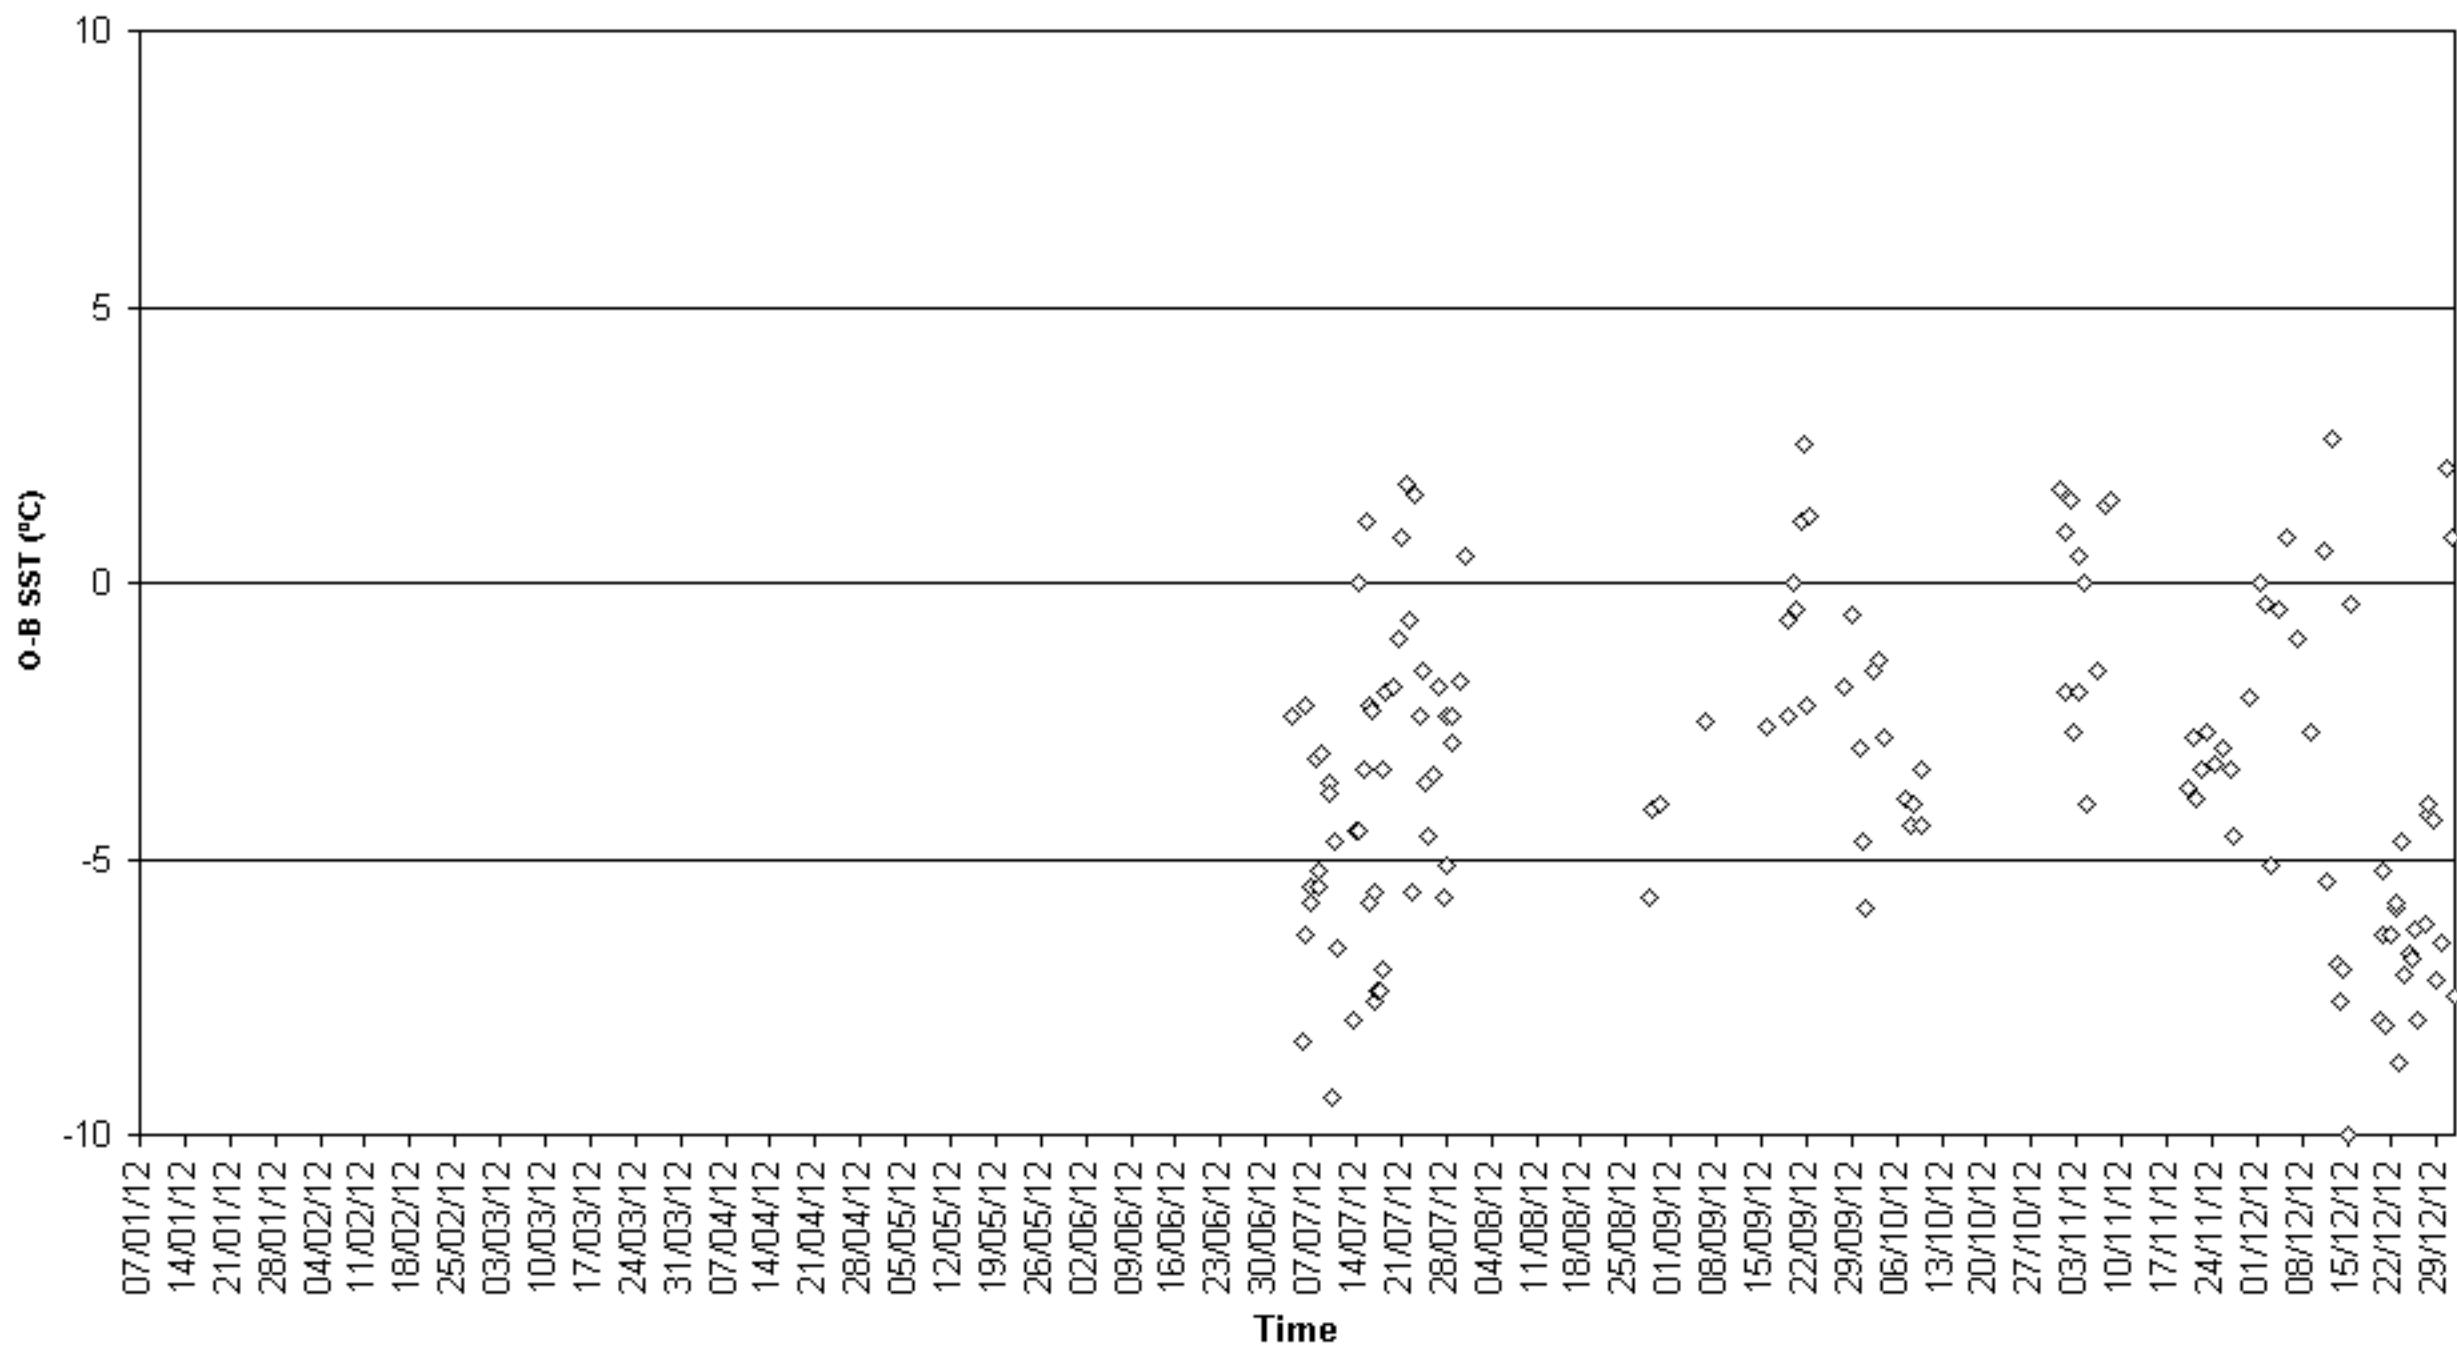


O-B SST (°C) for identifier V7VQ3
Number of obs. plotted = 72 Number of outliers = 0

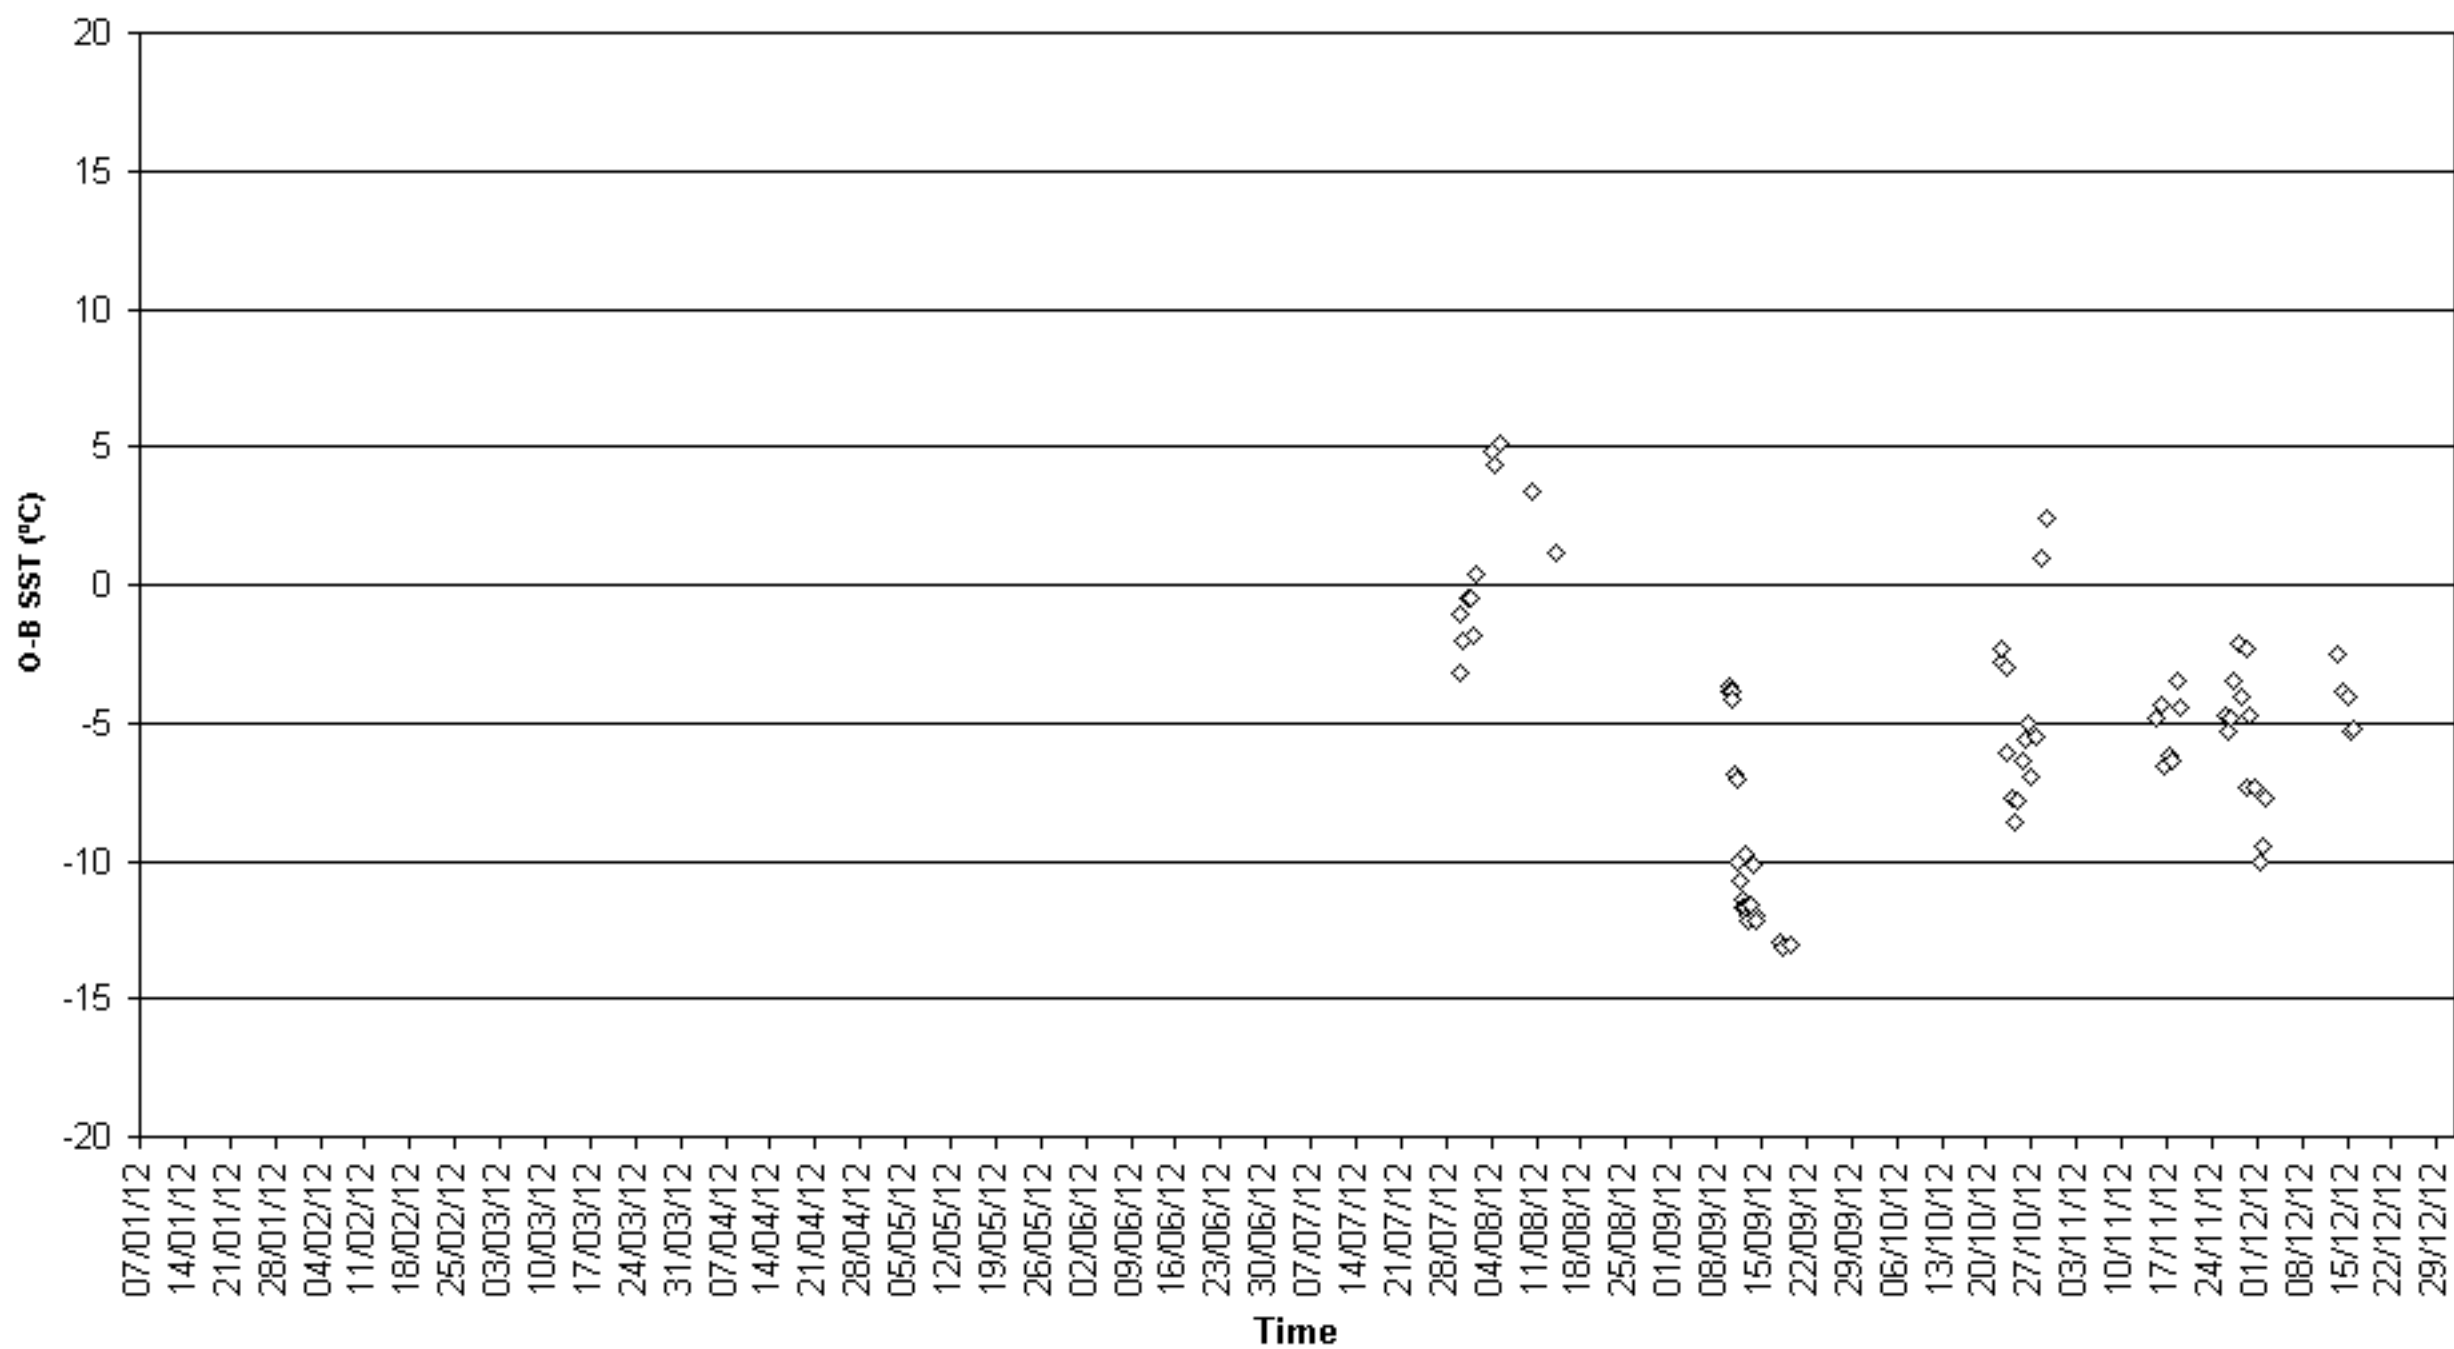


O-B SST (°C) for identifier VQKZ6
Number of obs. plotted = 120 Number of outliers = 0

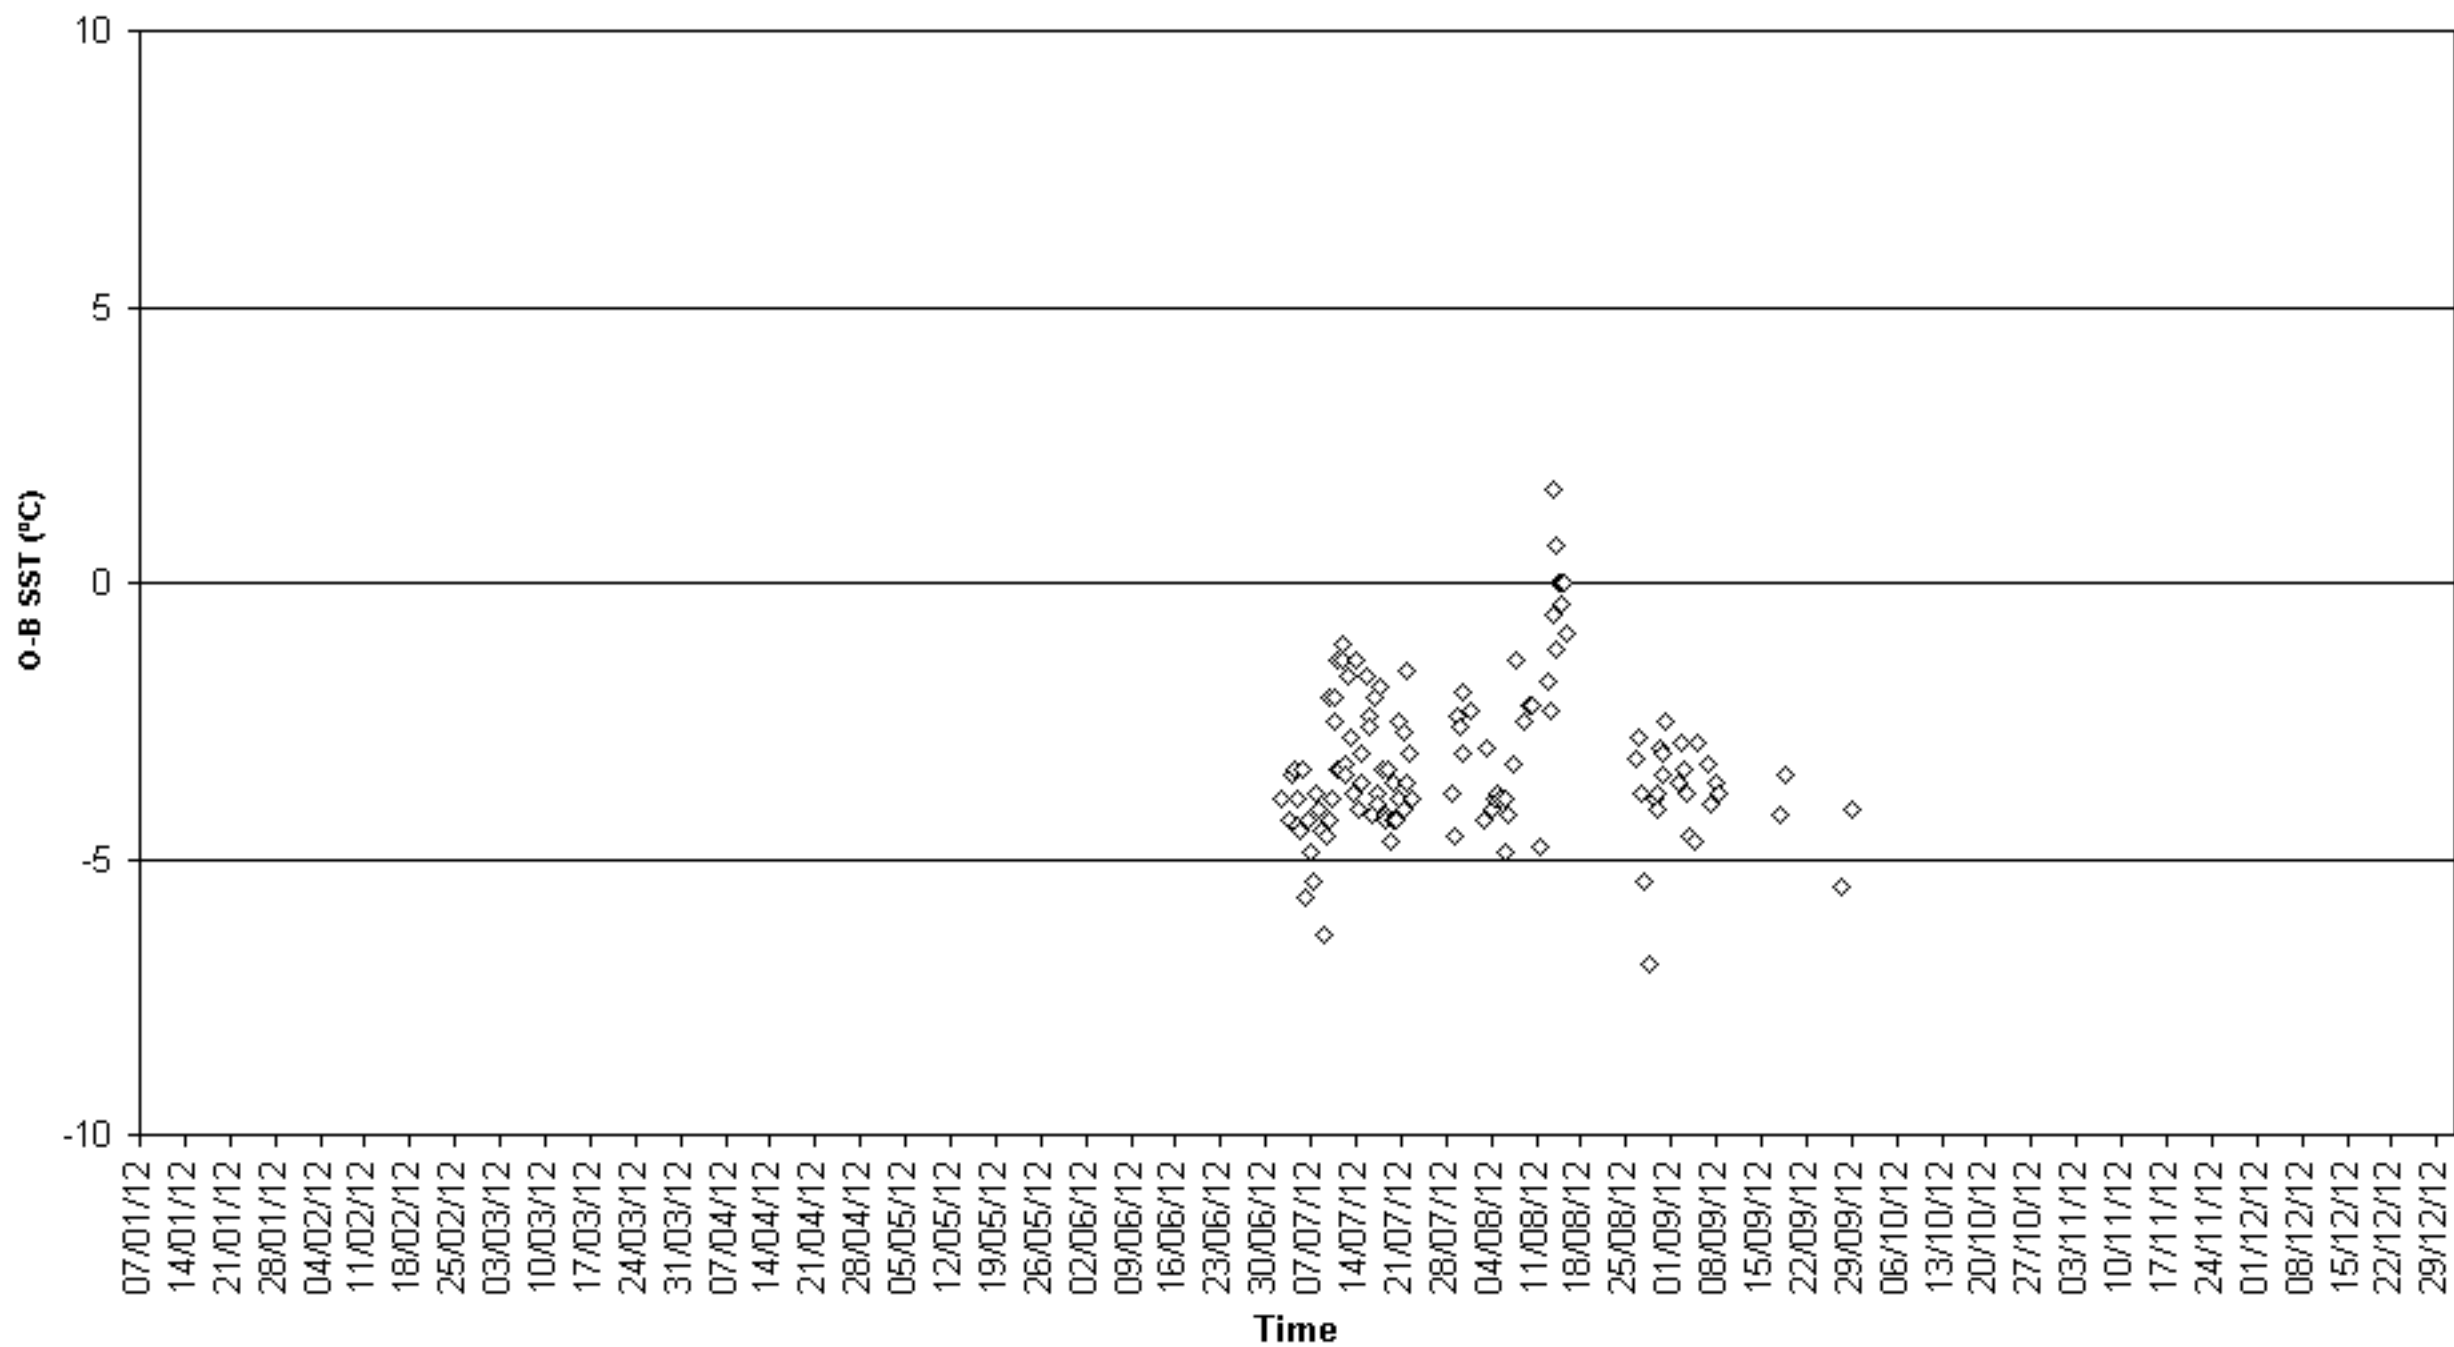


O-B SST (°C) for identifier VRDT5
Number of obs. plotted = 82 Number of outliers = 0

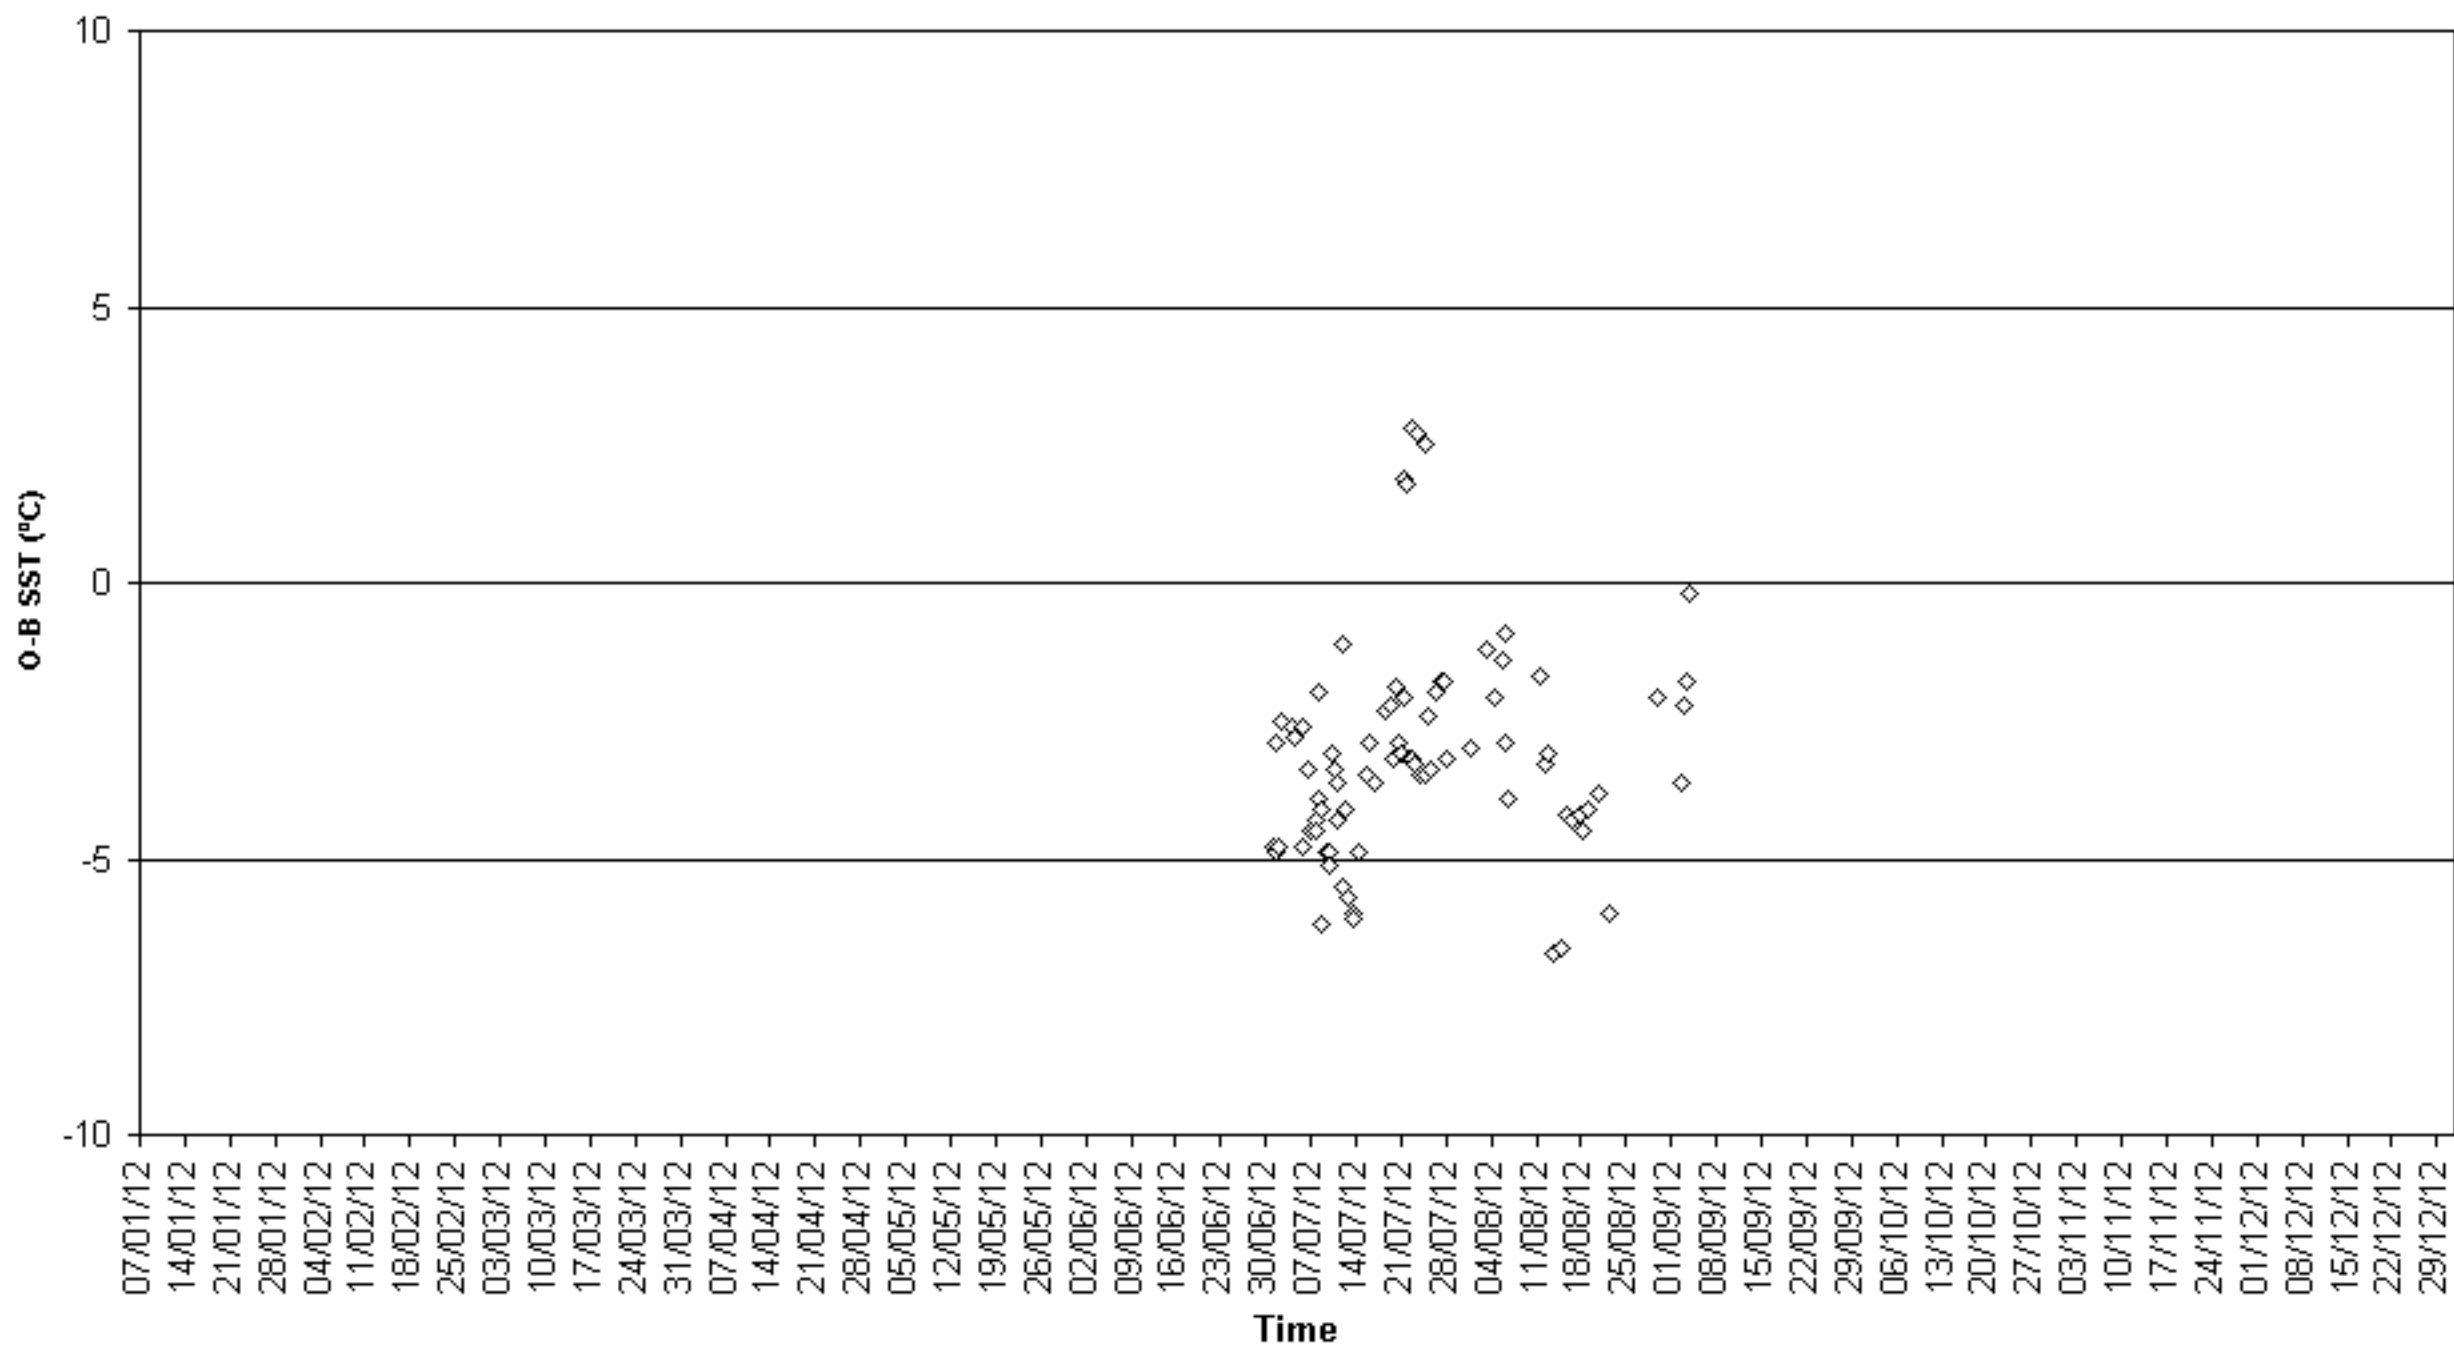


O-B SST (°C) for identifier VRKJ7
Number of obs. plotted = 274 Number of outliers = 1

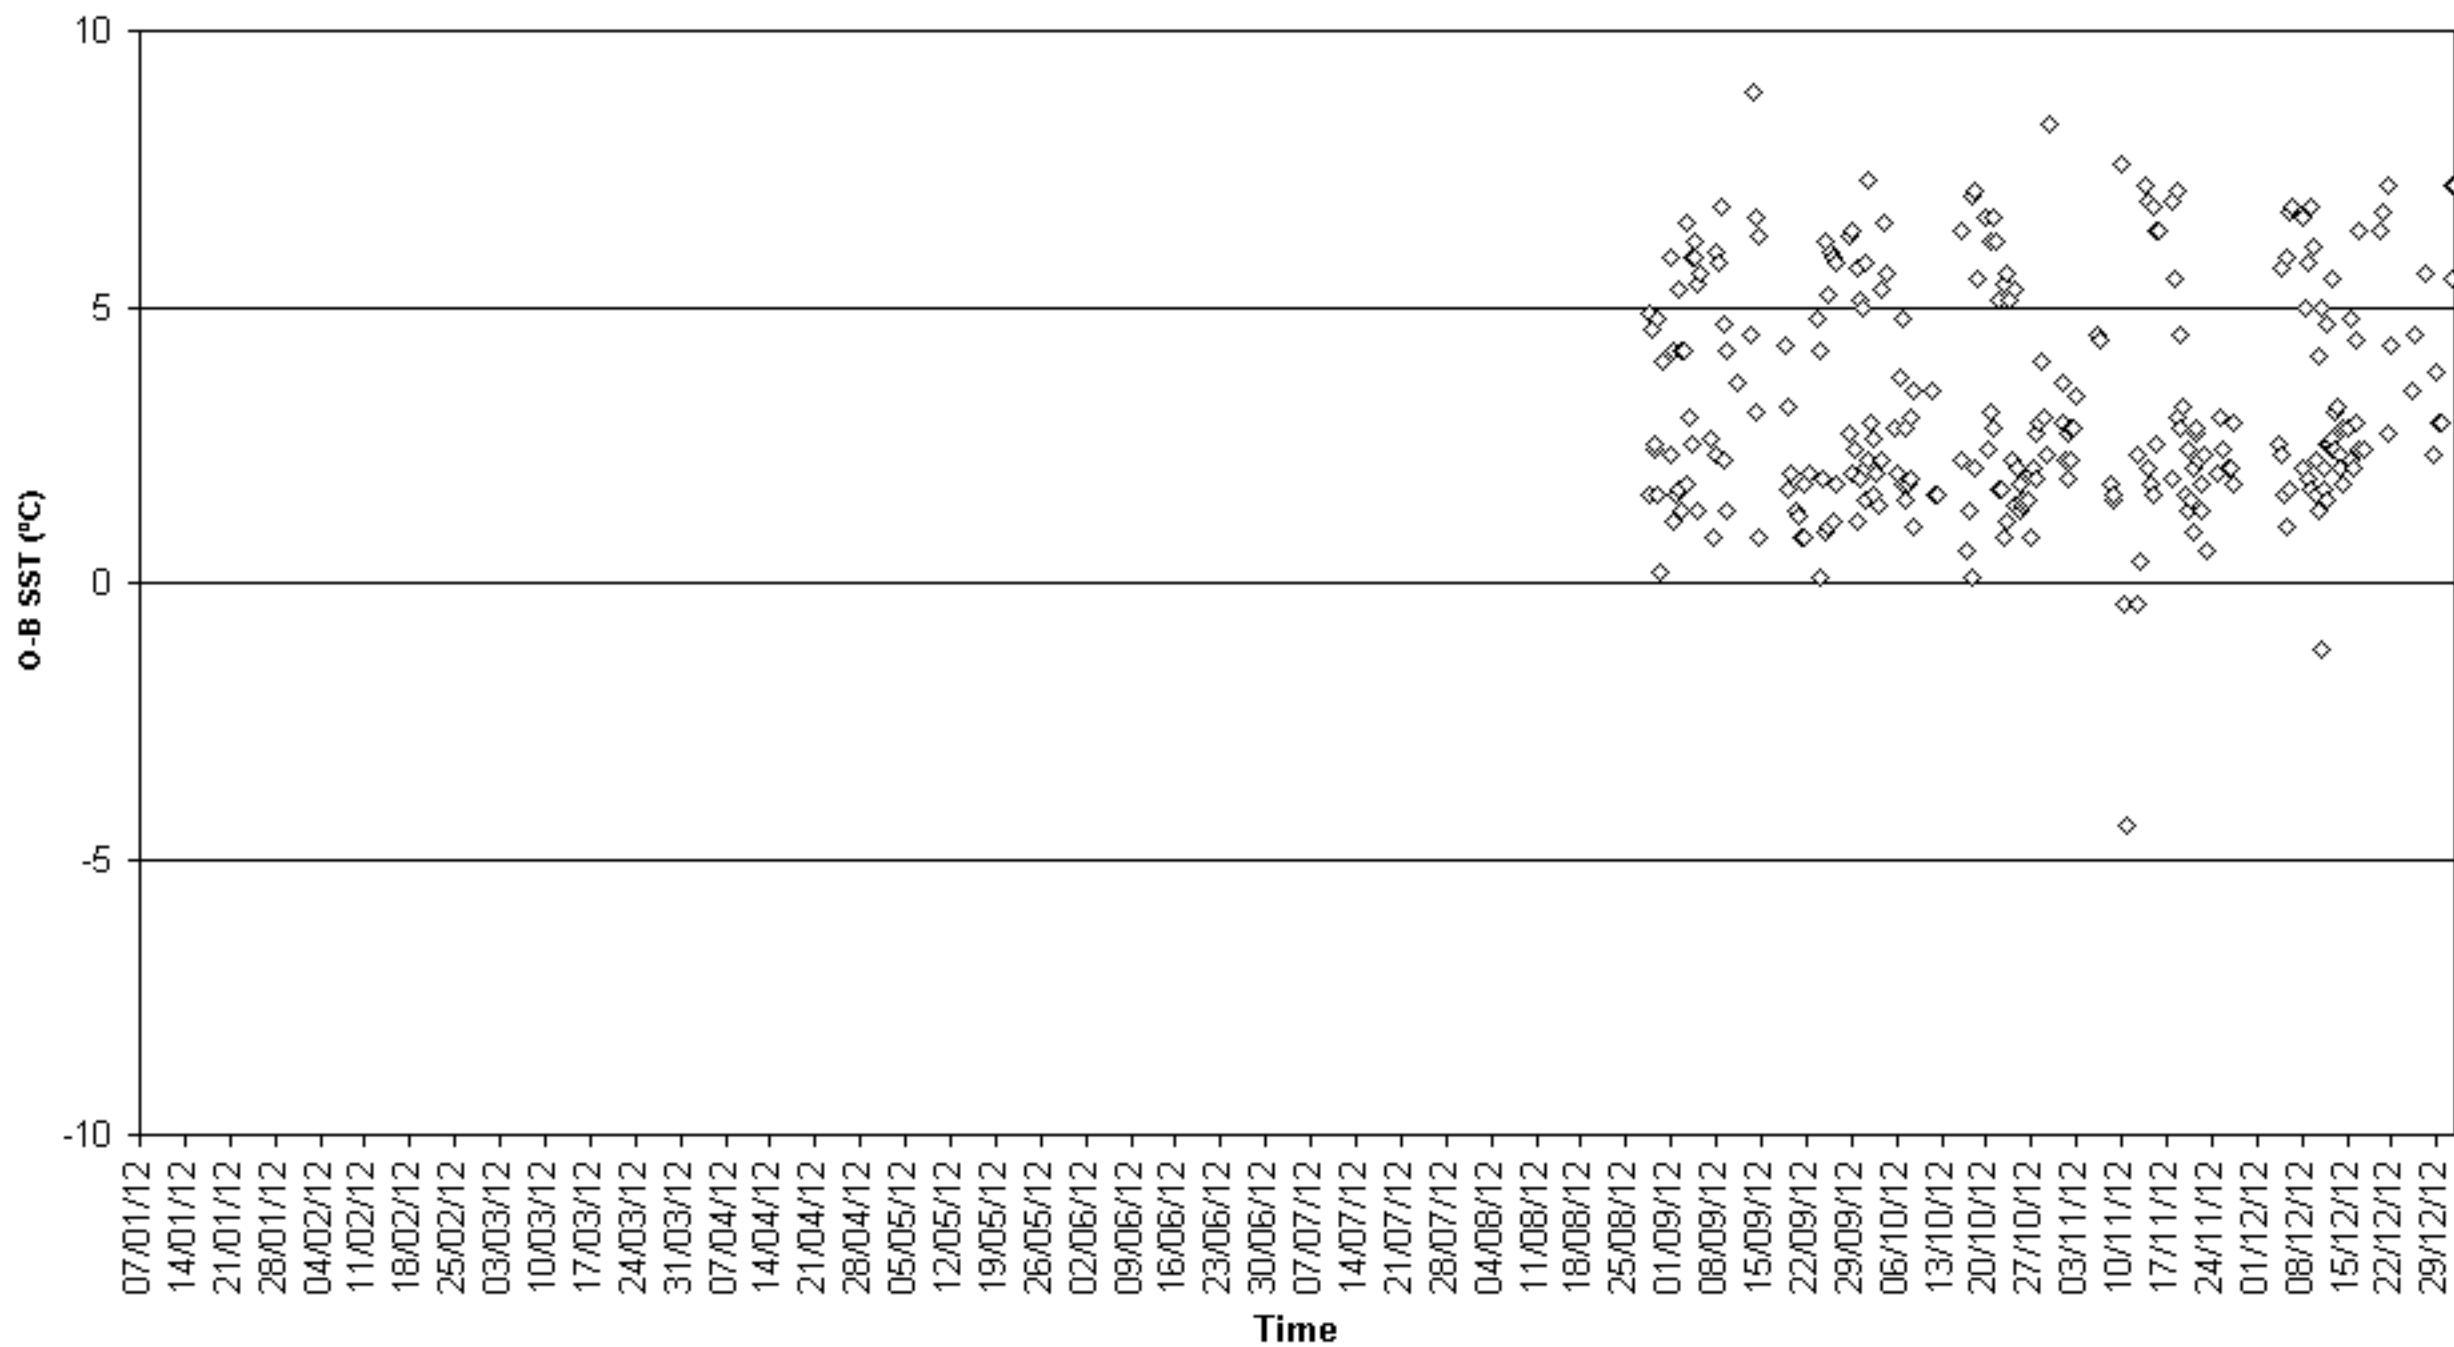


O-B SST (°C) for identifier VRKX8
Number of obs. plotted = 119 Number of outliers = 0

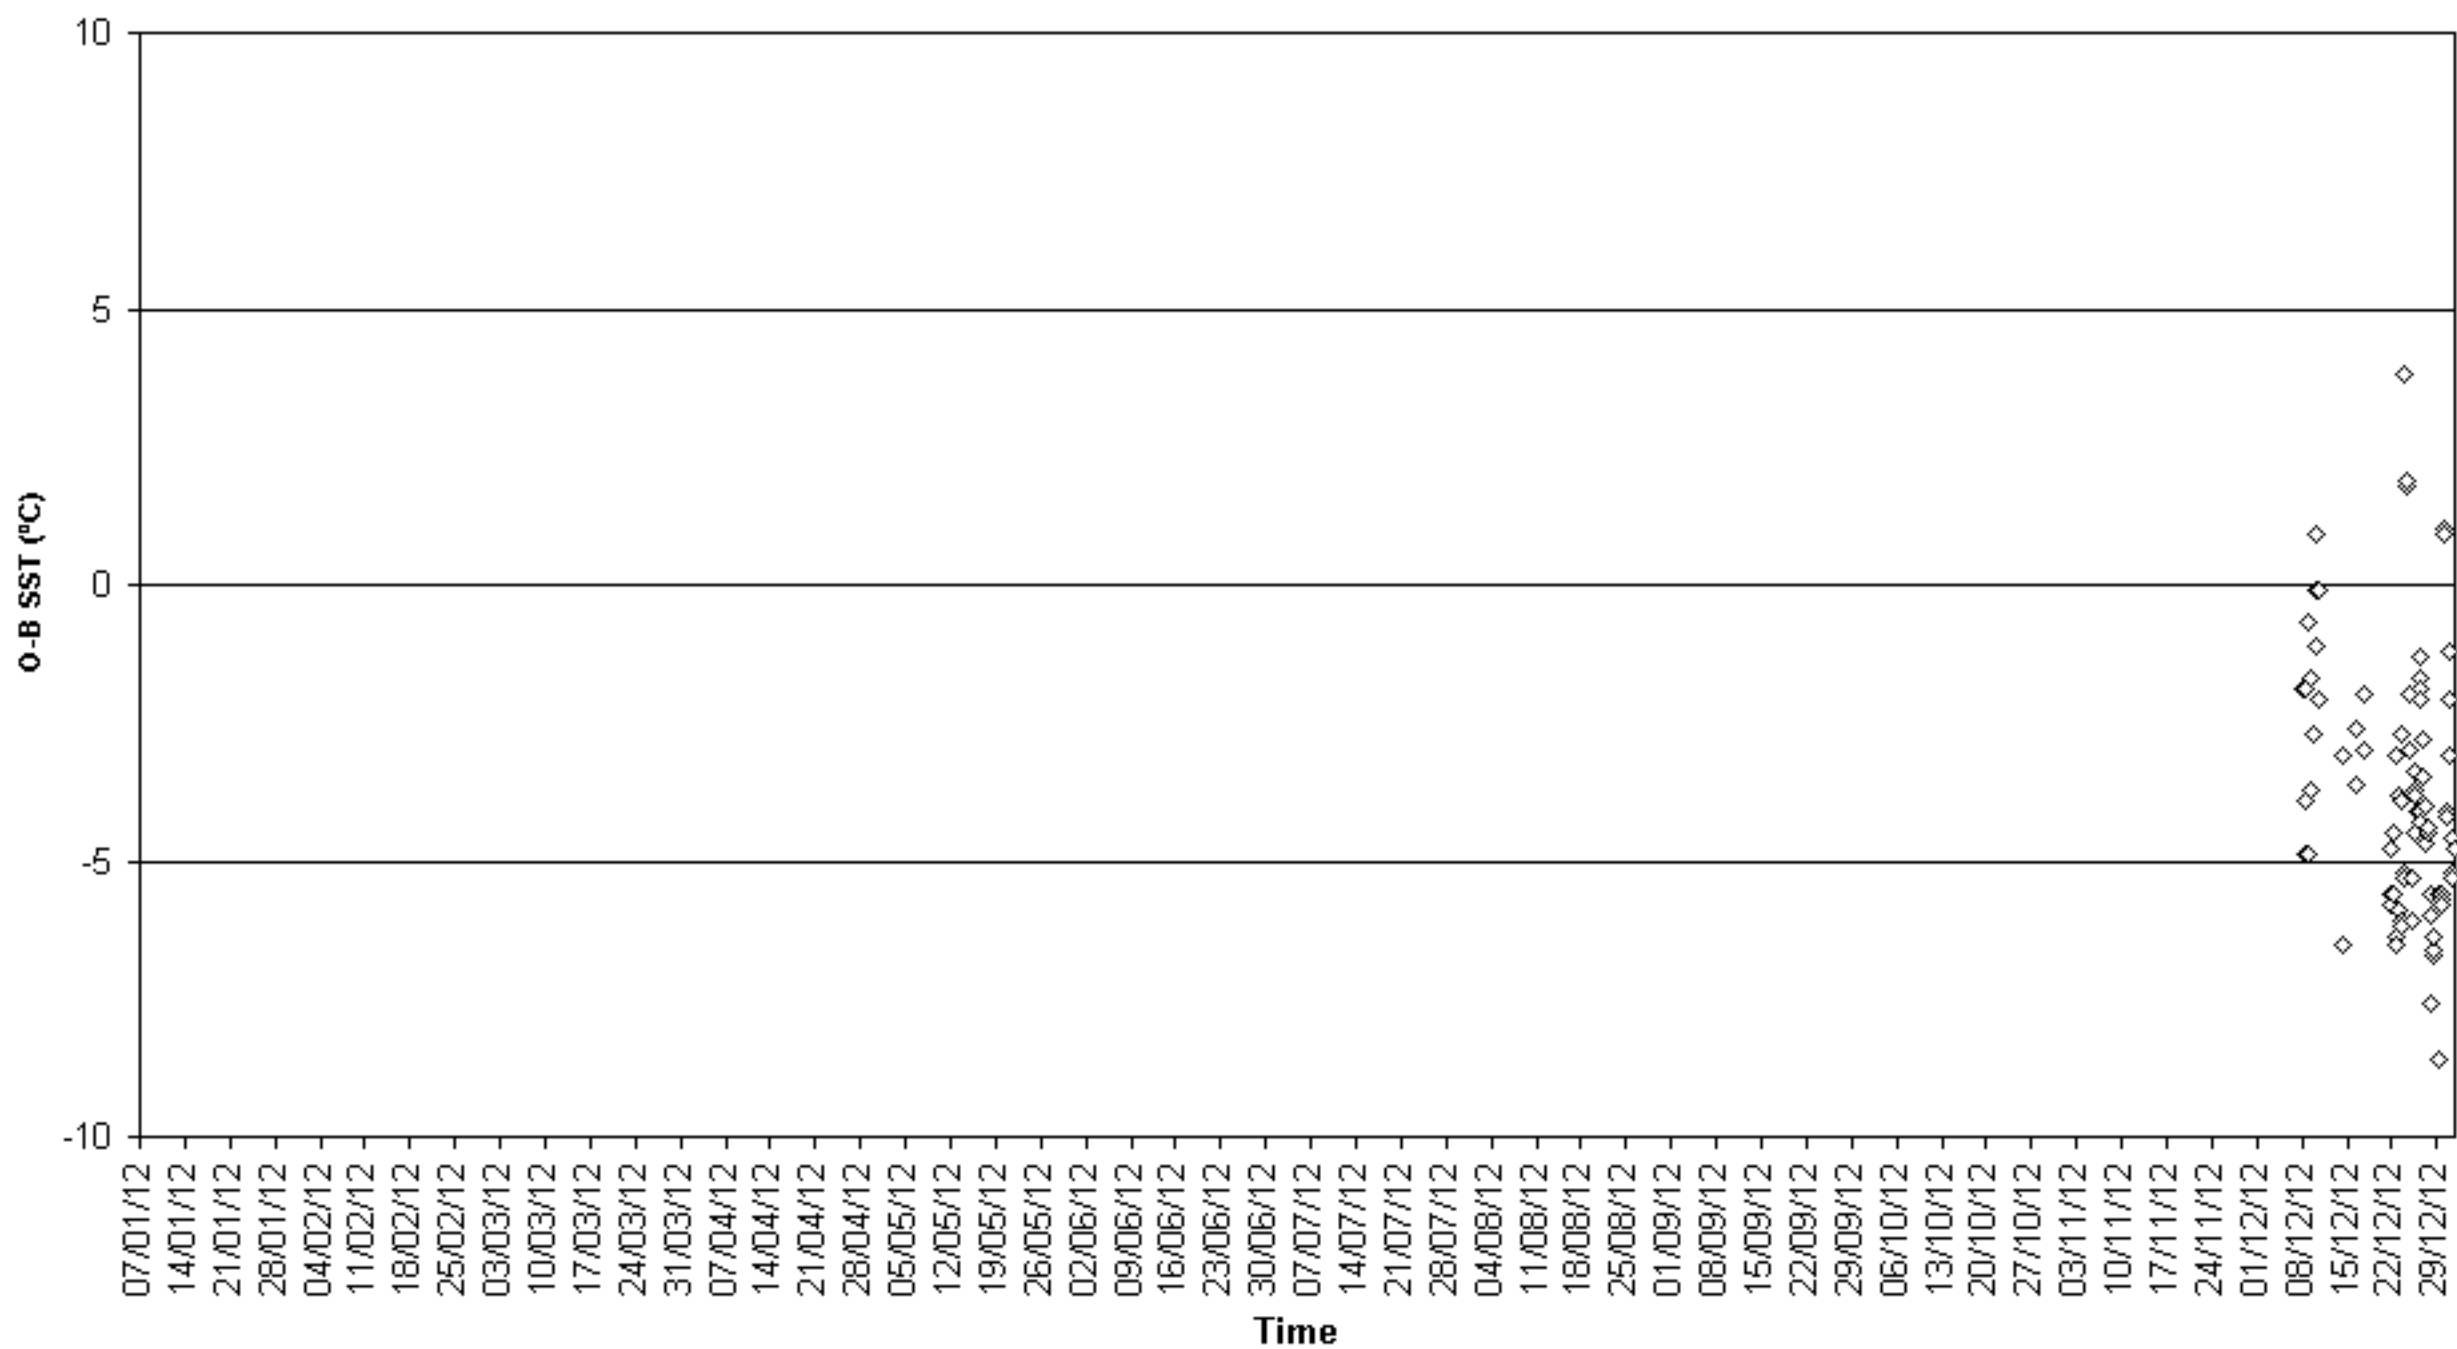


O-B SST (°C) for identifier WDC6923
Number of obs. plotted = 128 Number of outliers = 7

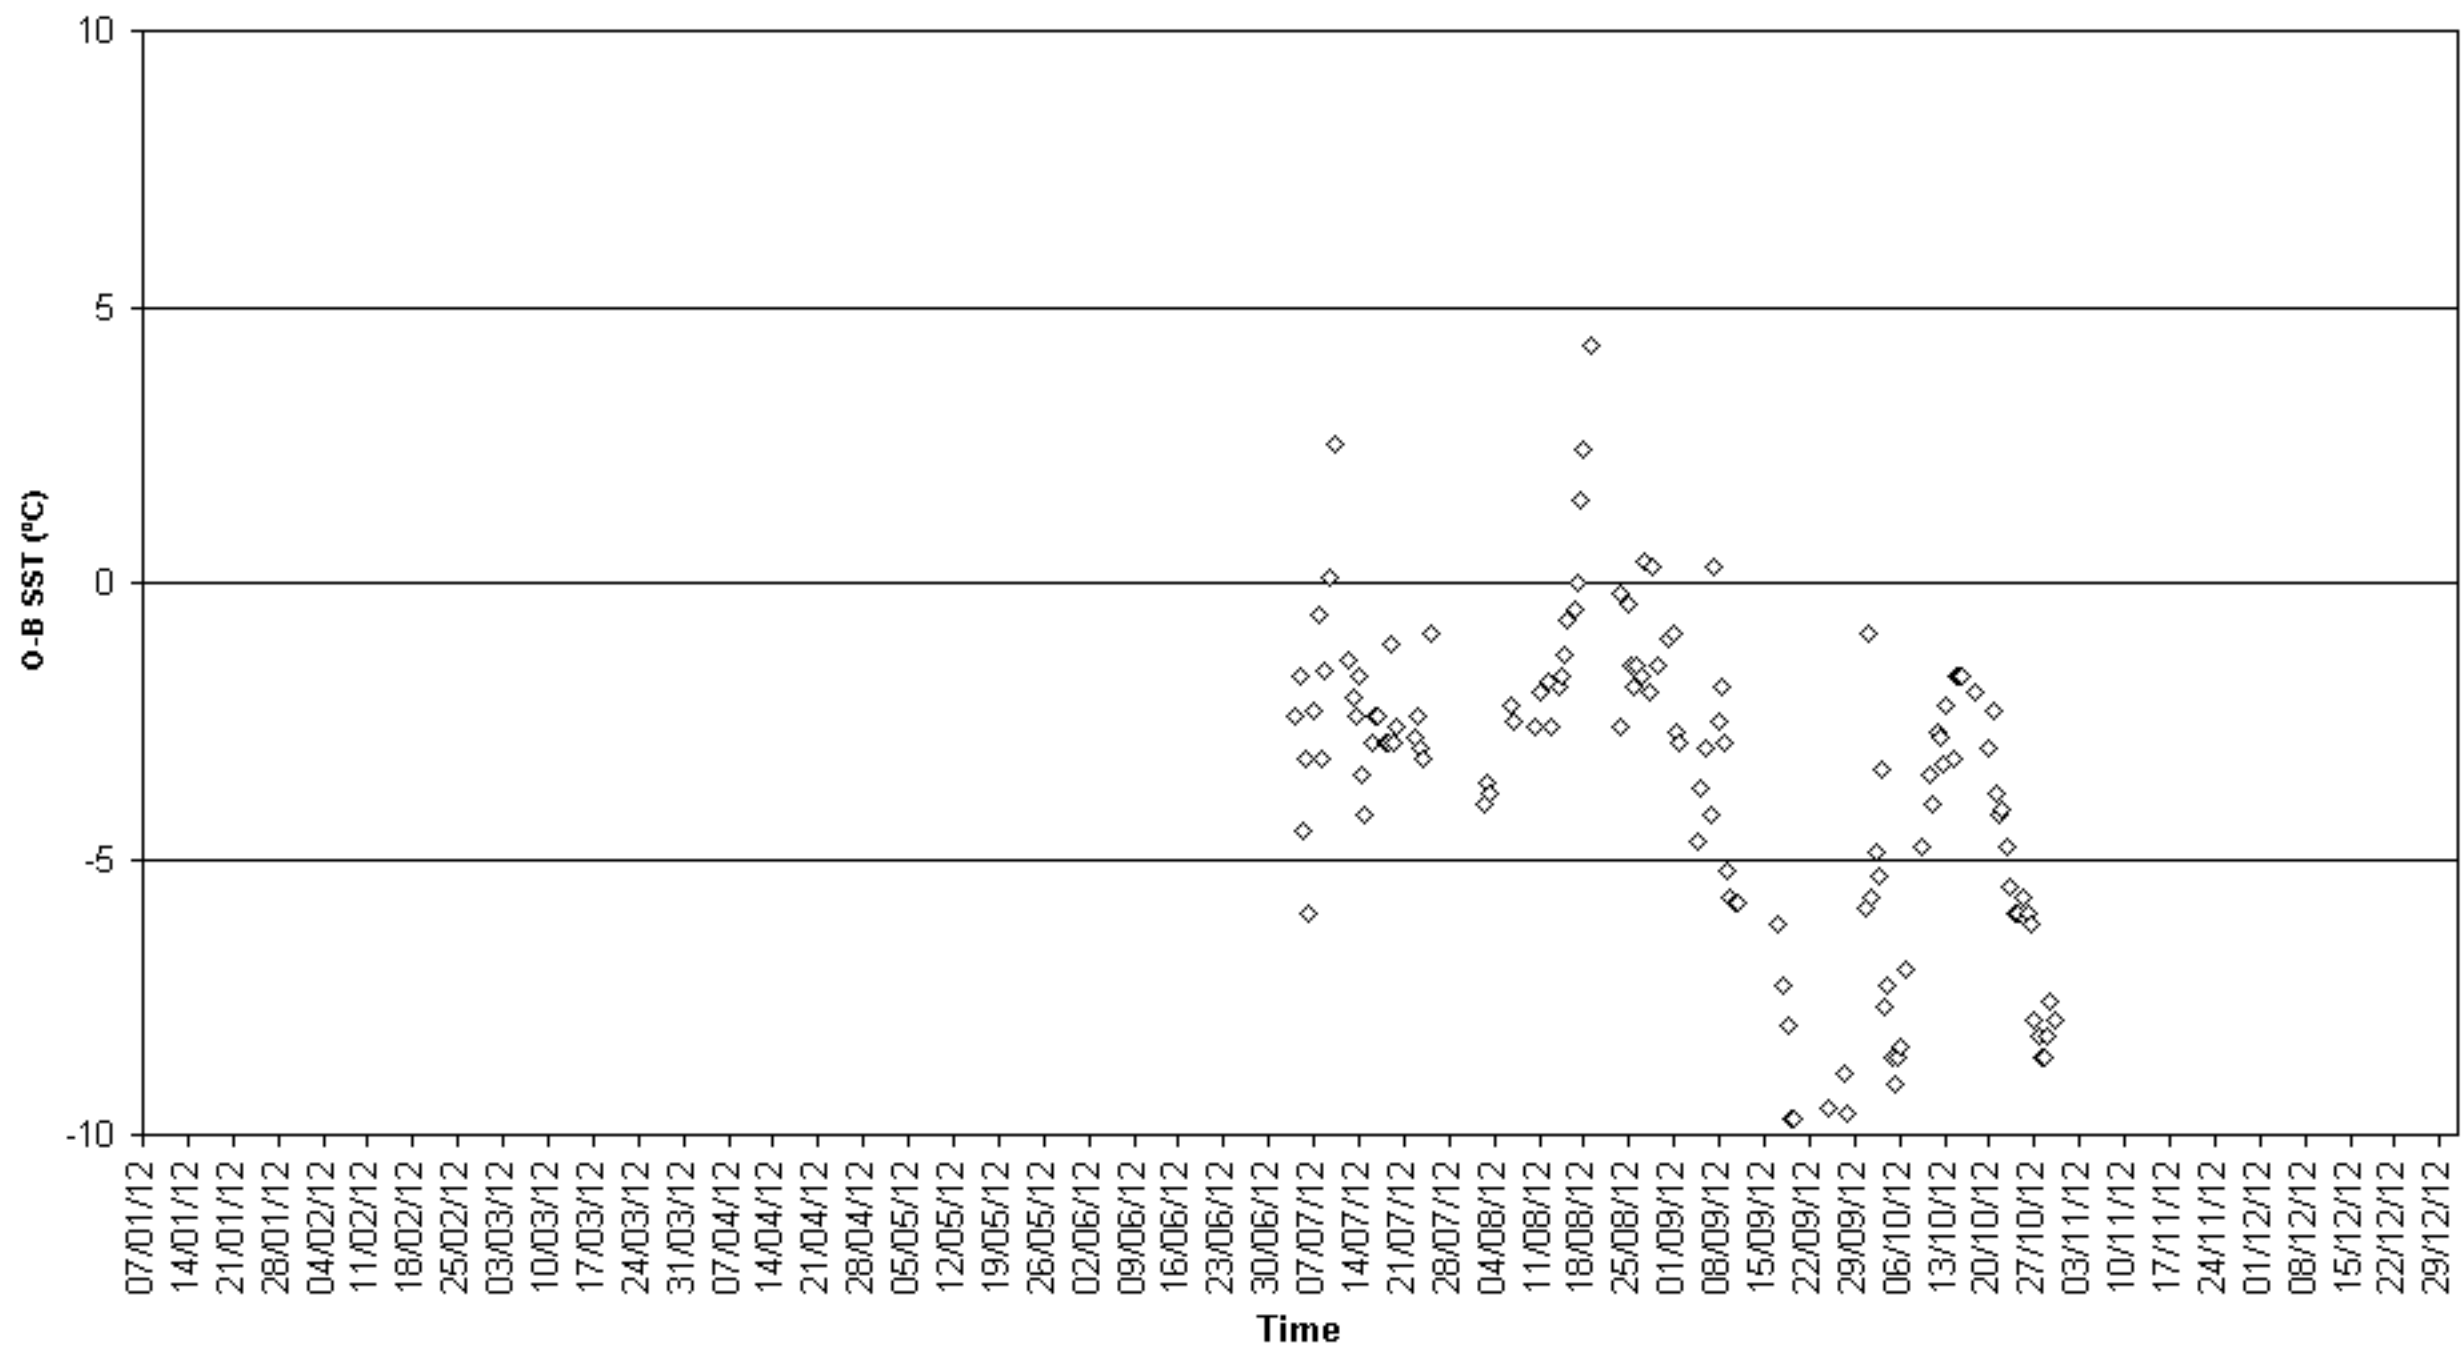


O-B SST (°C) for identifier WDE9193
Number of obs. plotted = 38 Number of outliers = 29

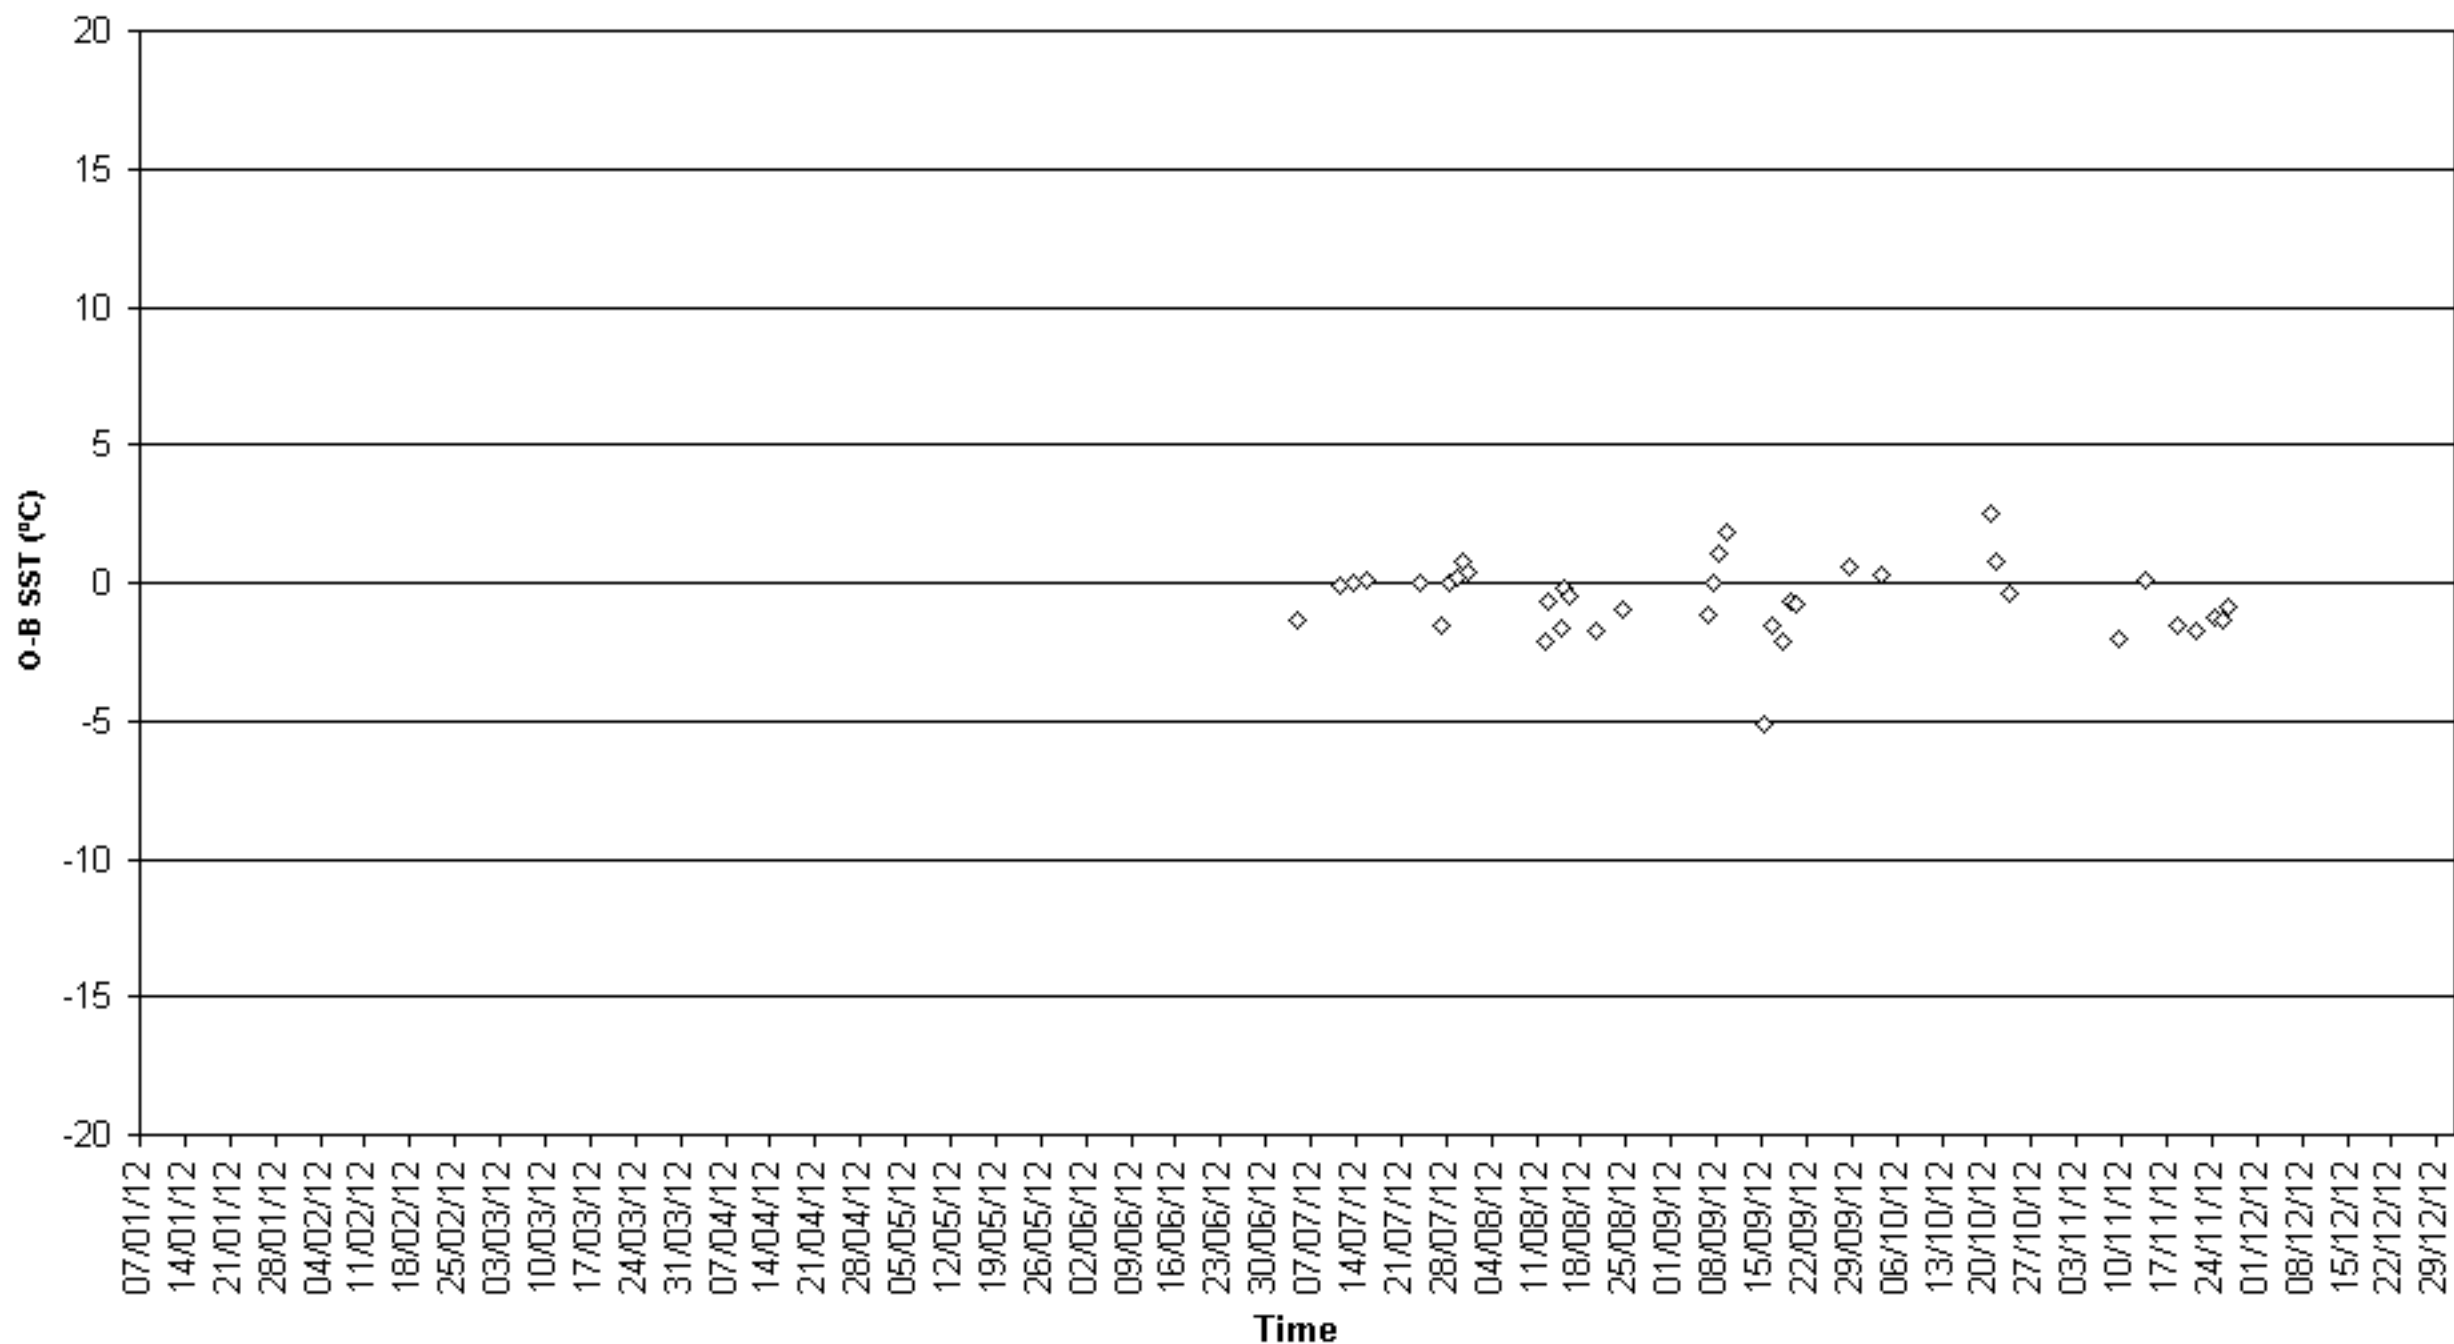


O-B SST (°C) for identifier WE4879
Number of obs. plotted = 47 Number of outliers = 1

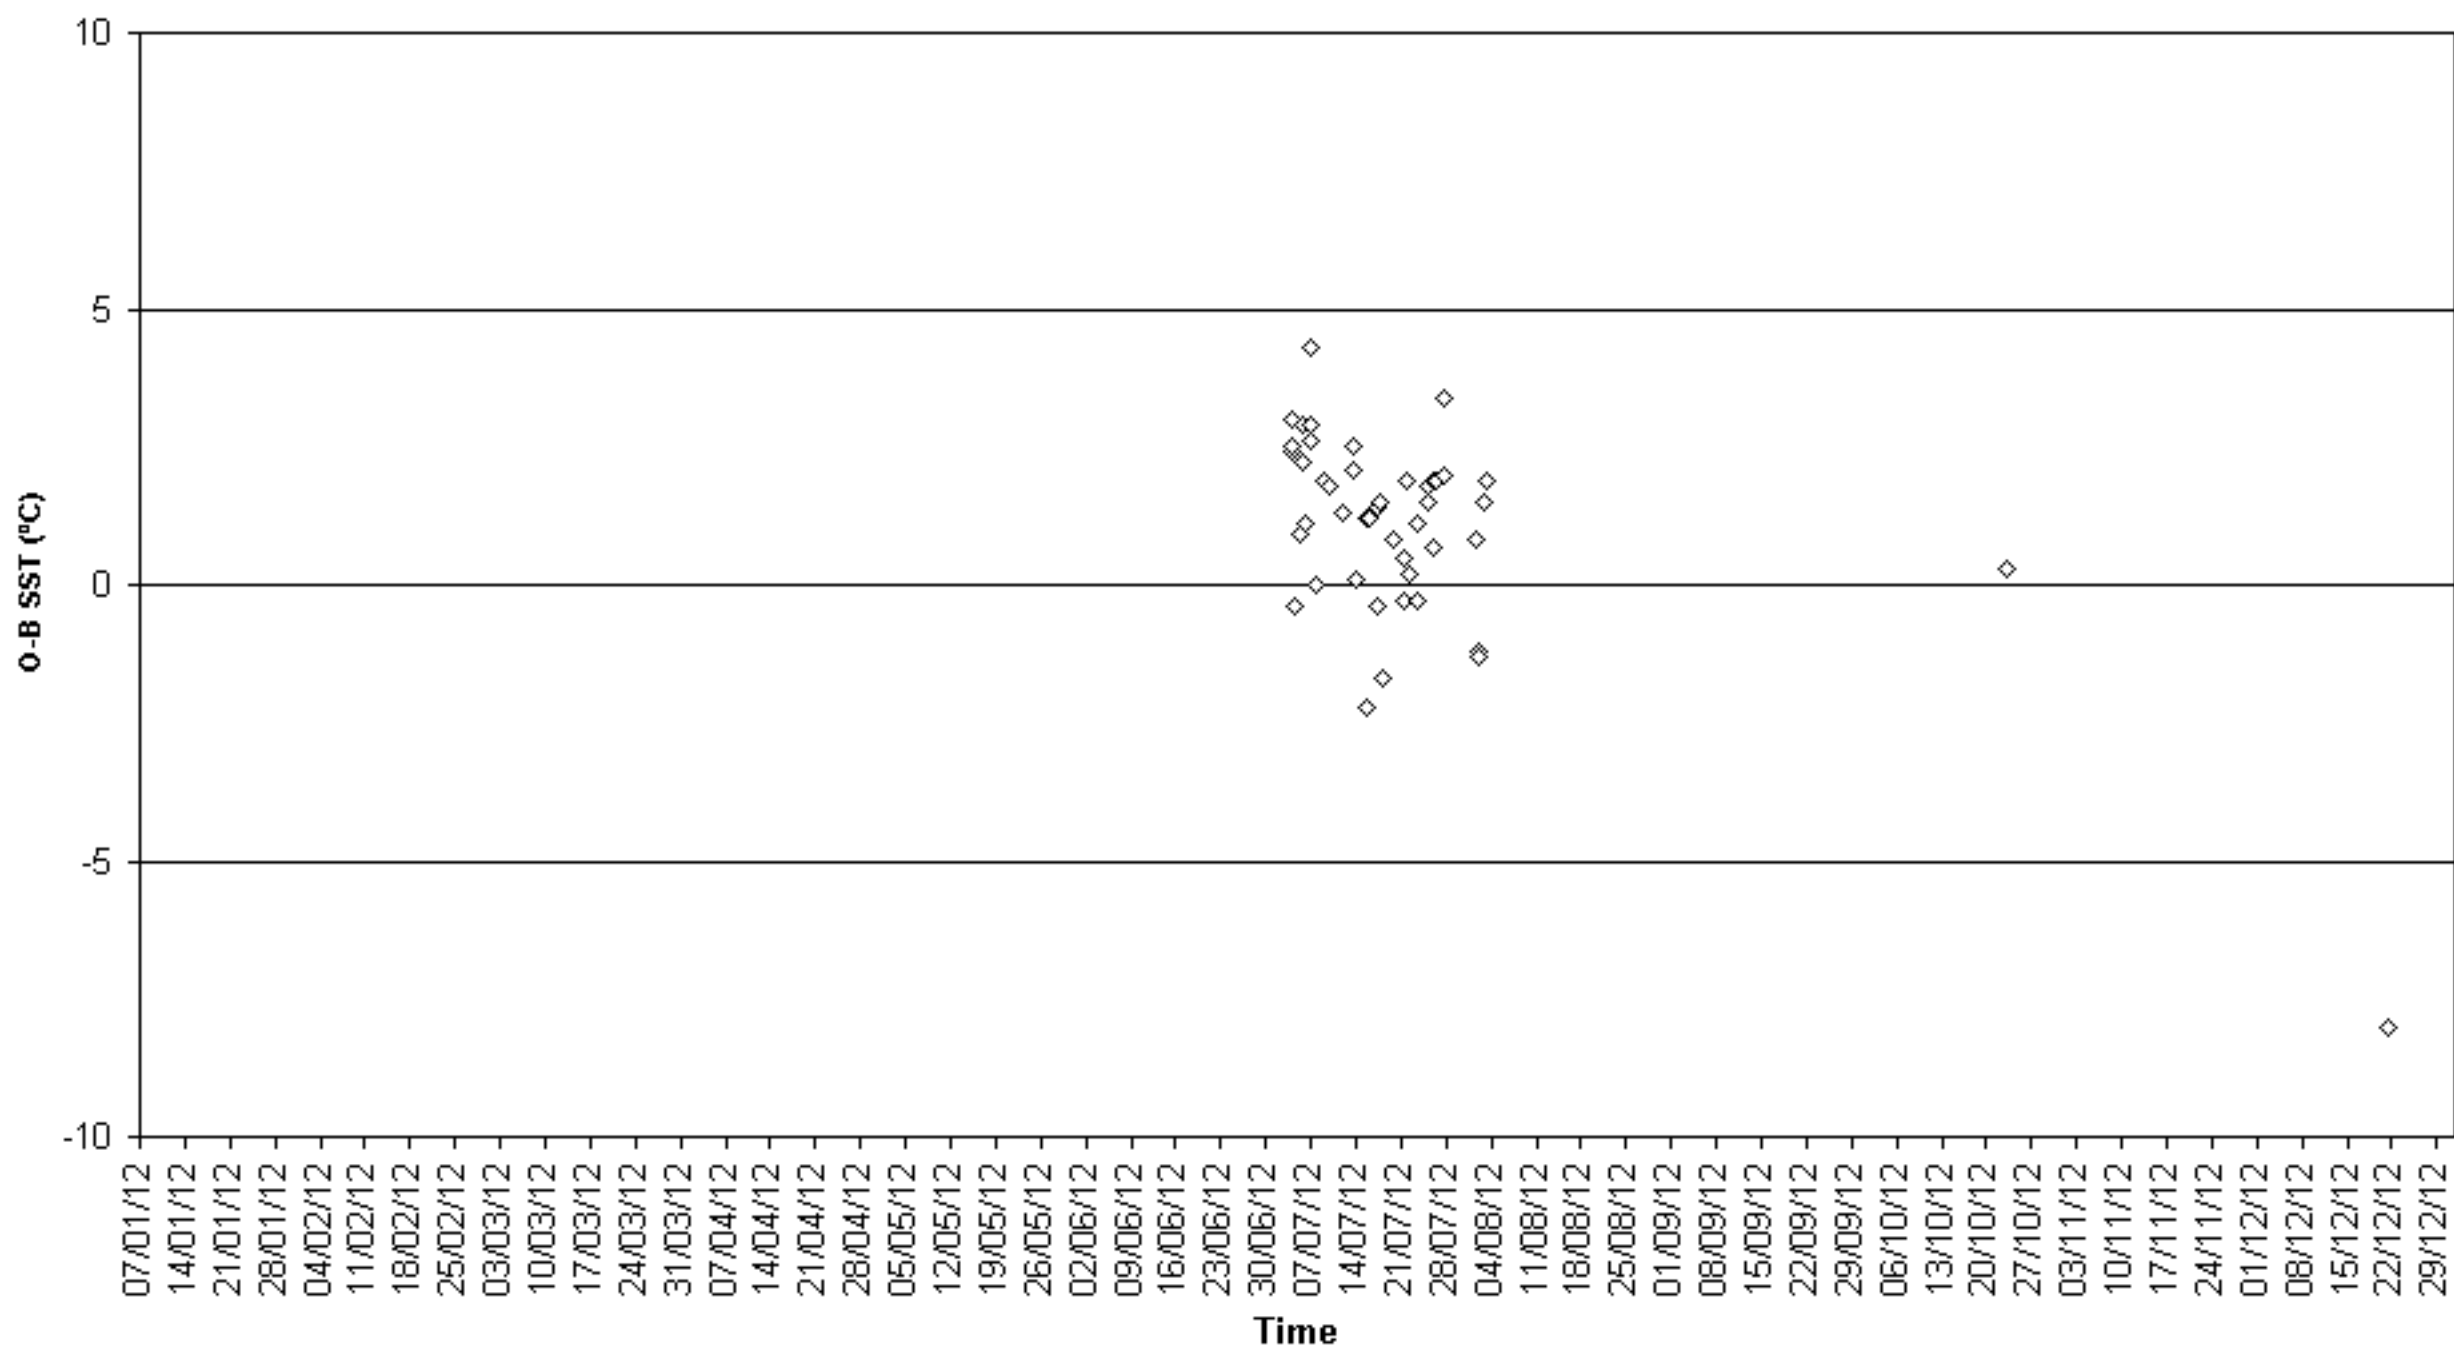


O-B SST (°C) for identifier WFLG
Number of obs. plotted = 445 Number of outliers = 1

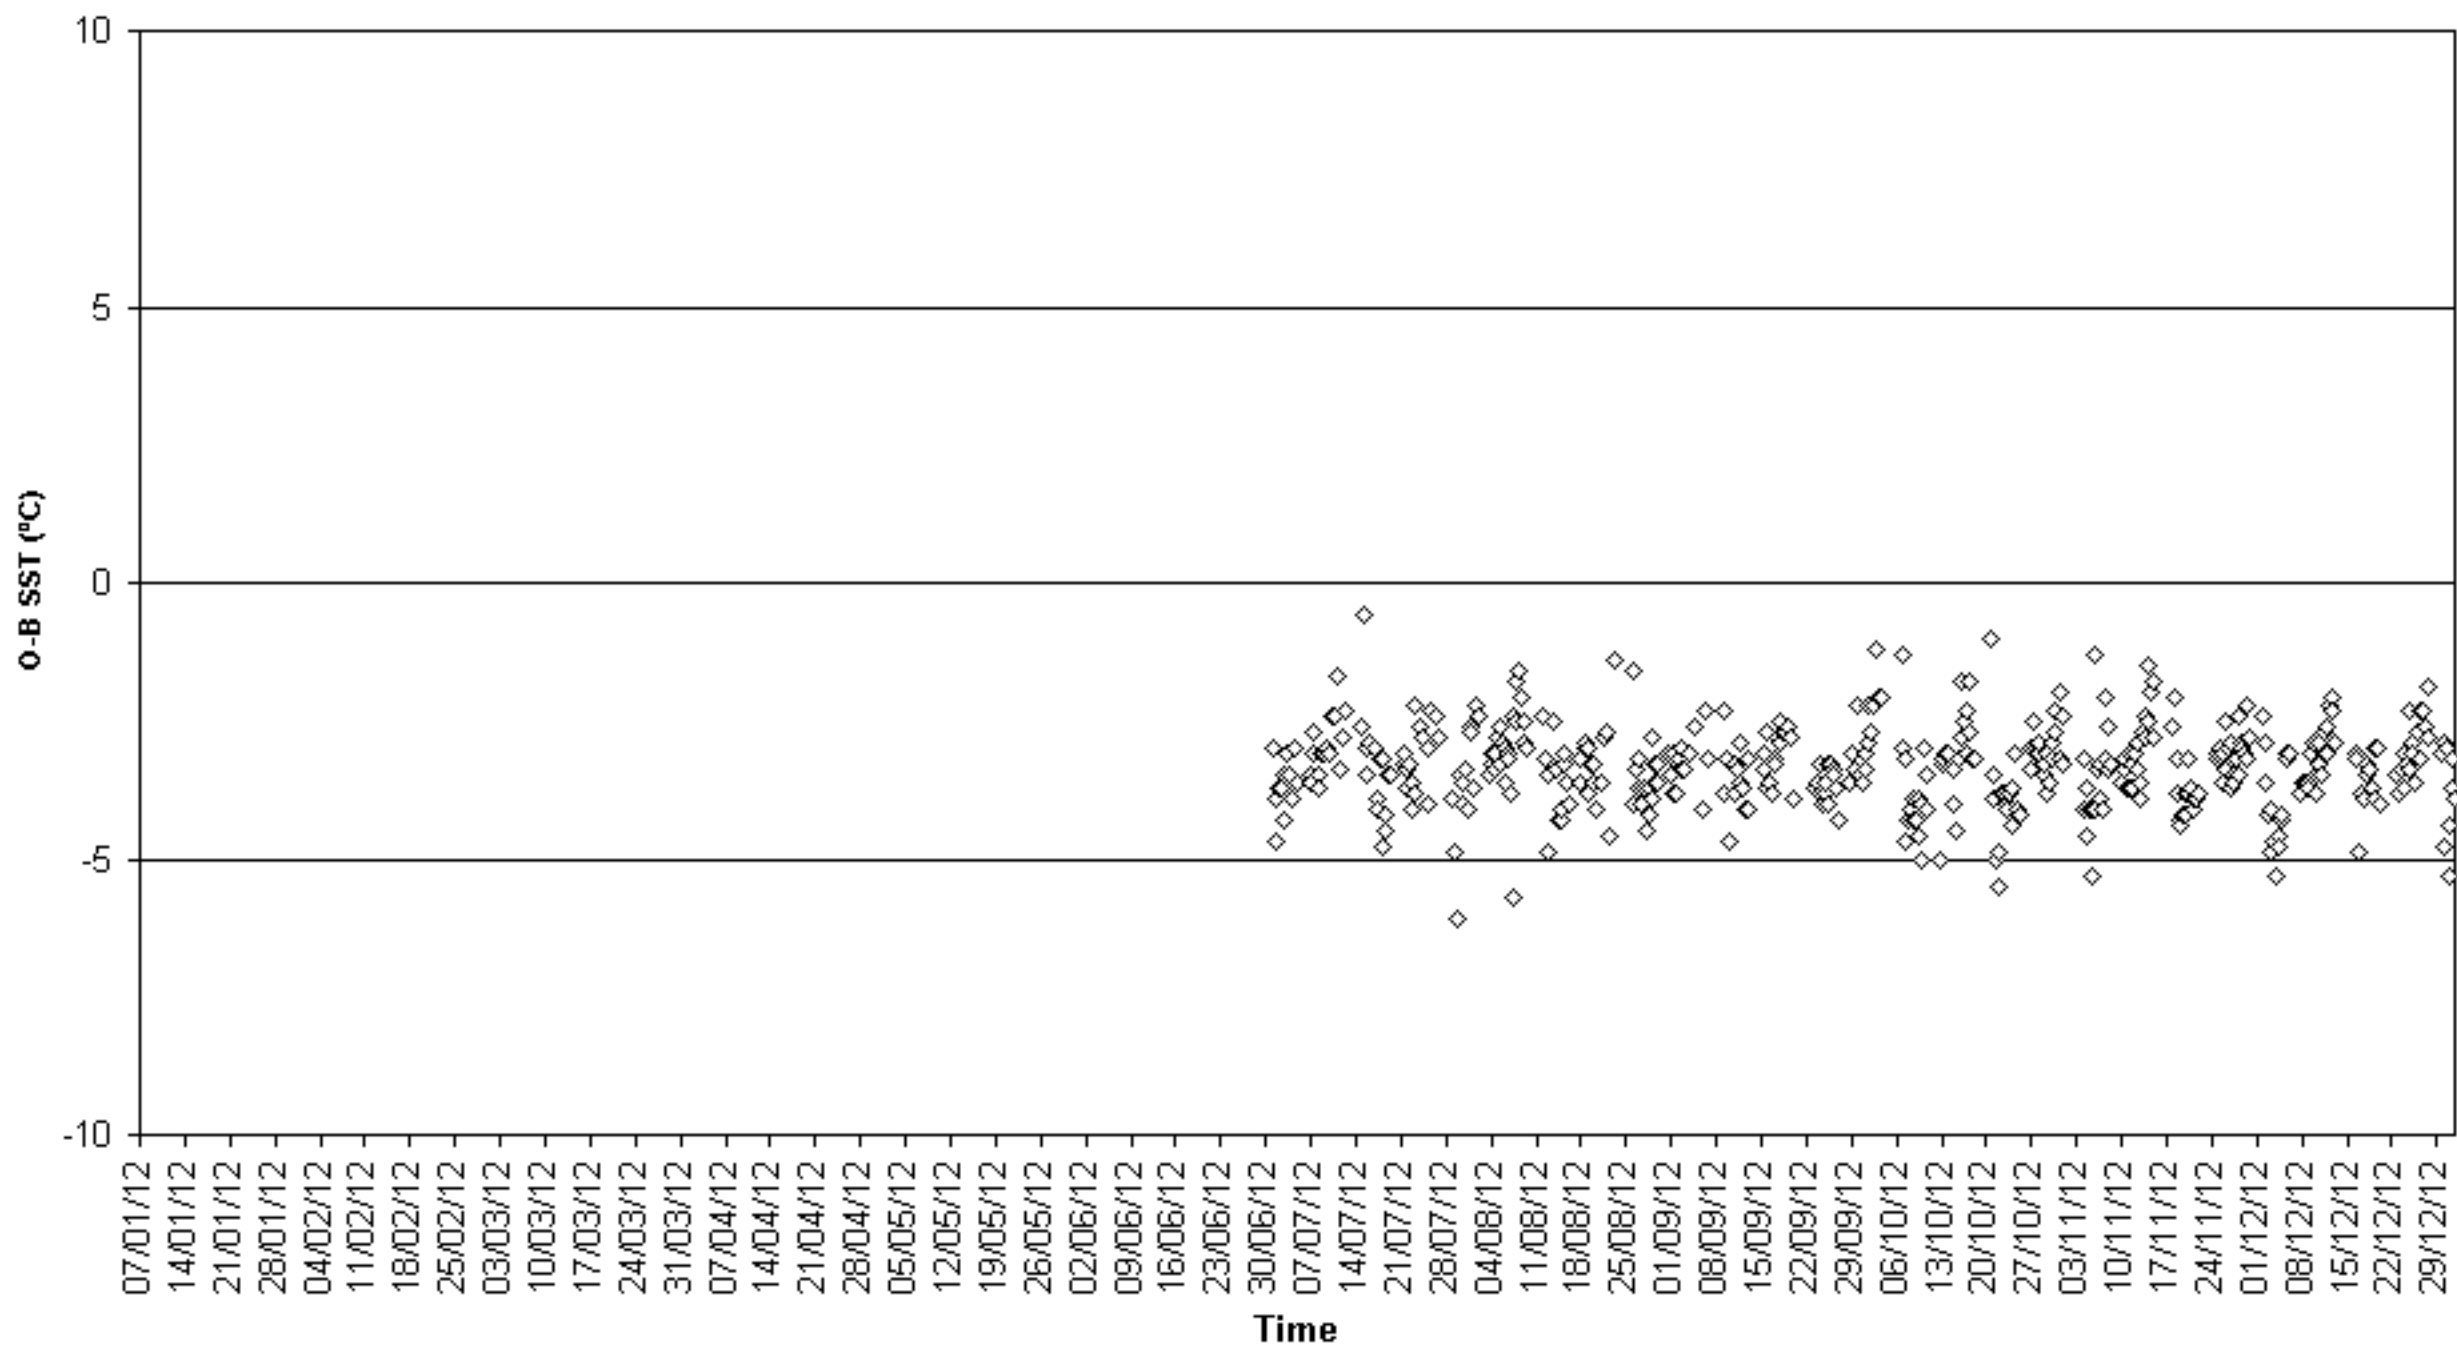


O-B SST (°C) for identifier WSLH
Number of obs. plotted = 137 Number of outliers = 0

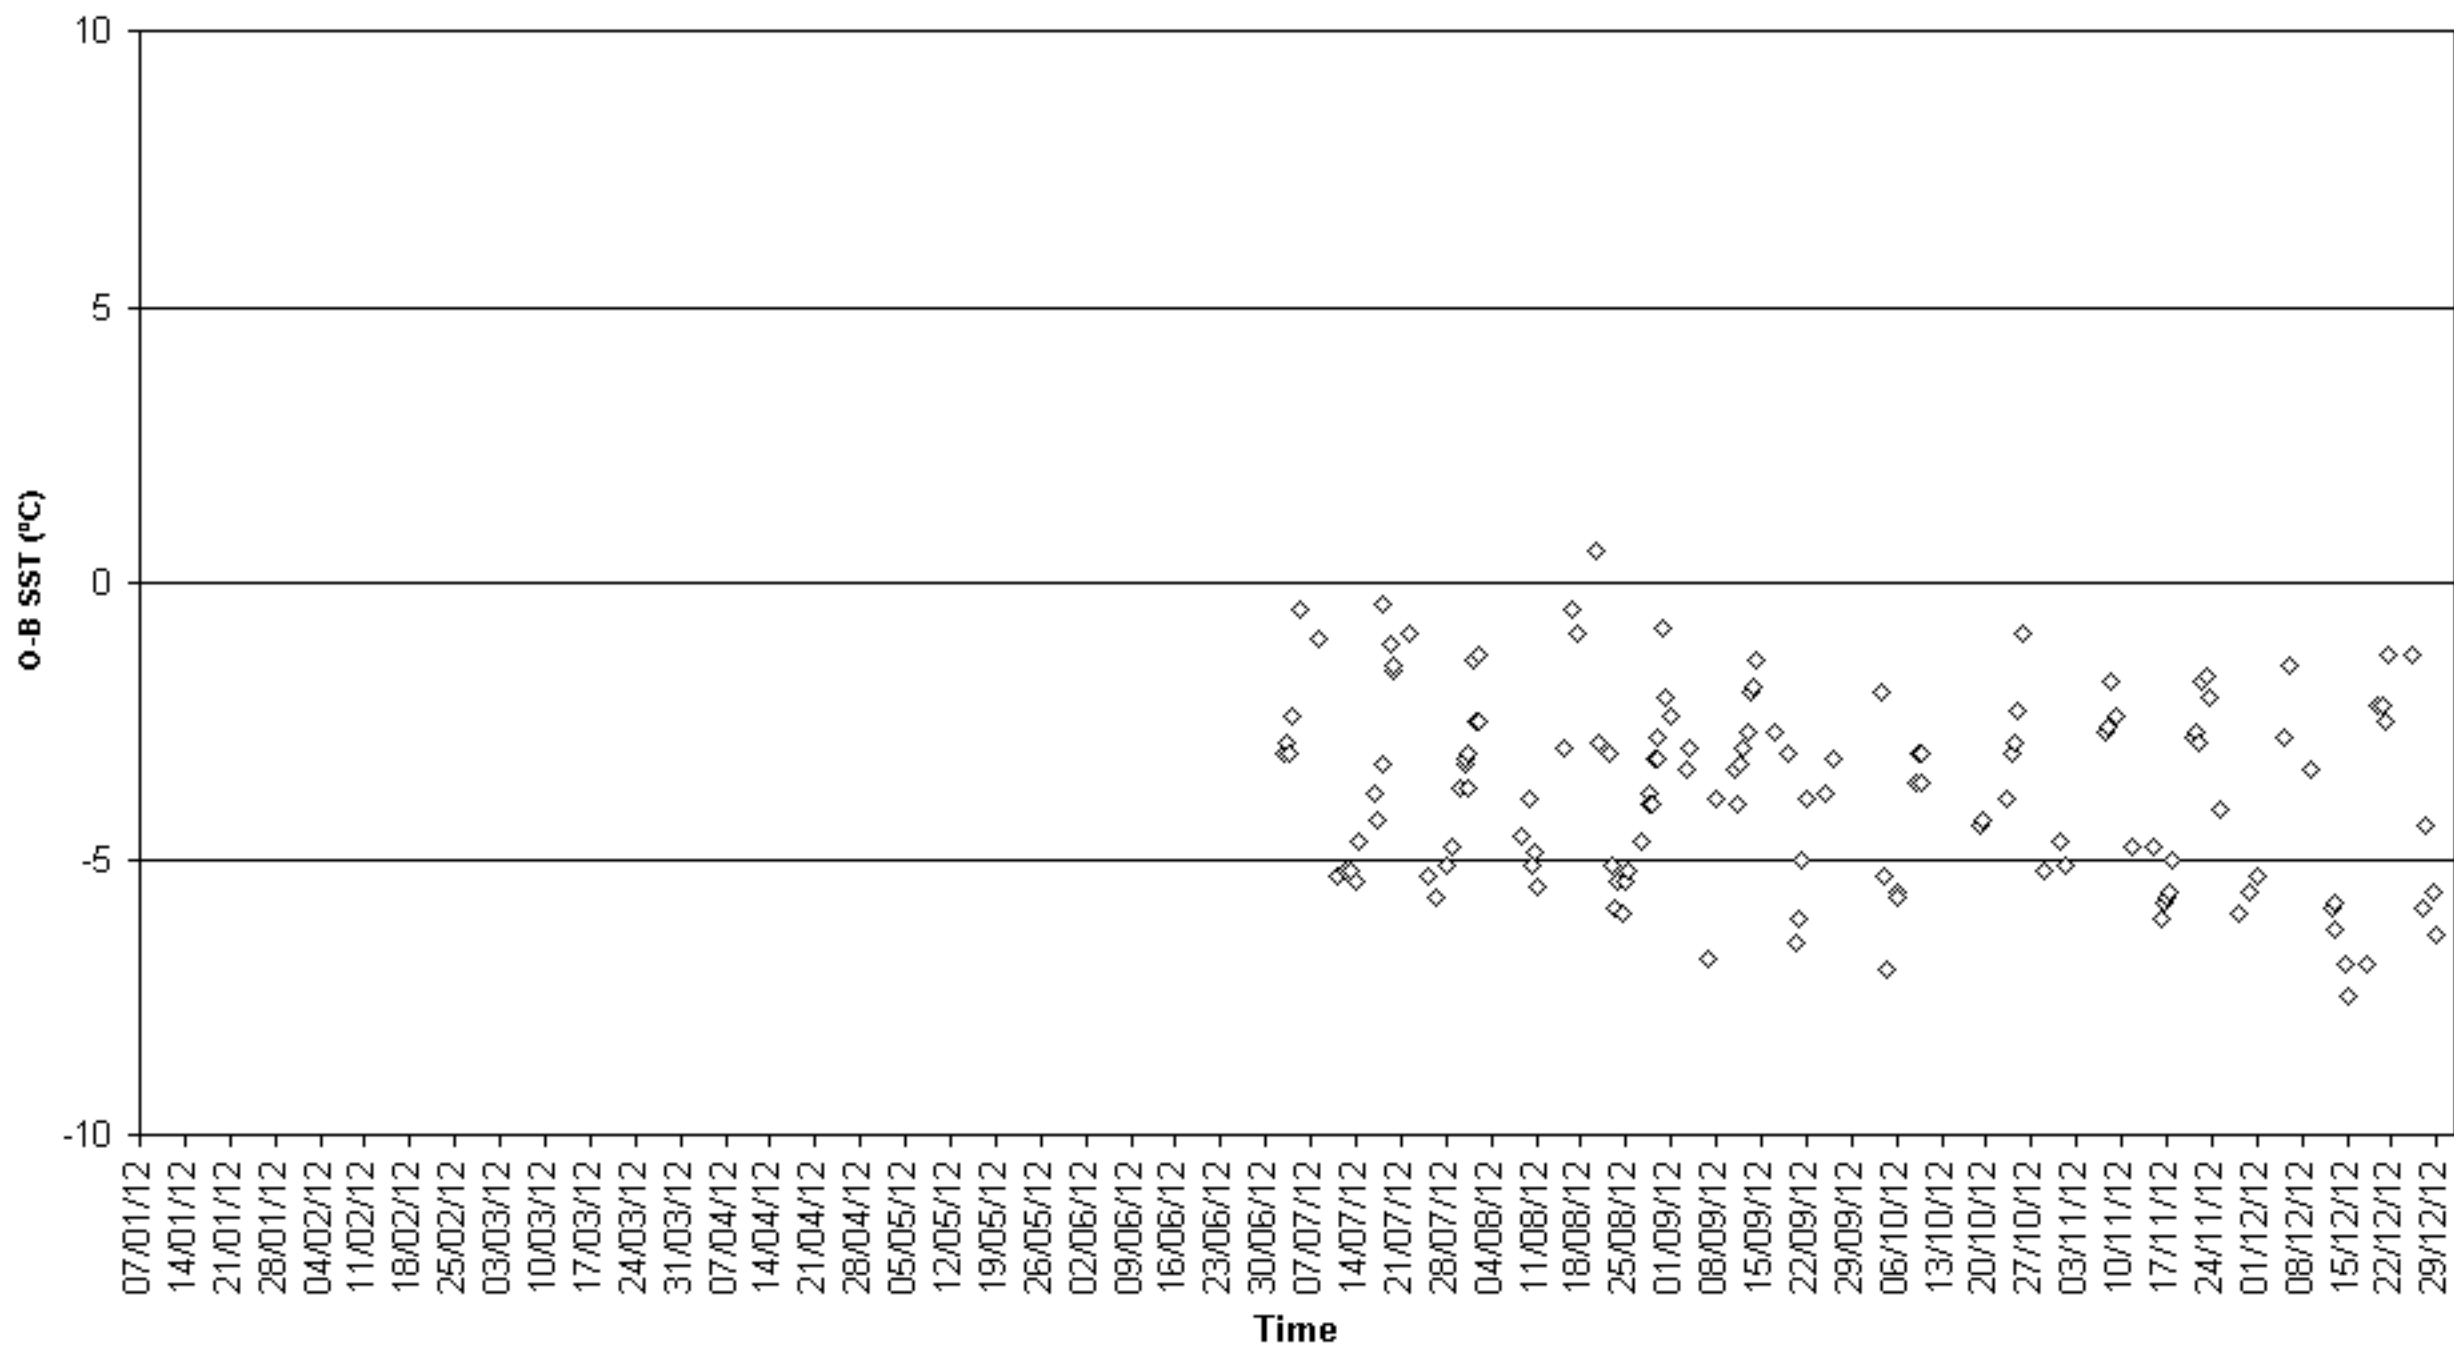

O-B SST (°C) for identifier WXU3434
Number of obs. plotted = 30 Number of outliers = 43

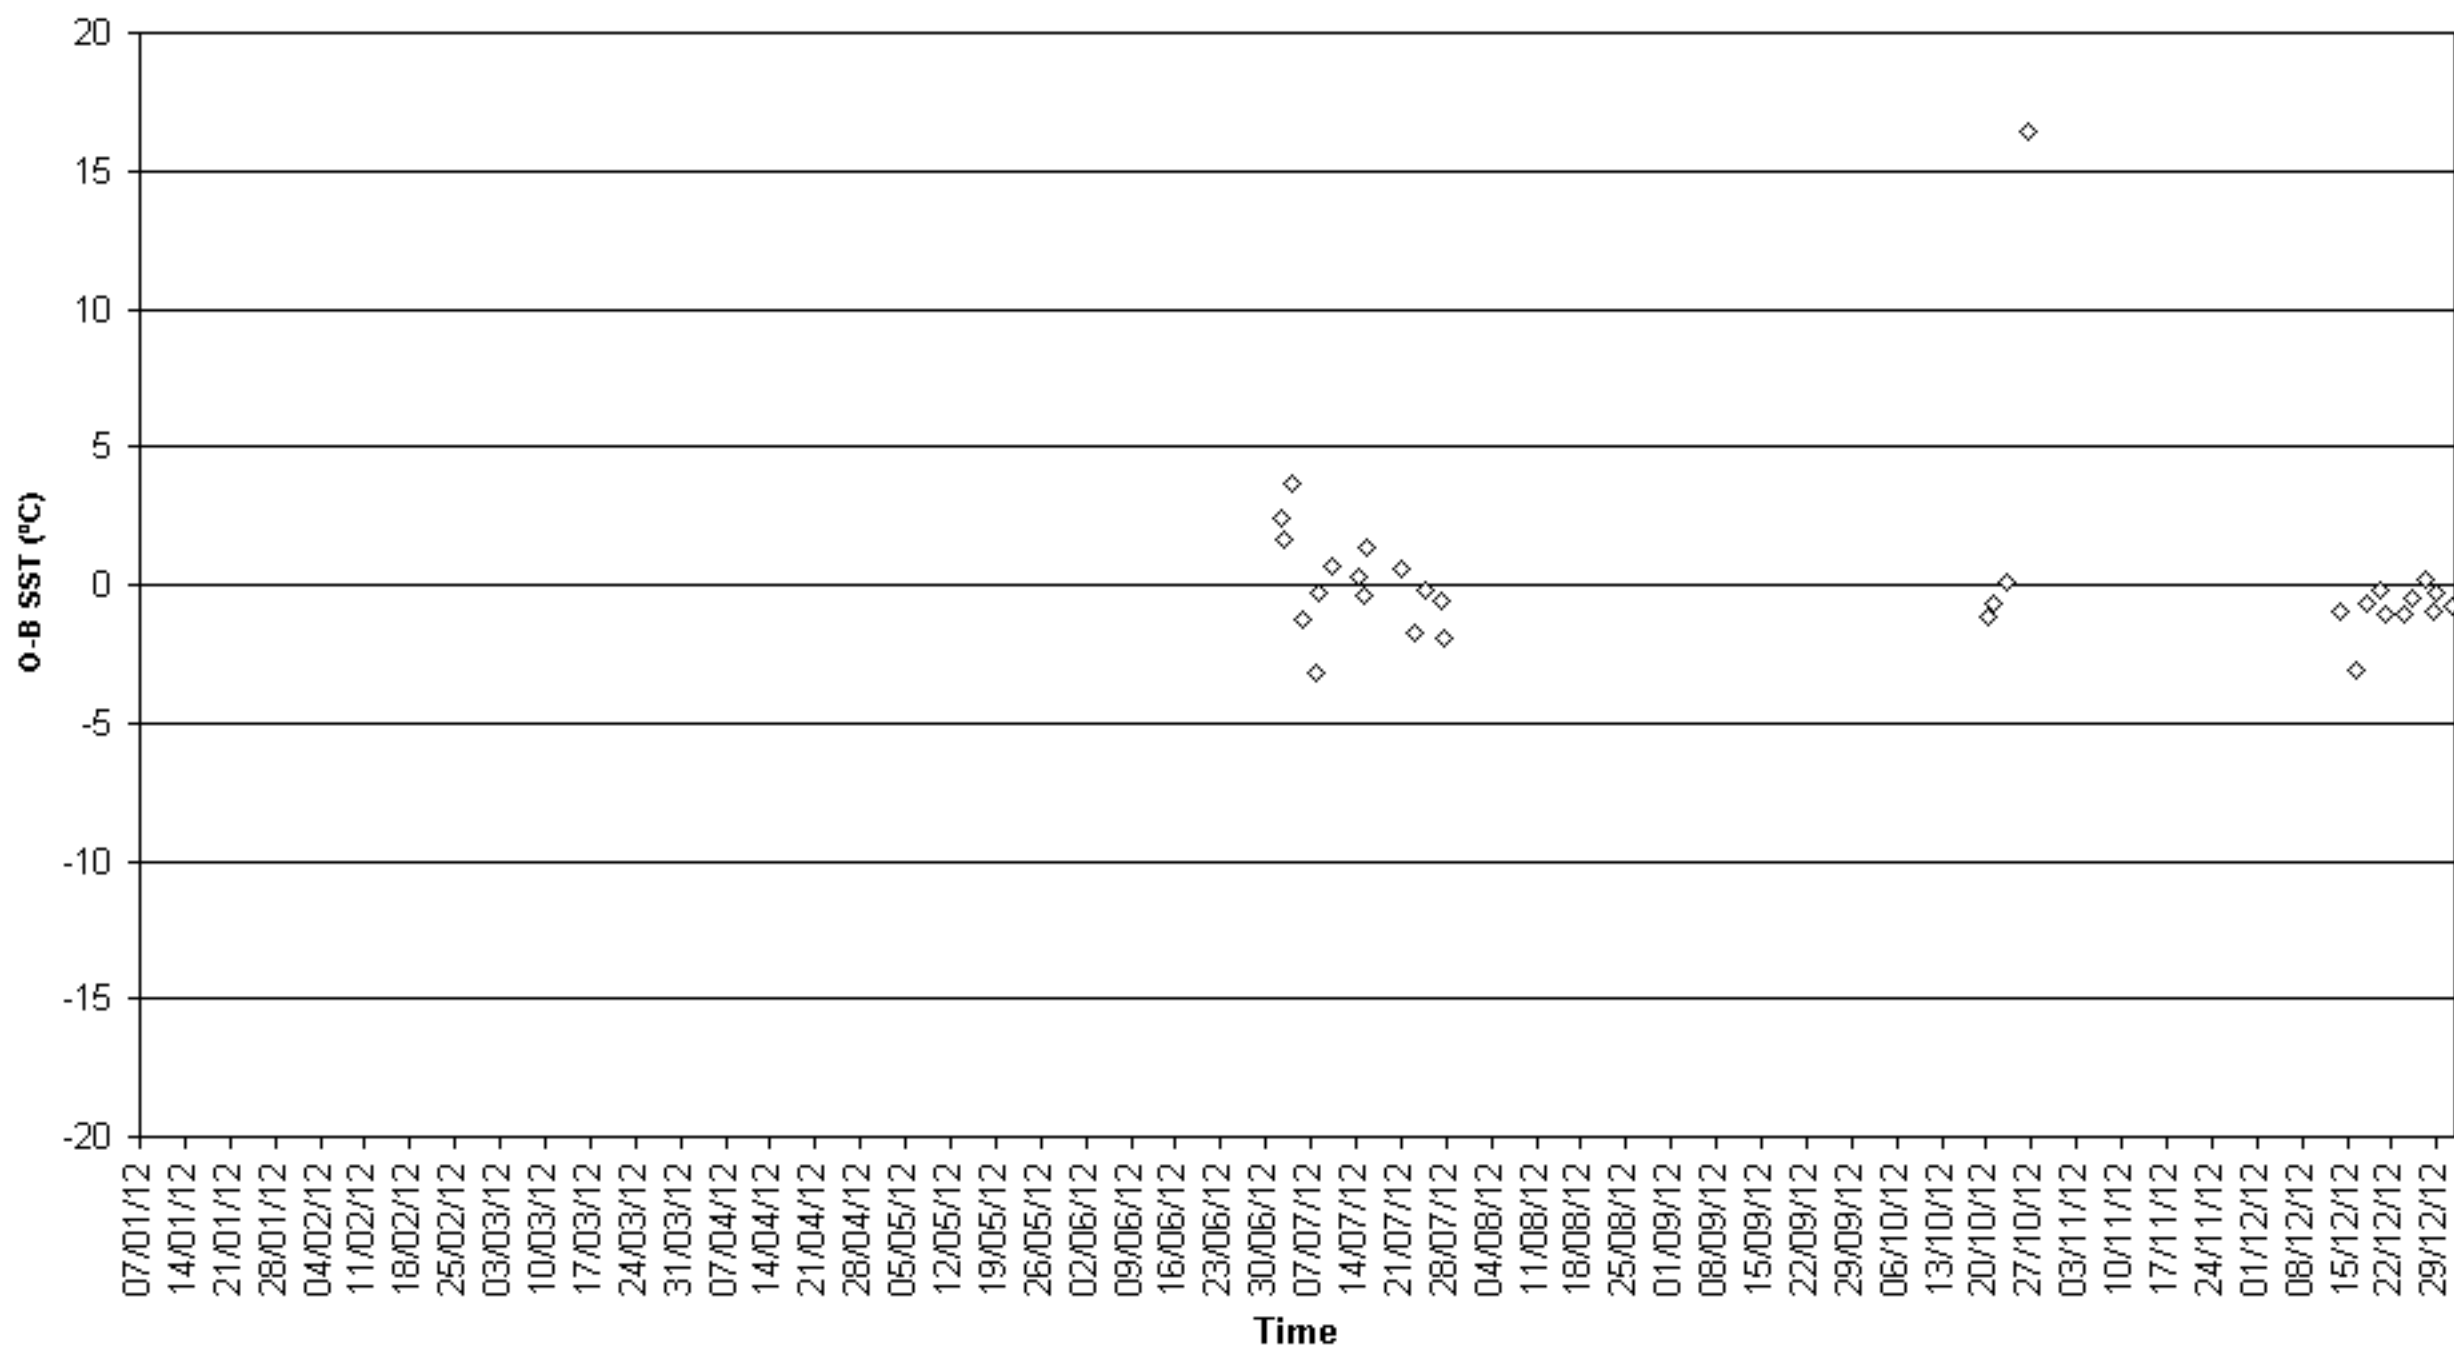

O-B SST (°C) for identifier WZJD
Number of obs. plotted = 458 Number of outliers = 2

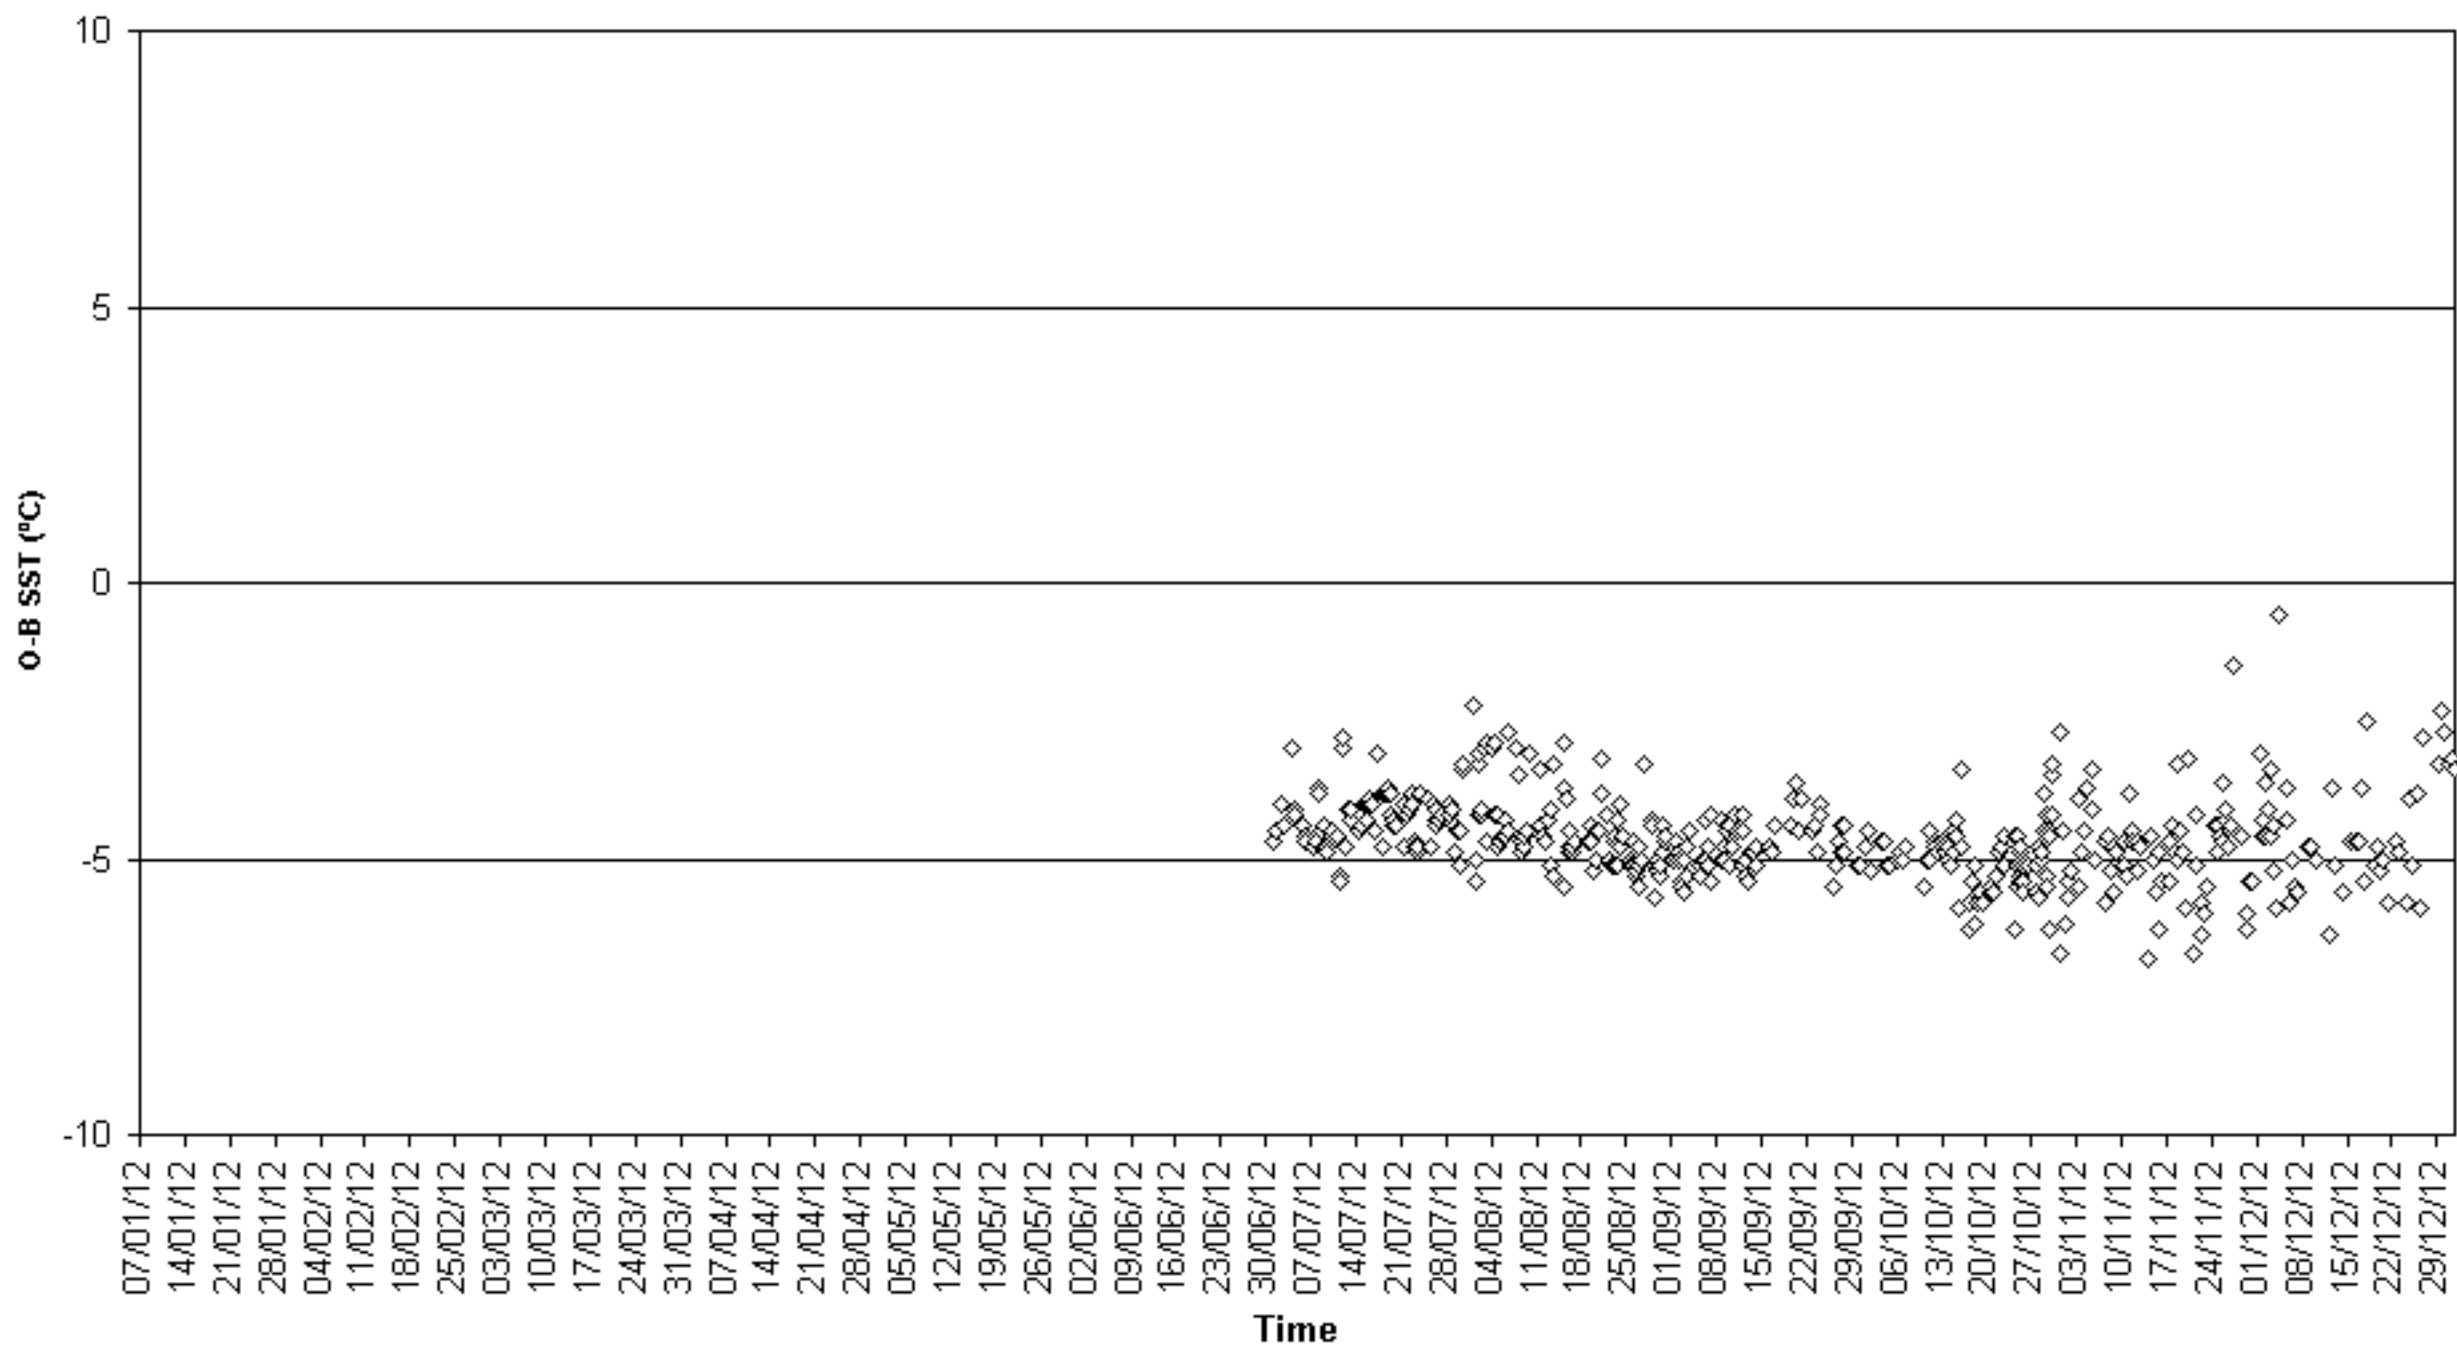

O-B SST (°C) for identifier ZDNC5
Number of obs. plotted = 281 Number of outliers = 0

